

PROJECT MANUAL

AKWESASNE MOHAWK CASINO & RESORT TAVERN KITCHEN RENOVATION

873 NEW YORK ROUTE 37
HOGANSBURG, NEW YORK 13655

PREPARED FOR



CONSTRUCTION
DOCUMENT
PHASE
SERVICES 100%



AKWESASNE MOHAWK CASINO & RESORT

873 NEW YORK ROUTE 37
HOGANSBURG, NEW YORK 13655

AEDA PROJECT #22012

July 28, 2022

1246 State Route 3
P.O. Box 762
Plattsburgh, NY 12901

PREPARED BY



518.562.1800
jaa@aedapc.com
www.aedapc.com

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 00 0110

TABLE OF CONTENTS

PROCUREMENT AND CONTRACTING REQUIREMENTS

1.01 DIVISION 00 -- PROCUREMENT AND CONTRACTING REQUIREMENTS

00 0101 - Project Title Page	
00 0110 - Table of Contents	
00 0115 - List of Drawing Sheets	
00 1113 - Advertisement for Bids	
00 2113 - Instructions to Bidders	
Instructions to Bidders (AIA Document A701)	
00 3000 - Bidder's Checklist	
00 3100 - Available Project Information	
00 4100 - Bid Form	
00 4000 - User-Certificate of Non-Collusion	
Certificate of Compliance with Iran Divestment Act	
00 4810 - Statement of Surety's Intent	
00 5200 - Agreement Form	
Agreement Form (AIA Document A101)	
Certificate of Owner's Attorney	
00 7200 - General Conditions	
General Conditions of the Contract for Construction (AIA Document A201)	
00 7300 - Supplementary Conditions	
Supplementary Conditions	
Performance Bond Form (AIA Document A312)	
Payment Bond Form (AIA Document A312)	
Change Order Form (AIA Document G701)	
Application for Certification of Payment (AIA Document G702)	
Continuation Sheet (AIA Document G703)	
Certification of Substantial Completion (AIA Document G704)	
00 9000 - Notice of Award	
00 9010 - Notice to Proceed	
Contractor's Affidavit of Payment of Debts and Claims (AIA Document G706)	
Contractor's Affidavit of Release of Leins (AIA Document G706A)	
Consent of Surety to Final Payment (AIA Document G707)	
Construction Change Directive (AIA Document G714)	
Request for Information (RFI) (AIA Document G716)	

SPECIFICATIONS

2.01 DIVISION 01 -- GENERAL REQUIREMENTS

01 1000 - Summary	
01 2000 - Price and Payment Procedures	
01 2500 - Substitution Procedures	
01 3000 - Administrative Requirements	

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- 01 3216 - Construction Progress Schedule
- 01 4000 - Quality Requirements
- 01 4216 - Definitions
- 01 5000 - Temporary Facilities and Controls
- 01 6000 - Product Requirements
- 01 7000 - Execution and Closeout Requirements
- 01 7419 - Construction Waste Management and Disposal
- 01 7800 - Closeout Submittals

2.02 DIVISION 02 -- EXISTING CONDITIONS

- 02 4100 - Demolition

2.03 DIVISION 03 -- CONCRETE

- 03 1000 - Concrete Forming and Accessories
- 03 2000 - Concrete Reinforcing
- 03 3000 - Cast-in-Place Concrete
- 03 3511 - Concrete Floor Finishes

2.04 DIVISION 05 -- METALS

- 05 1200 - Structural Steel Framing
- 05 3100 - Steel Decking

2.05 DIVISION 06 -- WOOD, PLASTICS, AND COMPOSITES

- 06 0573 - Wood Treatment
- 06 1000 - Rough Carpentry
- 06 1053 - Miscellaneous Rough Carpentry
- 06 8316 - Fiberglass Reinforced Paneling

2.06 DIVISION 07 -- THERMAL AND MOISTURE PROTECTION

- 07 2100 - Thermal Insulation
- 07 2600 - Underslab Vapor Barrier
- 07 5323 - EPDM Thermoset Single-Ply Roofing - Carlisle
- 07 6200 - Sheet Metal Flashing and Trim
- 07 7200 - Roof Accessories
- 07 8400 - Firestopping
- 07 9200 - Joint Sealants

2.07 DIVISION 08 -- OPENINGS

- 08 3100 - Access Doors and Panels

2.08 DIVISION 09 -- FINISHES

- 09 0561 - Common Work Results for Flooring Preparation
- 09 2116 - Gypsum Board Assemblies
- 09 2216 - Non-Structural Metal Framing
- 09 5100 - Acoustical Ceilings
- 09 6700 - Fluid-Applied Flooring
- 09 9123 - Interior Painting

2.09 DIVISION 11 -- EQUIPMENT

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

11 4000 - Foodservice Equipment

Foodservice Equipment Specification Sheets

2.10 DIVISION 22 -- PLUMBING

22 0529 - Hangers and Supports for Plumbing Piping and Equipment

22 0553 - Identification for Plumbing Piping and Equipment

22 0716 - Plumbing Equipment Insulation

22 0719 - Plumbing Piping Insulation

22 1005 - Plumbing Piping

22 1006 - Plumbing Piping Specialties

22 4000 - Plumbing Fixtures

Plumbing Fixture Specification Sheets

2.11 DIVISION 23 -- HEATING, VENTILATING, AND AIR-CONDITIONING (HVAC)

23 0130.51 - HVAC Air-Distribution System Cleaning

23 0529 - Hangers and Supports for HVAC Piping and Equipment

23 0553 - Identification for HVAC Piping and Equipment

23 0593 - Testing, Adjusting, and Balancing for HVAC

23 0713 - Duct Insulation

23 0719 - HVAC Piping Insulation - Airex

23 0913 - Instrumentation and Control Devices for HVAC

23 1126 - Facility Liquefied-Petroleum Gas Piping

23 3100 - HVAC Ducts and Casings

23 3300 - Air Duct Accessories

23 3700 - Air Outlets and Inlets

23 3813 - Commercial-Kitchen Hoods

2.12 DIVISION 26 -- ELECTRICAL

26 0519 - Low-Voltage Electrical Power Conductors and Cables

26 0526 - Grounding and Bonding for Electrical Systems

26 0529 - Hangers and Supports for Electrical Systems

26 0533.13 - Conduit for Electrical Systems

26 0533.16 - Boxes for Electrical Systems

26 0553 - Identification for Electrical Systems

26 0583 - Wiring Connections

26 0923 - Lighting Control Devices

26 2416 - Panelboards

26 2726 - Wiring Devices

26 5100 - Interior Lighting

Interior Lighting Specification Sheets

DIVISION 27 -- COMMUNICATIONS

27 1000 - Structured Cabling

APPENDICES

Appendix A - Native American Preference Policy

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

Appendix B - Fire Protection Calculations

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 00 0115
LIST OF DRAWING SHEETS

SHEET NUMBER	SHEET NAME
--------------	------------

TITLE

T001	TITLE SHEET
------	-------------

GENERAL

G001	GENERAL INFORMATION & KEY PLAN
------	--------------------------------

LIFE SAFETY

LS001	BUILDING CODE ANALYSIS
-------	------------------------

DEMOLITION PLANS

D100	DEMOLITION FLOOR SLAB PLAN
D101	ENLARGED DEMOLITION & TEMPORARY BARRIER PLAN
D121	DEMOLITION REFLECTED CEILING PLAN
D201	DEMOLITION ROOF PLAN
D301	KITCHEN EQUIPMENT PHOTOS
D302	KITCHEN EQUIPMENT PHOTOS
MEPD101	MEP DEMOLITION FLOOR PLAN
MEPD121	MEP REFLECTED CEILING DEMOLITION PLAN
MEPD201	MEP DEMOLITION ROOF PLAN

ARCHITECTURAL PLANS

A001	ARCHITECTURAL WALL TYPES & HORIZONTAL ASSEMBLIES
A100	FLOOR SLAB PLAN
A101	ENLARGED KITCHEN PLAN
A102	EQUIPMENT SCHEDULE
A111	ENLARGED REFLECTED CEILING PLAN
A121	ENLARGED ROOF PLAN
A301	BUILDING SECTIONS
A401	INTERIOR ELEVATIONS
A402	INTERIOR ELEVATIONS
A501	DETAILS
A601	SCHEDULES

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

FIRE PROTECTION PLAN

FP-001	FIRE PROTECTION NOTES & DETAILS
FP-002	FIRE PROTECTION NOTES & DETAILS
FP-101	EXISTING FIRE PROTECTION PLAN
FP-102	FIRE PROTECTION PLAN

PLUMBING DRAWINGS

P001	PLUMBING NOTES, LEGENDS, & SYMBOLS
P101	ENLARGED SANITARY WASTE & GREASE PIPING PLAN
P102	ENLARGED SANITARY DOMESTIC SUPPLY AND LP PIPING PLAN
P501	PLUMBING DETAILS
P601	PLUMBING SCHEDULES & SCHEMATICS

MECHANICAL DRAWINGS

M001	MECHANICAL NOTES, LEGENDS, & SYMBOLS
M101	ENLARGED MECHANICAL PLAN
M601	MECHANICAL SCHEDULES & DETAILS

ELECTRICAL DRAWINGS

E001	ELECTRICAL NOTES, LEGENDS, & SYMBOLS
E101	ENLARGED ELECTRICAL POWER PLAN
E102	ENLARGED ELECTRICAL LIGHTING PLAN
E601	ELECTRICAL SCHEDULES

FIRE ALARM PLANS

FA-001	FIRE ALARM NOTES & DETAILS
FA-101	EXISTING FIRE ALARM PLAN
FA-102	FIRE ALARM PLAN

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 00 1113
ADVERTISEMENT FOR BIDS

FROM:

1.01 THE OWNER (HEREINAFTER REFERRED TO AS AKWESASNE MOHAWK CASINO & RESORT):

Akwesasne Mohawk Casino & Resort
873 New York Route 37
Hogansburg, New York 13655

1.02 AND THE ARCHITECT (HEREINAFTER REFERRED TO AS ARCHITECT):

Architectural & Engineering Design Associates, P.C.
1246 New York State Route 3, P.O. Box 762
Plattsburgh, New York 12901

1.03 DATE: 07/28/2022

1.04 TO: POTENTIAL BIDDERS

- A. The Akwesasne Mohawk Casino & Resort is requesting sealed bids for the Tavern Kitchen Renovation, located on 873 NY Rt 37 in Hogansburg, NY. Bids will be received until 3:00 pm on the 19th day of August, 2022 and then privately opened and reviewed by Akwesasne Mohawk Casino & Resort .
- B. Bid proposals submitted by U.S. Mail, private carrier, or hand delivered prior to the day of the bid opening are to be sent to Akwesasne Mohawk Casino & Resort, 873 New York Route 37, Hogansburg, New York 13655, in care of Scott Freeman.
- C. All bids shall be submitted in a sealed envelope with the words "Akwesasne Mohawk Casino & Resort - Tavern Kitchen Renovation" clearly printed on the front. Provide two copies of bids.
- D. Project Description: This project consists of partial demolition & renovation to an existing kitchen.
- E. Refer to other bidding requirements described in Document 00 2113 - Instruction to Bidders and Document 00 3100 - Available Project Information.
- F. A pre-bid conference for all bidders is scheduled for 10:00am on the 12th day of August, 2022 at 873 New York Route 37, Hogansburg, New York 13655. All Prime Contract bidders as well as interested sub-contractors should plan to attend this meeting.
- G. Submit your offer on the Bid Form provided. Bidders may supplement this form as appropriate.
- H. Your offer will be required to be submitted under a condition of irrevocability for a period of 45 days after submission.
- I. The Owner reserves the right to accept or reject any or all offers.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 00 2113
INSTRUCTIONS TO BIDDERS

PART 1 GENERAL

1.01 INSTRUCTIONS

- A. AIA Document A701 - 2018, Instructions to Bidders.
 - 1. These instructions are attached following this document.

1.02 RELATED DOCUMENTS

- A. Section 00 0110 Table of Contents
- B. Section 00 0115 List of Drawing Sheets
- C. Section 00 1113 Advertisement for Bids

END OF SECTION

DRAFT AIA® Document A701™ – 2018

Instructions to Bidders

for the following Project:
(Name, location, and detailed description)

«22012-AMCR-Tavern Kitchen»
«873 New York Route 37
Hogansburg, New York 13655»
«This project consists of partial demolition & renovation to an existing kitchen.»

THE OWNER:
(Name, legal status, address, and other information)

«Akwesasne Mohawk Casino & Resort»« »
«873 New York Route 37
Hogansburg, New York 13655»
«Telephone Number: 518-358-2222»
«Fax Number: 518-358-4047»

THE ARCHITECT:
(Name, legal status, address, and other information)

«Architectural & Engineering Design Associates, PC»« »
«1246 Route 3
PO Box 762
Plattsburgh, New York 12901»
«Telephone Number: (518) 562-1800»
«Fax Number: (518) 562-1702»

TABLE OF ARTICLES


- 1 DEFINITIONS
- 2 BIDDER'S REPRESENTATIONS
- 3 BIDDING DOCUMENTS
- 4 BIDDING PROCEDURES
- 5 CONSIDERATION OF BIDS
- 6 POST-BID INFORMATION
- 7 PERFORMANCE BOND AND PAYMENT BOND
- 8 ENUMERATION OF THE PROPOSED CONTRACT DOCUMENTS

ADDITIONS AND DELETIONS: The author of this document has added information needed for its completion. The author may also have revised the text of the original AIA standard form. An *Additions and Deletions Report* that notes added information as well as revisions to the standard form text is available from the author and should be reviewed.

This document has important legal consequences. Consultation with an attorney is encouraged with respect to its completion or modification.

FEDERAL, STATE, AND LOCAL LAWS MAY IMPOSE REQUIREMENTS ON PUBLIC PROCUREMENT CONTRACTS. CONSULT LOCAL AUTHORITIES OR AN ATTORNEY TO VERIFY REQUIREMENTS APPLICABLE TO THIS PROCUREMENT BEFORE COMPLETING THIS FORM.

It is intended that AIA Document G612™-2017, Owner's Instructions to the Architect, Parts A and B will be completed prior to using this document.

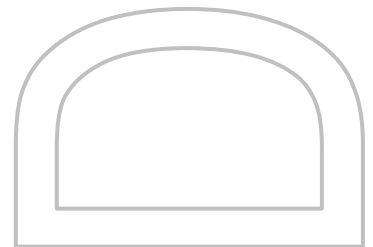

ELECTRONIC COPYING of any portion of this AIA® Document to another electronic file is prohibited and constitutes a violation of copyright laws as set forth in the footer of this document.

ARTICLE 1 DEFINITIONS

§ 1.1 Bidding Documents include the Bidding Requirements and the Proposed Contract Documents. The Bidding Requirements consist of the advertisement or invitation to bid, Instructions to Bidders, supplementary instructions to bidders, the bid form, and any other bidding forms. The Proposed Contract Documents consist of the unexecuted form of Agreement between the Owner and Contractor and that Agreement's Exhibits, Conditions of the Contract (General, Supplementary and other Conditions), Drawings, Specifications, all Addenda, and all other documents enumerated in Article 8 of these Instructions.

§ 1.2 Definitions set forth in the General Conditions of the Contract for Construction, or in other Proposed Contract Documents apply to the Bidding Documents.

§ 1.3 Addenda are written or graphic instruments issued by the Architect, which, by additions, deletions, clarifications, or corrections, modify or interpret the Bidding Documents.

§ 1.4 A Bid is a complete and properly executed proposal to do the Work for the sums stipulated therein, submitted in accordance with the Bidding Documents.

§ 1.5 The Base Bid is the sum stated in the Bid for which the Bidder offers to perform the Work described in the Bidding Documents, to which Work may be added or deleted by sums stated in Alternate Bids.

§ 1.6 An Alternate Bid (or Alternate) is an amount stated in the Bid to be added to or deducted from, or that does not change, the Base Bid if the corresponding change in the Work, as described in the Bidding Documents, is accepted.

§ 1.7 A Unit Price is an amount stated in the Bid as a price per unit of measurement for materials, equipment, or services, or a portion of the Work, as described in the Bidding Documents.

§ 1.8 A Bidder is a person or entity who submits a Bid and who meets the requirements set forth in the Bidding Documents.

§ 1.9 A Sub-bidder is a person or entity who submits a bid to a Bidder for materials, equipment, or labor for a portion of the Work.

ARTICLE 2 BIDDER'S REPRESENTATIONS

§ 2.1 By submitting a Bid, the Bidder represents that:

- .1 the Bidder has read and understands the Bidding Documents;
- .2 the Bidder understands how the Bidding Documents relate to other portions of the Project, if any, being bid concurrently or presently under construction;
- .3 the Bid complies with the Bidding Documents;
- .4 the Bidder has visited the site, become familiar with local conditions under which the Work is to be performed, and has correlated the Bidder's observations with the requirements of the Proposed Contract Documents;
- .5 the Bid is based upon the materials, equipment, and systems required by the Bidding Documents without exception; and
- .6 the Bidder has read and understands the provisions for liquidated damages, if any, set forth in the form of Agreement between the Owner and Contractor.

ARTICLE 3 BIDDING DOCUMENTS

§ 3.1 Distribution

§ 3.1.1 Bidders shall obtain complete Bidding Documents, as indicated below, from the issuing office designated in the advertisement or invitation to bid, for the deposit sum, if any, stated therein.

(Indicate how, such as by email, website, host site/platform, paper copy, or other method Bidders shall obtain Bidding Documents.)

«Project documents may be examined at no expense at the office of the Architect/Engineer; Architectural & Engineering Design Associates, P.C. 1246 State Route 3, Plattsburgh, New York, phone (518) 562-1800. Electronic project documents are available in the form of a PDF to any interested bidder through the office of AEDA, P.C. Paper copies can be requested at a determined value per sheet. Interested bidders should contact Heather Barnes, Office Manager at HBarnes@aedapc.com»

§ 3.1.2 Any required deposit shall be refunded to Bidders who submit a bona fide Bid and return the paper Bidding Documents in good condition within ten days after receipt of Bids. The cost to replace missing or damaged paper documents will be deducted from the deposit. A Bidder receiving a Contract award may retain the paper Bidding Documents, and the Bidder's deposit will be refunded.

§ 3.1.3 Bidding Documents will not be issued directly to Sub-bidders unless specifically offered in the advertisement or invitation to bid, or in supplementary instructions to bidders.

§ 3.1.4 Bidders shall use complete Bidding Documents in preparing Bids. Neither the Owner nor Architect assumes responsibility for errors or misinterpretations resulting from the use of incomplete Bidding Documents.

§ 3.1.5 The Bidding Documents will be available for the sole purpose of obtaining Bids on the Work. No license or grant of use is conferred by distribution of the Bidding Documents.

§ 3.2 Modification or Interpretation of Bidding Documents

§ 3.2.1 The Bidder shall carefully study the Bidding Documents, shall examine the site and local conditions, and shall notify the Architect of errors, inconsistencies, or ambiguities discovered and request clarification or interpretation pursuant to Section 3.2.2.

§ 3.2.2 Requests for clarification or interpretation of the Bidding Documents shall be submitted by the Bidder in writing and shall be received by the Architect at least seven days prior to the date for receipt of Bids.

(Indicate how, such as by email, website, host site/platform, paper copy, or other method Bidders shall submit requests for clarification and interpretation.)

«All questions regarding plans and specifications must be submitted in writing to Architectural & Engineering Design Associates, P.C. Responses will be issued in writing in the form of a project addendum and will be distributed to all plan holders. All questions received prior to the pre-bid conference will be reviewed at the pre-bid conference. The deadline for question submission will be 3pm two business days before the bid opening any questions submitted after this time will not be subject to response by addendum.»

§ 3.2.3 Modifications and interpretations of the Bidding Documents shall be made by Addendum. Modifications and interpretations of the Bidding Documents made in any other manner shall not be binding, and Bidders shall not rely upon them.

§ 3.3 Substitutions

§ 3.3.1 The materials, products, and equipment described in the Bidding Documents establish a standard of required function, dimension, appearance, and quality to be met by any proposed substitution.

§ 3.3.2 Substitution Process

§ 3.3.2.1 Written requests for substitutions shall be received by the Architect at least ten days prior to the date for receipt of Bids. Requests shall be submitted in the same manner as that established for submitting clarifications and interpretations in Section 3.2.2.

§ 3.3.2.2 Bidders shall submit substitution requests on a Substitution Request Form if one is provided in the Bidding Documents.

§ 3.3.2.3 If a Substitution Request Form is not provided, requests shall include (1) the name of the material or equipment specified in the Bidding Documents; (2) the reason for the requested substitution; (3) a complete description of the proposed substitution including the name of the material or equipment proposed as the substitute, performance and test data, and relevant drawings; and (4) any other information necessary for an evaluation. The request shall include a statement setting forth changes in other materials, equipment, or other portions of the Work, including changes in the work of other contracts or the impact on any Project Certifications (such as LEED), that will result from incorporation of the proposed substitution.

§ 3.3.3 The burden of proof of the merit of the proposed substitution is upon the proposer. The Architect's decision of approval or disapproval of a proposed substitution shall be final.

§ 3.3.4 If the Architect approves a proposed substitution prior to receipt of Bids, such approval shall be set forth in an Addendum. Approvals made in any other manner shall not be binding, and Bidders shall not rely upon them.

§ 3.3.5 No substitutions will be considered after the Contract award unless specifically provided for in the Contract Documents.

§ 3.4 Addenda

§ 3.4.1 Addenda will be transmitted to Bidders known by the issuing office to have received complete Bidding Documents.

(Indicate how, such as by email, website, host site/platform, paper copy, or other method Addenda will be transmitted.)

«Responses will be issued in writing in the form of a project addendum and will be distributed to all plan holders through email.»

§ 3.4.2 Addenda will be available where Bidding Documents are on file.

§ 3.4.3 Addenda will be issued no later than four days prior to the date for receipt of Bids, except an Addendum withdrawing the request for Bids or one which includes postponement of the date for receipt of Bids.

§ 3.4.4 Prior to submitting a Bid, each Bidder shall ascertain that the Bidder has received all Addenda issued, and the Bidder shall acknowledge their receipt in the Bid.

ARTICLE 4 BIDDING PROCEDURES

§ 4.1 Preparation of Bids

§ 4.1.1 Bids shall be submitted on the forms included with or identified in the Bidding Documents.

§ 4.1.2 All blanks on the bid form shall be legibly executed. Paper bid forms shall be executed in a non-erasable medium.

§ 4.1.3 Sums shall be expressed in both words and numbers, unless noted otherwise on the bid form. In case of discrepancy, the amount entered in words shall govern.

§ 4.1.4 Edits to entries made on paper bid forms must be initialed by the signer of the Bid.

§ 4.1.5 All requested Alternates shall be bid. If no change in the Base Bid is required, enter "No Change" or as required by the bid form.

§ 4.1.6 Where two or more Bids for designated portions of the Work have been requested, the Bidder may, without forfeiture of the bid security, state the Bidder's refusal to accept award of less than the combination of Bids stipulated by the Bidder. The Bidder shall neither make additional stipulations on the bid form nor qualify the Bid in any other manner.

§ 4.1.7 Each copy of the Bid shall state the legal name and legal status of the Bidder. As part of the documentation submitted with the Bid, the Bidder shall provide evidence of its legal authority to perform the Work in the jurisdiction where the Project is located. Each copy of the Bid shall be signed by the person or persons legally authorized to bind the Bidder to a contract. A Bid by a corporation shall further name the state of incorporation and have the corporate seal affixed. A Bid submitted by an agent shall have a current power of attorney attached, certifying the agent's authority to bind the Bidder.

§ 4.1.8 A Bidder shall incur all costs associated with the preparation of its Bid.

§ 4.2 Bid Security

§ 4.2.1 Each Bid shall be accompanied by the following bid security:

(Insert the form and amount of bid security.)

«Bid security shall be provided in the form of a bid bond or certified check of a sum no less than 5% of the Bid.»

§ 4.2.2 The Bidder pledges to enter into a Contract with the Owner on the terms stated in the Bid and shall, if required, furnish bonds covering the faithful performance of the Contract and payment of all obligations arising thereunder. Should the Bidder refuse to enter into such Contract or fail to furnish such bonds if required, the amount of the bid security shall be forfeited to the Owner as liquidated damages, not as a penalty. In the event the Owner fails to comply with Section 6.2, the amount of the bid security shall not be forfeited to the Owner.

§ 4.2.3 If a surety bond is required as bid security, it shall be written on AIA Document A310™, Bid Bond, unless otherwise provided in the Bidding Documents. The attorney-in-fact who executes the bond on behalf of the surety shall affix to the bond a certified and current copy of an acceptable power of attorney. The Bidder shall provide surety bonds from a company or companies lawfully authorized to issue surety bonds in the jurisdiction where the Project is located.

§ 4.2.4 The Owner will have the right to retain the bid security of Bidders to whom an award is being considered until (a) the Contract has been executed and bonds, if required, have been furnished; (b) the specified time has elapsed so that Bids may be withdrawn; or (c) all Bids have been rejected. However, if no Contract has been awarded or a Bidder has not been notified of the acceptance of its Bid, a Bidder may, beginning days after the opening of Bids, withdraw its Bid and request the return of its bid security.

§ 4.3 Submission of Bids

§ 4.3.1 A Bidder shall submit its Bid as indicated below:

(Indicate how, such as by website, host site/platform, paper copy, or other method Bidders shall submit their Bid.)

Bids proposals submitted by U.S. Mail, private carrier, or hand delivered prior to the day of the bid opening are to be sent to Akwesasne Mohawk Casino & Resort at 873 NY Route 37, Hogansburgh, New York in care of, Scott Freeman, General Manager. All bids shall be submitted in a sealed envelope with the words "Akwesasne Mohawk Casino & Resort - Tavern Kitchen Renovation" clearly printed on front. Provide two copies of all bid documents.

4.3.2 Paper copies of the Bid, the bid security, and any other documents required to be submitted with the Bid shall be enclosed in a sealed opaque envelope. The envelope shall be addressed to the party receiving the Bids and shall be identified with the Project name, the Bidder's name and address, and, if applicable, the designated portion of the Work for which the Bid is submitted. If the Bid is sent by mail, the sealed envelope shall be enclosed in a separate mailing envelope with the notation "SEALED BID ENCLOSED" on the face thereof.

§ 4.3.3 Bids shall be submitted by the date and time and at the place indicated in the invitation to bid. Bids submitted after the date and time for receipt of Bids, or at an incorrect place, will not be accepted.

§ 4.3.4 The Bidder shall assume full responsibility for timely delivery at the location designated for receipt of Bids.

§ 4.3.5 A Bid submitted by any method other than as provided in this Section 4.3 will not be accepted.

§ 4.4 Modification or Withdrawal of Bid

§ 4.4.1 Prior to the date and time designated for receipt of Bids, a Bidder may submit a new Bid to replace a Bid previously submitted, or withdraw its Bid entirely, by notice to the party designated to receive the Bids. Such notice shall be received and duly recorded by the receiving party on or before the date and time set for receipt of Bids. The receiving party shall verify that replaced or withdrawn Bids are removed from the other submitted Bids and not considered. Notice of submission of a replacement Bid or withdrawal of a Bid shall be worded so as not to reveal the amount of the original Bid.

§ 4.4.2 Withdrawn Bids may be resubmitted up to the date and time designated for the receipt of Bids in the same format as that established in Section 4.3, provided they fully conform with these Instructions to Bidders. Bid security shall be in an amount sufficient for the Bid as resubmitted.

§ 4.4.3 After the date and time designated for receipt of Bids, a Bidder who discovers that it made a clerical error in its Bid shall notify the Architect of such error within two days, or pursuant to a timeframe specified by the law of the jurisdiction where the Project is located, requesting withdrawal of its Bid. Upon providing evidence of such error to the reasonable satisfaction of the Architect, the Bid shall be withdrawn and not resubmitted. If a Bid is withdrawn pursuant to this Section 4.4.3, the bid security will be attended to as follows:

(State the terms and conditions, such as Bid rank, for returning or retaining the bid security.)

ARTICLE 5 CONSIDERATION OF BIDS

§ 5.1 Opening of Bids

If stipulated in an advertisement or invitation to bid, or when otherwise required by law, Bids properly identified and received within the specified time limits will be publicly opened and read aloud. A summary of the Bids may be made available to Bidders.

§ 5.2 Rejection of Bids

Unless otherwise prohibited by law, the Owner shall have the right to reject any or all Bids.

§ 5.3 Acceptance of Bid (Award)

§ 5.3.1 It is the intent of the Owner to award a Contract to the lowest responsive and responsible Bidder, provided the Bid has been submitted in accordance with the requirements of the Bidding Documents. Unless otherwise prohibited by law, the Owner shall have the right to waive informalities and irregularities in a Bid received and to accept the Bid which, in the Owner's judgment, is in the Owner's best interests.

§ 5.3.2 Unless otherwise prohibited by law, the Owner shall have the right to accept Alternates in any order or combination, unless otherwise specifically provided in the Bidding Documents, and to determine the lowest responsive and responsible Bidder on the basis of the sum of the Base Bid and Alternates accepted.

ARTICLE 6 POST-BID INFORMATION

§ 6.1 Contractor's Qualification Statement

Bidders to whom award of a Contract is under consideration shall submit to the Architect, upon request and within the timeframe specified by the Architect, a properly executed AIA Document A305™, Contractor's Qualification Statement, unless such a Statement has been previously required and submitted for this Bid.

§ 6.2 Owner's Financial Capability

A Bidder to whom award of a Contract is under consideration may request in writing, fourteen days prior to the expiration of the time for withdrawal of Bids, that the Owner furnish to the Bidder reasonable evidence that financial arrangements have been made to fulfill the Owner's obligations under the Contract. The Owner shall then furnish such reasonable evidence to the Bidder no later than seven days prior to the expiration of the time for withdrawal of Bids. Unless such reasonable evidence is furnished within the allotted time, the Bidder will not be required to execute the Agreement between the Owner and Contractor.

§ 6.3 Submittals

§ 6.3.1 After notification of selection for the award of the Contract, the Bidder shall, as soon as practicable or as stipulated in the Bidding Documents, submit in writing to the Owner through the Architect:

- .1 a designation of the Work to be performed with the Bidder's own forces;
- .2 names of the principal products and systems proposed for the Work and the manufacturers and suppliers of each; and
- .3 names of persons or entities (including those who are to furnish materials or equipment fabricated to a special design) proposed for the principal portions of the Work.

§ 6.3.2 The Bidder will be required to establish to the satisfaction of the Architect and Owner the reliability and responsibility of the persons or entities proposed to furnish and perform the Work described in the Bidding Documents.

§ 6.3.3 Prior to the execution of the Contract, the Architect will notify the Bidder if either the Owner or Architect, after due investigation, has reasonable objection to a person or entity proposed by the Bidder. If the Owner or Architect has reasonable objection to a proposed person or entity, the Bidder may, at the Bidder's option, withdraw the Bid or submit an acceptable substitute person or entity. The Bidder may also submit any required adjustment in the Base Bid or Alternate Bid to account for the difference in cost occasioned by such substitution. The Owner may accept the adjusted bid price or disqualify the Bidder. In the event of either withdrawal or disqualification, bid security will not be forfeited.

§ 6.3.4 Persons and entities proposed by the Bidder and to whom the Owner and Architect have made no reasonable objection must be used on the Work for which they were proposed and shall not be changed except with the written consent of the Owner and Architect.

ARTICLE 7 PERFORMANCE BOND AND PAYMENT BOND

§ 7.1 Bond Requirements

§ 7.1.1 If stipulated in the Bidding Documents, the Bidder shall furnish bonds covering the faithful performance of the Contract and payment of all obligations arising thereunder.

§ 7.1.2 If the furnishing of such bonds is stipulated in the Bidding Documents, the cost shall be included in the Bid. If the furnishing of such bonds is required after receipt of bids and before execution of the Contract, the cost of such bonds shall be added to the Bid in determining the Contract Sum.

§ 7.1.3 The Bidder shall provide surety bonds from a company or companies lawfully authorized to issue surety bonds in the jurisdiction where the Project is located.

§ 7.1.4 Unless otherwise indicated below, the Penal Sum of the Payment and Performance Bonds shall be the amount of the Contract Sum.

(If Payment or Performance Bonds are to be in an amount other than 100% of the Contract Sum, indicate the dollar amount or percentage of the Contract Sum.)

« »

§ 7.2 Time of Delivery and Form of Bonds

§ 7.2.1 The Bidder shall deliver the required bonds to the Owner not later than three days following the date of execution of the Contract. If the Work is to commence sooner in response to a letter of intent, the Bidder shall, prior to commencement of the Work, submit evidence satisfactory to the Owner that such bonds will be furnished and delivered in accordance with this Section 7.2.1.

§ 7.2.2 Unless otherwise provided, the bonds shall be written on AIA Document A312, Performance Bond and Payment Bond.

§ 7.2.3 The bonds shall be dated on or after the date of the Contract.

§ 7.2.4 The Bidder shall require the attorney-in-fact who executes the required bonds on behalf of the surety to affix to the bond a certified and current copy of the power of attorney.

ARTICLE 8 ENUMERATION OF THE PROPOSED CONTRACT DOCUMENTS

§ 8.1 Copies of the proposed Contract Documents have been made available to the Bidder and consist of the following documents:

- .1 AIA Document A101™–2017, Standard Form of Agreement Between Owner and Contractor, unless otherwise stated below.
(Insert the complete AIA Document number, including year, and Document title.)

« »

- .2 AIA Document A101™–2017, Exhibit A, Insurance and Bonds, unless otherwise stated below.
(Insert the complete AIA Document number, including year, and Document title.)

«See Supplemental Conditions »

- .3 AIA Document A201™–2017, General Conditions of the Contract for Construction, unless otherwise stated below.
(Insert the complete AIA Document number, including year, and Document title.)

« »

- 4 AIA Document E203™–2013, Building Information Modeling and Digital Data Exhibit, dated as indicated below:
(Insert the date of the E203-2013.)

«N/A»

5 Drawings

Number	Title	Date
«See Drawing Sheet List on T001 - Title Sheet»		

6 Specifications

Section	Title	Date	Pages
«See Section 00 0110 Table of Contents»			

7 Addenda:

Number	Date	Pages
« »		

8 Other Exhibits:

(Check all boxes that apply and include appropriate information identifying the exhibit where required.)

- [«N/A»] AIA Document E204™–2017, Sustainable Projects Exhibit, dated as indicated below:
(Insert the date of the E204-2017.)

« »

- [«N/A»] The Sustainability Plan:

Title	Date	Pages
«N/A»		

- [«N/A»] Supplementary and other Conditions of the Contract:

Document	Title	Date	Pages
«N/A»			

9 Other documents listed below:

(List here any additional documents that are intended to form part of the Proposed Contract Documents.)

«N/A»

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 00 3000
BIDDER'S CHECKLIST

ALL DOCUMENTS LIST BELOW TO BE COMPLETED BY BIDDER PRIOR TO BID SUBMISSION

3.01 PROJECT SPECIFIC REQUIREMENTS: EACH OF THE FOLLOWING MUST BE EXECUTED:

- A. Bid Form 00 4100:
 - 1. All blanks appropriately filled in ink with both words and figures, and signed where applicable
- B. Certification of compliance with the Iran divestment act:
 - 1. Requires completion and signature.

3.02 STATE & FEDERAL REQUIREMENTS: EACH OF THE FOLLOWING MUST BE EXECUTED:

- A. 00 4400 - Certificate of Non-Collusion:
 - 1. Requires Bidder's signature.
- B. 00 4810 - Statement of Surety's Intent:
 - 1. Requires completion and signature by Surety's Representative.
- C. Bid Security:
- D. List of Subcontractors:
 - 1. Submit in separate sealed envelope included within sealed Bid Envelope
- E. List of Last Five (5) projects:
 - 1. Include client/owner name & contact information

NOTE: TO BID CONTRACTS, THE BIDDER MUST COMPLETELY FILL OUT ALL FORMS LISTED ABOVE

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 00 3100

AVAILABLE PROJECT INFORMATION

PART 1 GENERAL

1.01 INFORMATION AVAILABLE TO BIDDERS

- A. All questions regarding plans and specifications must be submitted in writing to Architect. Responses will be issued in writing in the form of Project Addenda and will be distributed to all plan holders obtaining plans directly from Architect. All questions received prior to the pre-bid conference will be reviewed at the pre-bid conference. The deadline for question submission will be 3pm two business days before the bid opening. Any questions submitted after this time will not be subject to response by addendum.
- B. Bid Security in the amount of 5% of the Bid Amount will be required.
- C. The successful bidder will be required to provide Payment & Performance Bonds in the amount of 100% of their contract for this project.
- D. Sales Tax is not required to be included in the bid for this project, Owner is tax exempt.
- E. All required permits will be obtained by Owner.
- F. Bidders are required to complete appropriate Bid Form Document 00 4100.
- G. All bids shall be accompanied by a completed Certificate of Non-Collusion.
- H. All bids shall be accompanied by a list of all proposed subcontractors. Akwesasne Mohawk Casino & Resort reserves the right to reject any bidder's subcontractors.
- I. All bids shall be accompanied by a list of the last five projects completed, including a contact name and phone number.
- J. It is the intent of the project documents and the contract outlined therein to provide the Owner with a complete and functional project/facility without omission, therefore bidders are advised that complete contract documents are being issued to all bidders and details of the work for the contract may be found on any of the drawings or within any of the various specification sections regardless of trade breakdown, drawing titles and designation or section.
- K. In completing the Construction Payment Application process, bidders are advised that Owner will not pay for materials stored off site. Payment can be made for large components or other bulky materials delivered to the site provided that the materials or components are inventoried, secured and insured to the satisfaction of Owner and Architect. When applying for payment for stored materials the General Contractor will be required to submit with the payment application a detailed inventory of the materials, adequate evidence of insurance as well as billing invoices indicating the value of the materials.
- L. Change Orders as approved by the owner will be accepted allowing actual cost for labor and materials plus 10% overhead and 5% profit for general construction work performed by the contract holder. Subcontractors will be permitted to carry 10% combined overhead and profit on labor and material cost. The General Contractor will be permitted to carry 5% mark up on subcontractor change order cost. All change order requests must be provided on the standard AIA Change Order Forms and must be accompanied by a detailed breakdown of cost and material receipts or supplier quotes.
- M. Retainage for the project will be 10%, held through to the completion of all work, including issuance of the Substantial Completion Certificate, all punch list items are completed, submission of all as-built drawings, warranty and O&M documentation has been received and approved and final inspection certificates are issued to Akwesasne Mohawk Casino & Resort.
- N. Submission of Release and Waiver of Lien Documents by the General Contractor and each Subcontractor and/or Major Supplier will be required with each payment application submission. Final Release and Waiver of Lien Documents as well as Consent of Surety for Final Payment are required to be submitted with the final payment application.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- O. Project is to be completed by November 18th, 2022.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 00 4100

BID FORM

THE PROJECT AND THE PARTIES

1.01 TO:

Akwesasne Mohawk Casino & Resort (Owner)
873 New York Route 37
Hogansburg, New York 13655

1.02 FOR:

- A. All construction work, including but not limited to, all work in trades necessary to provide the Owner with a complete functioning facility and all work not specifically included in the contract as indicated in the project construction documents.

1.03 DATE: _____ (BIDDER TO ENTER DATE)

1.04 SUBMITTED BY: (BIDDER TO ENTER NAME AND ADDRESS)

A. Bidder's Full Name _____

1. Address _____

2. City, State, Zip _____

1.05 OFFER

- A. Having examined the Place of The Work and all matters referred to in the Instructions to Bidders and the Bid Documents prepared by Architectural & Engineering Design Associates, P.C. for the above mentioned project, we, the undersigned, hereby offer to enter into a Contract to perform the Work for the Sum of:

B. _____ dollars

C. (\$ _____), in lawful money of the United States of America.

D. We have included the security deposit as required by the Instruction to Bidders.

E. We have included the required performance assurance bonds in the Bid Amount as required by the Instructions to Bidders.

F. All applicable federal taxes are included and State of New York taxes are excluded from the Bid Sum.

G. We have included the names of all subcontractors and the portions of work they will perform.

1.06 ACCEPTANCE

A. This offer shall be open to acceptance and is irrevocable for forty five (45) days from the bid closing date.

B. If this bid is accepted by Owner within the time period stated above, we will:

1. Execute the Agreement within Ten (10) days of receipt of Notice of Award.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2. Furnish the required bonds within Ten (10) days of receipt of Notice of Award.
3. Commence work within Ten (10) days after written Notice to Proceed of this bid.

1.07 CONTRACT TIME

- A. If this Bid is accepted, we will:
- B. Complete the Work within the specified Time Frame.

1.08 CHANGES TO THE WORK

- A. When Architect establishes that the method of valuation for Changes in the Work will be net cost plus a percentage fee in accordance with General Conditions, our percentage fee will be:
 1. Ten (10) percent overhead and profit on the net cost of our own Work;
 2. Five (5) percent on the cost of work done by any Subcontractor.
- B. On work deleted from the Contract, our credit to Owner shall be Architect-approved net cost plus One Hundred (100) of the overhead and profit percentage noted above.

1.09 ADDENDA

- A. The following Addenda have been received. The modifications to the Bid Documents noted below have been considered and all costs are included in the Bid Sum.

1. Addendum # _____ Dated _____.

2. Addendum # _____ Dated _____.

3. Addendum # _____ Dated _____.

4. Addendum # _____ Dated _____.

5. Addendum # _____ Dated _____.

1.10 BID FORM SIGNATURE(S)

A. _____
(Bidder - print the full name of your firm)

B. _____
(Authorized signing officer, Title)

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

C. _____

(Seal)

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 00 4400
CERTIFICATE OF NON-COLLUSION

PART 1 GENERAL

1.01 NON-COLLUSIVE CERTIFICATION REQUIRED OF ALL BIDDERS UNDER SECTION 103-D OF THE GENERAL MUNICIPAL LAW AS AMENDED BY CHAPTER 751 OF THE LAWS OF 1965 AND CHAPTER 675 OF THE LAWS OF 1966 EFFECTIVE SEPTEMBER 1, 1966.

1.02 BY SUBMISSION OF THIS BID, THE BIDDER AND EACH PERSON SIGNING ON BEHALF OF THE BIDDER CERTIFIES, AND IN THE CASE OF A JOINT BID EACH PARTY THERETO CERTIFIES AS TO ITS OWN ORGANIZATION, UNDER PENALTY OF PERJURY, THAT TO THE BEST OF KNOWLEDGE AND BELIEF:

A. THE PRICES IN THIS BID HAVE BEEN ARRIVED AT INDEPENDENTLY WITHOUT COLLUSION, CONSULTATION, COMMUNICATION, OR AGREEMENT, FOR THE PURPOSE OF RESTRICTING COMPETITION, AS TO ANY MATTER RELATING TO SUCH PRICES WITH ANY OTHER BIDDER OR WITH ANY COMPETITOR;

B. UNLESS OTHERWISE REQUIRED BY LAW, THE PRICES WHICH HAVE BEEN QUOTED IN THIS BID HAVE NOT BEEN KNOWINGLY DISCLOSED BY THE BIDDER AND WILL NOT KNOWINGLY BE DISCLOSED BY THE BIDDER PRIOR TO OPENING, DIRECTLY OR INDIRECTLY, TO ANY OTHER BIDDER OR TO ANY COMPETITOR; AND

C. NO ATTEMPT HAS BEEN MADE OR WILL BE MADE BY THE BIDDER TO INDUCE ANY OTHER PERSON, PARTNERSHIP OR CORPORATION TO SUBMIT OR NOT TO SUBMIT A BID FOR THE PURPOSE OF RESTRICTING COMPETITION.

INDIVIDUAL BIDDER

A CO-PARTNERSHIP

A CORPORATION

BY: _____

END OF SECTION

CERTIFICATION OF COMPLIANCE WITH THE IRAN DIVESTMENT ACT

As a result of the Iran Divestment Act of 2012 (the "Act"), Chapter 1 of the 2012 Laws of New York, a new provision has been added to State Finance Law (SFL) § 165-a and New York General Municipal Law §103-g, both effective April 12, 2012. Under the Act, the Commissioner of the Office of General Services (OGS) will be developing a list of "persons" who are engaged in "investment activities in Iran" (both are defined terms in the law) (the "Prohibited Entities List"). Pursuant to SFL § 165-a(3)(b), the initial list is expected to be issued no later than 120 days after the Act's effective date at which time it will be posted on the OGS website.

By submitting a bid in response to this solicitation or by assuming the responsibility of a Contract awarded hereunder, each Bidder/Contractor, any person signing on behalf of any Bidder/Contractor and any assignee or subcontractor and, in the case of a joint bid, each party thereto, certifies, under penalty of perjury, that once the Prohibited Entities List is posted on the OGS website, that to the best of its knowledge and belief, that each Bidder/Contractor and any subcontractor or assignee is not identified on the Prohibited Entities List created pursuant to SFL § 165-a(3)(b).

Additionally, Bidder/Contractor is advised that once the Prohibited Entities List is posted on the OGS website, any Bidder/Contractor seeking to renew or extend a Contract or assume the responsibility of a Contract awarded in response to this solicitation must certify at the time the Contract is renewed, extended or assigned that it is not included on the Prohibited Entities List.

During the term of the Contract, should the County receive information that a Bidder/Contractor is in violation of the above-referenced certification, the County will offer the person or entity an opportunity to respond. If the person or entity fails to demonstrate that he/she/it has ceased engagement in the investment which is in violation of the Act within 90 days after the determination of such violation, then the County shall take such action as may be appropriate including, but not limited to, imposing sanctions, seeking compliance, recovering damages or declaring the Bidder/Contractor in default.

The County reserves the right to reject any bid or request for assignment for a Bidder/Contractor that appears on the Prohibited Entities List prior to the award of a contract and to pursue a responsibility review with respect to any Bidder/Contractor that is awarded a contract and subsequently appears on the Prohibited Entities List.

I, _____, being duly sworn, deposes and says that
he/she is the _____ of the _____

Corporation and that neither the Bidder/Contractor nor any proposed subcontractor is identified on the Prohibited Entities List.

SIGNED

SWORN to before me this

_____ day of _____

20__

Notary Public: _____

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 00 4810

STATEMENT OF SURETY'S INTENT

To: _____

We have received the bid of _____
(Contractor)

Of _____
(Address)

For _____

(Project)

Bids for which will be received on _____
(Bid Opening Date)

and wish to advise that should this Bid of the Contractor be accepted and the Contractor be accepted and the Contract awarded to him, it is our present intention to become surety on the Performance Bond and Labor and Materials Payment Bond required by the Contract.

Any arrangement for the bonds required by the Contract is a matter between the Contractor and ourselves, and we assume no liability to you or third parties if for any reason we do not execute the requisite bonds.

We are duly authorized to transact business in the State of New York, and we appear on the U.S. Treasury Department's most current list (Circular 570 as amended).

Attest: _____

Surety's Authorized Signature(s)

Attach Power of Attorney

(Corporate seal if any. If no seal, write "No Seal" across this place and sign.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 00 5200
AGREEMENT FORM

PART 1 GENERAL

1.01 FORM OF AGREEMENT

- A. AIA Document A101 - 2017, Standard Form of Agreement between Owner and Contractor.
 - 1. This agreement to be executed is attached following this page.

1.02 RELATED REQUIREMENTS

- A. Section 00 7200 - General Conditions.
- B. Section 00 7300 - Supplementary Conditions.
- C. Section 01 4216 - Definitions.

END OF SECTION

DRAFT AIA® Document A101® – 2017

Standard Form of Agreement Between Owner and Contractor where the basis of payment is a Stipulated Sum

AGREEMENT made as of the «» day of «» in the year «»
(In words, indicate day, month and year.)

BETWEEN the Owner:
(Name, legal status, address and other information)

«Akwasasne Mohawk Casino & Resort»
«873 New York Route 37
Hogansburg, New York 13655»
«Telephone Number: 518-358-2222»
«Fax Number: 518-358-4047»

and the Contractor:
(Name, legal status, address and other information)

«»
«»
«»
«»

for the following Project:
(Name, location and detailed description)

«22012-AMCR-Tavern Kitchen»
«873 New York Route 37
Hogansburg, New York 13655»
«This project consists of partial demolition & renovation to an existing kitchen.»

The Architect:
(Name, legal status, address and other information)

«Architectural & Engineering Design Associates, PC»
«1246 Route 3
PO Box 762
Plattsburgh, New York 12901»
«Telephone Number: (518) 562-1800»
«Fax Number: (518) 562-1702»

The Owner and Contractor agree as follows.

ADDITIONS AND DELETIONS:

The author of this document has added information needed for its completion. The author may also have revised the text of the original AIA standard form. An *Additions and Deletions Report* that notes added information as well as revisions to the standard form text is available from the author and should be reviewed.

This document has important legal consequences. Consultation with an attorney is encouraged with respect to its completion or modification.

The parties should complete A101®-2017, Exhibit A, Insurance and Bonds, contemporaneously with this Agreement. AIA Document A201®-2017, General Conditions of the Contract for Construction, is adopted in this document by reference. Do not use with other general conditions unless this document is modified.

ELECTRONIC COPYING of any portion of this AIA® Document to another electronic file is prohibited and constitutes a violation of copyright laws as set forth in the footer of this document.

TABLE OF ARTICLES

- 1 THE CONTRACT DOCUMENTS
- 2 THE WORK OF THIS CONTRACT
- 3 DATE OF COMMENCEMENT AND SUBSTANTIAL COMPLETION
- 4 CONTRACT SUM
- 5 PAYMENTS
- 6 DISPUTE RESOLUTION
- 7 TERMINATION OR SUSPENSION
- 8 MISCELLANEOUS PROVISIONS
- 9 ENUMERATION OF CONTRACT DOCUMENTS

EXHIBIT A INSURANCE AND BONDS

ARTICLE 1 THE CONTRACT DOCUMENTS

The Contract Documents consist of this Agreement, Conditions of the Contract (General, Supplementary, and other Conditions), Drawings, Specifications, Addenda issued prior to execution of this Agreement, other documents listed in this Agreement, and Modifications issued after execution of this Agreement, all of which form the Contract, and are as fully a part of the Contract as if attached to this Agreement or repeated herein. The Contract represents the entire and integrated agreement between the parties hereto and supersedes prior negotiations, representations, or agreements, either written or oral. An enumeration of the Contract Documents, other than a Modification, appears in Article 9.

ARTICLE 2 THE WORK OF THIS CONTRACT

The Contractor shall fully execute the Work described in the Contract Documents, except as specifically indicated in the Contract Documents to be the responsibility of others.

ARTICLE 3 DATE OF COMMENCEMENT AND SUBSTANTIAL COMPLETION

§ 3.1 The date of commencement of the Work shall be:

(Check one of the following boxes.)

[☐] The date of this Agreement.

[☒] A date set forth in a notice to proceed issued by the Owner.

[☐] Established as follows:

(Insert a date or a means to determine the date of commencement of the Work.)

<< ☐ >>

If a date of commencement of the Work is not selected, then the date of commencement shall be the date of this Agreement.

§ 3.2 The Contract Time shall be measured from the date of commencement of the Work.

§ 3.3 Substantial Completion

§ 3.3.1 Subject to adjustments of the Contract Time as provided in the Contract Documents, the Contractor shall achieve Substantial Completion of the entire Work:

(Check one of the following boxes and complete the necessary information.)

[☐] Not later than (☐) calendar days from the date of commencement of the Work.

[☒] By the following date:

§ 3.3.2 Subject to adjustments of the Contract Time as provided in the Contract Documents, if portions of the Work are to be completed prior to Substantial Completion of the entire Work, the Contractor shall achieve Substantial Completion of such portions by the following dates:

Portion of Work	Substantial Completion Date
<input type="text"/>	<input type="text"/>

§ 3.3.3 If the Contractor fails to achieve Substantial Completion as provided in this Section 3.3, liquidated damages, if any, shall be assessed as set forth in Section 4.5.

ARTICLE 4 CONTRACT SUM

§ 4.1 The Owner shall pay the Contractor the Contract Sum in current funds for the Contractor's performance of the Contract. The Contract Sum shall be (\$), subject to additions and deductions as provided in the Contract Documents.

§ 4.2 Alternates

§ 4.2.1 Alternates, if any, included in the Contract Sum:

Item	Price
<input type="text"/>	<input type="text"/>

§ 4.2.2 Subject to the conditions noted below, the following alternates may be accepted by the Owner following execution of this Agreement. Upon acceptance, the Owner shall issue a Modification to this Agreement.
(Insert below each alternate and the conditions that must be met for the Owner to accept the alternate.)

Item	Price	Conditions for Acceptance
<input type="text"/>	<input type="text"/>	<input type="text"/>

§ 4.3 Allowances, if any, included in the Contract Sum:
(Identify each allowance.)

Item	Price
<input type="text"/>	<input type="text"/>

§ 4.4 Unit prices, if any:
(Identify the item and state the unit price and quantity limitations, if any, to which the unit price will be applicable.)

Item	Units and Limitations	Price per Unit (\$0.00)
<input type="text"/>	<input type="text"/>	<input type="text"/>

§ 4.5 Liquidated damages, if any:
(Insert terms and conditions for liquidated damages, if any.)

§ 4.6 Other:
(Insert provisions for bonus or other incentives, if any, that might result in a change to the Contract Sum.)

ARTICLE 5 PAYMENTS

§ 5.1 Progress Payments

§ 5.1.1 Based upon Applications for Payment submitted to the Architect by the Contractor and Certificates for Payment issued by the Architect, the Owner shall make progress payments on account of the Contract Sum to the Contractor as provided below and elsewhere in the Contract Documents.

§ 5.1.2 The period covered by each Application for Payment shall be one calendar month ending on the last day of the month, or as follows:

« »

§ 5.1.3 Provided that an Application for Payment is received by the Architect not later than the «25th » day of a month, the Owner shall make payment of the amount certified to the Contractor not later than the «Last » day of the «Following » month. If an Application for Payment is received by the Architect after the application date fixed above, payment of the amount certified shall be made by the Owner not later than «45 » («Forty Five ») days after the Architect receives the Application for Payment.

(Federal, state or local laws may require payment within a certain period of time.)

§ 5.1.4 Each Application for Payment shall be based on the most recent schedule of values submitted by the Contractor in accordance with the Contract Documents. The schedule of values shall allocate the entire Contract Sum among the various portions of the Work. The schedule of values shall be prepared in such form, and supported by such data to substantiate its accuracy, as the Architect may require. This schedule of values shall be used as a basis for reviewing the Contractor's Applications for Payment.

§ 5.1.5 Applications for Payment shall show the percentage of completion of each portion of the Work as of the end of the period covered by the Application for Payment.

§ 5.1.6 In accordance with AIA Document A201™–2017, General Conditions of the Contract for Construction, and subject to other provisions of the Contract Documents, the amount of each progress payment shall be computed as follows:

§ 5.1.6.1 The amount of each progress payment shall first include:

- .1 That portion of the Contract Sum properly allocable to completed Work;
- .2 That portion of the Contract Sum properly allocable to materials and equipment delivered and suitably stored at the site for subsequent incorporation in the completed construction, or, if approved in advance by the Owner, suitably stored off the site at a location agreed upon in writing; and
- .3 That portion of Construction Change Directives that the Architect determines, in the Architect's professional judgment, to be reasonably justified.

§ 5.1.6.2 The amount of each progress payment shall then be reduced by:

- .1 The aggregate of any amounts previously paid by the Owner;
- .2 The amount, if any, for Work that remains uncorrected and for which the Architect has previously withheld a Certificate for Payment as provided in Article 9 of AIA Document A201–2017;
- .3 Any amount for which the Contractor does not intend to pay a Subcontractor or material supplier, unless the Work has been performed by others the Contractor intends to pay;
- .4 For Work performed or defects discovered since the last payment application, any amount for which the Architect may withhold payment, or nullify a Certificate of Payment in whole or in part, as provided in Article 9 of AIA Document A201–2017; and
- .5 Retainage withheld pursuant to Section 5.1.7.

§ 5.1.7 Retainage

§ 5.1.7.1 For each progress payment made prior to Substantial Completion of the Work, the Owner may withhold the following amount, as retainage, from the payment otherwise due:

(Insert a percentage or amount to be withheld as retainage from each Application for Payment. The amount of retainage may be limited by governing law.)

«5% »

§ 5.1.7.1.1 The following items are not subject to retainage:
(Insert any items not subject to the withholding of retainage, such as general conditions, insurance, etc.)

«N/A »

§ 5.1.7.2 Reduction or limitation of retainage, if any, shall be as follows:
(If the retainage established in Section 5.1.7.1 is to be modified prior to Substantial Completion of the entire Work, including modifications for Substantial Completion of portions of the Work as provided in Section 3.3.2, insert provisions for such modifications.)

«Retainage is to be submitted with final application »

§ 5.1.7.3 Except as set forth in this Section 5.1.7.3, upon Substantial Completion of the Work, the Contractor may submit an Application for Payment that includes the retainage withheld from prior Applications for Payment pursuant to this Section 5.1.7. The Application for Payment submitted at Substantial Completion shall not include retainage as follows:
(Insert any other conditions for release of retainage upon Substantial Completion.)

« »

§ 5.1.8 If final completion of the Work is materially delayed through no fault of the Contractor, the Owner shall pay the Contractor any additional amounts in accordance with Article 9 of AIA Document A201–2017.

§ 5.1.9 Except with the Owner's prior approval, the Contractor shall not make advance payments to suppliers for materials or equipment which have not been delivered and stored at the site.

§ 5.2 Final Payment

§ 5.2.1 Final payment, constituting the entire unpaid balance of the Contract Sum, shall be made by the Owner to the Contractor when

- .1 the Contractor has fully performed the Contract except for the Contractor's responsibility to correct Work as provided in Article 12 of AIA Document A201–2017, and to satisfy other requirements, if any, which extend beyond final payment; and
- .2 a final Certificate for Payment has been issued by the Architect.

§ 5.2.2 The Owner's final payment to the Contractor shall be made no later than 30 days after the issuance of the Architect's final Certificate for Payment, or as follows:

«N/A »

§ 5.3 Interest

Payments due and unpaid under the Contract shall bear interest from the date payment is due at the rate stated below, or in the absence thereof, at the legal rate prevailing from time to time at the place where the Project is located.

(Insert rate of interest agreed upon, if any.)

«N/A » % « »

ARTICLE 6 DISPUTE RESOLUTION

§ 6.1 Initial Decision Maker

The Architect will serve as the Initial Decision Maker pursuant to Article 15 of AIA Document A201–2017, unless the parties appoint below another individual, not a party to this Agreement, to serve as the Initial Decision Maker.
(If the parties mutually agree, insert the name, address and other contact information of the Initial Decision Maker, if other than the Architect.)

«- »

« »

« »

« »

§ 6.2 Binding Dispute Resolution

For any Claim subject to, but not resolved by, mediation pursuant to Article 15 of AIA Document A201–2017, the method of binding dispute resolution shall be as follows:

(Check the appropriate box.)

[☐] Arbitration pursuant to Section 15.4 of AIA Document A201–2017

[☒] Litigation in a Tribal court where tribal law is jurisdiction

[☐] Other *(Specify)*

« »

If the Owner and Contractor do not select a method of binding dispute resolution, or do not subsequently agree in writing to a binding dispute resolution method other than litigation, Claims will be resolved by litigation in a court of competent jurisdiction.

ARTICLE 7 TERMINATION OR SUSPENSION

§ 7.1 The Contract may be terminated by the Owner or the Contractor as provided in Article 14 of AIA Document A201–2017.

§ 7.1.1 If the Contract is terminated for the Owner's convenience in accordance with Article 14 of AIA Document A201–2017, then the Owner shall pay the Contractor a termination fee as follows:

(Insert the amount of, or method for determining, the fee, if any, payable to the Contractor following a termination for the Owner's convenience.)

«N/A »

§ 7.2 The Work may be suspended by the Owner as provided in Article 14 of AIA Document A201–2017.

ARTICLE 8 MISCELLANEOUS PROVISIONS

§ 8.1 Where reference is made in this Agreement to a provision of AIA Document A201–2017 or another Contract Document, the reference refers to that provision as amended or supplemented by other provisions of the Contract Documents.

§ 8.2 The Owner's representative:

(Name, address, email address, and other information)

«Scott Freeman»

«873 New York Route 37

Hogansburg, New York 13655»

«Telephone Number: 518-358-2222»

«Fax Number: 518-358-4047»

«Email SFreeman@mohawkasino.com »

« »

§ 8.3 The Contractor's representative:

(Name, address, email address, and other information)

« »

« »

« »

« »

« »

« »

§ 8.4 Neither the Owner's nor the Contractor's representative shall be changed without ten days' prior notice to the other party.

§ 8.5 Insurance and Bonds

§ 8.5.1 The Owner and the Contractor shall purchase and maintain insurance as set forth in AIA Document A101™–2017, Standard Form of Agreement Between Owner and Contractor where the basis of payment is a Stipulated Sum, Exhibit A, Insurance and Bonds, and elsewhere in the Contract Documents.

§ 8.5.2 The Contractor shall provide bonds as set forth in AIA Document A101™–2017 Exhibit A, and elsewhere in the Contract Documents.

§ 8.6 Notice in electronic format, pursuant to Article 1 of AIA Document A201–2017, may be given in accordance with AIA Document E203™–2013, Building Information Modeling and Digital Data Exhibit, if completed, or as otherwise set forth below:

(If other than in accordance with AIA Document E203–2013, insert requirements for delivering notice in electronic format such as name, title, and email address of the recipient and whether and how the system will be required to generate a read receipt for the transmission.)

« »

§ 8.7 Other provisions:

« »

ARTICLE 9 ENUMERATION OF CONTRACT DOCUMENTS

§ 9.1 This Agreement is comprised of the following documents:

- .1 AIA Document A101™–2017, Standard Form of Agreement Between Owner and Contractor
- .2 AIA Document A101™–2017, Exhibit A, Insurance and Bonds
- .3 AIA Document A201™–2017, General Conditions of the Contract for Construction
- .4 AIA Document E203™–2013, Building Information Modeling and Digital Data Exhibit, dated as indicated below:
(Insert the date of the E203-2013 incorporated into this Agreement.)

« »

.5 Drawings

Number	Title	Date
«See Sheet List on T001 »		

.6 Specifications

Section	Title	Date	Pages
«See Section 00 0110 - Table of Contents »			

.7 Addenda, if any:

Number	Date	Pages
« »		

Portions of Addenda relating to bidding or proposal requirements are not part of the Contract Documents unless the bidding or proposal requirements are also enumerated in this Article 9.

.8 Other Exhibits:

(Check all boxes that apply and include appropriate information identifying the exhibit where required.)

[« »] AIA Document E204™–2017, Sustainable Projects Exhibit, dated as indicated below:
(Insert the date of the E204-2017 incorporated into this Agreement.)

« »

[« »] The Sustainability Plan:

Title	Date	Pages
«N/A »		

[« »] Supplementary and other Conditions of the Contract:

Document	Title	Date	Pages
«N/A »			

.9 Other documents, if any, listed below:

(List here any additional documents that are intended to form part of the Contract Documents. AIA Document A201™–2017 provides that the advertisement or invitation to bid, Instructions to Bidders, sample forms, the Contractor's bid or proposal, portions of Addenda relating to bidding or proposal requirements, and other information furnished by the Owner in anticipation of receiving bids or proposals, are not part of the Contract Documents unless enumerated in this Agreement. Any such documents should be listed here only if intended to be part of the Contract Documents.)

«N/A »

This Agreement entered into as of the day and year first written above.

« »

OWNER (Signature)

«Scott Freeman»«, General Manager»

(Printed name and title)

« »

CONTRACTOR (Signature)

« »« »

(Printed name and title)

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

AGREEMENT

(Certification of Owner's Attorney)

I, the undersigned, _____, the duly authorized and acting legal representative of the Akwesasne Mohawk Casino & Resort do hereby certify as follows:

I have examined the foregoing Contract and the manner of execution thereof, and I am of the opinion that each of the aforesaid agreements has been duly executed by the proper parties thereto acting through their duly authorized representatives; that said representatives have full power and authority to execute said agreements on behalf of the respective parties named thereon; and that the foregoing agreements constitute valid and legally binding obligations upon the parties executing the same in accordance with the terms, conditions and provisions thereof.

By: _____
(Attorney for Akwesasne Mohawk Casino & Resort)

(Date)

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 00 7200
GENERAL CONDITIONS

PART 1 GENERAL

1.01 AIA DOCUMENT A201 - 2017, GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION.

A. These general conditions are attached following the document.

1.02 RELATED REQUIREMENTS

A. Section 00 7300 - Supplementary Conditions.

B. Section 01 4216 - Definitions.

END OF SECTION

DRAFT AIA® Document A201® – 2007

General Conditions of the Contract for Construction

for the following PROJECT:

(Name and location or address)

«22012-AMCR-Tavern Kitchen»
«873 New York Route 37
Hogansburg, New York 13655»

THE OWNER:

(Name, legal status and address)

«Akwesasne Mohawk Casino & Resort»« »
«873 New York Route 37
Hogansburg, New York 13655»

THE ARCHITECT:

(Name, legal status and address)

«Architectural & Engineering Design Associates, P.C.»«», Professional Corporation»
«1246 State Route 3
P.O. Box 767
Plattsburgh, New York 12901»

ADDITIONS AND DELETIONS:

The author of this document has added information needed for its completion. The author may also have revised the text of the original AIA standard form. An *Additions and Deletions Report* that notes added information as well as revisions to the standard form text is available from the author and should be reviewed.

This document has important legal consequences. Consultation with an attorney is encouraged with respect to its completion or modification.

TABLE OF ARTICLES

- 1 GENERAL PROVISIONS
- 2 OWNER
- 3 CONTRACTOR
- 4 ARCHITECT
- 5 SUBCONTRACTORS
- 6 CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS
- 7 CHANGES IN THE WORK
- 8 TIME
- 9 PAYMENTS AND COMPLETION
- 10 PROTECTION OF PERSONS AND PROPERTY
- 11 INSURANCE AND BONDS
- 12 UNCOVERING AND CORRECTION OF WORK
- 13 MISCELLANEOUS PROVISIONS
- 14 TERMINATION OR SUSPENSION OF THE CONTRACT

ELECTRONIC COPYING of any portion of this AIA® Document to another electronic file is prohibited and constitutes a violation of copyright laws as set forth in the footer of this document.



INDEX

(Topics and numbers in bold are section headings.)

Acceptance of Nonconforming Work

9.6.6, 9.9.3, **12.3**

Acceptance of Work

9.6.6, 9.8.2, 9.9.3, 9.10.1, 9.10.3, 12.3

Access to Work

3.16, 6.2.1, 12.1

Accident Prevention

10

Acts and Omissions

3.2, 3.3.2, 3.12.8, 3.18, 4.2.3, 8.3.1, 9.5.1, 10.2.5,
10.2.8, 13.4.2, 13.7, 14.1, 15.2

Addenda

1.1.1, 3.11

Additional Costs, Claims for

3.7.4, 3.7.5, 6.1.1, 7.3.7.5, 10.3, 15.1.4

Additional Inspections and Testing

9.4.2, 9.8.3, 12.2.1, **13.5**

Additional Insured

11.1.4

Additional Time, Claims for

3.2.4, 3.7.4, 3.7.5, 3.10.2, 8.3.2, **15.1.5**

Administration of the Contract

3.1.3, **4.2**, 9.4, 9.5

Advertisement or Invitation to Bid

1.1.1

Aesthetic Effect

4.2.13

Allowances

3.8, 7.3.8

All-risk Insurance

11.3.1, 11.3.1.1

Applications for Payment

4.2.5, 7.3.9, 9.2, **9.3**, 9.4, 9.5.1, 9.6.3, 9.7, 9.10,
11.1.3

Approvals

2.1.1, 2.2.2, 2.4, 3.1.3, 3.10.2, 3.12.8, 3.12.9, 3.12.10,
4.2.7, 9.3.2, 13.5.1

Arbitration

8.3.1, 11.3.10, 13.1, 15.3.2, **15.4**

ARCHITECT

4

Architect, Definition of

4.1.1

Architect, Extent of Authority

2.4, 3.12.7, 4.1, 4.2, 5.2, 6.3, 7.1.2, 7.3.7, 7.4, 9.2,
9.3.1, 9.4, 9.5, 9.6.3, 9.8, 9.10.1, 9.10.3, 12.1, 12.2.1,
13.5.1, 13.5.2, 14.2.2, 14.2.4, 15.1.3, 15.2.1

Architect, Limitations of Authority and Responsibility

2.1.1, 3.12.4, 3.12.8, 3.12.10, 4.1.2, 4.2.1, 4.2.2,
4.2.3, 4.2.6, 4.2.7, 4.2.10, 4.2.12, 4.2.13, 5.2.1, 7.4,
9.4.2, 9.5.3, 9.6.4, 15.1.3, 15.2

Architect's Additional Services and Expenses

2.4, 11.3.1.1, 12.2.1, 13.5.2, 13.5.3, 14.2.4

Architect's Administration of the Contract

3.1.3, 4.2, 3.7.4, 15.2, 9.4.1, 9.5

Architect's Approvals

2.4, 3.1.3, 3.5, 3.10.2, 4.2.7

Architect's Authority to Reject Work

3.5, 4.2.6, 12.1.2, 12.2.1

Architect's Copyright

1.1.7, 1.5

Architect's Decisions

3.7.4, 4.2.6, 4.2.7, 4.2.11, 4.2.12, 4.2.13, 4.2.14, 6.3,
7.3.7, 7.3.9, 8.1.3, 8.3.1, 9.2, 9.4.1, 9.5, 9.8.4, 9.9.1,
13.5.2, 15.2, 15.3

Architect's Inspections

3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.8.3, 9.9.2, 9.10.1, 13.5

Architect's Instructions

3.2.4, 3.3.1, 4.2.6, 4.2.7, 13.5.2

Architect's Interpretations

4.2.11, 4.2.12

Architect's Project Representative

4.2.10

Architect's Relationship with Contractor

1.1.2, 1.5, 3.1.3, 3.2.2, 3.2.3, 3.2.4, 3.3.1, 3.4.2, 3.5,
3.7.4, 3.7.5, 3.9.2, 3.9.3, 3.10, 3.11, 3.12, 3.16, 3.18,
4.1.2, 4.1.3, 4.2, 5.2, 6.2.2, 7, 8.3.1, 9.2, 9.3, 9.4, 9.5,
9.7, 9.8, 9.9, 10.2.6, 10.3, 11.3.7, 12, 13.4.2, 13.5,
15.2

Architect's Relationship with Subcontractors

1.1.2, 4.2.3, 4.2.4, 4.2.6, 9.6.3, 9.6.4, 11.3.7

Architect's Representations

9.4.2, 9.5.1, 9.10.1

Architect's Site Visits

3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.5.1, 9.9.2, 9.10.1, 13.5

Asbestos

10.3.1

Attorneys' Fees

3.18.1, 9.10.2, 10.3.3

Award of Separate Contracts

6.1.1, 6.1.2

Award of Subcontracts and Other Contracts for Portions of the Work

5.2

Basic Definitions

1.1

Bidding Requirements

1.1.1, 5.2.1, 11.4.1

Binding Dispute Resolution

9.7, 11.3.9, 11.3.10, 13.1, 15.2.5, 15.2.6.1, 15.3.1,
15.3.2, 15.4.1

Boiler and Machinery Insurance

11.3.2

Bonds, Lien

7.3.7.4, 9.10.2, 9.10.3

Bonds, Performance, and Payment

7.3.7.4, 9.6.7, 9.10.3, 11.3.9, **11.4**

Building Permit

3.7.1

Capitalization

1.3

Certificate of Substantial Completion

9.8.3, 9.8.4, 9.8.5

Certificates for Payment

4.2.1, 4.2.5, 4.2.9, 9.3.3, **9.4**, 9.5, 9.6.1, 9.6.6, 9.7, 9.10.1, 9.10.3, 14.1.1.3, 14.2.4, 15.1.3

Certificates of Inspection, Testing or Approval
13.5.4

Certificates of Insurance

9.10.2, 11.1.3

Change Orders

1.1.1, 2.4, 3.4.2, 3.7.4, 3.8.2.3, 3.11, 3.12.8, 4.2.8, 5.2.3, 7.1.2, 7.1.3, **7.2**, 7.3.2, 7.3.6, 7.3.9, 7.3.10, 8.3.1, 9.3.1.1, 9.10.3, 10.3.2, 11.3.1.2, 11.3.4, 11.3.9, 12.1.2, 15.1.3

Change Orders, Definition of

7.2.1

CHANGES IN THE WORK

2.2.1, 3.11, 4.2.8, 7, 7.2.1, 7.3.1, 7.4, 8.3.1, 9.3.1.1, 11.3.9

Claims, Definition of

15.1.1

CLAIMS AND DISPUTES

3.2.4, 6.1.1, 6.3, 7.3.9, 9.3.3, 9.10.4, 10.3.3, **15**, 15.4

Claims and Timely Assertion of Claims

15.4.1

Claims for Additional Cost

3.2.4, 3.7.4, 6.1.1, 7.3.9, 10.3.2, **15.1.4**

Claims for Additional Time

3.2.4, 3.7.4, 6.1.1, 8.3.2, 10.3.2, **15.1.5**

Concealed or Unknown Conditions, Claims for
3.7.4

Claims for Damages

3.2.4, 3.18, 6.1.1, 8.3.3, 9.5.1, 9.6.7, 10.3.3, 11.1.1, 11.3.5, 11.3.7, 14.1.3, 14.2.4, 15.1.6

Claims Subject to Arbitration

15.3.1, 15.4.1

Cleaning Up

3.15, 6.3

Commencement of the Work, Conditions Relating to
2.2.1, 3.2.2, 3.4.1, 3.7.1, 3.10.1, 3.12.6, 5.2.1, 5.2.3, 6.2.2, 8.1.2, 8.2.2, 8.3.1, 11.1, 11.3.1, 11.3.6, 11.4.1, 15.1.4

Commencement of the Work, Definition of

8.1.2

Communications Facilitating Contract

Administration

3.9.1, **4.2.4**

Completion, Conditions Relating to

3.4.1, 3.11, 3.15, 4.2.2, 4.2.9, 8.2, 9.4.2, 9.8, 9.9.1, 9.10, 12.2, 13.7, 14.1.2

COMPLETION, PAYMENTS AND

9

Completion, Substantial

4.2.9, 8.1.1, 8.1.3, 8.2.3, 9.4.2, 9.8, 9.9.1, 9.10.3, 12.2, 13.7

Compliance with Laws

1.6, 3.2.3, 3.6, 3.7, 3.12.10, 3.13, 4.1.1, 9.6.4, 10.2.2, 11.1, 11.3, 13.1, 13.4, 13.5.1, 13.5.2, 13.6, 14.1.1, 14.2.1.3, 15.2.8, 15.4.2, 15.4.3

Concealed or Unknown Conditions

3.7.4, 4.2.8, 8.3.1, 10.3

Conditions of the Contract

1.1.1, 6.1.1, 6.1.4

Consent, Written

3.4.2, 3.7.4, 3.12.8, 3.14.2, 4.1.2, 9.3.2, 9.8.5, 9.9.1, 9.10.2, 9.10.3, 11.3.1, 13.2, 13.4.2, 15.4.4.2

Consolidation or Joinder

15.4.4

CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS

1.1.4, **6**

Construction Change Directive, Definition of
7.3.1

Construction Change Directives

1.1.1, 3.4.2, 3.12.8, 4.2.8, 7.1.1, 7.1.2, 7.1.3, **7.3**, 9.3.1.1

Construction Schedules, Contractor's

3.10, 3.12.1, 3.12.2, 6.1.3, 15.1.5.2

Contingent Assignment of Subcontracts

5.4, 14.2.2.2

Continuing Contract Performance

15.1.3

Contract, Definition of

1.1.2

CONTRACT, TERMINATION OR SUSPENSION OF THE

5.4.1.1, 11.3.9, **14**

Contract Administration

3.1.3, 4, 9.4, 9.5

Contract Award and Execution, Conditions Relating to

3.7.1, 3.10, 5.2, 6.1, 11.1.3, 11.3.6, 11.4.1

Contract Documents, Copies Furnished and Use of
1.5.2, 2.2.5, 5.3

Contract Documents, Definition of

1.1.1

Contract Sum

3.7.4, 3.8, 5.2.3, 7.2, 7.3, 7.4, **9.1**, 9.4.2, 9.5.1.4, 9.6.7, 9.7, 10.3.2, 11.3.1, 14.2.4, 14.3.2, 15.1.4, 15.2.5

Contract Sum, Definition of

9.1

Contract Time

3.7.4, 3.7.5, 3.10.2, 5.2.3, 7.2.1.3, 7.3.1, 7.3.5, 7.4, 8.1.1, 8.2.1, 8.3.1, 9.5.1, 9.7, 10.3.2, 12.1.1, 14.3.2, 15.1.5.1, 15.2.5

Contract Time, Definition of

8.1.1

CONTRACTOR

3

Contractor, Definition of

3.1, **6.1.2**

Contractor's Construction Schedules

3.10, 3.12.1, 3.12.2, 6.1.3, 15.1.5.2

Contractor's Employees
3.3.2, 3.4.3, 3.8.1, 3.9, 3.18.2, 4.2.3, 4.2.6, 10.2, 10.3, 11.1.1, 11.3.7, 14.1, 14.2.1.1

Contractor's Liability Insurance
11.1
Contractor's Relationship with Separate Contractors and Owner's Forces
3.12.5, 3.14.2, 4.2.4, 6, 11.3.7, 12.1.2, 12.2.4
Contractor's Relationship with Subcontractors
1.2.2, 3.3.2, 3.18.1, 3.18.2, 5, 9.6.2, 9.6.7, 9.10.2, 11.3.1.2, 11.3.7, 11.3.8
Contractor's Relationship with the Architect
1.1.2, 1.5, 3.1.3, 3.2.2, 3.2.3, 3.2.4, 3.3.1, 3.4.2, 3.5, 3.7.4, 3.10, 3.11, 3.12, 3.16, 3.18, 4.1.3, 4.2, 5.2, 6.2.2, 7, 8.3.1, 9.2, 9.3, 9.4, 9.5, 9.7, 9.8, 9.9, 10.2.6, 10.3, 11.3.7, 12, 13.5, 15.1.2, 15.2.1
Contractor's Representations
3.2.1, 3.2.2, 3.5, 3.12.6, 6.2.2, 8.2.1, 9.3.3, 9.8.2
Contractor's Responsibility for Those Performing the Work
3.3.2, 3.18, 5.3, 6.1.3, 6.2, 9.5.1, 10.2.8
Contractor's Review of Contract Documents
3.2
Contractor's Right to Stop the Work
9.7
Contractor's Right to Terminate the Contract
14.1, 15.1.6
Contractor's Submittals
3.10, 3.11, 3.12.4, 4.2.7, 5.2.1, 5.2.3, 9.2, 9.3, 9.8.2, 9.8.3, 9.9.1, 9.10.2, 9.10.3, 11.1.3, 11.4.2
Contractor's Superintendent
3.9, 10.2.6
Contractor's Supervision and Construction Procedures
1.2.2, 3.3, 3.4, 3.12.10, 4.2.2, 4.2.7, 6.1.3, 6.2.4, 7.1.3, 7.3.5, 7.3.7, 8.2, 10, 12, 14, 15.1.3
Contractual Liability Insurance
11.1.1.8, 11.2
Coordination and Correlation
1.2, 3.2.1, 3.3.1, 3.10, 3.12.6, 6.1.3, 6.2.1
Copies Furnished of Drawings and Specifications
1.5, 2.2.5, 3.11
Copyrights
1.5, **3.17**
Correction of Work
2.3, 2.4, 3.7.3, 9.4.2, 9.8.2, 9.8.3, 9.9.1, 12.1.2, **12.2**
Correlation and Intent of the Contract Documents
1.2
Cost, Definition of
7.3.7
Costs
2.4, 3.2.4, 3.7.3, 3.8.2, 3.15.2, 5.4.2, 6.1.1, 6.2.3, 7.3.3.3, 7.3.7, 7.3.8, 7.3.9, 9.10.2, 10.3.2, 10.3.6, 11.3, 12.1.2, 12.2.1, 12.2.4, 13.5, 14
Cutting and Patching
3.14, 6.2.5
Damage to Construction of Owner or Separate Contractors

3.14.2, 6.2.4, 10.2.1.2, 10.2.5, 10.4, 11.1.1, 11.3, 12.2.4
Damage to the Work
3.14.2, 9.9.1, 10.2.1.2, 10.2.5, 10.4, 11.3.1, 12.2.4
Damages, Claims for
3.2.4, 3.18, 6.1.1, 8.3.3, 9.5.1, 9.6.7, 10.3.3, 11.1.1, 11.3.5, 11.3.7, 14.1.3, 14.2.4, 15.1.6
Damages for Delay
6.1.1, 8.3.3, 9.5.1.6, 9.7, 10.3.2
Date of Commencement of the Work, Definition of
8.1.2
Date of Substantial Completion, Definition of
8.1.3
Day, Definition of
8.1.4
Decisions of the Architect
3.7.4, 4.2.6, 4.2.7, 4.2.11, 4.2.12, 4.2.13, 15.2, 6.3, 7.3.7, 7.3.9, 8.1.3, 8.3.1, 9.2, 9.4, 9.5.1, 9.8.4, 9.9.1, 13.5.2, 14.2.2, 14.2.4, 15.1, 15.2
Decisions to Withhold Certification
9.4.1, **9.5**, 9.7, 14.1.1.3
Defective or Nonconforming Work, Acceptance, Rejection and Correction of
2.3, 2.4, 3.5, 4.2.6, 6.2.5, 9.5.1, 9.5.2, 9.6.6, 9.8.2, 9.9.3, 9.10.4, 12.2.1
Definitions
1.1, 2.1.1, 3.1.1, 3.5, 3.12.1, 3.12.2, 3.12.3, 4.1.1, 15.1.1, 5.1, 6.1.2, 7.2.1, 7.3.1, 8.1, 9.1, 9.8.1
Delays and Extensions of Time
3.2, 3.7.4, 5.2.3, 7.2.1, 7.3.1, 7.4, **8.3**, 9.5.1, 9.7, 10.3.2, 10.4, 14.3.2, 15.1.5, 15.2.5
Disputes
6.3, 7.3.9, 15.1, 15.2
Documents and Samples at the Site
3.11
Drawings, Definition of
1.1.5
Drawings and Specifications, Use and Ownership of
3.11
Effective Date of Insurance
8.2.2, 11.1.2
Emergencies
10.4, 14.1.1.2, 15.1.4
Employees, Contractor's
3.3.2, 3.4.3, 3.8.1, 3.9, 3.18.2, 4.2.3, 4.2.6, 10.2, 10.3.3, 11.1.1, 11.3.7, 14.1, 14.2.1.1
Equipment, Labor, Materials or
1.1.3, 1.1.6, 3.4, 3.5, 3.8.2, 3.8.3, 3.12, 3.13, 3.15.1, 4.2.6, 4.2.7, 5.2.1, 6.2.1, 7.3.7, 9.3.2, 9.3.3, 9.5.1.3, 9.10.2, 10.2.1, 10.2.4, 14.2.1.1, 14.2.1.2
Execution and Progress of the Work
1.1.3, 1.2.1, 1.2.2, 2.2.3, 2.2.5, 3.1, 3.3.1, 3.4.1, 3.5, 3.7.1, 3.10.1, 3.12, 3.14, 4.2, 6.2.2, 7.1.3, 7.3.5, 8.2, 9.5.1, 9.9.1, 10.2, 10.3, 12.2, 14.2, 14.3.1, 15.1.3
Extensions of Time
3.2.4, 3.7.4, 5.2.3, 7.2.1, 7.3, 7.4, 9.5.1, 9.7, 10.3.2, 10.4, 14.3, 15.1.5, 15.2.5
Failure of Payment

9.5.1.3, **9.7**, 9.10.2, 13.6, 14.1.1.3, 14.2.1.2
Faulty Work
(See Defective or Nonconforming Work)
Final Completion and Final Payment
4.2.1, 4.2.9, 9.8.2, **9.10**, 11.1.2, 11.1.3, 11.3.1, 11.3.5,
12.3, 14.2.4, 14.4.3
Financial Arrangements, Owner's
2.2.1, 13.2.2, 14.1.1.4
Fire and Extended Coverage Insurance
11.3.1.1
GENERAL PROVISIONS
1
Governing Law
13.1
Guarantees (See Warranty)
Hazardous Materials
10.2.4, **10.3**
Identification of Subcontractors and Suppliers
5.2.1
Indemnification
3.17, **3.18**, 9.10.2, 10.3.3, 10.3.5, 10.3.6, 11.3.1.2,
11.3.7
Information and Services Required of the Owner
2.1.2, **2.2**, 3.2.2, 3.12.4, 3.12.10, 6.1.3, 6.1.4, 6.2.5,
9.6.1, 9.6.4, 9.9.2, 9.10.3, 10.3.3, 11.2, 11.4, 13.5.1,
13.5.2, 14.1.1.4, 14.1.4, 15.1.3
Initial Decision
15.2
Initial Decision Maker, Definition of
1.1.8
Initial Decision Maker, Decisions
14.2.2, 14.2.4, 15.2.1, 15.2.2, 15.2.3, 15.2.4, 15.2.5
Initial Decision Maker, Extent of Authority
14.2.2, 14.2.4, 15.1.3, 15.2.1, 15.2.2, 15.2.3, 15.2.4,
15.2.5
Injury or Damage to Person or Property
10.2.8, 10.4
Inspections
3.1.3, 3.3.3, 3.7.1, 4.2.2, 4.2.6, 4.2.9, 9.4.2, 9.8.3,
9.9.2, 9.10.1, 12.2.1, 13.5
Instructions to Bidders
1.1.1
Instructions to the Contractor
3.2.4, 3.3.1, 3.8.1, 5.2.1, 7, 8.2.2, 12, 13.5.2
Instruments of Service, Definition of
1.1.7
Insurance
3.18.1, 6.1.1, 7.3.7, 9.3.2, 9.8.4, 9.9.1, 9.10.2, **11**
Insurance, Boiler and Machinery
11.3.2
Insurance, Contractor's Liability
11.1
Insurance, Effective Date of
8.2.2, 11.1.2
Insurance, Loss of Use
11.3.3
Insurance, Owner's Liability
11.2

Insurance, Property
10.2.5, **11.3**
Insurance, Stored Materials
9.3.2
INSURANCE AND BONDS
11
Insurance Companies, Consent to Partial Occupancy
9.9.1
Intent of the Contract Documents
1.2.1, 4.2.7, 4.2.12, 4.2.13, 7.4
Interest
13.6
Interpretation
1.2.3, **1.4**, 4.1.1, 5.1, 6.1.2, 15.1.1
Interpretations, Written
4.2.11, 4.2.12, 15.1.4
Judgment on Final Award
15.4.2
Labor and Materials, Equipment
1.1.3, 1.1.6, **3.4**, 3.5, 3.8.2, 3.8.3, 3.12, 3.13, 3.15.1,
4.2.6, 4.2.7, 5.2.1, 6.2.1, 7.3.7, 9.3.2, 9.3.3, 9.5.1.3,
9.10.2, 10.2.1, 10.2.4, 14.2.1.1, 14.2.1.2
Labor Disputes
8.3.1
Laws and Regulations
1.5, 3.2.3, 3.6, 3.7, 3.12.10, 3.13, 4.1.1, 9.6.4, 9.9.1,
10.2.2, 11.1.1, 11.3, 13.1, 13.4, 13.5.1, 13.5.2, 13.6,
14, 15.2.8, 15.4
Liens
2.1.2, 9.3.3, 9.10.2, 9.10.4, 15.2.8
Limitations, Statutes of
12.2.5, 13.7, 15.4.1.1
Limitations of Liability
2.3, 3.2.2, 3.5, 3.12.10, 3.17, 3.18.1, 4.2.6, 4.2.7,
4.2.12, 6.2.2, 9.4.2, 9.6.4, 9.6.7, 10.2.5, 10.3.3,
11.1.2, 11.2, 11.3.7, 12.2.5, 13.4.2
Limitations of Time
2.1.2, 2.2, 2.4, 3.2.2, 3.10, 3.11, 3.12.5, 3.15.1, 4.2.7,
5.2, 5.3, 5.4.1, 6.2.4, 7.3, 7.4, 8.2, 9.2, 9.3.1, 9.3.3,
9.4.1, 9.5, 9.6, 9.7, 9.8, 9.9, 9.10, 11.1.3, 11.3.1.5,
11.3.6, 11.3.10, 12.2, 13.5, 13.7, 14, 15
Loss of Use Insurance
11.3.3
Material Suppliers
1.5, 3.12.1, 4.2.4, 4.2.6, 5.2.1, 9.3, 9.4.2, 9.6, 9.10.5
Materials, Hazardous
10.2.4, **10.3**
Materials, Labor, Equipment and
1.1.3, 1.1.6, 1.5.1, 3.4.1, 3.5, 3.8.2, 3.8.3, 3.12, 3.13,
3.15.1, 4.2.6, 4.2.7, 5.2.1, 6.2.1, 7.3.7, 9.3.2, 9.3.3,
9.5.1.3, 9.10.2, 10.2.1.2, 10.2.4, 14.2.1.1, 14.2.1.2
Means, Methods, Techniques, Sequences and
Procedures of Construction
3.3.1, 3.12.10, 4.2.2, 4.2.7, 9.4.2
Mechanic's Lien
2.1.2, 15.2.8
Mediation

8.3.1, 10.3.5, 10.3.6, 15.2.1, 15.2.5, 15.2.6, **15.3**, 15.4.1

Minor Changes in the Work

1.1.1, 3.12.8, 4.2.8, 7.1, **7.4**

MISCELLANEOUS PROVISIONS

13

Modifications, Definition of

1.1.1

Modifications to the Contract

1.1.1, 1.1.2, 3.11, 4.1.2, 4.2.1, 5.2.3, 7, 8.3.1, 9.7, 10.3.2, 11.3.1

Mutual Responsibility

6.2

Nonconforming Work, Acceptance of

9.6.6, 9.9.3, **12.3**

Nonconforming Work, Rejection and Correction of
2.3, 2.4, 3.5, 4.2.6, 6.2.4, 9.5.1, 9.8.2, 9.9.3, 9.10.4, 12.2.1

Notice

2.2.1, 2.3, 2.4, 3.2.4, 3.3.1, 3.7.2, 3.12.9, 5.2.1, 9.7, 9.10, 10.2.2, 11.1.3, 12.2.2.1, 13.3, 13.5.1, 13.5.2, 14.1, 14.2, 15.2.8, 15.4.1

Notice, Written

2.3, 2.4, 3.3.1, 3.9.2, 3.12.9, 3.12.10, 5.2.1, 9.7, 9.10, 10.2.2, 10.3, 11.1.3, 11.3.6, 12.2.2.1, **13.3**, 14, 15.2.8, 15.4.1

Notice of Claims

3.7.4, 10.2.8, **15.1.2**, 15.4

Notice of Testing and Inspections

13.5.1, 13.5.2

Observations, Contractor's

3.2, 3.7.4

Occupancy

2.2.2, 9.6.6, 9.8, 11.3.1.5

Orders, Written

1.1.1, 2.3, 3.9.2, 7, 8.2.2, 11.3.9, 12.1, 12.2.2.1, 13.5.2, 14.3.1

OWNER

2

Owner, Definition of

2.1.1

Owner, Information and Services Required of the

2.1.2, **2.2**, 3.2.2, 3.12.10, 6.1.3, 6.1.4, 6.2.5, 9.3.2, 9.6.1, 9.6.4, 9.9.2, 9.10.3, 10.3.3, 11.2, 11.3, 13.5.1, 13.5.2, 14.1.1.4, 14.1.4, 15.1.3

Owner's Authority

1.5, 2.1.1, 2.3, 2.4, 3.4.2, 3.8.1, 3.12.10, 3.14.2, 4.1.2, 4.1.3, 4.2.4, 4.2.9, 5.2.1, 5.2.4, 5.4.1, 6.1, 6.3, 7.2.1, 7.3.1, 8.2.2, 8.3.1, 9.3.1, 9.3.2, 9.5.1, 9.6.4, 9.9.1, 9.10.2, 10.3.2, 11.1.3, 11.3.3, 11.3.10, 12.2.2, 12.3, 13.2.2, 14.3, 14.4, 15.2.7

Owner's Financial Capability

2.2.1, 13.2.2, 14.1.1.4

Owner's Liability Insurance

11.2

Owner's Relationship with Subcontractors

1.1.2, 5.2, 5.3, 5.4, 9.6.4, 9.10.2, 14.2.2

Owner's Right to Carry Out the Work

2.4, 14.2.2

Owner's Right to Clean Up

6.3

Owner's Right to Perform Construction and to Award Separate Contracts

6.1

Owner's Right to Stop the Work

2.3

Owner's Right to Suspend the Work

14.3

Owner's Right to Terminate the Contract

14.2

Ownership and Use of Drawings, Specifications and Other Instruments of Service

1.1.1, 1.1.6, 1.1.7, **1.5**, 2.2.5, 3.2.2, 3.11, 3.17, 4.2.12, 5.3

Partial Occupancy or Use

9.6.6, **9.9**, 11.3.1.5

Patching, Cutting and

3.14, 6.2.5

Patents

3.17

Payment, Applications for

4.2.5, 7.3.9, 9.2, **9.3**, 9.4, 9.5, 9.6.3, 9.7, 9.8.5, 9.10.1, 14.2.3, 14.2.4, 14.4.3

Payment, Certificates for

4.2.5, 4.2.9, 9.3.3, **9.4**, 9.5, 9.6.1, 9.6.6, 9.7, 9.10.1, 9.10.3, 13.7, 14.1.1.3, 14.2.4

Payment, Failure of

9.5.1.3, **9.7**, 9.10.2, 13.6, 14.1.1.3, 14.2.1.2

Payment, Final

4.2.1, 4.2.9, 9.8.2, 9.10, 11.1.2, 11.1.3, 11.4.1, 12.3, 13.7, 14.2.4, 14.4.3

Payment Bond, Performance Bond and

7.3.7.4, 9.6.7, 9.10.3, **11.4**

Payments, Progress

9.3, **9.6**, 9.8.5, 9.10.3, 13.6, 14.2.3, 15.1.3

PAYMENTS AND COMPLETION

9

Payments to Subcontractors

5.4.2, 9.5.1.3, 9.6.2, 9.6.3, 9.6.4, 9.6.7, 14.2.1.2

PCB

10.3.1

Performance Bond and Payment Bond

7.3.7.4, 9.6.7, 9.10.3, **11.4**

Permits, Fees, Notices and Compliance with Laws

2.2.2, **3.7**, 3.13, 7.3.7.4, 10.2.2

PERSONS AND PROPERTY, PROTECTION OF

10

Polychlorinated Biphenyl

10.3.1

Product Data, Definition of

3.12.2

Product Data and Samples, Shop Drawings

3.11, **3.12**, 4.2.7

Progress and Completion

4.2.2, **8.2**, 9.8, 9.9.1, 14.1.4, 15.1.3

Progress Payments

9.3, **9.6**, 9.8.5, 9.10.3, 13.6, 14.2.3, 15.1.3

Project, Definition of

1.1.4

Project Representatives

4.2.10

Property Insurance

10.2.5, **11.3**

PROTECTION OF PERSONS AND PROPERTY **10**

Regulations and Laws

1.5, 3.2.3, 3.6, 3.7, 3.12.10, 3.13, 4.1.1, 9.6.4, 9.9.1, 10.2.2, 11.1, 11.4, 13.1, 13.4, 13.5.1, 13.5.2, 13.6, 14, 15.2.8, 15.4

Rejection of Work

3.5, 4.2.6, 12.2.1

Releases and Waivers of Liens

9.10.2

Representations

3.2.1, 3.5, 3.12.6, 6.2.2, 8.2.1, 9.3.3, 9.4.2, 9.5.1, 9.8.2, 9.10.1

Representatives

2.1.1, 3.1.1, 3.9, 4.1.1, 4.2.1, 4.2.2, 4.2.10, 5.1.1, 5.1.2, 13.2.1

Responsibility for Those Performing the Work

3.3.2, 3.18, 4.2.3, 5.3, 6.1.3, 6.2, 6.3, 9.5.1, 10

Retainage

9.3.1, 9.6.2, 9.8.5, 9.9.1, 9.10.2, 9.10.3

Review of Contract Documents and Field

Conditions by Contractor

3.2, 3.12.7, 6.1.3

Review of Contractor's Submittals by Owner and Architect

3.10.1, 3.10.2, 3.11, 3.12, 4.2, 5.2, 6.1.3, 9.2, 9.8.2

Review of Shop Drawings, Product Data and

Samples by Contractor

3.12

Rights and Remedies

1.1.2, 2.3, 2.4, 3.5, 3.7.4, 3.15.2, 4.2.6, 5.3, 5.4, 6.1, 6.3, 7.3.1, 8.3, 9.5.1, 9.7, 10.2.5, 10.3, 12.2.2, 12.2.4, **13.4**, 14, 15.4

Royalties, Patents and Copyrights

3.17

Rules and Notices for Arbitration

15.4.1

Safety of Persons and Property

10.2, 10.4

Safety Precautions and Programs

3.3.1, 4.2.2, 4.2.7, 5.3, **10.1**, 10.2, 10.4

Samples, Definition of

3.12.3

Samples, Shop Drawings, Product Data and

3.11, **3.12**, 4.2.7

Samples at the Site, Documents and

3.11

Schedule of Values

9.2, 9.3.1

Schedules, Construction

3.10, 3.12.1, 3.12.2, 6.1.3, 15.1.5.2

Separate Contracts and Contractors

1.1.4, 3.12.5, 3.14.2, 4.2.4, 4.2.7, 6, 8.3.1, 12.1.2

Shop Drawings, Definition of

3.12.1

Shop Drawings, Product Data and Samples

3.11, **3.12**, 4.2.7

Site, Use of

3.13, 6.1.1, 6.2.1

Site Inspections

3.2.2, 3.3.3, 3.7.1, 3.7.4, 4.2, 9.4.2, 9.10.1, 13.5

Site Visits, Architect's

3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.5.1, 9.9.2, 9.10.1, 13.5

Special Inspections and Testing

4.2.6, 12.2.1, 13.5

Specifications, Definition of

1.1.6

Specifications

1.1.1, **1.1.6**, 1.2.2, 1.5, 3.11, 3.12.10, 3.17, 4.2.14

Statute of Limitations

13.7, 15.4.1.1

Stopping the Work

2.3, 9.7, 10.3, 14.1

Stored Materials

6.2.1, 9.3.2, 10.2.1.2, 10.2.4

Subcontractor, Definition of

5.1.1

SUBCONTRACTORS

5

Subcontractors, Work by

1.2.2, 3.3.2, 3.12.1, 4.2.3, 5.2.3, 5.3, 5.4, 9.3.1.2, 9.6.7

Subcontractual Relations

5.3, 5.4, 9.3.1.2, 9.6, 9.10, 10.2.1, 14.1, 14.2.1

Submittals

3.10, 3.11, 3.12, 4.2.7, 5.2.1, 5.2.3, 7.3.7, 9.2, 9.3, 9.8, 9.9.1, 9.10.2, 9.10.3, 11.1.3

Submittal Schedule

3.10.2, 3.12.5, 4.2.7

Subrogation, Waivers of

6.1.1, **11.3.7**

Substantial Completion

4.2.9, 8.1.1, 8.1.3, 8.2.3, 9.4.2, **9.8**, 9.9.1, 9.10.3, 12.2, 13.7

Substantial Completion, Definition of

9.8.1

Substitution of Subcontractors

5.2.3, 5.2.4

Substitution of Architect

4.1.3

Substitutions of Materials

3.4.2, 3.5, 7.3.8

Sub-subcontractor, Definition of

5.1.2

Subsurface Conditions

3.7.4

Successors and Assigns

13.2

Superintendent

3.9, 10.2.6

Supervision and Construction Procedures

1.2.2, **3.3**, 3.4, 3.12.10, 4.2.2, 4.2.7, 6.1.3, 6.2.4, 7.1.3, 7.3.7, 8.2, 8.3.1, 9.4.2, 10, 12, 14, 15.1.3

Surety

5.4.1.2, 9.8.5, 9.10.2, 9.10.3, 14.2.2, 15.2.7

Surety, Consent of

9.10.2, 9.10.3

Surveys

2.2.3

Suspension by the Owner for Convenience

14.3

Suspension of the Work

5.4.2, 14.3

Suspension or Termination of the Contract

5.4.1.1, 14

Taxes

3.6, 3.8.2.1, 7.3.7.4

Termination by the Contractor

14.1, 15.1.6

Termination by the Owner for Cause

5.4.1.1, **14.2**, 15.1.6

Termination by the Owner for Convenience

14.4

Termination of the Architect

4.1.3

Termination of the Contractor

14.2.2

TERMINATION OR SUSPENSION OF THE CONTRACT

14

Tests and Inspections

3.1.3, 3.3.3, 4.2.2, 4.2.6, 4.2.9, 9.4.2, 9.8.3, 9.9.2, 9.10.1, 10.3.2, 11.4.1, 12.2.1, **13.5**

TIME

8

Time, Delays and Extensions of

3.2.4, 3.7.4, 5.2.3, 7.2.1, 7.3.1, 7.4, **8.3**, 9.5.1, 9.7, 10.3.2, 10.4, 14.3.2, 15.1.5, 15.2.5

Time Limits

2.1.2, 2.2, 2.4, 3.2.2, 3.10, 3.11, 3.12.5, 3.15.1, 4.2, 5.2, 5.3, 5.4, 6.2.4, 7.3, 7.4, 8.2, 9.2, 9.3.1, 9.3.3, 9.4.1, 9.5, 9.6, 9.7, 9.8, 9.9, 9.10, 11.1.3, 12.2, 13.5, 13.7, 14, 15.1.2, 15.4

Time Limits on Claims

3.7.4, 10.2.8, **13.7**, 15.1.2

Title to Work

9.3.2, 9.3.3

Transmission of Data in Digital Form

1.6

UNCOVERING AND CORRECTION OF WORK

12

Uncovering of Work

12.1

Unforeseen Conditions, Concealed or Unknown

3.7.4, 8.3.1, 10.3

Unit Prices

7.3.3.2, 7.3.4

Use of Documents

1.1.1, 1.5, 2.2.5, 3.12.6, 5.3

Use of Site

3.13, 6.1.1, 6.2.1

Values, Schedule of

9.2, 9.3.1

Waiver of Claims by the Architect

13.4.2

Waiver of Claims by the Contractor

9.10.5, 13.4.2, 15.1.6

Waiver of Claims by the Owner

9.9.3, 9.10.3, 9.10.4, 12.2.2.1, 13.4.2, 14.2.4, 15.1.6

Waiver of Consequential Damages

14.2.4, 15.1.6

Waiver of Liens

9.10.2, 9.10.4

Waivers of Subrogation

6.1.1, **11.3.7**

Warranty

3.5, 4.2.9, 9.3.3, 9.8.4, 9.9.1, 9.10.4, 12.2.2, 13.7

Weather Delays

15.1.5.2

Work, Definition of

1.1.3

Written Consent

1.5.2, 3.4.2, 3.7.4, 3.12.8, 3.14.2, 4.1.2, 9.3.2, 9.8.5, 9.9.1, 9.10.2, 9.10.3, 11.4.1, 13.2, 13.4.2, 15.4.4.2

Written Interpretations

4.2.11, 4.2.12

Written Notice

2.3, 2.4, 3.3.1, 3.9, 3.12.9, 3.12.10, 5.2.1, 8.2.2, 9.7, 9.10, 10.2.2, 10.3, 11.1.3, 12.2.2, 12.2.4, **13.3**, 14, 15.4.1

Written Orders

1.1.1, 2.3, 3.9, 7, 8.2.2, 12.1, 12.2, 13.5.2, 14.3.1, 15.1.2

ARTICLE 1 GENERAL PROVISIONS

§ 1.1 BASIC DEFINITIONS

§ 1.1.1 THE CONTRACT DOCUMENTS

The Contract Documents are enumerated in the Agreement between the Owner and Contractor (hereinafter the Agreement) and consist of the Agreement, Conditions of the Contract (General, Supplementary and other Conditions), Drawings, Specifications, Addenda issued prior to execution of the Contract, other documents listed in the Agreement and Modifications issued after execution of the Contract. A Modification is (1) a written amendment to the Contract signed by both parties, (2) a Change Order, (3) a Construction Change Directive or (4) a written order for a minor change in the Work issued by the Architect. Unless specifically enumerated in the Agreement, the Contract Documents do not include the advertisement or invitation to bid, Instructions to Bidders, sample forms, other information furnished by the Owner in anticipation of receiving bids or proposals, the Contractor's bid or proposal, or portions of Addenda relating to bidding requirements.

§ 1.1.2 THE CONTRACT

The Contract Documents form the Contract for Construction. The Contract represents the entire and integrated agreement between the parties hereto and supersedes prior negotiations, representations or agreements, either written or oral. The Contract may be amended or modified only by a Modification. The Contract Documents shall not be construed to create a contractual relationship of any kind (1) between the Contractor and the Architect or the Architect's consultants, (2) between the Owner and a Subcontractor or a Sub-subcontractor, (3) between the Owner and the Architect or the Architect's consultants or (4) between any persons or entities other than the Owner and the Contractor. The Architect shall, however, be entitled to performance and enforcement of obligations under the Contract intended to facilitate performance of the Architect's duties.

§ 1.1.3 THE WORK

The term "Work" means the construction and services required by the Contract Documents, whether completed or partially completed, and includes all other labor, materials, equipment and services provided or to be provided by the Contractor to fulfill the Contractor's obligations. The Work may constitute the whole or a part of the Project.

§ 1.1.4 THE PROJECT

The Project is the total construction of which the Work performed under the Contract Documents may be the whole or a part and which may include construction by the Owner and by separate contractors.

§ 1.1.5 THE DRAWINGS

The Drawings are the graphic and pictorial portions of the Contract Documents showing the design, location and dimensions of the Work, generally including plans, elevations, sections, details, schedules and diagrams.

§ 1.1.6 THE SPECIFICATIONS

The Specifications are that portion of the Contract Documents consisting of the written requirements for materials, equipment, systems, standards and workmanship for the Work, and performance of related services.

§ 1.1.7 INSTRUMENTS OF SERVICE

Instruments of Service are representations, in any medium of expression now known or later developed, of the tangible and intangible creative work performed by the Architect and the Architect's consultants under their respective professional services agreements. Instruments of Service may include, without limitation, studies, surveys, models, sketches, drawings, specifications, and other similar materials.

§ 1.1.8 INITIAL DECISION MAKER

The Initial Decision Maker is the person identified in the Agreement to render initial decisions on Claims in accordance with Section 15.2 and certify termination of the Agreement under Section 14.2.2.

§ 1.2 CORRELATION AND INTENT OF THE CONTRACT DOCUMENTS

§ 1.2.1 The intent of the Contract Documents is to include all items necessary for the proper execution and completion of the Work by the Contractor. The Contract Documents are complementary, and what is required by one shall be as binding as if required by all; performance by the Contractor shall be required only to the extent consistent with the Contract Documents and reasonably inferable from them as being necessary to produce the indicated results.

§ 1.2.2 Organization of the Specifications into divisions, sections and articles, and arrangement of Drawings shall not control the Contractor in dividing the Work among Subcontractors or in establishing the extent of Work to be performed by any trade.

§ 1.2.3 Unless otherwise stated in the Contract Documents, words that have well-known technical or construction industry meanings are used in the Contract Documents in accordance with such recognized meanings.

§ 1.3 CAPITALIZATION

Terms capitalized in these General Conditions include those that are (1) specifically defined, (2) the titles of numbered articles or (3) the titles of other documents published by the American Institute of Architects.

§ 1.4 INTERPRETATION

In the interest of brevity the Contract Documents frequently omit modifying words such as “all” and “any” and articles such as “the” and “an,” but the fact that a modifier or an article is absent from one statement and appears in another is not intended to affect the interpretation of either statement.

§ 1.5 OWNERSHIP AND USE OF DRAWINGS, SPECIFICATIONS AND OTHER INSTRUMENTS OF SERVICE

§ 1.5.1 The Architect and the Architect’s consultants shall be deemed the authors and owners of their respective Instruments of Service, including the Drawings and Specifications, and will retain all common law, statutory and other reserved rights, including copyrights. The Contractor, Subcontractors, Sub-subcontractors, and material or equipment suppliers shall not own or claim a copyright in the Instruments of Service. Submittal or distribution to meet official regulatory requirements or for other purposes in connection with this Project is not to be construed as publication in derogation of the Architect’s or Architect’s consultants’ reserved rights.

§ 1.5.2 The Contractor, Subcontractors, Sub-subcontractors and material or equipment suppliers are authorized to use and reproduce the Instruments of Service provided to them solely and exclusively for execution of the Work. All copies made under this authorization shall bear the copyright notice, if any, shown on the Instruments of Service. The Contractor, Subcontractors, Sub-subcontractors, and material or equipment suppliers may not use the Instruments of Service on other projects or for additions to this Project outside the scope of the Work without the specific written consent of the Owner, Architect and the Architect’s consultants.

§ 1.6 TRANSMISSION OF DATA IN DIGITAL FORM

If the parties intend to transmit Instruments of Service or any other information or documentation in digital form, they shall endeavor to establish necessary protocols governing such transmissions, unless otherwise already provided in the Agreement or the Contract Documents.

ARTICLE 2 OWNER

§ 2.1 GENERAL

§ 2.1.1 The Owner is the person or entity identified as such in the Agreement and is referred to throughout the Contract Documents as if singular in number. The Owner shall designate in writing a representative who shall have express authority to bind the Owner with respect to all matters requiring the Owner’s approval or authorization. Except as otherwise provided in Section 4.2.1, the Architect does not have such authority. The term “Owner” means the Owner or the Owner’s authorized representative.

§ 2.1.2 The Owner shall furnish to the Contractor within fifteen days after receipt of a written request, information necessary and relevant for the Contractor to evaluate, give notice of or enforce mechanic’s lien rights. Such information shall include a correct statement of the record legal title to the property on which the Project is located, usually referred to as the site, and the Owner’s interest therein.

§ 2.2 INFORMATION AND SERVICES REQUIRED OF THE OWNER

§ 2.2.1 Prior to commencement of the Work, the Contractor may request in writing that the Owner provide reasonable evidence that the Owner has made financial arrangements to fulfill the Owner’s obligations under the Contract. Thereafter, the Contractor may only request such evidence if (1) the Owner fails to make payments to the Contractor as the Contract Documents require; (2) a change in the Work materially changes the Contract Sum; or (3) the Contractor identifies in writing a reasonable concern regarding the Owner’s ability to make payment when due. The Owner shall furnish such evidence as a condition precedent to commencement or continuation of the Work or the portion of the Work affected by a material change. After the Owner furnishes the evidence, the Owner shall not materially vary such financial arrangements without prior notice to the Contractor.

§ 2.2.2 Except for permits and fees that are the responsibility of the Contractor under the Contract Documents, including those required under Section 3.7.1, the Owner shall secure and pay for necessary approvals, easements, assessments and charges required for construction, use or occupancy of permanent structures or for permanent changes in existing facilities.

§ 2.2.3 The Owner shall furnish surveys describing physical characteristics, legal limitations and utility locations for the site of the Project, and a legal description of the site. The Contractor shall be entitled to rely on the accuracy of information furnished by the Owner but shall exercise proper precautions relating to the safe performance of the Work.

§ 2.2.4 The Owner shall furnish information or services required of the Owner by the Contract Documents with reasonable promptness. The Owner shall also furnish any other information or services under the Owner's control and relevant to the Contractor's performance of the Work with reasonable promptness after receiving the Contractor's written request for such information or services.

§ 2.2.5 Unless otherwise provided in the Contract Documents, the Owner shall furnish to the Contractor one copy of the Contract Documents for purposes of making reproductions pursuant to Section 1.5.2.

§ 2.3 OWNER'S RIGHT TO STOP THE WORK

If the Contractor fails to correct Work that is not in accordance with the requirements of the Contract Documents as required by Section 12.2 or repeatedly fails to carry out Work in accordance with the Contract Documents, the Owner may issue a written order to the Contractor to stop the Work, or any portion thereof, until the cause for such order has been eliminated; however, the right of the Owner to stop the Work shall not give rise to a duty on the part of the Owner to exercise this right for the benefit of the Contractor or any other person or entity, except to the extent required by Section 6.1.3.

§ 2.4 OWNER'S RIGHT TO CARRY OUT THE WORK

If the Contractor defaults or neglects to carry out the Work in accordance with the Contract Documents and fails within a ten-day period after receipt of written notice from the Owner to commence and continue correction of such default or neglect with diligence and promptness, the Owner may, without prejudice to other remedies the Owner may have, correct such deficiencies. In such case an appropriate Change Order shall be issued deducting from payments then or thereafter due the Contractor the reasonable cost of correcting such deficiencies, including Owner's expenses and compensation for the Architect's additional services made necessary by such default, neglect or failure. Such action by the Owner and amounts charged to the Contractor are both subject to prior approval of the Architect. If payments then or thereafter due the Contractor are not sufficient to cover such amounts, the Contractor shall pay the difference to the Owner.

ARTICLE 3 CONTRACTOR

§ 3.1 GENERAL

§ 3.1.1 The Contractor is the person or entity identified as such in the Agreement and is referred to throughout the Contract Documents as if singular in number. The Contractor shall be lawfully licensed, if required in the jurisdiction where the Project is located. The Contractor shall designate in writing a representative who shall have express authority to bind the Contractor with respect to all matters under this Contract. The term "Contractor" means the Contractor or the Contractor's authorized representative.

§ 3.1.2 The Contractor shall perform the Work in accordance with the Contract Documents.

§ 3.1.3 The Contractor shall not be relieved of obligations to perform the Work in accordance with the Contract Documents either by activities or duties of the Architect in the Architect's administration of the Contract, or by tests, inspections or approvals required or performed by persons or entities other than the Contractor.

§ 3.2 REVIEW OF CONTRACT DOCUMENTS AND FIELD CONDITIONS BY CONTRACTOR

§ 3.2.1 Execution of the Contract by the Contractor is a representation that the Contractor has visited the site, become generally familiar with local conditions under which the Work is to be performed and correlated personal observations with requirements of the Contract Documents.

§ 3.2.2 Because the Contract Documents are complementary, the Contractor shall, before starting each portion of the Work, carefully study and compare the various Contract Documents relative to that portion of the Work, as well as the information furnished by the Owner pursuant to Section 2.2.3, shall take field measurements of any existing conditions related to that portion of the Work, and shall observe any conditions at the site affecting it. These obligations are for the purpose of facilitating coordination and construction by the Contractor and are not for the purpose of discovering errors, omissions, or inconsistencies in the Contract Documents; however, the Contractor shall promptly report to the Architect any errors, inconsistencies or omissions discovered by or made known to the Contractor as a request for information in such form as the Architect may require. It is recognized that the Contractor's review is made in the Contractor's capacity as a contractor and not as a licensed design professional, unless otherwise specifically provided in the Contract Documents.

§ 3.2.3 The Contractor is not required to ascertain that the Contract Documents are in accordance with applicable laws, statutes, ordinances, codes, rules and regulations, or lawful orders of public authorities, but the Contractor shall promptly report to the Architect any nonconformity discovered by or made known to the Contractor as a request for information in such form as the Architect may require.

§ 3.2.4 If the Contractor believes that additional cost or time is involved because of clarifications or instructions the Architect issues in response to the Contractor's notices or requests for information pursuant to Sections 3.2.2 or 3.2.3, the Contractor shall make Claims as provided in Article 15. If the Contractor fails to perform the obligations of Sections 3.2.2 or 3.2.3, the Contractor shall pay such costs and damages to the Owner as would have been avoided if the Contractor had performed such obligations. If the Contractor performs those obligations, the Contractor shall not be liable to the Owner or Architect for damages resulting from errors, inconsistencies or omissions in the Contract Documents, for differences between field measurements or conditions and the Contract Documents, or for nonconformities of the Contract Documents to applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities.

§ 3.3 SUPERVISION AND CONSTRUCTION PROCEDURES

§ 3.3.1 The Contractor shall supervise and direct the Work, using the Contractor's best skill and attention. The Contractor shall be solely responsible for, and have control over, construction means, methods, techniques, sequences and procedures and for coordinating all portions of the Work under the Contract, unless the Contract Documents give other specific instructions concerning these matters. If the Contract Documents give specific instructions concerning construction means, methods, techniques, sequences or procedures, the Contractor shall evaluate the jobsite safety thereof and, except as stated below, shall be fully and solely responsible for the jobsite safety of such means, methods, techniques, sequences or procedures. If the Contractor determines that such means, methods, techniques, sequences or procedures may not be safe, the Contractor shall give timely written notice to the Owner and Architect and shall not proceed with that portion of the Work without further written instructions from the Architect. If the Contractor is then instructed to proceed with the required means, methods, techniques, sequences or procedures without acceptance of changes proposed by the Contractor, the Owner shall be solely responsible for any loss or damage arising solely from those Owner-required means, methods, techniques, sequences or procedures.

§ 3.3.2 The Contractor shall be responsible to the Owner for acts and omissions of the Contractor's employees, Subcontractors and their agents and employees, and other persons or entities performing portions of the Work for, or on behalf of, the Contractor or any of its Subcontractors.

§ 3.3.3 The Contractor shall be responsible for inspection of portions of Work already performed to determine that such portions are in proper condition to receive subsequent Work.

§ 3.4 LABOR AND MATERIALS

§ 3.4.1 Unless otherwise provided in the Contract Documents, the Contractor shall provide and pay for labor, materials, equipment, tools, construction equipment and machinery, water, heat, utilities, transportation, and other facilities and services necessary for proper execution and completion of the Work, whether temporary or permanent and whether or not incorporated or to be incorporated in the Work.

§ 3.4.2 Except in the case of minor changes in the Work authorized by the Architect in accordance with Sections 3.12.8 or 7.4, the Contractor may make substitutions only with the consent of the Owner, after evaluation by the Architect and in accordance with a Change Order or Construction Change Directive.

§ 3.4.3 The Contractor shall enforce strict discipline and good order among the Contractor's employees and other persons carrying out the Work. The Contractor shall not permit employment of unfit persons or persons not properly skilled in tasks assigned to them.

§ 3.5 WARRANTY

The Contractor warrants to the Owner and Architect that materials and equipment furnished under the Contract will be of good quality and new unless the Contract Documents require or permit otherwise. The Contractor further warrants that the Work will conform to the requirements of the Contract Documents and will be free from defects, except for those inherent in the quality of the Work the Contract Documents require or permit. Work, materials, or equipment not conforming to these requirements may be considered defective. The Contractor's warranty excludes remedy for damage or defect caused by abuse, alterations to the Work not executed by the Contractor, improper or insufficient maintenance, improper operation, or normal wear and tear and normal usage. If required by the Architect, the Contractor shall furnish satisfactory evidence as to the kind and quality of materials and equipment.

§ 3.6 TAXES

The Contractor shall pay sales, consumer, use and similar taxes for the Work provided by the Contractor that are legally enacted when bids are received or negotiations concluded, whether or not yet effective or merely scheduled to go into effect.

§ 3.7 PERMITS, FEES, NOTICES AND COMPLIANCE WITH LAWS

§ 3.7.1 Unless otherwise provided in the Contract Documents, the Contractor shall secure and pay for the building permit as well as for other permits, fees, licenses, and inspections by government agencies necessary for proper execution and completion of the Work that are customarily secured after execution of the Contract and legally required at the time bids are received or negotiations concluded.

§ 3.7.2 The Contractor shall comply with and give notices required by applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities applicable to performance of the Work.

§ 3.7.3 If the Contractor performs Work knowing it to be contrary to applicable laws, statutes, ordinances, codes, rules and regulations, or lawful orders of public authorities, the Contractor shall assume appropriate responsibility for such Work and shall bear the costs attributable to correction.

§ 3.7.4 Concealed or Unknown Conditions. If the Contractor encounters conditions at the site that are (1) subsurface or otherwise concealed physical conditions that differ materially from those indicated in the Contract Documents or (2) unknown physical conditions of an unusual nature, that differ materially from those ordinarily found to exist and generally recognized as inherent in construction activities of the character provided for in the Contract Documents, the Contractor shall promptly provide notice to the Owner and the Architect before conditions are disturbed and in no event later than 21 days after first observance of the conditions. The Architect will promptly investigate such conditions and, if the Architect determines that they differ materially and cause an increase or decrease in the Contractor's cost of, or time required for, performance of any part of the Work, will recommend an equitable adjustment in the Contract Sum or Contract Time, or both. If the Architect determines that the conditions at the site are not materially different from those indicated in the Contract Documents and that no change in the terms of the Contract is justified, the Architect shall promptly notify the Owner and Contractor in writing, stating the reasons. If either party disputes the Architect's determination or recommendation, that party may proceed as provided in Article 15.

§ 3.7.5 If, in the course of the Work, the Contractor encounters human remains or recognizes the existence of burial markers, archaeological sites or wetlands not indicated in the Contract Documents, the Contractor shall immediately suspend any operations that would affect them and shall notify the Owner and Architect. Upon receipt of such notice, the Owner shall promptly take any action necessary to obtain governmental authorization required to resume the operations. The Contractor shall continue to suspend such operations until otherwise instructed by the Owner but shall continue with all other operations that do not affect those remains or features. Requests for adjustments in the Contract Sum and Contract Time arising from the existence of such remains or features may be made as provided in Article 15.

§ 3.8 ALLOWANCES

§ 3.8.1 The Contractor shall include in the Contract Sum all allowances stated in the Contract Documents. Items covered by allowances shall be supplied for such amounts and by such persons or entities as the Owner may direct,

but the Contractor shall not be required to employ persons or entities to whom the Contractor has reasonable objection.

§ 3.8.2 Unless otherwise provided in the Contract Documents,

- .1 Allowances shall cover the cost to the Contractor of materials and equipment delivered at the site and all required taxes, less applicable trade discounts;
- .2 Contractor's costs for unloading and handling at the site, labor, installation costs, overhead, profit and other expenses contemplated for stated allowance amounts shall be included in the Contract Sum but not in the allowances; and
- .3 Whenever costs are more than or less than allowances, the Contract Sum shall be adjusted accordingly by Change Order. The amount of the Change Order shall reflect (1) the difference between actual costs and the allowances under Section 3.8.2.1 and (2) changes in Contractor's costs under Section 3.8.2.2.

§ 3.8.3 Materials and equipment under an allowance shall be selected by the Owner with reasonable promptness.

§ 3.9 SUPERINTENDENT

§ 3.9.1 The Contractor shall employ a competent superintendent and necessary assistants who shall be in attendance at the Project site during performance of the Work. The superintendent shall represent the Contractor, and communications given to the superintendent shall be as binding as if given to the Contractor.

§ 3.9.2 The Contractor, as soon as practicable after award of the Contract, shall furnish in writing to the Owner through the Architect the name and qualifications of a proposed superintendent. The Architect may reply within 14 days to the Contractor in writing stating (1) whether the Owner or the Architect has reasonable objection to the proposed superintendent or (2) that the Architect requires additional time to review. Failure of the Architect to reply within the 14 day period shall constitute notice of no reasonable objection.

§ 3.9.3 The Contractor shall not employ a proposed superintendent to whom the Owner or Architect has made reasonable and timely objection. The Contractor shall not change the superintendent without the Owner's consent, which shall not unreasonably be withheld or delayed.

§ 3.10 CONTRACTOR'S CONSTRUCTION SCHEDULES

§ 3.10.1 The Contractor, promptly after being awarded the Contract, shall prepare and submit for the Owner's and Architect's information a Contractor's construction schedule for the Work. The schedule shall not exceed time limits current under the Contract Documents, shall be revised at appropriate intervals as required by the conditions of the Work and Project, shall be related to the entire Project to the extent required by the Contract Documents, and shall provide for expeditious and practicable execution of the Work.

§ 3.10.2 The Contractor shall prepare a submittal schedule, promptly after being awarded the Contract and thereafter as necessary to maintain a current submittal schedule, and shall submit the schedule(s) for the Architect's approval. The Architect's approval shall not unreasonably be delayed or withheld. The submittal schedule shall (1) be coordinated with the Contractor's construction schedule, and (2) allow the Architect reasonable time to review submittals. If the Contractor fails to submit a submittal schedule, the Contractor shall not be entitled to any increase in Contract Sum or extension of Contract Time based on the time required for review of submittals.

§ 3.10.3 The Contractor shall perform the Work in general accordance with the most recent schedules submitted to the Owner and Architect.

§ 3.11 DOCUMENTS AND SAMPLES AT THE SITE

The Contractor shall maintain at the site for the Owner one copy of the Drawings, Specifications, Addenda, Change Orders and other Modifications, in good order and marked currently to indicate field changes and selections made during construction, and one copy of approved Shop Drawings, Product Data, Samples and similar required submittals. These shall be available to the Architect and shall be delivered to the Architect for submittal to the Owner upon completion of the Work as a record of the Work as constructed.

§ 3.12 SHOP DRAWINGS, PRODUCT DATA AND SAMPLES

§ 3.12.1 Shop Drawings are drawings, diagrams, schedules and other data specially prepared for the Work by the Contractor or a Subcontractor, Sub-subcontractor, manufacturer, supplier or distributor to illustrate some portion of the Work.

§ 3.12.2 Product Data are illustrations, standard schedules, performance charts, instructions, brochures, diagrams and other information furnished by the Contractor to illustrate materials or equipment for some portion of the Work.

§ 3.12.3 Samples are physical examples that illustrate materials, equipment or workmanship and establish standards by which the Work will be judged.

§ 3.12.4 Shop Drawings, Product Data, Samples and similar submittals are not Contract Documents. Their purpose is to demonstrate the way by which the Contractor proposes to conform to the information given and the design concept expressed in the Contract Documents for those portions of the Work for which the Contract Documents require submittals. Review by the Architect is subject to the limitations of Section 4.2.7. Informational submittals upon which the Architect is not expected to take responsive action may be so identified in the Contract Documents. Submittals that are not required by the Contract Documents may be returned by the Architect without action.

§ 3.12.5 The Contractor shall review for compliance with the Contract Documents, approve and submit to the Architect Shop Drawings, Product Data, Samples and similar submittals required by the Contract Documents in accordance with the submittal schedule approved by the Architect or, in the absence of an approved submittal schedule, with reasonable promptness and in such sequence as to cause no delay in the Work or in the activities of the Owner or of separate contractors.

§ 3.12.6 By submitting Shop Drawings, Product Data, Samples and similar submittals, the Contractor represents to the Owner and Architect that the Contractor has (1) reviewed and approved them, (2) determined and verified materials, field measurements and field construction criteria related thereto, or will do so and (3) checked and coordinated the information contained within such submittals with the requirements of the Work and of the Contract Documents.

§ 3.12.7 The Contractor shall perform no portion of the Work for which the Contract Documents require submittal and review of Shop Drawings, Product Data, Samples or similar submittals until the respective submittal has been approved by the Architect.

§ 3.12.8 The Work shall be in accordance with approved submittals except that the Contractor shall not be relieved of responsibility for deviations from requirements of the Contract Documents by the Architect's approval of Shop Drawings, Product Data, Samples or similar submittals unless the Contractor has specifically informed the Architect in writing of such deviation at the time of submittal and (1) the Architect has given written approval to the specific deviation as a minor change in the Work, or (2) a Change Order or Construction Change Directive has been issued authorizing the deviation. The Contractor shall not be relieved of responsibility for errors or omissions in Shop Drawings, Product Data, Samples or similar submittals by the Architect's approval thereof.

§ 3.12.9 The Contractor shall direct specific attention, in writing or on resubmitted Shop Drawings, Product Data, Samples or similar submittals, to revisions other than those requested by the Architect on previous submittals. In the absence of such written notice, the Architect's approval of a resubmission shall not apply to such revisions.

§ 3.12.10 The Contractor shall not be required to provide professional services that constitute the practice of architecture or engineering unless such services are specifically required by the Contract Documents for a portion of the Work or unless the Contractor needs to provide such services in order to carry out the Contractor's responsibilities for construction means, methods, techniques, sequences and procedures. The Contractor shall not be required to provide professional services in violation of applicable law. If professional design services or certifications by a design professional related to systems, materials or equipment are specifically required of the Contractor by the Contract Documents, the Owner and the Architect will specify all performance and design criteria that such services must satisfy. The Contractor shall cause such services or certifications to be provided by a properly licensed design professional, whose signature and seal shall appear on all drawings, calculations, specifications, certifications, Shop Drawings and other submittals prepared by such professional. Shop Drawings and other submittals related to the Work designed or certified by such professional, if prepared by others, shall bear such professional's written approval when submitted to the Architect. The Owner and the Architect shall be entitled

to rely upon the adequacy, accuracy and completeness of the services, certifications and approvals performed or provided by such design professionals, provided the Owner and Architect have specified to the Contractor all performance and design criteria that such services must satisfy. Pursuant to this Section 3.12.10, the Architect will review, approve or take other appropriate action on submittals only for the limited purpose of checking for conformance with information given and the design concept expressed in the Contract Documents. The Contractor shall not be responsible for the adequacy of the performance and design criteria specified in the Contract Documents.

§ 3.13 USE OF SITE

The Contractor shall confine operations at the site to areas permitted by applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities and the Contract Documents and shall not unreasonably encumber the site with materials or equipment.

§ 3.14 CUTTING AND PATCHING

§ 3.14.1 The Contractor shall be responsible for cutting, fitting or patching required to complete the Work or to make its parts fit together properly. All areas requiring cutting, fitting and patching shall be restored to the condition existing prior to the cutting, fitting and patching, unless otherwise required by the Contract Documents.

§ 3.14.2 The Contractor shall not damage or endanger a portion of the Work or fully or partially completed construction of the Owner or separate contractors by cutting, patching or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter such construction by the Owner or a separate contractor except with written consent of the Owner and of such separate contractor; such consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold from the Owner or a separate contractor the Contractor's consent to cutting or otherwise altering the Work.

§ 3.15 CLEANING UP

§ 3.15.1 The Contractor shall keep the premises and surrounding area free from accumulation of waste materials or rubbish caused by operations under the Contract. At completion of the Work, the Contractor shall remove waste materials, rubbish, the Contractor's tools, construction equipment, machinery and surplus materials from and about the Project.

§ 3.15.2 If the Contractor fails to clean up as provided in the Contract Documents, the Owner may do so and Owner shall be entitled to reimbursement from the Contractor.

§ 3.16 ACCESS TO WORK

The Contractor shall provide the Owner and Architect access to the Work in preparation and progress wherever located.

§ 3.17 ROYALTIES, PATENTS AND COPYRIGHTS

The Contractor shall pay all royalties and license fees. The Contractor shall defend suits or claims for infringement of copyrights and patent rights and shall hold the Owner and Architect harmless from loss on account thereof, but shall not be responsible for such defense or loss when a particular design, process or product of a particular manufacturer or manufacturers is required by the Contract Documents, or where the copyright violations are contained in Drawings, Specifications or other documents prepared by the Owner or Architect. However, if the Contractor has reason to believe that the required design, process or product is an infringement of a copyright or a patent, the Contractor shall be responsible for such loss unless such information is promptly furnished to the Architect.

§ 3.18 INDEMNIFICATION

§ 3.18.1 To the fullest extent permitted by law the Contractor shall indemnify and hold harmless the Owner, Architect, Architect's consultants, and agents and employees of any of them from and against claims, damages, losses and expenses, including but not limited to attorneys' fees, arising out of or resulting from performance of the Work, provided that such claim, damage, loss or expense is attributable to bodily injury, sickness, disease or death, or to injury to or destruction of tangible property (other than the Work itself), but only to the extent caused by the negligent acts or omissions of the Contractor, a Subcontractor, anyone directly or indirectly employed by them or anyone for whose acts they may be liable, regardless of whether or not such claim, damage, loss or expense is caused in part by a party indemnified hereunder. Such obligation shall not be construed to negate, abridge, or reduce

other rights or obligations of indemnity that would otherwise exist as to a party or person described in this Section 3.18.

§ 3.18.2 In claims against any person or entity indemnified under this Section 3.18 by an employee of the Contractor, a Subcontractor, anyone directly or indirectly employed by them or anyone for whose acts they may be liable, the indemnification obligation under Section 3.18.1 shall not be limited by a limitation on amount or type of damages, compensation or benefits payable by or for the Contractor or a Subcontractor under workers' compensation acts, disability benefit acts or other employee benefit acts.

ARTICLE 4 ARCHITECT

§ 4.1 GENERAL

§ 4.1.1 The Owner shall retain an architect lawfully licensed to practice architecture or an entity lawfully practicing architecture in the jurisdiction where the Project is located. That person or entity is identified as the Architect in the Agreement and is referred to throughout the Contract Documents as if singular in number.

§ 4.1.2 Duties, responsibilities and limitations of authority of the Architect as set forth in the Contract Documents shall not be restricted, modified or extended without written consent of the Owner, Contractor and Architect. Consent shall not be unreasonably withheld.

§ 4.1.3 If the employment of the Architect is terminated, the Owner shall employ a successor architect as to whom the Contractor has no reasonable objection and whose status under the Contract Documents shall be that of the Architect.

§ 4.2 ADMINISTRATION OF THE CONTRACT

§ 4.2.1 The Architect will provide administration of the Contract as described in the Contract Documents and will be an Owner's representative during construction until the date the Architect issues the final Certificate for Payment. The Architect will have authority to act on behalf of the Owner only to the extent provided in the Contract Documents.

§ 4.2.2 The Architect will visit the site at intervals appropriate to the stage of construction, or as otherwise agreed with the Owner, to become generally familiar with the progress and quality of the portion of the Work completed, and to determine in general if the Work observed is being performed in a manner indicating that the Work, when fully completed, will be in accordance with the Contract Documents. However, the Architect will not be required to make exhaustive or continuous on-site inspections to check the quality or quantity of the Work. The Architect will not have control over, charge of, or responsibility for, the construction means, methods, techniques, sequences or procedures, or for the safety precautions and programs in connection with the Work, since these are solely the Contractor's rights and responsibilities under the Contract Documents, except as provided in Section 3.3.1.

§ 4.2.3 On the basis of the site visits, the Architect will keep the Owner reasonably informed about the progress and quality of the portion of the Work completed, and report to the Owner (1) known deviations from the Contract Documents and from the most recent construction schedule submitted by the Contractor, and (2) defects and deficiencies observed in the Work. The Architect will not be responsible for the Contractor's failure to perform the Work in accordance with the requirements of the Contract Documents. The Architect will not have control over or charge of and will not be responsible for acts or omissions of the Contractor, Subcontractors, or their agents or employees, or any other persons or entities performing portions of the Work.

§ 4.2.4 COMMUNICATIONS FACILITATING CONTRACT ADMINISTRATION

Except as otherwise provided in the Contract Documents or when direct communications have been specially authorized, the Owner and Contractor shall endeavor to communicate with each other through the Architect about matters arising out of or relating to the Contract. Communications by and with the Architect's consultants shall be through the Architect. Communications by and with Subcontractors and material suppliers shall be through the Contractor. Communications by and with separate contractors shall be through the Owner.

§ 4.2.5 Based on the Architect's evaluations of the Contractor's Applications for Payment, the Architect will review and certify the amounts due the Contractor and will issue Certificates for Payment in such amounts.

§ 4.2.6 The Architect has authority to reject Work that does not conform to the Contract Documents. Whenever the Architect considers it necessary or advisable, the Architect will have authority to require inspection or testing of the

Work in accordance with Sections 13.5.2 and 13.5.3, whether or not such Work is fabricated, installed or completed. However, neither this authority of the Architect nor a decision made in good faith either to exercise or not to exercise such authority shall give rise to a duty or responsibility of the Architect to the Contractor, Subcontractors, material and equipment suppliers, their agents or employees, or other persons or entities performing portions of the Work.

§ 4.2.7 The Architect will review and approve, or take other appropriate action upon, the Contractor's submittals such as Shop Drawings, Product Data and Samples, but only for the limited purpose of checking for conformance with information given and the design concept expressed in the Contract Documents. The Architect's action will be taken in accordance with the submittal schedule approved by the Architect or, in the absence of an approved submittal schedule, with reasonable promptness while allowing sufficient time in the Architect's professional judgment to permit adequate review. Review of such submittals is not conducted for the purpose of determining the accuracy and completeness of other details such as dimensions and quantities, or for substantiating instructions for installation or performance of equipment or systems, all of which remain the responsibility of the Contractor as required by the Contract Documents. The Architect's review of the Contractor's submittals shall not relieve the Contractor of the obligations under Sections 3.3, 3.5 and 3.12. The Architect's review shall not constitute approval of safety precautions or, unless otherwise specifically stated by the Architect, of any construction means, methods, techniques, sequences or procedures. The Architect's approval of a specific item shall not indicate approval of an assembly of which the item is a component.

§ 4.2.8 The Architect will prepare Change Orders and Construction Change Directives, and may authorize minor changes in the Work as provided in Section 7.4. The Architect will investigate and make determinations and recommendations regarding concealed and unknown conditions as provided in Section 3.7.4.

§ 4.2.9 The Architect will conduct inspections to determine the date or dates of Substantial Completion and the date of final completion; issue Certificates of Substantial Completion pursuant to Section 9.8; receive and forward to the Owner, for the Owner's review and records, written warranties and related documents required by the Contract and assembled by the Contractor pursuant to Section 9.10; and issue a final Certificate for Payment pursuant to Section 9.10.

§ 4.2.10 If the Owner and Architect agree, the Architect will provide one or more project representatives to assist in carrying out the Architect's responsibilities at the site. The duties, responsibilities and limitations of authority of such project representatives shall be as set forth in an exhibit to be incorporated in the Contract Documents.

§ 4.2.11 The Architect will interpret and decide matters concerning performance under, and requirements of, the Contract Documents on written request of either the Owner or Contractor. The Architect's response to such requests will be made in writing within any time limits agreed upon or otherwise with reasonable promptness.

§ 4.2.12 Interpretations and decisions of the Architect will be consistent with the intent of, and reasonably inferable from, the Contract Documents and will be in writing or in the form of drawings. When making such interpretations and decisions, the Architect will endeavor to secure faithful performance by both Owner and Contractor, will not show partiality to either and will not be liable for results of interpretations or decisions rendered in good faith.

§ 4.2.13 The Architect's decisions on matters relating to aesthetic effect will be final if consistent with the intent expressed in the Contract Documents.

§ 4.2.14 The Architect will review and respond to requests for information about the Contract Documents. The Architect's response to such requests will be made in writing within any time limits agreed upon or otherwise with reasonable promptness. If appropriate, the Architect will prepare and issue supplemental Drawings and Specifications in response to the requests for information.

ARTICLE 5 SUBCONTRACTORS

§ 5.1 DEFINITIONS

§ 5.1.1 A Subcontractor is a person or entity who has a direct contract with the Contractor to perform a portion of the Work at the site. The term "Subcontractor" is referred to throughout the Contract Documents as if singular in number and means a Subcontractor or an authorized representative of the Subcontractor. The term "Subcontractor" does not include a separate contractor or subcontractors of a separate contractor.

§ 5.1.2 A Sub-subcontractor is a person or entity who has a direct or indirect contract with a Subcontractor to perform a portion of the Work at the site. The term “Sub-subcontractor” is referred to throughout the Contract Documents as if singular in number and means a Sub-subcontractor or an authorized representative of the Sub-subcontractor.

§ 5.2 AWARD OF SUBCONTRACTS AND OTHER CONTRACTS FOR PORTIONS OF THE WORK

§ 5.2.1 Unless otherwise stated in the Contract Documents or the bidding requirements, the Contractor, as soon as practicable after award of the Contract, shall furnish in writing to the Owner through the Architect the names of persons or entities (including those who are to furnish materials or equipment fabricated to a special design) proposed for each principal portion of the Work. The Architect may reply within 14 days to the Contractor in writing stating (1) whether the Owner or the Architect has reasonable objection to any such proposed person or entity or (2) that the Architect requires additional time for review. Failure of the Owner or Architect to reply within the 14-day period shall constitute notice of no reasonable objection.

§ 5.2.2 The Contractor shall not contract with a proposed person or entity to whom the Owner or Architect has made reasonable and timely objection. The Contractor shall not be required to contract with anyone to whom the Contractor has made reasonable objection.

§ 5.2.3 If the Owner or Architect has reasonable objection to a person or entity proposed by the Contractor, the Contractor shall propose another to whom the Owner or Architect has no reasonable objection. If the proposed but rejected Subcontractor was reasonably capable of performing the Work, the Contract Sum and Contract Time shall be increased or decreased by the difference, if any, occasioned by such change, and an appropriate Change Order shall be issued before commencement of the substitute Subcontractor’s Work. However, no increase in the Contract Sum or Contract Time shall be allowed for such change unless the Contractor has acted promptly and responsively in submitting names as required.

§ 5.2.4 The Contractor shall not substitute a Subcontractor, person or entity previously selected if the Owner or Architect makes reasonable objection to such substitution.

§ 5.3 SUBCONTRACTUAL RELATIONS

By appropriate agreement, written where legally required for validity, the Contractor shall require each Subcontractor, to the extent of the Work to be performed by the Subcontractor, to be bound to the Contractor by terms of the Contract Documents, and to assume toward the Contractor all the obligations and responsibilities, including the responsibility for safety of the Subcontractor’s Work, which the Contractor, by these Documents, assumes toward the Owner and Architect. Each subcontract agreement shall preserve and protect the rights of the Owner and Architect under the Contract Documents with respect to the Work to be performed by the Subcontractor so that subcontracting thereof will not prejudice such rights, and shall allow to the Subcontractor, unless specifically provided otherwise in the subcontract agreement, the benefit of all rights, remedies and redress against the Contractor that the Contractor, by the Contract Documents, has against the Owner. Where appropriate, the Contractor shall require each Subcontractor to enter into similar agreements with Sub-subcontractors. The Contractor shall make available to each proposed Subcontractor, prior to the execution of the subcontract agreement, copies of the Contract Documents to which the Subcontractor will be bound, and, upon written request of the Subcontractor, identify to the Subcontractor terms and conditions of the proposed subcontract agreement that may be at variance with the Contract Documents. Subcontractors will similarly make copies of applicable portions of such documents available to their respective proposed Sub-subcontractors.

§ 5.4 CONTINGENT ASSIGNMENT OF SUBCONTRACTS

§ 5.4.1 Each subcontract agreement for a portion of the Work is assigned by the Contractor to the Owner, provided that

- .1 assignment is effective only after termination of the Contract by the Owner for cause pursuant to Section 14.2 and only for those subcontract agreements that the Owner accepts by notifying the Subcontractor and Contractor in writing; and
- .2 assignment is subject to the prior rights of the surety, if any, obligated under bond relating to the Contract.

When the Owner accepts the assignment of a subcontract agreement, the Owner assumes the Contractor’s rights and obligations under the subcontract.

§ 5.4.2 Upon such assignment, if the Work has been suspended for more than 30 days, the Subcontractor's compensation shall be equitably adjusted for increases in cost resulting from the suspension.

§ 5.4.3 Upon such assignment to the Owner under this Section 5.4, the Owner may further assign the subcontract to a successor contractor or other entity. If the Owner assigns the subcontract to a successor contractor or other entity, the Owner shall nevertheless remain legally responsible for all of the successor contractor's obligations under the subcontract.

ARTICLE 6 CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS

§ 6.1 OWNER'S RIGHT TO PERFORM CONSTRUCTION AND TO AWARD SEPARATE CONTRACTS

§ 6.1.1 The Owner reserves the right to perform construction or operations related to the Project with the Owner's own forces, and to award separate contracts in connection with other portions of the Project or other construction or operations on the site under Conditions of the Contract identical or substantially similar to these including those portions related to insurance and waiver of subrogation. If the Contractor claims that delay or additional cost is involved because of such action by the Owner, the Contractor shall make such Claim as provided in Article 15.

§ 6.1.2 When separate contracts are awarded for different portions of the Project or other construction or operations on the site, the term "Contractor" in the Contract Documents in each case shall mean the Contractor who executes each separate Owner-Contractor Agreement.

§ 6.1.3 The Owner shall provide for coordination of the activities of the Owner's own forces and of each separate contractor with the Work of the Contractor, who shall cooperate with them. The Contractor shall participate with other separate contractors and the Owner in reviewing their construction schedules. The Contractor shall make any revisions to the construction schedule deemed necessary after a joint review and mutual agreement. The construction schedules shall then constitute the schedules to be used by the Contractor, separate contractors and the Owner until subsequently revised.

§ 6.1.4 Unless otherwise provided in the Contract Documents, when the Owner performs construction or operations related to the Project with the Owner's own forces, the Owner shall be deemed to be subject to the same obligations and to have the same rights that apply to the Contractor under the Conditions of the Contract, including, without excluding others, those stated in Article 3, this Article 6 and Articles 10, 11 and 12.

§ 6.2 MUTUAL RESPONSIBILITY

§ 6.2.1 The Contractor shall afford the Owner and separate contractors reasonable opportunity for introduction and storage of their materials and equipment and performance of their activities, and shall connect and coordinate the Contractor's construction and operations with theirs as required by the Contract Documents.

§ 6.2.2 If part of the Contractor's Work depends for proper execution or results upon construction or operations by the Owner or a separate contractor, the Contractor shall, prior to proceeding with that portion of the Work, promptly report to the Architect apparent discrepancies or defects in such other construction that would render it unsuitable for such proper execution and results. Failure of the Contractor so to report shall constitute an acknowledgment that the Owner's or separate contractor's completed or partially completed construction is fit and proper to receive the Contractor's Work, except as to defects not then reasonably discoverable.

§ 6.2.3 The Contractor shall reimburse the Owner for costs the Owner incurs that are payable to a separate contractor because of the Contractor's delays, improperly timed activities or defective construction. The Owner shall be responsible to the Contractor for costs the Contractor incurs because of a separate contractor's delays, improperly timed activities, damage to the Work or defective construction.

§ 6.2.4 The Contractor shall promptly remedy damage the Contractor wrongfully causes to completed or partially completed construction or to property of the Owner or separate contractors as provided in Section 10.2.5.

§ 6.2.5 The Owner and each separate contractor shall have the same responsibilities for cutting and patching as are described for the Contractor in Section 3.14.

§ 6.3 OWNER'S RIGHT TO CLEAN UP

If a dispute arises among the Contractor, separate contractors and the Owner as to the responsibility under their respective contracts for maintaining the premises and surrounding area free from waste materials and rubbish, the Owner may clean up and the Architect will allocate the cost among those responsible.

ARTICLE 7 CHANGES IN THE WORK

§ 7.1 GENERAL

§ 7.1.1 Changes in the Work may be accomplished after execution of the Contract, and without invalidating the Contract, by Change Order, Construction Change Directive or order for a minor change in the Work, subject to the limitations stated in this Article 7 and elsewhere in the Contract Documents.

§ 7.1.2 A Change Order shall be based upon agreement among the Owner, Contractor and Architect; a Construction Change Directive requires agreement by the Owner and Architect and may or may not be agreed to by the Contractor; an order for a minor change in the Work may be issued by the Architect alone.

§ 7.1.3 Changes in the Work shall be performed under applicable provisions of the Contract Documents, and the Contractor shall proceed promptly, unless otherwise provided in the Change Order, Construction Change Directive or order for a minor change in the Work.

§ 7.2 CHANGE ORDERS

§ 7.2.1 A Change Order is a written instrument prepared by the Architect and signed by the Owner, Contractor and Architect stating their agreement upon all of the following:

- .1 The change in the Work;
- .2 The amount of the adjustment, if any, in the Contract Sum; and
- .3 The extent of the adjustment, if any, in the Contract Time.

§ 7.3 CONSTRUCTION CHANGE DIRECTIVES

§ 7.3.1 A Construction Change Directive is a written order prepared by the Architect and signed by the Owner and Architect, directing a change in the Work prior to agreement on adjustment, if any, in the Contract Sum or Contract Time, or both. The Owner may by Construction Change Directive, without invalidating the Contract, order changes in the Work within the general scope of the Contract consisting of additions, deletions or other revisions, the Contract Sum and Contract Time being adjusted accordingly.

§ 7.3.2 A Construction Change Directive shall be used in the absence of total agreement on the terms of a Change Order.

§ 7.3.3 If the Construction Change Directive provides for an adjustment to the Contract Sum, the adjustment shall be based on one of the following methods:

- .1 Mutual acceptance of a lump sum properly itemized and supported by sufficient substantiating data to permit evaluation;
- .2 Unit prices stated in the Contract Documents or subsequently agreed upon;
- .3 Cost to be determined in a manner agreed upon by the parties and a mutually acceptable fixed or percentage fee; or
- .4 As provided in Section 7.3.7.

§ 7.3.4 If unit prices are stated in the Contract Documents or subsequently agreed upon, and if quantities originally contemplated are materially changed in a proposed Change Order or Construction Change Directive so that application of such unit prices to quantities of Work proposed will cause substantial inequity to the Owner or Contractor, the applicable unit prices shall be equitably adjusted.

§ 7.3.5 Upon receipt of a Construction Change Directive, the Contractor shall promptly proceed with the change in the Work involved and advise the Architect of the Contractor's agreement or disagreement with the method, if any, provided in the Construction Change Directive for determining the proposed adjustment in the Contract Sum or Contract Time.

§ 7.3.6 A Construction Change Directive signed by the Contractor indicates the Contractor's agreement therewith, including adjustment in Contract Sum and Contract Time or the method for determining them. Such agreement shall be effective immediately and shall be recorded as a Change Order.

§ 7.3.7 If the Contractor does not respond promptly or disagrees with the method for adjustment in the Contract Sum, the Architect shall determine the method and the adjustment on the basis of reasonable expenditures and savings of those performing the Work attributable to the change, including, in case of an increase in the Contract Sum, an amount for overhead and profit as set forth in the Agreement, or if no such amount is set forth in the Agreement, a reasonable amount. In such case, and also under Section 7.3.3.3, the Contractor shall keep and present, in such form as the Architect may prescribe, an itemized accounting together with appropriate supporting data. Unless otherwise provided in the Contract Documents, costs for the purposes of this Section 7.3.7 shall be limited to the following:

- .1 Costs of labor, including social security, old age and unemployment insurance, fringe benefits required by agreement or custom, and workers' compensation insurance;
- .2 Costs of materials, supplies and equipment, including cost of transportation, whether incorporated or consumed;
- .3 Rental costs of machinery and equipment, exclusive of hand tools, whether rented from the Contractor or others;
- .4 Costs of premiums for all bonds and insurance, permit fees, and sales, use or similar taxes related to the Work; and
- .5 Additional costs of supervision and field office personnel directly attributable to the change.

§ 7.3.8 The amount of credit to be allowed by the Contractor to the Owner for a deletion or change that results in a net decrease in the Contract Sum shall be actual net cost as confirmed by the Architect. When both additions and credits covering related Work or substitutions are involved in a change, the allowance for overhead and profit shall be figured on the basis of net increase, if any, with respect to that change.

§ 7.3.9 Pending final determination of the total cost of a Construction Change Directive to the Owner, the Contractor may request payment for Work completed under the Construction Change Directive in Applications for Payment. The Architect will make an interim determination for purposes of monthly certification for payment for those costs and certify for payment the amount that the Architect determines, in the Architect's professional judgment, to be reasonably justified. The Architect's interim determination of cost shall adjust the Contract Sum on the same basis as a Change Order, subject to the right of either party to disagree and assert a Claim in accordance with Article 15.

§ 7.3.10 When the Owner and Contractor agree with a determination made by the Architect concerning the adjustments in the Contract Sum and Contract Time, or otherwise reach agreement upon the adjustments, such agreement shall be effective immediately and the Architect will prepare a Change Order. Change Orders may be issued for all or any part of a Construction Change Directive.

§ 7.4 MINOR CHANGES IN THE WORK

The Architect has authority to order minor changes in the Work not involving adjustment in the Contract Sum or extension of the Contract Time and not inconsistent with the intent of the Contract Documents. Such changes will be effected by written order signed by the Architect and shall be binding on the Owner and Contractor.

ARTICLE 8 TIME

§ 8.1 DEFINITIONS

§ 8.1.1 Unless otherwise provided, Contract Time is the period of time, including authorized adjustments, allotted in the Contract Documents for Substantial Completion of the Work.

§ 8.1.2 The date of commencement of the Work is the date established in the Agreement.

§ 8.1.3 The date of Substantial Completion is the date certified by the Architect in accordance with Section 9.8.

§ 8.1.4 The term "day" as used in the Contract Documents shall mean calendar day unless otherwise specifically defined.

§ 8.2 PROGRESS AND COMPLETION

§ 8.2.1 Time limits stated in the Contract Documents are of the essence of the Contract. By executing the Agreement the Contractor confirms that the Contract Time is a reasonable period for performing the Work.

§ 8.2.2 The Contractor shall not knowingly, except by agreement or instruction of the Owner in writing, prematurely commence operations on the site or elsewhere prior to the effective date of insurance required by Article 11 to be

furnished by the Contractor and Owner. The date of commencement of the Work shall not be changed by the effective date of such insurance.

§ 8.2.3 The Contractor shall proceed expeditiously with adequate forces and shall achieve Substantial Completion within the Contract Time.

§ 8.3 DELAYS AND EXTENSIONS OF TIME

§ 8.3.1 If the Contractor is delayed at any time in the commencement or progress of the Work by an act or neglect of the Owner or Architect, or of an employee of either, or of a separate contractor employed by the Owner; or by changes ordered in the Work; or by labor disputes, fire, unusual delay in deliveries, unavoidable casualties or other causes beyond the Contractor's control; or by delay authorized by the Owner pending mediation and arbitration; or by other causes that the Architect determines may justify delay, then the Contract Time shall be extended by Change Order for such reasonable time as the Architect may determine.

§ 8.3.2 Claims relating to time shall be made in accordance with applicable provisions of Article 15.

§ 8.3.3 This Section 8.3 does not preclude recovery of damages for delay by either party under other provisions of the Contract Documents.

ARTICLE 9 PAYMENTS AND COMPLETION

§ 9.1 CONTRACT SUM

The Contract Sum is stated in the Agreement and, including authorized adjustments, is the total amount payable by the Owner to the Contractor for performance of the Work under the Contract Documents.

§ 9.2 SCHEDULE OF VALUES

Where the Contract is based on a stipulated sum or Guaranteed Maximum Price, the Contractor shall submit to the Architect, before the first Application for Payment, a schedule of values allocating the entire Contract Sum to the various portions of the Work and prepared in such form and supported by such data to substantiate its accuracy as the Architect may require. This schedule, unless objected to by the Architect, shall be used as a basis for reviewing the Contractor's Applications for Payment.

§ 9.3 APPLICATIONS FOR PAYMENT

§ 9.3.1 At least ten days before the date established for each progress payment, the Contractor shall submit to the Architect an itemized Application for Payment prepared in accordance with the schedule of values, if required under Section 9.2, for completed portions of the Work. Such application shall be notarized, if required, and supported by such data substantiating the Contractor's right to payment as the Owner or Architect may require, such as copies of requisitions from Subcontractors and material suppliers, and shall reflect retainage if provided for in the Contract Documents.

§ 9.3.1.1 As provided in Section 7.3.9, such applications may include requests for payment on account of changes in the Work that have been properly authorized by Construction Change Directives, or by interim determinations of the Architect, but not yet included in Change Orders.

§ 9.3.1.2 Applications for Payment shall not include requests for payment for portions of the Work for which the Contractor does not intend to pay a Subcontractor or material supplier, unless such Work has been performed by others whom the Contractor intends to pay.

§ 9.3.2 Unless otherwise provided in the Contract Documents, payments shall be made on account of materials and equipment delivered and suitably stored at the site for subsequent incorporation in the Work. If approved in advance by the Owner, payment may similarly be made for materials and equipment suitably stored off the site at a location agreed upon in writing. Payment for materials and equipment stored on or off the site shall be conditioned upon compliance by the Contractor with procedures satisfactory to the Owner to establish the Owner's title to such materials and equipment or otherwise protect the Owner's interest, and shall include the costs of applicable insurance, storage and transportation to the site for such materials and equipment stored off the site.

§ 9.3.3 The Contractor warrants that title to all Work covered by an Application for Payment will pass to the Owner no later than the time of payment. The Contractor further warrants that upon submittal of an Application for Payment all Work for which Certificates for Payment have been previously issued and payments received from the

Owner shall, to the best of the Contractor's knowledge, information and belief, be free and clear of liens, claims, security interests or encumbrances in favor of the Contractor, Subcontractors, material suppliers, or other persons or entities making a claim by reason of having provided labor, materials and equipment relating to the Work.

§ 9.4 CERTIFICATES FOR PAYMENT

§ 9.4.1 The Architect will, within seven days after receipt of the Contractor's Application for Payment, either issue to the Owner a Certificate for Payment, with a copy to the Contractor, for such amount as the Architect determines is properly due, or notify the Contractor and Owner in writing of the Architect's reasons for withholding certification in whole or in part as provided in Section 9.5.1.

§ 9.4.2 The issuance of a Certificate for Payment will constitute a representation by the Architect to the Owner, based on the Architect's evaluation of the Work and the data comprising the Application for Payment, that, to the best of the Architect's knowledge, information and belief, the Work has progressed to the point indicated and that the quality of the Work is in accordance with the Contract Documents. The foregoing representations are subject to an evaluation of the Work for conformance with the Contract Documents upon Substantial Completion, to results of subsequent tests and inspections, to correction of minor deviations from the Contract Documents prior to completion and to specific qualifications expressed by the Architect. The issuance of a Certificate for Payment will further constitute a representation that the Contractor is entitled to payment in the amount certified. However, the issuance of a Certificate for Payment will not be a representation that the Architect has (1) made exhaustive or continuous on-site inspections to check the quality or quantity of the Work, (2) reviewed construction means, methods, techniques, sequences or procedures, (3) reviewed copies of requisitions received from Subcontractors and material suppliers and other data requested by the Owner to substantiate the Contractor's right to payment, or (4) made examination to ascertain how or for what purpose the Contractor has used money previously paid on account of the Contract Sum.

§ 9.5 DECISIONS TO WITHHOLD CERTIFICATION

§ 9.5.1 The Architect may withhold a Certificate for Payment in whole or in part, to the extent reasonably necessary to protect the Owner, if in the Architect's opinion the representations to the Owner required by Section 9.4.2 cannot be made. If the Architect is unable to certify payment in the amount of the Application, the Architect will notify the Contractor and Owner as provided in Section 9.4.1. If the Contractor and Architect cannot agree on a revised amount, the Architect will promptly issue a Certificate for Payment for the amount for which the Architect is able to make such representations to the Owner. The Architect may also withhold a Certificate for Payment or, because of subsequently discovered evidence, may nullify the whole or a part of a Certificate for Payment previously issued, to such extent as may be necessary in the Architect's opinion to protect the Owner from loss for which the Contractor is responsible, including loss resulting from acts and omissions described in Section 3.3.2, because of

- .1 defective Work not remedied;
- .2 third party claims filed or reasonable evidence indicating probable filing of such claims unless security acceptable to the Owner is provided by the Contractor;
- .3 failure of the Contractor to make payments properly to Subcontractors or for labor, materials or equipment;
- .4 reasonable evidence that the Work cannot be completed for the unpaid balance of the Contract Sum;
- .5 damage to the Owner or a separate contractor;
- .6 reasonable evidence that the Work will not be completed within the Contract Time, and that the unpaid balance would not be adequate to cover actual or liquidated damages for the anticipated delay; or
- .7 repeated failure to carry out the Work in accordance with the Contract Documents.

§ 9.5.2 When the above reasons for withholding certification are removed, certification will be made for amounts previously withheld.

§ 9.5.3 If the Architect withholds certification for payment under Section 9.5.1.3, the Owner may, at its sole option, issue joint checks to the Contractor and to any Subcontractor or material or equipment suppliers to whom the Contractor failed to make payment for Work properly performed or material or equipment suitably delivered. If the Owner makes payments by joint check, the Owner shall notify the Architect and the Architect will reflect such payment on the next Certificate for Payment.

§ 9.6 PROGRESS PAYMENTS

§ 9.6.1 After the Architect has issued a Certificate for Payment, the Owner shall make payment in the manner and within the time provided in the Contract Documents, and shall so notify the Architect.

§ 9.6.2 The Contractor shall pay each Subcontractor no later than seven days after receipt of payment from the Owner the amount to which the Subcontractor is entitled, reflecting percentages actually retained from payments to the Contractor on account of the Subcontractor's portion of the Work. The Contractor shall, by appropriate agreement with each Subcontractor, require each Subcontractor to make payments to Sub-subcontractors in a similar manner.

§ 9.6.3 The Architect will, on request, furnish to a Subcontractor, if practicable, information regarding percentages of completion or amounts applied for by the Contractor and action taken thereon by the Architect and Owner on account of portions of the Work done by such Subcontractor.

§ 9.6.4 The Owner has the right to request written evidence from the Contractor that the Contractor has properly paid Subcontractors and material and equipment suppliers amounts paid by the Owner to the Contractor for subcontracted Work. If the Contractor fails to furnish such evidence within seven days, the Owner shall have the right to contact Subcontractors to ascertain whether they have been properly paid. Neither the Owner nor Architect shall have an obligation to pay or to see to the payment of money to a Subcontractor, except as may otherwise be required by law.

§ 9.6.5 Contractor payments to material and equipment suppliers shall be treated in a manner similar to that provided in Sections 9.6.2, 9.6.3 and 9.6.4.

§ 9.6.6 A Certificate for Payment, a progress payment, or partial or entire use or occupancy of the Project by the Owner shall not constitute acceptance of Work not in accordance with the Contract Documents.

§ 9.6.7 Unless the Contractor provides the Owner with a payment bond in the full penal sum of the Contract Sum, payments received by the Contractor for Work properly performed by Subcontractors and suppliers shall be held by the Contractor for those Subcontractors or suppliers who performed Work or furnished materials, or both, under contract with the Contractor for which payment was made by the Owner. Nothing contained herein shall require money to be placed in a separate account and not commingled with money of the Contractor, shall create any fiduciary liability or tort liability on the part of the Contractor for breach of trust or shall entitle any person or entity to an award of punitive damages against the Contractor for breach of the requirements of this provision.

§ 9.7 FAILURE OF PAYMENT

If the Architect does not issue a Certificate for Payment, through no fault of the Contractor, within seven days after receipt of the Contractor's Application for Payment, or if the Owner does not pay the Contractor within seven days after the date established in the Contract Documents the amount certified by the Architect or awarded by binding dispute resolution, then the Contractor may, upon seven additional days' written notice to the Owner and Architect, stop the Work until payment of the amount owing has been received. The Contract Time shall be extended appropriately and the Contract Sum shall be increased by the amount of the Contractor's reasonable costs of shut-down, delay and start-up, plus interest as provided for in the Contract Documents.

§ 9.8 SUBSTANTIAL COMPLETION

§ 9.8.1 Substantial Completion is the stage in the progress of the Work when the Work or designated portion thereof is sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work for its intended use.

§ 9.8.2 When the Contractor considers that the Work, or a portion thereof which the Owner agrees to accept separately, is substantially complete, the Contractor shall prepare and submit to the Architect a comprehensive list of items to be completed or corrected prior to final payment. Failure to include an item on such list does not alter the responsibility of the Contractor to complete all Work in accordance with the Contract Documents.

§ 9.8.3 Upon receipt of the Contractor's list, the Architect will make an inspection to determine whether the Work or designated portion thereof is substantially complete. If the Architect's inspection discloses any item, whether or not included on the Contractor's list, which is not sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work or designated portion thereof for its intended use, the Contractor shall, before issuance of the Certificate of Substantial Completion, complete or correct such item upon notification by the Architect. In such case, the Contractor shall then submit a request for another inspection by the Architect to determine Substantial Completion.

§ 9.8.4 When the Work or designated portion thereof is substantially complete, the Architect will prepare a Certificate of Substantial Completion that shall establish the date of Substantial Completion, shall establish responsibilities of the Owner and Contractor for security, maintenance, heat, utilities, damage to the Work and insurance, and shall fix the time within which the Contractor shall finish all items on the list accompanying the Certificate. Warranties required by the Contract Documents shall commence on the date of Substantial Completion of the Work or designated portion thereof unless otherwise provided in the Certificate of Substantial Completion.

§ 9.8.5 The Certificate of Substantial Completion shall be submitted to the Owner and Contractor for their written acceptance of responsibilities assigned to them in such Certificate. Upon such acceptance and consent of surety, if any, the Owner shall make payment of retainage applying to such Work or designated portion thereof. Such payment shall be adjusted for Work that is incomplete or not in accordance with the requirements of the Contract Documents.

§ 9.9 PARTIAL OCCUPANCY OR USE

§ 9.9.1 The Owner may occupy or use any completed or partially completed portion of the Work at any stage when such portion is designated by separate agreement with the Contractor, provided such occupancy or use is consented to by the insurer as required under Section 11.3.1.5 and authorized by public authorities having jurisdiction over the Project. Such partial occupancy or use may commence whether or not the portion is substantially complete, provided the Owner and Contractor have accepted in writing the responsibilities assigned to each of them for payments, retainage, if any, security, maintenance, heat, utilities, damage to the Work and insurance, and have agreed in writing concerning the period for correction of the Work and commencement of warranties required by the Contract Documents. When the Contractor considers a portion substantially complete, the Contractor shall prepare and submit a list to the Architect as provided under Section 9.8.2. Consent of the Contractor to partial occupancy or use shall not be unreasonably withheld. The stage of the progress of the Work shall be determined by written agreement between the Owner and Contractor or, if no agreement is reached, by decision of the Architect.

§ 9.9.2 Immediately prior to such partial occupancy or use, the Owner, Contractor and Architect shall jointly inspect the area to be occupied or portion of the Work to be used in order to determine and record the condition of the Work.

§ 9.9.3 Unless otherwise agreed upon, partial occupancy or use of a portion or portions of the Work shall not constitute acceptance of Work not complying with the requirements of the Contract Documents.

§ 9.10 FINAL COMPLETION AND FINAL PAYMENT

§ 9.10.1 Upon receipt of the Contractor's written notice that the Work is ready for final inspection and acceptance and upon receipt of a final Application for Payment, the Architect will promptly make such inspection and, when the Architect finds the Work acceptable under the Contract Documents and the Contract fully performed, the Architect will promptly issue a final Certificate for Payment stating that to the best of the Architect's knowledge, information and belief, and on the basis of the Architect's on-site visits and inspections, the Work has been completed in accordance with terms and conditions of the Contract Documents and that the entire balance found to be due the Contractor and noted in the final Certificate is due and payable. The Architect's final Certificate for Payment will constitute a further representation that conditions listed in Section 9.10.2 as precedent to the Contractor's being entitled to final payment have been fulfilled.

§ 9.10.2 Neither final payment nor any remaining retained percentage shall become due until the Contractor submits to the Architect (1) an affidavit that payrolls, bills for materials and equipment, and other indebtedness connected with the Work for which the Owner or the Owner's property might be responsible or encumbered (less amounts withheld by Owner) have been paid or otherwise satisfied, (2) a certificate evidencing that insurance required by the Contract Documents to remain in force after final payment is currently in effect and will not be canceled or allowed to expire until at least 30 days' prior written notice has been given to the Owner, (3) a written statement that the Contractor knows of no substantial reason that the insurance will not be renewable to cover the period required by the Contract Documents, (4) consent of surety, if any, to final payment and (5), if required by the Owner, other data establishing payment or satisfaction of obligations, such as receipts, releases and waivers of liens, claims, security interests or encumbrances arising out of the Contract, to the extent and in such form as may be designated by the Owner. If a Subcontractor refuses to furnish a release or waiver required by the Owner, the Contractor may furnish a bond satisfactory to the Owner to indemnify the Owner against such lien. If such lien remains unsatisfied after payments are made, the Contractor shall refund to the Owner all money that the Owner may be compelled to pay in discharging such lien, including all costs and reasonable attorneys' fees.

§ 9.10.3 If, after Substantial Completion of the Work, final completion thereof is materially delayed through no fault of the Contractor or by issuance of Change Orders affecting final completion, and the Architect so confirms, the Owner shall, upon application by the Contractor and certification by the Architect, and without terminating the Contract, make payment of the balance due for that portion of the Work fully completed and accepted. If the remaining balance for Work not fully completed or corrected is less than retainage stipulated in the Contract Documents, and if bonds have been furnished, the written consent of surety to payment of the balance due for that portion of the Work fully completed and accepted shall be submitted by the Contractor to the Architect prior to certification of such payment. Such payment shall be made under terms and conditions governing final payment, except that it shall not constitute a waiver of claims.

§ 9.10.4 The making of final payment shall constitute a waiver of Claims by the Owner except those arising from

- .1 liens, Claims, security interests or encumbrances arising out of the Contract and unsettled;
- .2 failure of the Work to comply with the requirements of the Contract Documents; or
- .3 terms of special warranties required by the Contract Documents.

§ 9.10.5 Acceptance of final payment by the Contractor, a Subcontractor or material supplier shall constitute a waiver of claims by that payee except those previously made in writing and identified by that payee as unsettled at the time of final Application for Payment.

ARTICLE 10 PROTECTION OF PERSONS AND PROPERTY

§ 10.1 SAFETY PRECAUTIONS AND PROGRAMS

The Contractor shall be responsible for initiating, maintaining and supervising all safety precautions and programs in connection with the performance of the Contract.

§ 10.2 SAFETY OF PERSONS AND PROPERTY

§ 10.2.1 The Contractor shall take reasonable precautions for safety of, and shall provide reasonable protection to prevent damage, injury or loss to

- .1 employees on the Work and other persons who may be affected thereby;
- .2 the Work and materials and equipment to be incorporated therein, whether in storage on or off the site, under care, custody or control of the Contractor or the Contractor's Subcontractors or Sub-subcontractors; and
- .3 other property at the site or adjacent thereto, such as trees, shrubs, lawns, walks, pavements, roadways, structures and utilities not designated for removal, relocation or replacement in the course of construction.

§ 10.2.2 The Contractor shall comply with and give notices required by applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities bearing on safety of persons or property or their protection from damage, injury or loss.

§ 10.2.3 The Contractor shall erect and maintain, as required by existing conditions and performance of the Contract, reasonable safeguards for safety and protection, including posting danger signs and other warnings against hazards, promulgating safety regulations and notifying owners and users of adjacent sites and utilities.

§ 10.2.4 When use or storage of explosives or other hazardous materials or equipment or unusual methods are necessary for execution of the Work, the Contractor shall exercise utmost care and carry on such activities under supervision of properly qualified personnel.

§ 10.2.5 The Contractor shall promptly remedy damage and loss (other than damage or loss insured under property insurance required by the Contract Documents) to property referred to in Sections 10.2.1.2 and 10.2.1.3 caused in whole or in part by the Contractor, a Subcontractor, a Sub-subcontractor, or anyone directly or indirectly employed by any of them, or by anyone for whose acts they may be liable and for which the Contractor is responsible under Sections 10.2.1.2 and 10.2.1.3, except damage or loss attributable to acts or omissions of the Owner or Architect or anyone directly or indirectly employed by either of them, or by anyone for whose acts either of them may be liable, and not attributable to the fault or negligence of the Contractor. The foregoing obligations of the Contractor are in addition to the Contractor's obligations under Section 3.18.

§ 10.2.6 The Contractor shall designate a responsible member of the Contractor's organization at the site whose duty shall be the prevention of accidents. This person shall be the Contractor's superintendent unless otherwise designated by the Contractor in writing to the Owner and Architect.

§ 10.2.7 The Contractor shall not permit any part of the construction or site to be loaded so as to cause damage or create an unsafe condition.

§ 10.2.8 INJURY OR DAMAGE TO PERSON OR PROPERTY

If either party suffers injury or damage to person or property because of an act or omission of the other party, or of others for whose acts such party is legally responsible, written notice of such injury or damage, whether or not insured, shall be given to the other party within a reasonable time not exceeding 21 days after discovery. The notice shall provide sufficient detail to enable the other party to investigate the matter.

§ 10.3 HAZARDOUS MATERIALS

§ 10.3.1 The Contractor is responsible for compliance with any requirements included in the Contract Documents regarding hazardous materials. If the Contractor encounters a hazardous material or substance not addressed in the Contract Documents and if reasonable precautions will be inadequate to prevent foreseeable bodily injury or death to persons resulting from a material or substance, including but not limited to asbestos or polychlorinated biphenyl (PCB), encountered on the site by the Contractor, the Contractor shall, upon recognizing the condition, immediately stop Work in the affected area and report the condition to the Owner and Architect in writing.

§ 10.3.2 Upon receipt of the Contractor's written notice, the Owner shall obtain the services of a licensed laboratory to verify the presence or absence of the material or substance reported by the Contractor and, in the event such material or substance is found to be present, to cause it to be rendered harmless. Unless otherwise required by the Contract Documents, the Owner shall furnish in writing to the Contractor and Architect the names and qualifications of persons or entities who are to perform tests verifying the presence or absence of such material or substance or who are to perform the task of removal or safe containment of such material or substance. The Contractor and the Architect will promptly reply to the Owner in writing stating whether or not either has reasonable objection to the persons or entities proposed by the Owner. If either the Contractor or Architect has an objection to a person or entity proposed by the Owner, the Owner shall propose another to whom the Contractor and the Architect have no reasonable objection. When the material or substance has been rendered harmless, Work in the affected area shall resume upon written agreement of the Owner and Contractor. By Change Order, the Contract Time shall be extended appropriately and the Contract Sum shall be increased in the amount of the Contractor's reasonable additional costs of shut-down, delay and start-up.

§ 10.3.3 To the fullest extent permitted by law, the Owner shall indemnify and hold harmless the Contractor, Subcontractors, Architect, Architect's consultants and agents and employees of any of them from and against claims, damages, losses and expenses, including but not limited to attorneys' fees, arising out of or resulting from performance of the Work in the affected area if in fact the material or substance presents the risk of bodily injury or death as described in Section 10.3.1 and has not been rendered harmless, provided that such claim, damage, loss or expense is attributable to bodily injury, sickness, disease or death, or to injury to or destruction of tangible property (other than the Work itself), except to the extent that such damage, loss or expense is due to the fault or negligence of the party seeking indemnity.

§ 10.3.4 The Owner shall not be responsible under this Section 10.3 for materials or substances the Contractor brings to the site unless such materials or substances are required by the Contract Documents. The Owner shall be responsible for materials or substances required by the Contract Documents, except to the extent of the Contractor's fault or negligence in the use and handling of such materials or substances.

§ 10.3.5 The Contractor shall indemnify the Owner for the cost and expense the Owner incurs (1) for remediation of a material or substance the Contractor brings to the site and negligently handles, or (2) where the Contractor fails to perform its obligations under Section 10.3.1, except to the extent that the cost and expense are due to the Owner's fault or negligence.

§ 10.3.6 If, without negligence on the part of the Contractor, the Contractor is held liable by a government agency for the cost of remediation of a hazardous material or substance solely by reason of performing Work as required by the Contract Documents, the Owner shall indemnify the Contractor for all cost and expense thereby incurred.

§ 10.4 EMERGENCIES

In an emergency affecting safety of persons or property, the Contractor shall act, at the Contractor's discretion, to prevent threatened damage, injury or loss. Additional compensation or extension of time claimed by the Contractor on account of an emergency shall be determined as provided in Article 15 and Article 7.

ARTICLE 11 INSURANCE AND BONDS

§ 11.1 CONTRACTOR'S LIABILITY INSURANCE

§ 11.1.1 The Contractor shall purchase from and maintain in a company or companies lawfully authorized to do business in the jurisdiction in which the Project is located such insurance as will protect the Contractor from claims set forth below which may arise out of or result from the Contractor's operations and completed operations under the Contract and for which the Contractor may be legally liable, whether such operations be by the Contractor or by a Subcontractor or by anyone directly or indirectly employed by any of them, or by anyone for whose acts any of them may be liable:

- .1 Claims under workers' compensation, disability benefit and other similar employee benefit acts that are applicable to the Work to be performed;
- .2 Claims for damages because of bodily injury, occupational sickness or disease, or death of the Contractor's employees;
- .3 Claims for damages because of bodily injury, sickness or disease, or death of any person other than the Contractor's employees;
- .4 Claims for damages insured by usual personal injury liability coverage;
- .5 Claims for damages, other than to the Work itself, because of injury to or destruction of tangible property, including loss of use resulting therefrom;
- .6 Claims for damages because of bodily injury, death of a person or property damage arising out of ownership, maintenance or use of a motor vehicle;
- .7 Claims for bodily injury or property damage arising out of completed operations; and
- .8 Claims involving contractual liability insurance applicable to the Contractor's obligations under Section 3.18.

§ 11.1.2 The insurance required by Section 11.1.1 shall be written for not less than limits of liability specified in the Contract Documents or required by law, whichever coverage is greater. Coverages, whether written on an occurrence or claims-made basis, shall be maintained without interruption from the date of commencement of the Work until the date of final payment and termination of any coverage required to be maintained after final payment, and, with respect to the Contractor's completed operations coverage, until the expiration of the period for correction of Work or for such other period for maintenance of completed operations coverage as specified in the Contract Documents.

§ 11.1.3 Certificates of insurance acceptable to the Owner shall be filed with the Owner prior to commencement of the Work and thereafter upon renewal or replacement of each required policy of insurance. These certificates and the insurance policies required by this Section 11.1 shall contain a provision that coverages afforded under the policies will not be canceled or allowed to expire until at least 30 days' prior written notice has been given to the Owner. An additional certificate evidencing continuation of liability coverage, including coverage for completed operations, shall be submitted with the final Application for Payment as required by Section 9.10.2 and thereafter upon renewal or replacement of such coverage until the expiration of the time required by Section 11.1.2. Information concerning reduction of coverage on account of revised limits or claims paid under the General Aggregate, or both, shall be furnished by the Contractor with reasonable promptness.

§ 11.1.4 The Contractor shall cause the commercial liability coverage required by the Contract Documents to include (1) the Owner, the Architect and the Architect's consultants as additional insureds for claims caused in whole or in part by the Contractor's negligent acts or omissions during the Contractor's operations; and (2) the Owner as an additional insured for claims caused in whole or in part by the Contractor's negligent acts or omissions during the Contractor's completed operations.

§ 11.2 OWNER'S LIABILITY INSURANCE

The Owner shall be responsible for purchasing and maintaining the Owner's usual liability insurance.

§ 11.3 PROPERTY INSURANCE

§ 11.3.1 Unless otherwise provided, the Owner shall purchase and maintain, in a company or companies lawfully authorized to do business in the jurisdiction in which the Project is located, property insurance written on a builder's

risk “all-risk” or equivalent policy form in the amount of the initial Contract Sum, plus value of subsequent Contract Modifications and cost of materials supplied or installed by others, comprising total value for the entire Project at the site on a replacement cost basis without optional deductibles. Such property insurance shall be maintained, unless otherwise provided in the Contract Documents or otherwise agreed in writing by all persons and entities who are beneficiaries of such insurance, until final payment has been made as provided in Section 9.10 or until no person or entity other than the Owner has an insurable interest in the property required by this Section 11.3 to be covered, whichever is later. This insurance shall include interests of the Owner, the Contractor, Subcontractors and Sub-subcontractors in the Project.

§ 11.3.1.1 Property insurance shall be on an “all-risk” or equivalent policy form and shall include, without limitation, insurance against the perils of fire (with extended coverage) and physical loss or damage including, without duplication of coverage, theft, vandalism, malicious mischief, collapse, earthquake, flood, windstorm, falsework, testing and startup, temporary buildings and debris removal including demolition occasioned by enforcement of any applicable legal requirements, and shall cover reasonable compensation for Architect’s and Contractor’s services and expenses required as a result of such insured loss.

§ 11.3.1.2 If the Owner does not intend to purchase such property insurance required by the Contract and with all of the coverages in the amount described above, the Owner shall so inform the Contractor in writing prior to commencement of the Work. The Contractor may then effect insurance that will protect the interests of the Contractor, Subcontractors and Sub-subcontractors in the Work, and by appropriate Change Order the cost thereof shall be charged to the Owner. If the Contractor is damaged by the failure or neglect of the Owner to purchase or maintain insurance as described above, without so notifying the Contractor in writing, then the Owner shall bear all reasonable costs properly attributable thereto.

§ 11.3.1.3 If the property insurance requires deductibles, the Owner shall pay costs not covered because of such deductibles.

§ 11.3.1.4 This property insurance shall cover portions of the Work stored off the site, and also portions of the Work in transit.

§ 11.3.1.5 Partial occupancy or use in accordance with Section 9.9 shall not commence until the insurance company or companies providing property insurance have consented to such partial occupancy or use by endorsement or otherwise. The Owner and the Contractor shall take reasonable steps to obtain consent of the insurance company or companies and shall, without mutual written consent, take no action with respect to partial occupancy or use that would cause cancellation, lapse or reduction of insurance.

§ 11.3.2 BOILER AND MACHINERY INSURANCE

The Owner shall purchase and maintain boiler and machinery insurance required by the Contract Documents or by law, which shall specifically cover such insured objects during installation and until final acceptance by the Owner; this insurance shall include interests of the Owner, Contractor, Subcontractors and Sub-subcontractors in the Work, and the Owner and Contractor shall be named insureds.

§ 11.3.3 LOSS OF USE INSURANCE

The Owner, at the Owner’s option, may purchase and maintain such insurance as will insure the Owner against loss of use of the Owner’s property due to fire or other hazards, however caused. The Owner waives all rights of action against the Contractor for loss of use of the Owner’s property, including consequential losses due to fire or other hazards however caused.

§ 11.3.4 If the Contractor requests in writing that insurance for risks other than those described herein or other special causes of loss be included in the property insurance policy, the Owner shall, if possible, include such insurance, and the cost thereof shall be charged to the Contractor by appropriate Change Order.

§ 11.3.5 If during the Project construction period the Owner insures properties, real or personal or both, at or adjacent to the site by property insurance under policies separate from those insuring the Project, or if after final payment property insurance is to be provided on the completed Project through a policy or policies other than those insuring the Project during the construction period, the Owner shall waive all rights in accordance with the terms of Section 11.3.7 for damages caused by fire or other causes of loss covered by this separate property insurance. All separate policies shall provide this waiver of subrogation by endorsement or otherwise.

§ 11.3.6 Before an exposure to loss may occur, the Owner shall file with the Contractor a copy of each policy that includes insurance coverages required by this Section 11.3. Each policy shall contain all generally applicable conditions, definitions, exclusions and endorsements related to this Project. Each policy shall contain a provision that the policy will not be canceled or allowed to expire, and that its limits will not be reduced, until at least 30 days' prior written notice has been given to the Contractor.

§ 11.3.7 WAIVERS OF SUBROGATION

The Owner and Contractor waive all rights against (1) each other and any of their subcontractors, sub-subcontractors, agents and employees, each of the other, and (2) the Architect, Architect's consultants, separate contractors described in Article 6, if any, and any of their subcontractors, sub-subcontractors, agents and employees, for damages caused by fire or other causes of loss to the extent covered by property insurance obtained pursuant to this Section 11.3 or other property insurance applicable to the Work, except such rights as they have to proceeds of such insurance held by the Owner as fiduciary. The Owner or Contractor, as appropriate, shall require of the Architect, Architect's consultants, separate contractors described in Article 6, if any, and the subcontractors, sub-subcontractors, agents and employees of any of them, by appropriate agreements, written where legally required for validity, similar waivers each in favor of other parties enumerated herein. The policies shall provide such waivers of subrogation by endorsement or otherwise. A waiver of subrogation shall be effective as to a person or entity even though that person or entity would otherwise have a duty of indemnification, contractual or otherwise, did not pay the insurance premium directly or indirectly, and whether or not the person or entity had an insurable interest in the property damaged.

§ 11.3.8 A loss insured under the Owner's property insurance shall be adjusted by the Owner as fiduciary and made payable to the Owner as fiduciary for the insureds, as their interests may appear, subject to requirements of any applicable mortgagee clause and of Section 11.3.10. The Contractor shall pay Subcontractors their just shares of insurance proceeds received by the Contractor, and by appropriate agreements, written where legally required for validity, shall require Subcontractors to make payments to their Sub-subcontractors in similar manner.

§ 11.3.9 If required in writing by a party in interest, the Owner as fiduciary shall, upon occurrence of an insured loss, give bond for proper performance of the Owner's duties. The cost of required bonds shall be charged against proceeds received as fiduciary. The Owner shall deposit in a separate account proceeds so received, which the Owner shall distribute in accordance with such agreement as the parties in interest may reach, or as determined in accordance with the method of binding dispute resolution selected in the Agreement between the Owner and Contractor. If after such loss no other special agreement is made and unless the Owner terminates the Contract for convenience, replacement of damaged property shall be performed by the Contractor after notification of a Change in the Work in accordance with Article 7.

§ 11.3.10 The Owner as fiduciary shall have power to adjust and settle a loss with insurers unless one of the parties in interest shall object in writing within five days after occurrence of loss to the Owner's exercise of this power; if such objection is made, the dispute shall be resolved in the manner selected by the Owner and Contractor as the method of binding dispute resolution in the Agreement. If the Owner and Contractor have selected arbitration as the method of binding dispute resolution, the Owner as fiduciary shall make settlement with insurers or, in the case of a dispute over distribution of insurance proceeds, in accordance with the directions of the arbitrators.

§ 11.4 PERFORMANCE BOND AND PAYMENT BOND

§ 11.4.1 The Owner shall have the right to require the Contractor to furnish bonds covering faithful performance of the Contract and payment of obligations arising thereunder as stipulated in bidding requirements or specifically required in the Contract Documents on the date of execution of the Contract.

§ 11.4.2 Upon the request of any person or entity appearing to be a potential beneficiary of bonds covering payment of obligations arising under the Contract, the Contractor shall promptly furnish a copy of the bonds or shall authorize a copy to be furnished.

ARTICLE 12 UNCOVERING AND CORRECTION OF WORK

§ 12.1 UNCOVERING OF WORK

§ 12.1.1 If a portion of the Work is covered contrary to the Architect's request or to requirements specifically expressed in the Contract Documents, it must, if requested in writing by the Architect, be uncovered for the Architect's examination and be replaced at the Contractor's expense without change in the Contract Time.

§ 12.1.2 If a portion of the Work has been covered that the Architect has not specifically requested to examine prior to its being covered, the Architect may request to see such Work and it shall be uncovered by the Contractor. If such Work is in accordance with the Contract Documents, costs of uncovering and replacement shall, by appropriate Change Order, be at the Owner's expense. If such Work is not in accordance with the Contract Documents, such costs and the cost of correction shall be at the Contractor's expense unless the condition was caused by the Owner or a separate contractor in which event the Owner shall be responsible for payment of such costs.

§ 12.2 CORRECTION OF WORK

§ 12.2.1 BEFORE OR AFTER SUBSTANTIAL COMPLETION

The Contractor shall promptly correct Work rejected by the Architect or failing to conform to the requirements of the Contract Documents, whether discovered before or after Substantial Completion and whether or not fabricated, installed or completed. Costs of correcting such rejected Work, including additional testing and inspections, the cost of uncovering and replacement, and compensation for the Architect's services and expenses made necessary thereby, shall be at the Contractor's expense.

§ 12.2.2 AFTER SUBSTANTIAL COMPLETION

§ 12.2.2.1 In addition to the Contractor's obligations under Section 3.5, if, within one year after the date of Substantial Completion of the Work or designated portion thereof or after the date for commencement of warranties established under Section 9.9.1, or by terms of an applicable special warranty required by the Contract Documents, any of the Work is found to be not in accordance with the requirements of the Contract Documents, the Contractor shall correct it promptly after receipt of written notice from the Owner to do so unless the Owner has previously given the Contractor a written acceptance of such condition. The Owner shall give such notice promptly after discovery of the condition. During the one-year period for correction of Work, if the Owner fails to notify the Contractor and give the Contractor an opportunity to make the correction, the Owner waives the rights to require correction by the Contractor and to make a claim for breach of warranty. If the Contractor fails to correct nonconforming Work within a reasonable time during that period after receipt of notice from the Owner or Architect, the Owner may correct it in accordance with Section 2.4.

§ 12.2.2.2 The one-year period for correction of Work shall be extended with respect to portions of Work first performed after Substantial Completion by the period of time between Substantial Completion and the actual completion of that portion of the Work.

§ 12.2.2.3 The one-year period for correction of Work shall not be extended by corrective Work performed by the Contractor pursuant to this Section 12.2.

§ 12.2.3 The Contractor shall remove from the site portions of the Work that are not in accordance with the requirements of the Contract Documents and are neither corrected by the Contractor nor accepted by the Owner.

§ 12.2.4 The Contractor shall bear the cost of correcting destroyed or damaged construction, whether completed or partially completed, of the Owner or separate contractors caused by the Contractor's correction or removal of Work that is not in accordance with the requirements of the Contract Documents.

§ 12.2.5 Nothing contained in this Section 12.2 shall be construed to establish a period of limitation with respect to other obligations the Contractor has under the Contract Documents. Establishment of the one-year period for correction of Work as described in Section 12.2.2 relates only to the specific obligation of the Contractor to correct the Work, and has no relationship to the time within which the obligation to comply with the Contract Documents may be sought to be enforced, nor to the time within which proceedings may be commenced to establish the Contractor's liability with respect to the Contractor's obligations other than specifically to correct the Work.

§ 12.3 ACCEPTANCE OF NONCONFORMING WORK

If the Owner prefers to accept Work that is not in accordance with the requirements of the Contract Documents, the Owner may do so instead of requiring its removal and correction, in which case the Contract Sum will be reduced as appropriate and equitable. Such adjustment shall be effected whether or not final payment has been made.

ARTICLE 13 MISCELLANEOUS PROVISIONS

§ 13.1 GOVERNING LAW

The Contract shall be governed by the law of the place where the Project is located except that, if the parties have selected arbitration as the method of binding dispute resolution, the Federal Arbitration Act shall govern Section 15.4.

§ 13.2 SUCCESSORS AND ASSIGNS

§ 13.2.1 The Owner and Contractor respectively bind themselves, their partners, successors, assigns and legal representatives to covenants, agreements and obligations contained in the Contract Documents. Except as provided in Section 13.2.2, neither party to the Contract shall assign the Contract as a whole without written consent of the other. If either party attempts to make such an assignment without such consent, that party shall nevertheless remain legally responsible for all obligations under the Contract.

§ 13.2.2 The Owner may, without consent of the Contractor, assign the Contract to a lender providing construction financing for the Project, if the lender assumes the Owner's rights and obligations under the Contract Documents. The Contractor shall execute all consents reasonably required to facilitate such assignment.

§ 13.3 WRITTEN NOTICE

Written notice shall be deemed to have been duly served if delivered in person to the individual, to a member of the firm or entity, or to an officer of the corporation for which it was intended; or if delivered at, or sent by registered or certified mail or by courier service providing proof of delivery to, the last business address known to the party giving notice.

§ 13.4 RIGHTS AND REMEDIES

§ 13.4.1 Duties and obligations imposed by the Contract Documents and rights and remedies available thereunder shall be in addition to and not a limitation of duties, obligations, rights and remedies otherwise imposed or available by law.

§ 13.4.2 No action or failure to act by the Owner, Architect or Contractor shall constitute a waiver of a right or duty afforded them under the Contract, nor shall such action or failure to act constitute approval of or acquiescence in a breach there under, except as may be specifically agreed in writing.

§ 13.5 TESTS AND INSPECTIONS

§ 13.5.1 Tests, inspections and approvals of portions of the Work shall be made as required by the Contract Documents and by applicable laws, statutes, ordinances, codes, rules and regulations or lawful orders of public authorities. Unless otherwise provided, the Contractor shall make arrangements for such tests, inspections and approvals with an independent testing laboratory or entity acceptable to the Owner, or with the appropriate public authority, and shall bear all related costs of tests, inspections and approvals. The Contractor shall give the Architect timely notice of when and where tests and inspections are to be made so that the Architect may be present for such procedures. The Owner shall bear costs of (1) tests, inspections or approvals that do not become requirements until after bids are received or negotiations concluded, and (2) tests, inspections or approvals where building codes or applicable laws or regulations prohibit the Owner from delegating their cost to the Contractor.

§ 13.5.2 If the Architect, Owner or public authorities having jurisdiction determine that portions of the Work require additional testing, inspection or approval not included under Section 13.5.1, the Architect will, upon written authorization from the Owner, instruct the Contractor to make arrangements for such additional testing, inspection or approval by an entity acceptable to the Owner, and the Contractor shall give timely notice to the Architect of when and where tests and inspections are to be made so that the Architect may be present for such procedures. Such costs, except as provided in Section 13.5.3, shall be at the Owner's expense.

§ 13.5.3 If such procedures for testing, inspection or approval under Sections 13.5.1 and 13.5.2 reveal failure of the portions of the Work to comply with requirements established by the Contract Documents, all costs made necessary by such failure including those of repeated procedures and compensation for the Architect's services and expenses shall be at the Contractor's expense.

§ 13.5.4 Required certificates of testing, inspection or approval shall, unless otherwise required by the Contract Documents, be secured by the Contractor and promptly delivered to the Architect.

§ 13.5.5 If the Architect is to observe tests, inspections or approvals required by the Contract Documents, the Architect will do so promptly and, where practicable, at the normal place of testing.

§ 13.5.6 Tests or inspections conducted pursuant to the Contract Documents shall be made promptly to avoid unreasonable delay in the Work.

§ 13.6 INTEREST

Payments due and unpaid under the Contract Documents shall bear interest from the date payment is due at such rate as the parties may agree upon in writing or, in the absence thereof, at the legal rate prevailing from time to time at the place where the Project is located.

§ 13.7 TIME LIMITS ON CLAIMS

The Owner and Contractor shall commence all claims and causes of action, whether in contract, tort, breach of warranty or otherwise, against the other arising out of or related to the Contract in accordance with the requirements of the final dispute resolution method selected in the Agreement within the time period specified by applicable law, but in any case not more than 10 years after the date of Substantial Completion of the Work. The Owner and Contractor waive all claims and causes of action not commenced in accordance with this Section 13.7.

ARTICLE 14 TERMINATION OR SUSPENSION OF THE CONTRACT

§ 14.1 TERMINATION BY THE CONTRACTOR

§ 14.1.1 The Contractor may terminate the Contract if the Work is stopped for a period of 30 consecutive days through no act or fault of the Contractor or a Subcontractor, Sub-subcontractor or their agents or employees or any other persons or entities performing portions of the Work under direct or indirect contract with the Contractor, for any of the following reasons:

- .1 Issuance of an order of a court or other public authority having jurisdiction that requires all Work to be stopped;
- .2 An act of government, such as a declaration of national emergency that requires all Work to be stopped;
- .3 Because the Architect has not issued a Certificate for Payment and has not notified the Contractor of the reason for withholding certification as provided in Section 9.4.1, or because the Owner has not made payment on a Certificate for Payment within the time stated in the Contract Documents; or
- .4 The Owner has failed to furnish to the Contractor promptly, upon the Contractor's request, reasonable evidence as required by Section 2.2.1.

§ 14.1.2 The Contractor may terminate the Contract if, through no act or fault of the Contractor or a Subcontractor, Sub-subcontractor or their agents or employees or any other persons or entities performing portions of the Work under direct or indirect contract with the Contractor, repeated suspensions, delays or interruptions of the entire Work by the Owner as described in Section 14.3 constitute in the aggregate more than 100 percent of the total number of days scheduled for completion, or 120 days in any 365-day period, whichever is less.

§ 14.1.3 If one of the reasons described in Section 14.1.1 or 14.1.2 exists, the Contractor may, upon seven days' written notice to the Owner and Architect, terminate the Contract and recover from the Owner payment for Work executed, including reasonable overhead and profit, costs incurred by reason of such termination, and damages.

§ 14.1.4 If the Work is stopped for a period of 60 consecutive days through no act or fault of the Contractor or a Subcontractor or their agents or employees or any other persons performing portions of the Work under contract with the Contractor because the Owner has repeatedly failed to fulfill the Owner's obligations under the Contract Documents with respect to matters important to the progress of the Work, the Contractor may, upon seven additional days' written notice to the Owner and the Architect, terminate the Contract and recover from the Owner as provided in Section 14.1.3.

§ 14.2 TERMINATION BY THE OWNER FOR CAUSE

§ 14.2.1 The Owner may terminate the Contract if the Contractor

- .1 repeatedly refuses or fails to supply enough properly skilled workers or proper materials;
- .2 fails to make payment to Subcontractors for materials or labor in accordance with the respective agreements between the Contractor and the Subcontractors;
- .3 repeatedly disregards applicable laws, statutes, ordinances, codes, rules and regulations, or lawful orders of a public authority; or

- .4 otherwise is guilty of substantial breach of a provision of the Contract Documents.

§ 14.2.2 When any of the above reasons exist, the Owner, upon certification by the Initial Decision Maker that sufficient cause exists to justify such action, may without prejudice to any other rights or remedies of the Owner and after giving the Contractor and the Contractor's surety, if any, seven days' written notice, terminate employment of the Contractor and may, subject to any prior rights of the surety:

- .1 Exclude the Contractor from the site and take possession of all materials, equipment, tools, and construction equipment and machinery thereon owned by the Contractor;
- .2 Accept assignment of subcontracts pursuant to Section 5.4; and
- .3 Finish the Work by whatever reasonable method the Owner may deem expedient. Upon written request of the Contractor, the Owner shall furnish to the Contractor a detailed accounting of the costs incurred by the Owner in finishing the Work.

§ 14.2.3 When the Owner terminates the Contract for one of the reasons stated in Section 14.2.1, the Contractor shall not be entitled to receive further payment until the Work is finished.

§ 14.2.4 If the unpaid balance of the Contract Sum exceeds costs of finishing the Work, including compensation for the Architect's services and expenses made necessary thereby, and other damages incurred by the Owner and not expressly waived, such excess shall be paid to the Contractor. If such costs and damages exceed the unpaid balance, the Contractor shall pay the difference to the Owner. The amount to be paid to the Contractor or Owner, as the case may be, shall be certified by the Initial Decision Maker, upon application, and this obligation for payment shall survive termination of the Contract.

§ 14.3 SUSPENSION BY THE OWNER FOR CONVENIENCE

§ 14.3.1 The Owner may, without cause, order the Contractor in writing to suspend, delay or interrupt the Work in whole or in part for such period of time as the Owner may determine.

§ 14.3.2 The Contract Sum and Contract Time shall be adjusted for increases in the cost and time caused by suspension, delay or interruption as described in Section 14.3.1. Adjustment of the Contract Sum shall include profit. No adjustment shall be made to the extent

- .1 that performance is, was or would have been so suspended, delayed or interrupted by another cause for which the Contractor is responsible; or
- .2 that an equitable adjustment is made or denied under another provision of the Contract.

§ 14.4 TERMINATION BY THE OWNER FOR CONVENIENCE

§ 14.4.1 The Owner may, at any time, terminate the Contract for the Owner's convenience and without cause.

§ 14.4.2 Upon receipt of written notice from the Owner of such termination for the Owner's convenience, the Contractor shall

- .1 cease operations as directed by the Owner in the notice;
- .2 take actions necessary, or that the Owner may direct, for the protection and preservation of the Work; and
- .3 except for Work directed to be performed prior to the effective date of termination stated in the notice, terminate all existing subcontracts and purchase orders and enter into no further subcontracts and purchase orders.

§ 14.4.3 In case of such termination for the Owner's convenience, the Contractor shall be entitled to receive payment for Work executed, and costs incurred by reason of such termination, along with reasonable overhead and profit on the Work not executed.

ARTICLE 15 CLAIMS AND DISPUTES

§ 15.1 CLAIMS

§ 15.1.1 DEFINITION

A Claim is a demand or assertion by one of the parties seeking, as a matter of right, payment of money, or other relief with respect to the terms of the Contract. The term "Claim" also includes other disputes and matters in question between the Owner and Contractor arising out of or relating to the Contract. The responsibility to substantiate Claims shall rest with the party making the Claim.

§ 15.1.2 NOTICE OF CLAIMS

Claims by either the Owner or Contractor must be initiated by written notice to the other party and to the Initial Decision Maker with a copy sent to the Architect, if the Architect is not serving as the Initial Decision Maker. Claims by either party must be initiated within 21 days after occurrence of the event giving rise to such Claim or within 21 days after the claimant first recognizes the condition giving rise to the Claim, whichever is later.

§ 15.1.3 CONTINUING CONTRACT PERFORMANCE

Pending final resolution of a Claim, except as otherwise agreed in writing or as provided in Section 9.7 and Article 14, the Contractor shall proceed diligently with performance of the Contract and the Owner shall continue to make payments in accordance with the Contract Documents. The Architect will prepare Change Orders and issue Certificates for Payment in accordance with the decisions of the Initial Decision Maker.

§ 15.1.4 CLAIMS FOR ADDITIONAL COST

If the Contractor wishes to make a Claim for an increase in the Contract Sum, written notice as provided herein shall be given before proceeding to execute the Work. Prior notice is not required for Claims relating to an emergency endangering life or property arising under Section 10.4.

§ 15.1.5 CLAIMS FOR ADDITIONAL TIME

§ 15.1.5.1 If the Contractor wishes to make a Claim for an increase in the Contract Time, written notice as provided herein shall be given. The Contractor's Claim shall include an estimate of cost and of probable effect of delay on progress of the Work. In the case of a continuing delay, only one Claim is necessary.

§ 15.1.5.2 If adverse weather conditions are the basis for a Claim for additional time, such Claim shall be documented by data substantiating that weather conditions were abnormal for the period of time, could not have been reasonably anticipated and had an adverse effect on the scheduled construction.

§ 15.1.6 CLAIMS FOR CONSEQUENTIAL DAMAGES

The Contractor and Owner waive Claims against each other for consequential damages arising out of or relating to this Contract. This mutual waiver includes

- .1 damages incurred by the Owner for rental expenses, for losses of use, income, profit, financing, business and reputation, and for loss of management or employee productivity or of the services of such persons; and
- .2 damages incurred by the Contractor for principal office expenses including the compensation of personnel stationed there, for losses of financing, business and reputation, and for loss of profit except anticipated profit arising directly from the Work.

This mutual waiver is applicable, without limitation, to all consequential damages due to either party's termination in accordance with Article 14. Nothing contained in this Section 15.1.6 shall be deemed to preclude an award of liquidated damages, when applicable, in accordance with the requirements of the Contract Documents.

§ 15.2 INITIAL DECISION

§ 15.2.1 Claims, excluding those arising under Sections 10.3, 10.4, 11.3.9, and 11.3.10, shall be referred to the Initial Decision Maker for initial decision. The Architect will serve as the Initial Decision Maker, unless otherwise indicated in the Agreement. Except for those Claims excluded by this Section 15.2.1, an initial decision shall be required as a condition precedent to mediation of any Claim arising prior to the date final payment is due, unless 30 days have passed after the Claim has been referred to the Initial Decision Maker with no decision having been rendered. Unless the Initial Decision Maker and all affected parties agree, the Initial Decision Maker will not decide disputes between the Contractor and persons or entities other than the Owner.

§ 15.2.2 The Initial Decision Maker will review Claims and within ten days of the receipt of a Claim take one or more of the following actions: (1) request additional supporting data from the claimant or a response with supporting data from the other party, (2) reject the Claim in whole or in part, (3) approve the Claim, (4) suggest a compromise, or (5) advise the parties that the Initial Decision Maker is unable to resolve the Claim if the Initial Decision Maker lacks sufficient information to evaluate the merits of the Claim or if the Initial Decision Maker concludes that, in the Initial Decision Maker's sole discretion, it would be inappropriate for the Initial Decision Maker to resolve the Claim.

§ 15.2.3 In evaluating Claims, the Initial Decision Maker may, but shall not be obligated to, consult with or seek information from either party or from persons with special knowledge or expertise who may assist the Initial Decision Maker in rendering a decision. The Initial Decision Maker may request the Owner to authorize retention of such persons at the Owner's expense.

§ 15.2.4 If the Initial Decision Maker requests a party to provide a response to a Claim or to furnish additional supporting data, such party shall respond, within ten days after receipt of such request, and shall either (1) provide a response on the requested supporting data, (2) advise the Initial Decision Maker when the response or supporting data will be furnished or (3) advise the Initial Decision Maker that no supporting data will be furnished. Upon receipt of the response or supporting data, if any, the Initial Decision Maker will either reject or approve the Claim in whole or in part.

§ 15.2.5 The Initial Decision Maker will render an initial decision approving or rejecting the Claim, or indicating that the Initial Decision Maker is unable to resolve the Claim. This initial decision shall (1) be in writing; (2) state the reasons therefor; and (3) notify the parties and the Architect, if the Architect is not serving as the Initial Decision Maker, of any change in the Contract Sum or Contract Time or both. The initial decision shall be final and binding on the parties but subject to mediation and, if the parties fail to resolve their dispute through mediation, to binding dispute resolution.

§ 15.2.6 Either party may file for mediation of an initial decision at any time, subject to the terms of Section 15.2.6.1.

§ 15.2.6.1 Either party may, within 30 days from the date of an initial decision, demand in writing that the other party file for mediation within 60 days of the initial decision. If such a demand is made and the party receiving the demand fails to file for mediation within the time required, then both parties waive their rights to mediate or pursue binding dispute resolution proceedings with respect to the initial decision.

§ 15.2.7 In the event of a Claim against the Contractor, the Owner may, but is not obligated to, notify the surety, if any, of the nature and amount of the Claim. If the Claim relates to a possibility of a Contractor's default, the Owner may, but is not obligated to, notify the surety and request the surety's assistance in resolving the controversy.

§ 15.2.8 If a Claim relates to or is the subject of a mechanic's lien, the party asserting such Claim may proceed in accordance with applicable law to comply with the lien notice or filing deadlines.

§ 15.3 MEDIATION

§ 15.3.1 Claims, disputes, or other matters in controversy arising out of or related to the Contract except those waived as provided for in Sections 9.10.4, 9.10.5, and 15.1.6 shall be subject to mediation as a condition precedent to binding dispute resolution.

§ 15.3.2 The parties shall endeavor to resolve their Claims by mediation which, unless the parties mutually agree otherwise, shall be administered by the American Arbitration Association in accordance with its Construction Industry Mediation Procedures in effect on the date of the Agreement. A request for mediation shall be made in writing, delivered to the other party to the Contract, and filed with the person or entity administering the mediation. The request may be made concurrently with the filing of binding dispute resolution proceedings but, in such event, mediation shall proceed in advance of binding dispute resolution proceedings, which shall be stayed pending mediation for a period of 60 days from the date of filing, unless stayed for a longer period by agreement of the parties or court order. If an arbitration is stayed pursuant to this Section 15.3.2, the parties may nonetheless proceed to the selection of the arbitrator(s) and agree upon a schedule for later proceedings.

§ 15.3.3 The parties shall share the mediator's fee and any filing fees equally. The mediation shall be held in the place where the Project is located, unless another location is mutually agreed upon. Agreements reached in mediation shall be enforceable as settlement agreements in any court having jurisdiction thereof.

§ 15.4 ARBITRATION

§ 15.4.1 If the parties have selected arbitration as the method for binding dispute resolution in the Agreement, any Claim subject to, but not resolved by, mediation shall be subject to arbitration which, unless the parties mutually agree otherwise, shall be administered by the American Arbitration Association in accordance with its Construction Industry Arbitration Rules in effect on the date of the Agreement. A demand for arbitration shall be made in writing, delivered to the other party to the Contract, and filed with the person or entity administering the arbitration. The

party filing a notice of demand for arbitration must assert in the demand all Claims then known to that party on which arbitration is permitted to be demanded.

§ 15.4.1.1 A demand for arbitration shall be made no earlier than concurrently with the filing of a request for mediation, but in no event shall it be made after the date when the institution of legal or equitable proceedings based on the Claim would be barred by the applicable statute of limitations. For statute of limitations purposes, receipt of a written demand for arbitration by the person or entity administering the arbitration shall constitute the institution of legal or equitable proceedings based on the Claim.

§ 15.4.2 The award rendered by the arbitrator or arbitrators shall be final, and judgment may be entered upon it in accordance with applicable law in any court having jurisdiction thereof.

§ 15.4.3 The foregoing agreement to arbitrate and other agreements to arbitrate with an additional person or entity duly consented to by parties to the Agreement shall be specifically enforceable under applicable law in any court having jurisdiction thereof.

§ 15.4.4 CONSOLIDATION OR JOINDER

§ 15.4.4.1 Either party, at its sole discretion, may consolidate an arbitration conducted under this Agreement with any other arbitration to which it is a party provided that (1) the arbitration agreement governing the other arbitration permits consolidation, (2) the arbitrations to be consolidated substantially involve common questions of law or fact, and (3) the arbitrations employ materially similar procedural rules and methods for selecting arbitrator(s).

§ 15.4.4.2 Either party, at its sole discretion, may include by joinder persons or entities substantially involved in a common question of law or fact whose presence is required if complete relief is to be accorded in arbitration, provided that the party sought to be joined consents in writing to such joinder. Consent to arbitration involving an additional person or entity shall not constitute consent to arbitration of any claim, dispute or other matter in question not described in the written consent.

§ 15.4.4.3 The Owner and Contractor grant to any person or entity made a party to an arbitration conducted under this Section 15.4, whether by joinder or consolidation, the same rights of joinder and consolidation as the Owner and Contractor under this Agreement.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 00 7300
SUPPLEMENTARY CONDITIONS

PART 1 GENERAL

1.01 SUMMARY

- A. These Supplementary Conditions amend and supplement the General Conditions defined in Document 00 7200 - General Conditions and other provisions of Contract Documents as indicated within. Provisions that are not so amended or supplemented remain in full force and effect.
- B. The terms used in these Supplementary Conditions that are defined in the General Conditions have the meanings assigned to them in the General Conditions.

END OF SECTION

SUPPLEMENTARY CONDITIONS

Part 1 – Supplementary Conditions

It is understood and agreed that by submitting a bid that the Contractor has examined these contract documents, drawings and specifications and has visited the site of the Work, and has satisfied himself relative to the Work to be performed.

1.1 Tax Exempt

The OWNER is not responsible for and will not pay local or state taxes. Our New York State tax exemption number is 16-1558843.

1.2 Type of Contract Resulting from Bid

A Firm-Fixed-Fee contract for Scope of Work provided in quoting.

1.3 Fairness of Pricing

Owner shall pay the contract price contained in the winning Contractors proposal and the successful Contractor warrants that such price is no higher than the Contractors current prices on orders by others for products of the kind and specification covered by this agreement for similar quantities under similar or like conditions and method of purchase. In the event Contractor breaches this warranty, the prices of the items shall be reduced to the Contractors current prices on orders and overpricing refunded to the Owner within 30 days or, the alternative, Owner may cancel the contract, which will be issued upon award, without liability to Contractor for breach or Contractors actual expense.

1.4 Covenants Against Kickbacks

The Owner will not tolerate Kickbacks in any form.

- A.** OWNER defines a "Kickback" as any cash, fee, commission, and gift, an item of value or compensation of any kind in exchange for favorable treatment in obtaining or retaining any purchase order or securing a contract with Owner.
- B.** Contractor agrees that its officers or employees have not and will not provide or attempt to provide, either directly or indirectly, any Kickback to any employees of the SRMT, its enterprises, agents, government or any member of the Tribe in an attempt to influence a decision.
- C.** Failure to abide by this specific section shall be sufficient reason for the immediate termination, without further notice, of this and any other purchase order or contract the Contractor currently has with Owner.

1.5 Subcontractors

All subcontractors must be approved by Owner. The use of subcontractors does not relieve the Contractor of any responsibility to Owner. Additional information about subcontractors may be requested before award. The intention of the Contractor to use subcontractors must be stated in Tab 1 of the response in the Installation Plan. The subcontractor's qualifications must be placed in Tab 2 behind the Contractors Company Information to include: subcontractor name, years of experience, qualifications, applicable training, and references.

The Contractor must identify any and all subcontractors he plans to use on this project. Failure

to disclose the use of subcontractors may lead to disqualification after award of contract.

1.6 Omissions

Omission in the Proposal of any provision herein described shall not be construed as to relieve the Contractor of any responsibility or obligation to complete and satisfactorily deliver, operate, and support any and all equipment or services.

1.7 Commencement of Work

Commencement of the Work shall be subject to the discretion of the Owner and the Owner reserves the right to make all decisions regarding such commencement.

1.8 Codes, Permits and Inspections

A. The Contractor shall obtain the required permits, if required, give all notices, and comply with all Federal, State and Tribal laws, ordinances, codes, rules and regulations bearing on the conduct of the work under this contract. If the Contractor observes that the drawings and specifications are at variance therewith, he shall promptly notify the Owner in writing. If the Contractor performs any work knowing it to be contrary to such laws, ordinances, codes, rules and regulations, and without such notice to the Owner, he shall bear all cost arising there from.

B. The latest version of the National Electric Code, along with the National Electric Safety Code, shall be followed. If local regulations or codes are more stringent, then those requirements shall govern and Contractor shall advise the Project Manager of the applicable code.

1.9 Materials, Equipment and Employees

The contractor shall, unless otherwise specified, supply and pay for all labor, transportation, materials, tools, apparatus, lights, power, fuel, sanitary facilities and incidentals necessary for the completion of his work, and shall install, maintain and remove all equipment of the construction, other utensils or things, and construct in the best and most workmanlike manner, a complete job and everything incidental thereto, as shown on the plans, stated in the specifications, or reasonably implied there from, all in accordance with the contract documents.

All materials shall be new and of quality specified, except where reclaimed material is authorized herein and approved for use. Workmanship shall at all times be of grade accepted as the best practice of the particular trade involved, and as stipulated in written standards of recognized organizations or institutes of the respective trades except as exceeded or qualified by the specification.

If at any time during the construction and completion of the work covered by these contract documents, the conduct of any workman of the various crafts is adjudged a nuisance to the Owner or if any workman be considered detrimental to the work, the Contractor shall order such parties removed immediately from the site.

The Contractor shall designate a foreman/superintendent who shall direct the work.

1.10 General Site Conditions

Work will need to be coordinated to allow occupancy or minimal lapse in electrical services or if required only done when electrical services in occupied area is not required.

1.11 Safety Requirements

The Contractor shall be responsible for the entire site and the construction of the same and provide all the necessary protections as required by laws or ordinances governing such conditions and as required by the Owner or Designer. He shall be responsible for any damage to the Owner's property or that of others on the job, by himself, his personnel or his subcontractors, and shall make good such damages. He shall be responsible for and pay for any claims against the Owner arising from such damages.

The Contractor shall adhere to the rules, regulations and interpretations of the New York State Department of labor relating to Occupational Safety and Health Standards for the Construction Industry, and any revisions thereto as adopted by General Statutes of New York.

The Contractor shall provide all necessary safety measures for the protection of all persons on the work, and shall fully comply with all state laws or regulations and New York State Building Code requirements to prevent accident or injury to persons on or about the location of the work. He shall clearly mark or post signs warning of hazards existing, barricades, and take necessary safety measures to protect the public and the Owner's employees during all construction operations.

1.12 Project Timelines

The actual sequence and duration of the work activities requested will be coordinated and directed by the Owner's Project Office at its sole discretion.

1.13 Authority of Owner

Notwithstanding any other provisions of the Contract to the contrary, the Contractor, once its activities begin on the Site, shall comply with the site rules of Owner. The Contractor shall direct its personnel and subcontractors to respect and abide by the authority of the Owner and the Project Manager on all matters related to the Contractors operation at the Site, including but not limited to:

- A.** Use of Site resources such as elevators and loading docks
- B.** Connection to and use of utilities
- C.** Safety Issues
- D.** Trash Removal and Site cleanliness
- E.** Site Security

1.14 Use of Premise

- A.** Contractor shall at all times conduct his operations to ensure the least inconvenience to the public and employees. Very limited disruptions to service will be allowed during peak business hours.
- B.** Confine storage of materials to areas as approved by the project office.
- C.** Contractor shall provide adequate signing and barricades and take necessary safety measures to protect the public during all construction operations.
- D.** The Contractor shall keep the sites and surrounding area reasonably free from rubbish

at all times and shall remove debris from the site from time to time or when directed to do so by the Owner. Before final inspection and acceptance of the project, the Contractor shall thoroughly clean the sites, and completely prepare the project and site for use by the Owner.

- E. The Contractor shall be responsible for any and all damages to portions of the building caused by it, its employees or subcontractors; including but not limited to:
 - a. Damage to any portion of the building caused by the movement of tools, materials, or equipment.
 - b. Damage to any component, including ceiling tiles, of the construction of spaces in which the Contractor is working.
 - c. Damage to the electrical distribution system and/or other space "turned over" to the Contractor.
 - d. Damage to the electrical, mechanical, and/or life safety or other systems caused by inappropriate operation or connections made by the Contractor or other actions of Contractor.
 - e. Other Damage to the materials, tools and/or equipment of Owner, its consultants, subcontractors, Architect, other contractors, agents and leases.

1.15 Bonding

Performance and Payment Bonds shall be required for any contract over \$1,000,000.00 or if Owner is seeking outside funding for project completion in the sum of one hundred (100%) of contract amount.

Contractor shall furnish a Performance and Payment Bond executed by a surety company authorized to do business in New York State. The bonds shall be in full contract amount. All bonds shall be countersigned by an authorized agent of the bonding company who is licensed to do business in New York State.

- A. Owner requires a surety bond with an A.M. BEST rating of "A".
- B. If required, successful Contractor with have fifteen (15) days from date of notification of award of proposal to furnish to the Owner, including but not limited to, contracts, bonds, certificates of insurance, otherwise the proposal award may be withdrawn and awarded to the next lowest responsible proposal or completely rejected and re-solicited at the discretion of the Owner.
- C. If any subcontractors are included or involved in your performance of contract provisions, Owner reserves the right to require a 100% Payment Bond.

1.16 Guarantee

The Contractor shall unconditionally guarantee materials and workmanship against patent defects arising from faulty materials, faulty workmanship or negligence for a period of twelve (12) months following the final acceptance of the work and shall replace such defective materials or workmanship without cost to the Owner.

Where items of equipment or material carry a manufacturer's warranty for any period in excess of twelve (12) months, then the manufacturer's warranty shall apply for that particular piece of equipment or material. The Contractor shall replace such defective equipment or materials, without cost to the Owner, within the manufacturer's warranty period.

Contractor shall tag each piece of new equipment with information about one year warranty

as well as manufacturer's warranty information to include: contact information for local warrantee coverage.

1.17 Independent Contractor

In performing the obligations required by the Contract, the Contractor will act as an independent contractor and not as an employee or agent of the Owner.

1.18 Contractor – Subcontractor Relationships

The Contractor agrees that the terms of these contract documents shall apply equally to a subcontractor as to the Contractor, and that the subcontractor is bound by those terms as an employee of the Contractor.

1.19 Hold Harmless Provisions

The Contractor shall hold the OWNER harmless from and indemnify the OWNER against any and all claims, demands and actions based upon or arising out of any activities performed by the Contractor and its employees and agents under this Contract and shall, at the request of the OWNER, defend any and all actions brought against the OWNER based upon any such claims or demands.

1.20 Change Orders

Change orders will be approved in writing after notice to the OWNER of the necessary modification. No additional/modified work will commence until the CONTRACTOR has received an approved Change Order, and Purchase Order if required.

1.21 Invoices for Payment

The CONTRACTOR may submit pay applications on Standard AIA form. Application for payment shall be itemized and supported by substantiating data as required by the Owner with a schedule of values for partial payments. Contractor is also required to submit an unconditional waiver and release upon progress payment with every pay application. A 10% retainage will be required.

Final payment will be made upon acceptance of the Contractor's work by the Owner. The Contractor shall forward the application for final payment along with the following documents: Consent of surety to final payment, if required; Contractor's Affidavit of Release of Lien AIA document G706A (properly signed, notarized with no exceptions); Contractor's Affidavit of Payments of Debts and Claims AIA document G706 (properly signed, notarized with no exceptions) and all other documents further described in the closeout check list included in this agreement.

1.22 Insurance Coverage

During the term of the contract, the contractor at its sole cost and expense shall provide proof of commercial insurance of such type and with such terms and limits as may be reasonably associated with the contract. As a minimum, the contractor shall provide and maintain the following coverage and limits and naming OWNER as additional insured:

A. Worker's Compensation - The Contractor shall provide and maintain Worker's Compensation Insurance, as required by the laws of New York, as well as employer's liability coverage with minimum limits of

\$1,000,000.00, covering all of contractor's employees who are engaged in any work under the contract. If any work is sublet, the contractor shall require the subcontractor to provide the same coverage for any of his employees engaged in any work under the contract.

B. Commercial General Liability – General Liability Coverage on a comprehensive broad form on an occurrence basis in the minimum amounts of \$1,000,000.00 combined single limit naming OWNER as additional insured.

C. Automobile – Automobile Liability Insurance, to include liability coverage, covering all owned, hired and non- owned vehicles used in connection with the contract. The minimum combined single limit shall be \$1, 000, 000.00 bodily injury and property damage; \$500,000.00 uninsured/under insured motorist.

D. Requirements – Providing and maintaining adequate insurance coverage is a material obligation of the contractor and is of the essence of this contract. All such insurance shall meet all laws of the State of New York. Such insurance coverage shall be obtained from companies that are authorized to provide such coverage and that are authorized by the Commissioner of Insurance to do business in New York. The Contractor shall at all times comply with the terms of such insurance policies and all requirements of the insurer under any such insurance policies, except as they may conflict with New York laws or this contract. The limits of coverage under each insurance policy maintained by the contractor shall not be interpreted as limiting the contractor's liability and obligations under the contract.

1.23 Target Business Program

Contractor acknowledges that the St. Regis Mohawk Tribe has a policy to establish and implement its Targeted Business Program (the "TBE Program"). This Program will allow additional consideration to be given to Tribal Member Contractor's in selection of qualified Subcontractors for the Project. In consideration of this proposal Contractor agrees to satisfy this policy and to provide information regarding its actions intended to satisfy this policy that is requested by the St. Regis Mohawk Tribe.

1.24 Compliance with Law

The Contractor shall comply with all applicable federal, NY State, Tribal laws, regulations and local ordinances in the performance of the Contract.

1.25 Audit Provisions

The OWNER shall have the right at reasonable times and at a site designated by the OWNER, to audit the books, documents and records of the Contractor to the extent that the books, documents and records relate to costs or pricing data for the Contract. The Contractor agrees to maintain records which will support the prices charged and costs incurred for the Contract.

The Contractor shall preserve books, documents, and records that relate to costs or pricing data for the Contract for a period of one (1) year from date of final payment. The Contractor shall give full and free access to all records to the OWNER and/or their authorized representatives.

1.26 Default

The OWNER may, subject to the provisions of Section Force Majeure, and in addition to its other rights under the Contract, declare the Contractor in default by written notice thereof to

the Contractor, and terminate (as provided in Section named, Termination Provisions) the whole or any part of this Contract including a purchase order, for any of the following reasons:

- A.** Failure to deliver the awarded item(s) within the time specified in the Contract or contract purchase order or as otherwise specified;
- B.** Improper delivery;
- C.** Failure to provide an item(s) which is in conformance with the specifications referenced in the Invitation for Bids;
- D.** Delivery of a defective item;
- E.** Failure or refusal to remove and replace any item(s) rejected as defective or nonconforming within fifteen (15) days after notification;
- F.** Insolvency or bankruptcy;
- G.** Failure to protect, to repair, or to make good any damage or injury to property; or
- H.** Breach of any provision of this Contract.
 - a.** In the event that the OWNER terminate this Contract in whole or in part as provided in Subparagraph a. above, the OWNER may procure, upon such terms and in such manner as it determines, on item(s) similar or identical to those so terminated, and the Contractor shall be liable to the OWNER for any reasonable excess costs for such similar or identical item(s) included within the terminated part of the Contract.
 - b.** If the Contract is terminated in whole or in part as provided in Subparagraph a. above, the OWNER, in addition to any other rights provided in this paragraph, may require the Contractor to transfer title and deliver immediately to the OWNER in the manner and to the extent directed by the Purchasing Department, such partially manufactured or delivered item(s) as the Contractor has specifically produced or specifically acquired for the performance of such part of the Contract as it has been terminated. Except as provided below. Payment for any partially manufactured or delivered item(s). Such sum as the OWNER determines to be necessary to protect the OWNER against loss.
 - c.** The rights and remedies of the OWNER provided in this paragraph shall not be exclusive and are in addition to any other rights and remedies provided by law or under this Contract.
 - d.** The OWNER's failure to exercise any rights or remedies provided in this paragraph shall not be construed to be a waiver by the OWNER of its rights and remedies in regard to the event of default or any succeeding event of default.

1.27 Force Majeure

Neither party will incur any liability to the other of its performance of any obligation under this Contract is prevented or delayed by causes beyond its control and without fault or negligence of either party. Causes beyond a party's control may include, but are not limited to, acts of God or war, changes in controlling law, regulations, orders or severe weather conditions, civil disorders, natural disasters, fire, epidemics and quarantines, general strikes throughout the trade, and freight embargoes.

The Contractor shall notify the OWNER orally within five (5) days and in writing within ten (10)

days of the date on which the Contractor becomes aware, or should have reasonably become aware, that such cause would prevent or delay its performance. Such notification shall (i) describe fully such cause(s) and its effect on performance, (ii) state whether performance under the contract is prevented or delayed and (iii) if performance is delayed, state a reasonable estimate of the duration of the delay. The Contractor shall have the burden of proving that such cause(s) delayed or prevented its performance despite its diligent efforts to perform and shall produce such supporting documentation as the OWNER may reasonably request. After receipt of such notification, the OWNER may effect to cancel the Contract or to extend the time for performance as reasonably necessary to compensate for the Contractor's delay.

1.28 Termination Provisions

The OWNER has the right to terminate this Contract for any of the following reasons. Termination shall be effective upon written notice to the Contractor.

- A. Termination for Convenience:** The OWNER shall have the right to terminate the Contract or a purchase order for its convenience if the OWNER determines termination to be in its best interest. The Contractor shall be paid for work satisfactorily completed prior to the effective date of the termination, but in no event shall the Contractor be entitled to recover loss of profits.
- B. Termination for Cause:** The OWNER shall have the right to terminate the Contract for Contractor default under Section named, Default, upon written notice to the Contractor. The OWNER shall also have the right, upon written notice to the Contractor, to terminate the Contract or a purchase order for other cause as specified in this Contract or by law. If it is later determined that the OWNER erred in terminating the Contract or a contract purchase order for cause, then at the OWNER's discretion, the Contract shall be deemed to have been terminated for convenience under the Section named Termination.

1.29 Assignability and Subcontracting

Subject to the terms and conditions, the Contract shall be binding upon the parties and their respective successors and assigns.

1.30 Licensing

Non-Gaming Vendors may be required to submit a GSR application if total annual purchases exceed \$50,000 but only when deemed necessary by the tribal gaming commission.

1.34 Project Closeout

A. General

- a. Furnish to the Owner, operation and maintenance manuals, if applicable.
- b. The Contractor and all Subcontractors and interested parties shall be present at all inspections as set forth in this section and as specified elsewhere in agreement.
- c. The project closeout documentation check list, as shown and described in this section, shall be completed by the Prime Contractor and all items required for closeout shall be delivered to the Owner in two (2) copies bound in a three-ring notebook binder.
- d. Comply with all items as listed in this section.

B. Final Inspections

- a. This project shall have both a Pre-Final inspection and a Final Inspections made before it is finally accepted by the Owner.
- b. The Pre-Final Inspection shall be held after all service areas are in place and in operation.
- c. The Final Inspection shall be held with the Owner, the Contractor and Subcontractors to demonstrate to the Owner that all areas are to specifications as defined in proposal and to their satisfaction.

C. Closeout Documentation Checklist

- a. The Contractor shall furnish all letters, warranties, reports, certificates, certification and all other items as required on the closeout checklist as shown at the end of this section before contract retainage amount shall be released.

A. Substantial Completion

- a. Substantial completion is the date that the Owner and Designer determine the project is complete enough for the Owner to achieve beneficial occupancy. It is also the date that begins the warranty periods.

B. Final Completion

Please refer to the Check list below for a detailed listing of documentation, certification and submittals required for Final Completion and Final Payment.

The following closeout items must be submitted by the Contractor before final payment. Two copies of each will be required.

- _____ 1. Executed Certificate of Substantial Completion with attached punch list.
- _____ 2. Executed Final Change Order (If applicable).
- _____ 3. Final Application for Payment.
- _____ 4. Consent of Surety to Final Payment (If applicable).
- _____ 5. Contractor's Affidavit of Release of Liens (properly signed, notarized, with no exceptions) AIA document G706A.
- _____ 6. Contractor's Affidavit of Payments of Debts and Claims (properly signed, notarized, with no exceptions) AIA document G706.
- _____ 7. Properly executed release of liens by subcontractors and/or Contractors (If applicable).
- _____ 8. Approved Inspection Certificates by local authorities having jurisdiction (If applicable).

_____ **9. Contractor's One-Year Warranty (notarized).**

_____ **10. Warranty summary sheet and original warranties for specific items.**

_____ **11. List of all subcontractors and suppliers with names, addresses, and phone numbers (especially emergency numbers).**

_____ **12. Operations and Maintenance Manuals (If applicable).**

Contractor's signature

Date

Exhibit A

CERTIFICATION REGARDING DRUG-FREE WORKPLACE:

The CONTRACTOR certifies that he will provide a drug-free workplace by:

(a) publishing a statement notifying employees that the unlawful manufacture, distribution, dispensing, possession or use of a controlled substance is prohibited in the CONTRACTOR's workplace and specifying the actions that will be taken against employees for violation of such prohibition;

(b) establishing a drug-free awareness program to inform employees about:

(1) The dangers of drug abuse in the workplace;

(2) The CONTRACTOR's policy on maintaining a drug-free workplace;

(3) Any available drug counseling, rehabilitation, and employee assistance programs; and,

(4) The penalties that may be imposed upon employees for drug abuse violations occurring in the workplace;

(c) Making it a requirement that each employee to be engaged in the performance of this Agreement be given a copy of the statement required by paragraph (a);

(d) Notifying the employee in the statement required by paragraph (a) that, as a condition of employment under this Agreement, the employee will:

(1) Abide by the terms of the statement; and

(2) Notify the employer of any criminal drug statute conviction for a violation occurring in the workplace no later than five days after such conviction;

(e) Notifying the OWNER within ten days after receiving notice under subparagraph (d)(2) from an employee or otherwise receiving actual notice of such conviction;

(f) Taking one of the following actions, within 30 days of receiving notice under subparagraph (d)(2), with respect to any employee who is so convicted:

(1) Taking appropriate personnel action against such an employee, up to and including termination; or

(2) requiring such employee to participate satisfactorily in a drug abuse assistance or rehabilitation program approved for such purposes by a Federal, State or local health, law enforcement, or other appropriate agency;

(g) Making a good faith effort to continue to maintain a drug-free workplace through implementation of paragraphs (a), (b), (c), (d), (e) and (f).

As the CONTRACTOR/duly authorized representative of the CONTRACTOR, I hereby certify the above:

Signature: _____
Name (print): _____ Date: _____
Title: _____

Exhibit B
UNCONDITIONAL WAIVER AND RELEASE
UPON PROGRESS PAYMENT

The undersigned has received a progress payment in the sum of _____ for labor, services, equipment or materials.

Furnished to: AKWESASNE MOHAWK CASINO

On the job of: (_____)

Located at: Akwesasne Mohawk Casino

873 State Rt. 37

Hogansburg, NY 13655

And does hereby release any mechanic's lien, stop notice, or bond right that the undersigned has on the above referenced job to the following extent. This release covers a progress payment for labor, services, equipment or material

Furnished to: AKWESASNE MOHAWK CASINO

Date: _____

Only and does not cover any retention retained before or after the release date; extras furnished before the release date for which payment has not been received; extras or items furnished under written change order which has been fully executed by the parties prior to the release date are covered by this release unless specifically reserved by the claimant in the release. This release of any mechanic's lien, stop notice, or bond right shall not otherwise affect the contract rights, including rights between parties to the contract based upon a rescission, abandonment, or breach of the contract, or the right of the undersigned to recover compensation for furnished labor, services, equipment or material was not compensated by the progress payment.

Date: _____

Company: _____

Print name and title: _____

Signature: _____

DRAFT AIA® Document A312™ – 2010

Performance Bond

CONTRACTOR:

(Name, legal status and address)

« »
« »

SURETY:

(Name, legal status and principal place of business)

« »
« »

OWNER:

(Name, legal status and address)

«Akwasne Mohawk Casino & Resort»
«873 New York Route 37
Hogansburg, New York 13655»

CONSTRUCTION CONTRACT

Date: « »

Amount: \$ « »

Description:

(Name and location)

«22012-AMCR-Tavern Kitchen»
«873 New York Route 37
Hogansburg, New York 13655»

BOND

Date:

(Not earlier than Construction Contract Date)

« »

Amount: \$ « »

Modifications to this « » None « » See Section 16

Bond:

CONTRACTOR AS PRINCIPAL

Company: (Corporate Seal)

Signature: « »

Name and « »

Title:

SURETY

Company: (Corporate Seal)

Signature: « »

Name and « »

Title:

(Any additional signatures appear on the last page of this Performance Bond.)

(FOR INFORMATION ONLY — Name, address and telephone)

AGENT or BROKER:

« »
« »
« »

OWNER'S REPRESENTATIVE:

(Architect, Engineer or other party:)

«Scott Freeman»
«873 New York Route 37
Hogansburg, New York 13655»
«Telephone Number: 518-358-2222»
«Fax Number: 518-358-4047»
«SFreeman@mohawkasino.com »
« »

ADDITIONS AND DELETIONS:

The author of this document has added information needed for its completion. The author may also have revised the text of the original AIA standard form. An Additions and Deletions Report that notes added information as well as revisions to the standard form text is available from the author and should be reviewed.

This document has important legal consequences. Consultation with an attorney is encouraged with respect to its completion or modification.

Any singular reference to Contractor, Surety, Owner or other party shall be considered plural where applicable.

ELECTRONIC COPYING of any portion of this AIA® Document to another electronic file is prohibited and constitutes a violation of copyright laws as set forth in the footer of this document.

§ 1 The Contractor and Surety, jointly and severally, bind themselves, their heirs, executors, administrators, successors and assigns to the Owner for the performance of the Construction Contract, which is incorporated herein by reference.

§ 2 If the Contractor performs the Construction Contract, the Surety and the Contractor shall have no obligation under this Bond, except when applicable to participate in a conference as provided in Section 3.

§ 3 If there is no Owner Default under the Construction Contract, the Surety's obligation under this Bond shall arise after

- .1** the Owner first provides notice to the Contractor and the Surety that the Owner is considering declaring a Contractor Default. Such notice shall indicate whether the Owner is requesting a conference among the Owner, Contractor and Surety to discuss the Contractor's performance. If the Owner does not request a conference, the Surety may, within five (5) business days after receipt of the Owner's notice, request such a conference. If the Surety timely requests a conference, the Owner shall attend. Unless the Owner agrees otherwise, any conference requested under this Section 3.1 shall be held within ten (10) business days of the Surety's receipt of the Owner's notice. If the Owner, the Contractor and the Surety agree, the Contractor shall be allowed a reasonable time to perform the Construction Contract, but such an agreement shall not waive the Owner's right, if any, subsequently to declare a Contractor Default;
- .2** the Owner declares a Contractor Default, terminates the Construction Contract and notifies the Surety; and
- .3** the Owner has agreed to pay the Balance of the Contract Price in accordance with the terms of the Construction Contract to the Surety or to a contractor selected to perform the Construction Contract.

§ 4 Failure on the part of the Owner to comply with the notice requirement in Section 3.1 shall not constitute a failure to comply with a condition precedent to the Surety's obligations, or release the Surety from its obligations, except to the extent the Surety demonstrates actual prejudice.

§ 5 When the Owner has satisfied the conditions of Section 3, the Surety shall promptly and at the Surety's expense take one of the following actions:

§ 5.1 Arrange for the Contractor, with the consent of the Owner, to perform and complete the Construction Contract;

§ 5.2 Undertake to perform and complete the Construction Contract itself, through its agents or independent contractors;

§ 5.3 Obtain bids or negotiated proposals from qualified contractors acceptable to the Owner for a contract for performance and completion of the Construction Contract, arrange for a contract to be prepared for execution by the Owner and a contractor selected with the Owner's concurrence, to be secured with performance and payment bonds executed by a qualified surety equivalent to the bonds issued on the Construction Contract, and pay to the Owner the amount of damages as described in Section 7 in excess of the Balance of the Contract Price incurred by the Owner as a result of the Contractor Default; or

§ 5.4 Waive its right to perform and complete, arrange for completion, or obtain a new contractor and with reasonable promptness under the circumstances:

- .1** After investigation, determine the amount for which it may be liable to the Owner and, as soon as practicable after the amount is determined, make payment to the Owner; or
- .2** Deny liability in whole or in part and notify the Owner, citing the reasons for denial.

§ 6 If the Surety does not proceed as provided in Section 5 with reasonable promptness, the Surety shall be deemed to be in default on this Bond seven days after receipt of an additional written notice from the Owner to the Surety demanding that the Surety perform its obligations under this Bond, and the Owner shall be entitled to enforce any remedy available to the Owner. If the Surety proceeds as provided in Section 5.4, and the Owner refuses the payment or the Surety has denied liability, in whole or in part, without further notice the Owner shall be entitled to enforce any remedy available to the Owner.

§ 7 If the Surety elects to act under Section 5.1, 5.2 or 5.3, then the responsibilities of the Surety to the Owner shall not be greater than those of the Contractor under the Construction Contract, and the responsibilities of the Owner to

the Surety shall not be greater than those of the Owner under the Construction Contract. Subject to the commitment by the Owner to pay the Balance of the Contract Price, the Surety is obligated, without duplication, for

- .1 the responsibilities of the Contractor for correction of defective work and completion of the Construction Contract;
- .2 additional legal, design professional and delay costs resulting from the Contractor's Default, and resulting from the actions or failure to act of the Surety under Section 5; and
- .3 liquidated damages, or if no liquidated damages are specified in the Construction Contract, actual damages caused by delayed performance or non-performance of the Contractor.

§ 8 If the Surety elects to act under Section 5.1, 5.3 or 5.4, the Surety's liability is limited to the amount of this Bond.

§ 9 The Surety shall not be liable to the Owner or others for obligations of the Contractor that are unrelated to the Construction Contract, and the Balance of the Contract Price shall not be reduced or set off on account of any such unrelated obligations. No right of action shall accrue on this Bond to any person or entity other than the Owner or its heirs, executors, administrators, successors and assigns.

§ 10 The Surety hereby waives notice of any change, including changes of time, to the Construction Contract or to related subcontracts, purchase orders and other obligations.

§ 11 Any proceeding, legal or equitable, under this Bond may be instituted in any court of competent jurisdiction in the location in which the work or part of the work is located and shall be instituted within two years after a declaration of Contractor Default or within two years after the Contractor ceased working or within two years after the Surety refuses or fails to perform its obligations under this Bond, whichever occurs first. If the provisions of this Paragraph are void or prohibited by law, the minimum period of limitation available to sureties as a defense in the jurisdiction of the suit shall be applicable.

§ 12 Notice to the Surety, the Owner or the Contractor shall be mailed or delivered to the address shown on the page on which their signature appears.

§ 13 When this Bond has been furnished to comply with a statutory or other legal requirement in the location where the construction was to be performed, any provision in this Bond conflicting with said statutory or legal requirement shall be deemed deleted herefrom and provisions conforming to such statutory or other legal requirement shall be deemed incorporated herein. When so furnished, the intent is that this Bond shall be construed as a statutory bond and not as a common law bond.

§ 14 Definitions

§ 14.1 Balance of the Contract Price. The total amount payable by the Owner to the Contractor under the Construction Contract after all proper adjustments have been made, including allowance to the Contractor of any amounts received or to be received by the Owner in settlement of insurance or other claims for damages to which the Contractor is entitled, reduced by all valid and proper payments made to or on behalf of the Contractor under the Construction Contract.

§ 14.2 Construction Contract. The agreement between the Owner and Contractor identified on the cover page, including all Contract Documents and changes made to the agreement and the Contract Documents.

§ 14.3 Contractor Default. Failure of the Contractor, which has not been remedied or waived, to perform or otherwise to comply with a material term of the Construction Contract.

§ 14.4 Owner Default. Failure of the Owner, which has not been remedied or waived, to pay the Contractor as required under the Construction Contract or to perform and complete or comply with the other material terms of the Construction Contract.

§ 14.5 Contract Documents. All the documents that comprise the agreement between the Owner and Contractor.

§ 15 If this Bond is issued for an agreement between a Contractor and subcontractor, the term Contractor in this Bond shall be deemed to be Subcontractor and the term Owner shall be deemed to be Contractor.

§ 16 Modifications to this bond are as follows:

« »

(Space is provided below for additional signatures of added parties, other than those appearing on the cover page.)

CONTRACTOR AS PRINCIPAL

Company: (Corporate Seal)

Signature: « »

Name and Title: « »« »

Address: « »

SURETY

Company: (Corporate Seal)

Signature: « »

Name and Title: « »« »

Address: « »

DRAFT AIA® Document A312™ – 2010

Payment Bond

CONTRACTOR:

(Name, legal status and address)

« »
« »

SURETY:

(Name, legal status and principal place of business)

« »
« »

OWNER:

(Name, legal status and address)

«Akwesasne Mohawk Casino & Resort»
«873 New York Route 37
Hogansburg, New York 13655»

CONSTRUCTION CONTRACT

Date: « »

Amount: \$ « »

Description:

(Name and location)

«22012-AMCR-Tavern Kitchen»
«873 New York Route 37
Hogansburg, New York 13655»

BOND

Date:

(Not earlier than Construction Contract Date)

« »

Amount: \$ « »

Modifications to this Bond: « » None « » See Section 18

CONTRACTOR AS PRINCIPAL

Company: (Corporate Seal)

Signature: « »

SURETY

Company: (Corporate Seal)

Signature: « »

Name and Title: « »

Name and Title: « »

(Any additional signatures appear on the last page of this Payment Bond.)

(FOR INFORMATION ONLY — Name, address and telephone)

AGENT or BROKER:

« »
« »
« »

OWNER'S REPRESENTATIVE:

(Architect, Engineer or other party:)

«Scott Freeman»
«873 New York Route 37
Hogansburg, New York 13655»
«Telephone Number: 518-358-2222»
«Fax Number: 518-358-4047»
«SFreeman@mohawkasino.com »
« »

ADDITIONS AND DELETIONS:

The author of this document has added information needed for its completion. The author may also have revised the text of the original AIA standard form. An Additions and Deletions Report that notes added information as well as revisions to the standard form text is available from the author and should be reviewed.

This document has important legal consequences. Consultation with an attorney is encouraged with respect to its completion or modification.

Any singular reference to Contractor, Surety, Owner or other party shall be considered plural where applicable.

ELECTRONIC COPYING of any portion of this AIA® Document to another electronic file is prohibited and constitutes a violation of copyright laws as set forth in the footer of this document.

TABLE

§ 1 The Contractor and Surety, jointly and severally, bind themselves, their heirs, executors, administrators, successors and assigns to the Owner to pay for labor, materials and equipment furnished for use in the performance of the Construction Contract, which is incorporated herein by reference, subject to the following terms.

§ 2 If the Contractor promptly makes payment of all sums due to Claimants, and defends, indemnifies and holds harmless the Owner from claims, demands, liens or suits by any person or entity seeking payment for labor, materials or equipment furnished for use in the performance of the Construction Contract, then the Surety and the Contractor shall have no obligation under this Bond.

§ 3 If there is no Owner Default under the Construction Contract, the Surety's obligation to the Owner under this Bond shall arise after the Owner has promptly notified the Contractor and the Surety (at the address described in Section 13) of claims, demands, liens or suits against the Owner or the Owner's property by any person or entity seeking payment for labor, materials or equipment furnished for use in the performance of the Construction Contract and tendered defense of such claims, demands, liens or suits to the Contractor and the Surety.

§ 4 When the Owner has satisfied the conditions in Section 3, the Surety shall promptly and at the Surety's expense defend, indemnify and hold harmless the Owner against a duly tendered claim, demand, lien or suit.

§ 5 The Surety's obligations to a Claimant under this Bond shall arise after the following:

§ 5.1 Claimants, who do not have a direct contract with the Contractor,

- .1 have furnished a written notice of non-payment to the Contractor, stating with substantial accuracy the amount claimed and the name of the party to whom the materials were, or equipment was, furnished or supplied or for whom the labor was done or performed, within ninety (90) days after having last performed labor or last furnished materials or equipment included in the Claim; and
- .2 have sent a Claim to the Surety (at the address described in Section 13).

§ 5.2 Claimants, who are employed by or have a direct contract with the Contractor, have sent a Claim to the Surety (at the address described in Section 13).

§ 6 If a notice of non-payment required by Section 5.1.1 is given by the Owner to the Contractor, that is sufficient to satisfy a Claimant's obligation to furnish a written notice of non-payment under Section 5.1.1.

§ 7 When a Claimant has satisfied the conditions of Sections 5.1 or 5.2, whichever is applicable, the Surety shall promptly and at the Surety's expense take the following actions:

§ 7.1 Send an answer to the Claimant, with a copy to the Owner, within sixty (60) days after receipt of the Claim, stating the amounts that are undisputed and the basis for challenging any amounts that are disputed; and

§ 7.2 Pay or arrange for payment of any undisputed amounts.

§ 7.3 The Surety's failure to discharge its obligations under Section 7.1 or Section 7.2 shall not be deemed to constitute a waiver of defenses the Surety or Contractor may have or acquire as to a Claim, except as to undisputed amounts for which the Surety and Claimant have reached agreement. If, however, the Surety fails to discharge its obligations under Section 7.1 or Section 7.2, the Surety shall indemnify the Claimant for the reasonable attorney's fees the Claimant incurs thereafter to recover any sums found to be due and owing to the Claimant.

§ 8 The Surety's total obligation shall not exceed the amount of this Bond, plus the amount of reasonable attorney's fees provided under Section 7.3, and the amount of this Bond shall be credited for any payments made in good faith by the Surety.

§ 9 Amounts owed by the Owner to the Contractor under the Construction Contract shall be used for the performance of the Construction Contract and to satisfy claims, if any, under any construction performance bond. By the Contractor furnishing and the Owner accepting this Bond, they agree that all funds earned by the Contractor in the performance of the Construction Contract are dedicated to satisfy obligations of the Contractor and Surety under this Bond, subject to the Owner's priority to use the funds for the completion of the work.

§ 10 The Surety shall not be liable to the Owner, Claimants or others for obligations of the Contractor that are unrelated to the Construction Contract. The Owner shall not be liable for the payment of any costs or expenses of any Claimant under this Bond, and shall have under this Bond no obligation to make payments to, or give notice on behalf of, Claimants or otherwise have any obligations to Claimants under this Bond.

§ 11 The Surety hereby waives notice of any change, including changes of time, to the Construction Contract or to related subcontracts, purchase orders and other obligations.

§ 12 No suit or action shall be commenced by a Claimant under this Bond other than in a court of competent jurisdiction in the state in which the project that is the subject of the Construction Contract is located or after the expiration of one year from the date (1) on which the Claimant sent a Claim to the Surety pursuant to Section 5.1.2 or 5.2, or (2) on which the last labor or service was performed by anyone or the last materials or equipment were furnished by anyone under the Construction Contract, whichever of (1) or (2) first occurs. If the provisions of this Paragraph are void or prohibited by law, the minimum period of limitation available to sureties as a defense in the jurisdiction of the suit shall be applicable.

§ 13 Notice and Claims to the Surety, the Owner or the Contractor shall be mailed or delivered to the address shown on the page on which their signature appears. Actual receipt of notice or Claims, however accomplished, shall be sufficient compliance as of the date received.

§ 14 When this Bond has been furnished to comply with a statutory or other legal requirement in the location where the construction was to be performed, any provision in this Bond conflicting with said statutory or legal requirement shall be deemed deleted herefrom and provisions conforming to such statutory or other legal requirement shall be deemed incorporated herein. When so furnished, the intent is that this Bond shall be construed as a statutory bond and not as a common law bond.

§ 15 Upon request by any person or entity appearing to be a potential beneficiary of this Bond, the Contractor and Owner shall promptly furnish a copy of this Bond or shall permit a copy to be made.

§ 16 Definitions

§ 16.1 Claim. A written statement by the Claimant including at a minimum:

- .1 the name of the Claimant;
- .2 the name of the person for whom the labor was done, or materials or equipment furnished;
- .3 a copy of the agreement or purchase order pursuant to which labor, materials or equipment was furnished for use in the performance of the Construction Contract;
- .4 a brief description of the labor, materials or equipment furnished;
- .5 the date on which the Claimant last performed labor or last furnished materials or equipment for use in the performance of the Construction Contract;
- .6 the total amount earned by the Claimant for labor, materials or equipment furnished as of the date of the Claim;
- .7 the total amount of previous payments received by the Claimant; and
- .8 the total amount due and unpaid to the Claimant for labor, materials or equipment furnished as of the date of the Claim.

§ 16.2 Claimant. An individual or entity having a direct contract with the Contractor or with a subcontractor of the Contractor to furnish labor, materials or equipment for use in the performance of the Construction Contract. The term Claimant also includes any individual or entity that has rightfully asserted a claim under an applicable mechanic's lien or similar statute against the real property upon which the Project is located. The intent of this Bond shall be to include without limitation in the terms "labor, materials or equipment" that part of water, gas, power, light, heat, oil, gasoline, telephone service or rental equipment used in the Construction Contract, architectural and engineering services required for performance of the work of the Contractor and the Contractor's subcontractors, and all other items for which a mechanic's lien may be asserted in the jurisdiction where the labor, materials or equipment were furnished.

§ 16.3 Construction Contract. The agreement between the Owner and Contractor identified on the cover page, including all Contract Documents and all changes made to the agreement and the Contract Documents.

§ 16.4 Owner Default. Failure of the Owner, which has not been remedied or waived, to pay the Contractor as required under the Construction Contract or to perform and complete or comply with the other material terms of the Construction Contract.

§ 16.5 Contract Documents. All the documents that comprise the agreement between the Owner and Contractor.

§ 17 If this Bond is issued for an agreement between a Contractor and subcontractor, the term Contractor in this Bond shall be deemed to be Subcontractor and the term Owner shall be deemed to be Contractor.

§ 18 Modifications to this bond are as follows:

« »

(Space is provided below for additional signatures of added parties, other than those appearing on the cover page.)

CONTRACTOR AS PRINCIPAL

Company: _____ (Corporate Seal)
Signature: « »

Name and Title: « »
Address: « »

SURETY

Company: _____ (Corporate Seal)
Signature: « »

Name and Title: « »
Address: « »

DRAFT

AIA® Document G701™ - 2017

Change Order**PROJECT:** *(Name and address)*

22012-AMCR-Tavern Kitchen
873 New York Route 37
Hogansburg, New York 13655

CONTRACT INFORMATION:

Contract For: General Construction
Date:

CHANGE ORDER INFORMATION:

Change Order Number: 001
Date:

OWNER: *(Name and address)*

Akwesasne Mohawk Casino & Resort

873 New York Route 37
Hogansburg, New York 13655

ARCHITECT: *(Name and address)*

Architectural & Engineering Design
Associates, P.C.
1246 State Route 3
P.O. Box 767
Plattsburgh, New York 12901

CONTRACTOR: *(Name and address)***THE CONTRACT IS CHANGED AS FOLLOWS:**

(Insert a detailed description of the change and, if applicable, attach or reference specific exhibits. Also include agreed upon adjustments attributable to executed Construction Change Directives.)

The original Contract Sum was

\$ 0.00

The net change by previously authorized Change Orders

\$ 0.00

The Contract Sum prior to this Change Order was

\$ 0.00

The Contract Sum will be unchanged by this Change Order in the amount of

\$ 0.00

The new Contract Sum including this Change Order will be

\$ 0.00

The Contract Time will be unchanged by Zero (0) days.

The new date of Substantial Completion will be

NOTE: This Change Order does not include adjustments to the Contract Sum or Guaranteed Maximum Price, or the Contract Time, that have been authorized by Construction Change Directive until the cost and time have been agreed upon by both the Owner and Contractor, in which case a Change Order is executed to supersede the Construction Change Directive.

NOT VALID UNTIL SIGNED BY THE ARCHITECT, CONTRACTOR AND OWNER.

Architectural & Engineering Design
Associates, P.C.

ARCHITECT *(Firm name)*

Akwesasne Mohawk Casino & Resort

OWNER *(Firm name)*

SIGNATURE

Shane E. Chatelle, Project Architect

PRINTED NAME AND TITLE

DATE

SIGNATURE

PRINTED NAME AND TITLE

DATE

SIGNATURE

Scott Freeman, General Manager

PRINTED NAME AND TITLE

DATE

Application and Certificate for Payment

TO OWNER:	Akwesasne Mohawk Casino & Resort 873 New York Route 37 Hogansburg, New York 13655	PROJECT:	22012-AMCR-Tavern Kitchen 873 New York Route 37 Hogansburg, New York 13655	APPLICATION NO:	001	Distribution to:
FROM CONTRACTOR:	VIA ARCHITECT:			PERIOD TO:		OWNER: <input type="checkbox"/>
				CONTRACT FOR:	General Construction	ARCHITECT: <input type="checkbox"/>
				CONTRACT DATE:		CONTRACTOR: <input type="checkbox"/>
				PROJECT NOS:	22012 / /	FIELD: <input type="checkbox"/>
						OTHER: <input type="checkbox"/>

CONTRACTOR'S APPLICATION FOR PAYMENT

Application is made for payment, as shown below, in connection with the Contract.
AIA Document G703®, Continuation Sheet, is attached.

1. ORIGINAL CONTRACT SUM	\$0.00
2. NET CHANGE BY CHANGE ORDERS	\$0.00
3. CONTRACT SUM TO DATE (Line 1 ± 2)	\$0.00
4. TOTAL COMPLETED & STORED TO DATE (Column G on G703)	\$0.00
5. RETAINAGE:	
a. 0 % of Completed Work (Column D + E on G703)	\$0.00
b. 0 % of Stored Material (Column F on G703)	\$0.00
Total Retainage (Lines 5a + 5b or Total in Column I of G703)	\$0.00

6. TOTAL EARNED LESS RETAINAGE	\$0.00
(Line 4 Less Line 5 Total)	
7. LESS PREVIOUS CERTIFICATES FOR PAYMENT	\$0.00
(Line 6 from prior Certificate)	
8. CURRENT PAYMENT DUE	\$0.00
9. BALANCE TO FINISH, INCLUDING RETAINAGE	\$0.00
(Line 3 less Line 6)	

ARCHITECT'S CERTIFICATE FOR PAYMENT

In accordance with the Contract Documents, based on on-site observations and the data comprising this application, the Architect certifies to the Owner that to the best of the Architect's knowledge, information and belief the Work has progressed as indicated, the quality of the Work is in accordance with the Contract Documents, and the Contractor is entitled to payment of the AMOUNT CERTIFIED.

AMOUNT CERTIFIED	\$0.00
(Attach explanation if amount certified differs from the amount applied. Initial all figures on this Application and on the Continuation Sheet that are changed to conform with the amount certified.)	

ARCHITECT:

By:	Date:
This Certificate is not negotiable. The AMOUNT CERTIFIED is payable only to the Contractor named herein. Issuance, payment and acceptance of payment are without prejudice to any rights of the Owner or Contractor under this Contract.	

CHANGE ORDER SUMMARY	ADDITIONS	DEDUCTIONS
Total changes approved in previous months by Owner	\$0.00	\$0.00
Total approved this Month	\$0.00	\$0.00
TOTALS	\$0.00	\$0.00
NET CHANGES by Change Order		\$0.00

AIA Document G702®, Application and Certification for Payment, or G732™, Application and Certificate for Payment, Construction Manager as Adviser Edition, containing Contractor's signed certification is attached.

9
8
7
6
5
4
3
2
1

DRAFT

AIA® Document G704® – 2017

Certificate of Substantial Completion

PROJECT: <i>(name and address)</i> 22012-AMCR-Tavern Kitchen 873 New York Route 37 Hogansburg, New York 13655	CONTRACT INFORMATION: Contract For: General Construction Date:	CERTIFICATE INFORMATION: Certificate Number: 001 Date:
OWNER: <i>(name and address)</i> Akwasasne Mohawk Casino & Resort 873 New York Route 37 Hogansburg, New York 13655	ARCHITECT: <i>(name and address)</i> Architectural & Engineering Design Associates, P.C. 1246 State Route 3 P.O. Box 767 Plattsburgh, New York 12901	CONTRACTOR: <i>(name and address)</i>

The Work identified below has been reviewed and found, to the Architect's best knowledge, information, and belief, to be substantially complete. Substantial Completion is the stage in the progress of the Work when the Work or designated portion is sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work for its intended use. The date of Substantial Completion of the Project or portion designated below is the date established by this Certificate.

(Identify the Work, or portion thereof, that is substantially complete.)

Architectural &
Engineering Design
Associates, P.C.

ARCHITECT *(Firm Name)*

SIGNATURE

Shane E. Chatelle, Project
Architect

PRINTED NAME AND TITLE

DATE OF SUBSTANTIAL COMPLETION

WARRANTIES

The date of Substantial Completion of the Project or portion designated above is also the date of commencement of applicable warranties required by the Contract Documents, except as stated below:

(Identify warranties that do not commence on the date of Substantial Completion, if any, and indicate their date of commencement.)

WORK TO BE COMPLETED OR CORRECTED

A list of items to be completed or corrected is attached hereto, or transmitted as agreed upon by the parties, and identified as follows:

(Identify the list of Work to be completed or corrected.)

The failure to include any items on such list does not alter the responsibility of the Contractor to complete all Work in accordance with the Contract Documents. Unless otherwise agreed to in writing, the date of commencement of warranties for items on the attached list will be the date of issuance of the final Certificate of Payment or the date of final payment, whichever occurs first. The Contractor will complete or correct the Work on the list of items attached hereto within () days from the above date of Substantial Completion.

Cost estimate of Work to be completed or corrected: \$

The responsibilities of the Owner and Contractor for security, maintenance, heat, utilities, damage to the Work, insurance, and other items identified below shall be as follows:

(Note: Owner's and Contractor's legal and insurance counsel should review insurance requirements and coverage.)

The Owner and Contractor hereby accept the responsibilities assigned to them in this Certificate of Substantial Completion:

CONTRACTOR (<i>Firm Name</i>) Akwasasne Mohawk Casino & Resort	SIGNATURE	PRINTED NAME AND TITLE Scott Freeman, General Manager	DATE
OWNER (<i>Firm Name</i>)	SIGNATURE	PRINTED NAME AND TITLE	DATE



AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 00 9000
NOTICE OF AWARD

THE OWNER HAS CONSIDERED THE BID SUBMITTED BY YOU FOR THE ABOVE DESCRIBED
PROJECT IN RESPONSE TO ITS ADVERTISEMENT FOR BIDS DATED _____
_____ AND INSTRUCTION TO
BIDDERS.

YOU ARE HEREBY NOTIFIED THAT YOUR BID HAS BEEN ACCEPTED FOR ITEMS IN THE
AMOUNT OF _____ DOLLARS (\$ _____)

YOU ARE REQUIRED BY THE INSTRUCTIONS TO BIDDERS TO EXECUTE THE AGREEMENT AND
FURNISH THE REQUIRED CERTIFICATES OF INSURANCE & PAYMENT/PERFORMANCE BONDS
WITHIN TEN (10) CALENDAR DAYS FROM THE DATE OF THIS NOTICE TO YOU.

YOU ARE REQUIRED TO RETURN AN ACKNOWLEDGED COPY IF THIS NOTICE OF AWARD TO
THE OWNER.

DATED THIS _____ DAY OF _____.

ACCEPTANCE OF NOTICE & RECEIPT OF THE ABOVE NOTICE OF AWARD IS HEREBY
ACKNOWLEDGED BY:

_____ CONTRACTOR	_____ OWNER
---------------------	----------------

_____ DATE	_____ DATE
---------------	---------------

_____ CONTRACTOR REPRESENTATIVE	_____ OWNER REPRESENTATIVE
------------------------------------	-------------------------------

_____ TITLE	_____ TITLE
----------------	----------------

EMPLOYEE IDENTIFICATION NUMBER

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 00 9001
NOTICE TO PROCEED

YOU ARE HEREBY NOTIFIED TO COMMENCE THE ABOVE DESCRIBED PROJECT IN
ACCORDANCE WITH THE AGREEMENT DATED _____,
_____, ON OR BEFORE _____, AND YOU
ARE TO COMPLETE THE WORK WITHIN _____ CONSECUTIVE CALENDAR
DAYS THEREAFTER.

THE DATE OF COMPLETION OF ALL WORK IS THEREFORE _____.

ACCEPTANCE OF NOTICE & RECEIPT OF THE ABOVE NOTICE TO PROCEED IS HEREBY
ACKNOWLEDGED BY:

CONTRACTOR

OWNER

DATE

DATE

CONTRACTORS REPRESENTATIVE

OWNER REPRESENTATIVE

TITLE

TITLE

EMPLOYER IDENTIFICATION NUMBER

END OF SECTION

DRAFT

AIA® Document G706™ – 1994

Contractor's Affidavit of Payment of Debts and Claims

PROJECT: *(Name and address)*

22012-AMCR-Tavern Kitchen
873 New York Route 37
Hogansburg, New York
13655

ARCHITECT'S PROJECT NUMBER:

22012

CONTRACT FOR: General Construction

OWNER: ☐

ARCHITECT: ☐

CONTRACTOR: ☐

SURETY: ☐

OTHER: ☐

TO OWNER: *(Name and address)*

Akwesasne Mohawk Casino &
Resort
873 New York Route 37
Hogansburg, New York
13655

CONTRACT DATED:

STATE OF:
COUNTY OF:

The undersigned hereby certifies that, except as listed below, payment has been made in full and all obligations have otherwise been satisfied for all materials and equipment furnished, for all work, labor, and services performed, and for all known indebtedness and claims against the Contractor for damages arising in any manner in connection with the performance of the Contract referenced above for which the Owner or Owner's property might in any way be held responsible or encumbered.

EXCEPTIONS:

SUPPORTING DOCUMENTS ATTACHED HERETO:

1. Consent of Surety to Final Payment. Whenever Surety is involved, Consent of Surety is required. AIA Document G707, Consent of Surety, may be used for this purpose

Indicate Attachment ☐ Yes ☒ No

CONTRACTOR: *(Name and address)*

BY:

(Signature of authorized representative)

(Printed name and title)

The following supporting documents should be attached hereto if required by the Owner:

1. Contractor's Release or Waiver of Liens, conditional upon receipt of final payment.
2. Separate Releases or Waivers of Liens from Subcontractors and material and equipment suppliers, to the extent required by the Owner, accompanied by a list thereof.
3. Contractor's Affidavit of Release of Liens (AIA Document G706A).

Subscribed and sworn to before me on this date:

Notary Public:
My Commission Expires:

DRAFT

AIA[®] Document G706A[™] – 1994

Contractor's Affidavit of Release of Liens

PROJECT: *(Name and address)*

22012-AMCR-Tavern Kitchen

873 New York Route 37

Hogansburg, New York 13655

TO OWNER: *(Name and address)*

Akwesasne Mohawk Casino & Resort

873 New York Route 37

Hogansburg, New York 13655

ARCHITECT'S PROJECT NUMBER:

22012

CONTRACT FOR: General

Construction

CONTRACT DATED:

OWNER: ☐

ARCHITECT: ☐

CONTRACTOR: ☐

SURETY: ☐

OTHER: ☐

STATE OF:

COUNTY OF:

The undersigned hereby certifies that to the best of the undersigned's knowledge, information and belief, except as listed below, the Releases or Waivers of Lien attached hereto include the Contractor, all Subcontractors, all suppliers of materials and equipment, and all performers of Work, labor or services who have or may have liens or encumbrances or the right to assert liens or encumbrances against any property of the Owner arising in any manner out of the performance of the Contract referenced above.

EXCEPTIONS:

SUPPORTING DOCUMENTS ATTACHED HERETO:

1. Contractor's Release or Waiver of Liens, conditional upon receipt of final payment.
2. Separate Releases or Waivers of Liens from Subcontractors and material and equipment suppliers, to the extent required by the Owner, accompanied by a list thereof.

CONTRACTOR: *(Name and address)*

BY:

(Signature of authorized representative)

(Printed name and title)

Subscribed and sworn to before me on this date:

Notary Public:

My Commission Expires:

DRAFT

AIA® Document G707™ - 1994

Consent Of Surety to Final Payment

PROJECT: *(Name and address)*

22012-AMCR-Tavern Kitchen
873 New York Route 37
Hogansburg, New York 13655

ARCHITECT'S PROJECT NUMBER: 22012

CONTRACT FOR: General Construction

OWNER: ☐

ARCHITECT: ☐

CONTRACTOR: ☐

SURETY: ☐

OTHER: ☐

TO OWNER: *(Name and address)*

Akwesasne Mohawk Casino & Resort
873 New York Route 37
Hogansburg, New York 13655

CONTRACT DATED:

In accordance with the provisions of the Contract between the Owner and the Contractor as indicated above, the

(Insert name and address of Surety)

on bond of

(Insert name and address of Contractor)

hereby approves of the final payment to the Contractor, and agrees that final payment to the Contractor shall not relieve the Surety of any of its obligations to

(Insert name and address of Owner)

Akwesasne Mohawk Casino & Resort
873 New York Route 37
Hogansburg, New York 13655

as set forth in said Surety's bond.

IN WITNESS WHEREOF, the Surety has hereunto set its hand on this date:

(Insert in writing the month followed by the numeric date and year.)

(Surety)

(Signature of authorized representative)

Attest:

(Seal):

(Printed name and title)

DRAFT

AIA® Document G714™ - 2017

Construction Change Directive

PROJECT: *(name and address)*

22012-AMCR-Tavern Kitchen
873 New York Route 37
Hogansburg, New York 13655

CONTRACT INFORMATION:

Contract For: General Construction
Date:

CCD INFORMATION:

Directive Number: 001
Date:

OWNER: *(name and address)*

Akwesasne Mohawk Casino & Resort

873 New York Route 37
Hogansburg, New York 13655

ARCHITECT: *(name and address)*

Architectural & Engineering Design
Associates, P.C.
1246 State Route 3
P.O. Box 767
Plattsburgh, New York 12901

CONTRACTOR: *(name and address)*

The Contractor is hereby directed to make the following change(s) in this Contract:
(Insert a detailed description of the change and, if applicable, attach or reference specific exhibits.)

PROPOSED ADJUSTMENTS

1. The proposed basis of adjustment to the Contract Sum or Guaranteed Maximum Price is:

- ☒ Lump Sum decrease of \$0.00
☐ Unit Price of \$ per
☐ Cost, as defined below, plus the following fee:
(Insert a definition of, or method for determining, cost)

- ☐ As follows:

2. The Contract Time is proposed to remain unchanged. The proposed adjustment, if any, is (0 days).

NOTE: The Owner, Architect and Contractor should execute a Change Order to supersede this Construction Change Directive to the extent they agree upon adjustments to the Contract Sum, Contract Time, or Guaranteed Maximum price for the change(s) described herein.

When signed by the Owner and Architect and received by the Contractor, this document becomes effective IMMEDIATELY as a Construction Change Directive (CCD), and the Contractor shall proceed with the change(s) described above.

Contractor signature indicates agreement with the proposed adjustments in Contract Sum and Contract Time set forth in this CCD.

Architectural & Engineering Design
Associates, P.C.

ARCHITECT *(Firm name)*

Akwesasne Mohawk Casino &
Resort

OWNER *(Firm name)*

CONTRACTOR *(Firm name)*

SIGNATURE

Shane E. Chatelle, Project Architect
PRINTED NAME AND TITLE

SIGNATURE

Scott Freeman, General Manager
PRINTED NAME AND TITLE

SIGNATURE

PRINTED NAME AND TITLE

DATE

DATE

DATE

DRAFT

AIA[®] Document G716[™] - 2004

Request for Information ("RFI")

TO:

Shane E. Chatelle
Architectural & Engineering Design Associates, P.C.
1246 State Route 3
P.O. Box 767
Plattsburgh, New York 12901

FROM:

PROJECT:

22012-AMCR-Tavern Kitchen
873 New York Route 37
Hogansburg, New York 13655

ISSUE DATE:

RFI No. 001

REQUESTED REPLY DATE:

PROJECT NUMBERS: 22012 /

COPIES TO:

RFI DESCRIPTION: *(Fully describe the question or type of information requested.)*

REFERENCES/ATTACHMENTS: *(List specific documents researched when seeking the information requested.)*

SPECIFICATIONS:

DRAWINGS:

OTHER:

SENDER'S RECOMMENDATION: *(If RFI concerns a site or construction condition, the sender may provide a recommended solution, including cost and/or schedule considerations.)*

RECEIVER'S REPLY: *(Provide answer to RFI, including cost and/or schedule considerations.)*

BY

DATE

COPIES TO

Note: This reply is not an authorization to proceed with work involving additional cost, time or both. If any reply requires a change to the Contract Documents, a Change Order, Construction Change Directive or a Minor Change in the work must be executed in accordance with the Contract Documents.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 01 1000

SUMMARY

PART 1 GENERAL

1.01 PROJECT

- A. Project Name: Akwesasne Mohawk Casino & Resort - Tavern Kitchen Renovation.
- B. Owner's Name: Akwesasne Mohawk Casino & Resort.
- C. Architect's Name: Architectural & Engineering Design Associates, P.C..
- D. This project consists of partial demolition & renovation to an existing kitchen.

1.02 CONTRACT DESCRIPTION

- A. Contract Type: A single prime contract based on a Stipulated Price as described in Document 00 5200 - Agreement Form.

1.03 DESCRIPTION OF ALTERATIONS WORK

- A. Scope of demolition and removal work is indicated on drawings and specified in Section 02 4100.
- B. Scope of alterations work is indicated on drawings.
- C. Plumbing: Alter existing system and add new construction, keeping existing in operation.
- D. Electrical Power and Lighting: Alter existing system and add new construction, keeping existing in operation.
- E. Fire Suppression Sprinklers: Alter existing system and add new construction, keeping existing in operation.
- F. Fire Alarm: Alter existing system and add new construction, keeping existing in operation.

1.04 OWNER OCCUPANCY

- A. Owner intends to continue to occupy adjacent portions of the existing building during the entire construction period.
- B. Owner intends to occupy the Project upon Substantial Completion.
- C. Cooperate with Owner to minimize conflict and to facilitate Owner's operations.
- D. Schedule the Work to accommodate Owner occupancy.

1.05 CONTRACTOR USE OF SITE AND PREMISES

- A. Construction Operations: Limited to areas noted on Drawings.
 - 1. Locate and conduct construction activities in ways that will limit disturbance to site.
- B. Provide access to and from site as required by law and by Owner:
 - 1. Emergency Building Exits During Construction: Keep all exits required by code open during construction period; provide temporary exit signs if exit routes are temporarily altered.
 - 2. Do not obstruct roadways, sidewalks, or other public ways without permit.

1.06 WORK SEQUENCE

- A. Coordinate construction schedule and operations with Owner.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 01 2000

PRICE AND PAYMENT PROCEDURES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Procedures for preparation and submittal of applications for progress payments.
- B. Documentation of changes in Contract Sum and Contract Time.
- C. Procedures for preparation and submittal of application for final payment.

1.02 RELATED REQUIREMENTS

- A. Section 00 7200 - General Conditions: Additional requirements for progress payments, final payment, changes in the Work.
- B. Section 01 2200 - Unit Prices: Monetary values of unit prices; Payment and modification procedures relating to unit prices.
- C. Section 01 7800 - Closeout Submittals: Project record documents.

1.03 SCHEDULE OF VALUES

- A. Electronic media printout including equivalent information will be considered in lieu of standard form specified; submit draft to Architect for approval.
- B. Forms filled out by hand will not be accepted.

1.04 APPLICATIONS FOR PROGRESS PAYMENTS

- A. Payment Period: Submit at intervals stipulated in the Agreement.
- B. Use Form AIA G702 and Form AIA G703, edition stipulated in the Agreement.
- C. Electronic media printout including equivalent information will be considered in lieu of standard form specified; submit sample to Architect for approval.
- D. Forms filled out by hand will not be accepted.
- E. For each item, provide a column for listing each of the following:
 - 1. Item Number.
 - 2. Description of work.
 - 3. Scheduled Values.
 - 4. Previous Applications.
 - 5. Work in Place and Stored Materials under this Application.
 - 6. Authorized Change Orders.
 - 7. Total Completed and Stored to Date of Application.
 - 8. Balance to Finish.
 - 9. Retainage.
- F. Execute certification by signature of authorized officer.
- G. Submit one electronic and three hard-copies of each Application for Payment.
- H. When Architect requires substantiating information, submit data justifying dollar amounts in question. Provide one copy of data with cover letter for each copy of submittal. Show application number and date, and line item by number and description.

1.05 MODIFICATION PROCEDURES

- A. For minor changes not involving an adjustment to the Contract Sum or Contract Time, Architect will issue instructions directly to Contractor.
- B. For other required changes, Architect will issue a document signed by Owner instructing Contractor to proceed with the change, for subsequent inclusion in a Change Order.
 - 1. The document will describe the required changes and will designate method of determining any change in Contract Sum or Contract Time.
 - 2. Promptly execute the change.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- C. For changes for which advance pricing is desired, Architect will issue a document that includes a detailed description of a proposed change with supplementary or revised drawings and specifications, a change in Contract Time for executing the change with a stipulation of any overtime work required and the period of time during which the requested price will be considered valid. Contractor shall prepare and submit a fixed price quotation within 10 days.
- D. Computation of Change in Contract Amount: As specified in the Agreement and Conditions of the Contract.
 - 1. For change requested by Contractor, the amount will be based on the Contractor's request for a Change Order as approved by Architect/Owner.
 - 2. For pre-determined unit prices and quantities, the amount will be based on the fixed unit prices.
 - 3. For change ordered by Architect without a quotation from Contractor, the amount will be determined by Architect based on the Contractor's substantiation of costs as specified for Time and Material work.
- E. Substantiation of Costs: Provide full information required for evaluation.
 - 1. On request, provide the following data:
 - a. Quantities of products, labor, and equipment.
 - b. Taxes, insurance, and bonds.
 - c. Overhead and profit.
 - d. Justification for any change in Contract Time.
 - e. Credit for deletions from Contract, similarly documented.
 - 2. Support each claim for additional costs with additional information:
 - a. Origin and date of claim.
 - b. Dates and times work was performed, and by whom.
 - c. Time records and wage rates paid.
 - d. Invoices and receipts for products, equipment, and subcontracts, similarly documented.
- F. Execution of Change Orders: Architect will issue Change Orders for signatures of parties as provided in the Conditions of the Contract.
- G. After execution of Change Order, promptly revise Schedule of Values and Application for Payment forms to record each authorized Change Order as a separate line item and adjust the Contract Sum.
- H. Promptly revise progress schedules to reflect any change in Contract Time, revise sub-schedules to adjust times for other items of work affected by the change, and resubmit.
- I. Promptly enter changes in Project Record Documents.

1.06 APPLICATION FOR FINAL PAYMENT

- A. Prepare Application for Final Payment as specified for progress payments, identifying total adjusted Contract Sum, previous payments, and sum remaining due.
- B. Application for Final Payment will not be considered until the following have been accomplished:
 - 1. All closeout procedures specified in Section 01 7000.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 01 2500
SUBSTITUTION PROCEDURES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Procedural requirements for proposed substitutions.

1.02 RELATED REQUIREMENTS

- A. Section 01 2200 - Unit Prices, for additional unit price requirements.
- B. Section 01 3000 - Administrative Requirements: Submittal procedures, coordination.
- C. Section 01 6000 - Product Requirements: Fundamental product requirements, product options, delivery, storage, and handling.

1.03 DEFINITIONS

- A. Substitutions: Changes from Contract Documents requirements proposed by Contractor to materials, products, assemblies, and equipment.
 - 1. Substitutions for Cause: Proposed due to changed Project circumstances beyond Contractor's control.
 - a. Unavailability.
 - b. Regulatory changes.
 - 2. Substitutions for Convenience: Proposed due to possibility of offering substantial advantage to the Project.
 - a. Substitution requests offering advantages solely to the Contractor will not be considered.

1.04 REFERENCE STANDARDS

- A. CSI/CSC Form 1.5C - Substitution Request (During the Bidding/Negotiating Stage); Current Edition.
- B. CSI/CSC Form 13.1A - Substitution Request (After the Bidding/Negotiating Phase); Current Edition.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 GENERAL REQUIREMENTS

- A. A Substitution Request for products, assemblies, materials, and equipment constitutes a representation that the submitter:
 - 1. Has investigated proposed product and determined that it meets or exceeds the quality level of the specified product, equipment, assembly, or system.
 - 2. Agrees to provide the same warranty for the substitution as for the specified product.
 - 3. Agrees to provide same or equivalent maintenance service and source of replacement parts, as applicable.
 - 4. Agrees to coordinate installation and make changes to other work that may be required for the work to be complete, with no additional cost to Owner.
 - 5. Waives claims for additional costs or time extension that may subsequently become apparent.
 - 6. Agrees to reimburse Owner and Architect for review or redesign services associated with re-approval by authorities.
- B. A Substitution Request for specified installer constitutes a representation that the submitter:
 - 1. Has acted in good faith to obtain services of specified installer, but was unable to come to commercial, or other terms.
- C. Document each request with complete data substantiating compliance of proposed substitution with Contract Documents. Burden of proof is on proposer.
 - 1. Note explicitly any non-compliant characteristics.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- D. Content: Include information necessary for tracking the status of each Substitution Request, and information necessary to provide an actionable response.
1. No specific form is required. Contractor's Substitution Request documentation must include the following:
 - a. Project Information:
 - 1) Official project name and number, and any additional required identifiers established in Contract Documents.
 - 2) Owner's, Architect's, and Contractor's names.
 - b. Substitution Request Information:
 - 1) Discrete and consecutive Substitution Request number, and descriptive subject/title.
 - 2) Indication of whether the substitution is for cause or convenience.
 - 3) Issue date.
 - 4) Reference to particular Contract Document(s) specification section number, title, and article/paragraph(s).
 - 5) Description of Substitution.
 - 6) Reason why the specified item cannot be provided.
 - 7) Differences between proposed substitution and specified item.
 - 8) Description of how proposed substitution affects other parts of work.
 - c. Attached Comparative Data: Provide point-by-point, side-by-side comparison addressing essential attributes specified, as appropriate and relevant for the item:
 - 1) Physical characteristics.
 - 2) In-service performance.
 - 3) Expected durability.
 - 4) Visual effect.
 - 5) Sustainable design features.
 - 6) Warranties.
 - 7) Other salient features and requirements.
 - 8) Include, as appropriate or requested, the following types of documentation:
 - (a) Product Data:
 - (b) Samples.
 - (c) Certificates, test, reports or similar qualification data.
 - (d) Drawings, when required to show impact on adjacent construction elements.
 - d. Impact of Substitution:
 - 1) Savings to Owner for accepting substitution.
 - 2) Change to Contract Time due to accepting substitution.
- E. Limit each request to a single proposed substitution item.
1. Submit an electronic document, combining the request form with supporting data into single document.

3.02 SUBSTITUTION PROCEDURES DURING PROCUREMENT

- A. Submittal Time Restrictions:
1. Owner will consider requests for substitutions only if submitted at least 10 days prior to the date for receipt of bids.
- B. Instructions to Bidders specifies time restrictions for submitting requests for substitutions during the bidding period, and the documents required.

3.03 SUBSTITUTION PROCEDURES DURING CONSTRUCTION

- A. Submittal Form (after award of contract):
- B. Submit request for Substitution for Cause within 14 days of discovery of need for substitution, but not later than 14 days prior to time required for review and approval by Architect, in order to stay on approved project schedule.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- C. Submit request for Substitution for Convenience immediately upon discovery of its potential advantage to the project, but not later than 14 days prior to time required for review and approval by Architect, in order to stay on approved project schedule.
 - 1. In addition to meeting general documentation requirements, document how the requested substitution benefits the Owner through cost savings, time savings, greater energy conservation, or in other specific ways.
 - 2. Document means of coordinating of substitution item with other portions of the work, including work by affected subcontractors.
 - 3. Bear the costs engendered by proposed substitution of:
 - a. Owner's compensation to the Architect for any required redesign, time spent processing and evaluating the request.
- D. Substitutions will not be considered under one or more of the following circumstances:
 - 1. Without a separate written request.

3.04 RESOLUTION

- A. Architect may request additional information and documentation prior to rendering a decision. Provide this data in an expeditious manner.

3.05 ACCEPTANCE

- A. Accepted substitutions change the work of the Project. They will be documented and incorporated into work of the project by Change Order, Construction Change Directive, Architectural Supplementary Instructions, or similar instruments provided for in the Conditions of the Contract.

3.06 CLOSEOUT ACTIVITIES

- A. See Section 01 7800 - Closeout Submittals, for closeout submittals.
- B. Include completed Substitution Request Forms as part of the Project record. Include both approved and rejected Requests.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 01 3000
ADMINISTRATIVE REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. General administrative requirements.
- B. Preconstruction meeting.
- C. Progress meetings.
- D. Construction progress schedule.
- E. Coordination drawings.
- F. Submittals for review, information, and project closeout.
- G. Number of copies of submittals.
- H. Requests for Interpretation (RFI) procedures.
- I. Submittal procedures.

1.02 RELATED REQUIREMENTS

- A. Section 00 7200 - General Conditions: Dates for applications for payment.
- B. Section 00 7300 - Supplementary Conditions: Duties of the Construction Manager.
- C. Section 01 6000 - Product Requirements: General product requirements.
- D. Section 01 7000 - Execution and Closeout Requirements: Additional coordination requirements.
- E. Section 01 7800 - Closeout Submittals: Project record documents; operation and maintenance data; warranties and bonds.

1.03 REFERENCE STANDARDS

- A. AIA G716 - Request for Information; 2004.

1.04 GENERAL ADMINISTRATIVE REQUIREMENTS

- A. Comply with requirements of Section 01 7000 - Execution and Closeout Requirements for coordination of execution of administrative tasks with timing of construction activities.
- B. Make the following types of submittals to Architect:
 - 1. Requests for Interpretation (RFI).
 - 2. Requests for substitution.
 - 3. Shop drawings, product data, and samples.
 - 4. Test and inspection reports.
 - 5. Design data.
 - 6. Manufacturer's instructions and field reports.
 - 7. Applications for payment and change order requests.
 - 8. Progress schedules.
 - 9. Correction Punch List and Final Correction Punch List for Substantial Completion.
 - 10. Closeout submittals.

1.05 PROJECT COORDINATOR

- A. Project Coordinator: Architectural & Engineering Design Associates, P.C..
- B. Cooperate with the Project Coordinator in allocation of mobilization areas of site; for field offices and sheds, for delivery and equipment access, traffic, and parking facilities.
- C. During construction, coordinate use of site and facilities through the Project Coordinator.
- D. Comply with Project Coordinator's procedures for intra-project communications; submittals, reports and records, schedules, coordination drawings, and recommendations; and resolution of ambiguities and conflicts.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- E. Comply with instructions of the Project Coordinator for use of temporary utilities and construction facilities. Responsibility for providing temporary utilities and construction facilities is identified in Section 01 1000 - Summary.
- F. Coordinate field engineering and layout work under instructions of the Project Coordinator.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 PRECONSTRUCTION MEETING

- A. Architect will schedule a meeting after Notice of Award.
- B. Attendance Required:
 - 1. Owner.
 - 2. Architect.
 - 3. Contractor.
- C. Agenda:
 - 1. Execution of Owner-Contractor Agreement.
 - 2. Submission of executed bonds and insurance certificates.
 - 3. Distribution of Contract Documents.
 - 4. Submission of list of subcontractors, list of products, schedule of values, and progress schedule.
 - 5. Designation of personnel representing the parties to Contract and Architect.
 - 6. Procedures and processing of field decisions, submittals, substitutions, applications for payments, proposal request, Change Orders, and Contract closeout procedures.
 - 7. Scheduling.
- D. Record minutes and distribute copies within two days after meeting to participants, with two copies to Architect, Owner, participants, and those affected by decisions made.

3.02 PROGRESS MEETINGS

- A. Attendance Required:
 - 1. Contractor.
 - 2. Owner.
 - 3. Architect.
 - 4. Special consultants.
 - 5. Contractor's superintendent.
 - 6. Major subcontractors.
- B. Agenda:
 - 1. Review minutes of previous meetings.
 - 2. Review of work progress.
 - 3. Field observations, problems, and decisions.
 - 4. Identification of problems that impede, or will impede, planned progress.
 - 5. Review of submittals schedule and status of submittals.
 - 6. Review of RFIs log and status of responses.
 - 7. Review of off-site fabrication and delivery schedules.
 - 8. Maintenance of progress schedule.
 - 9. Corrective measures to regain projected schedules.
 - 10. Planned progress during succeeding work period.
 - 11. Coordination of projected progress.
 - 12. Maintenance of quality and work standards.
 - 13. Effect of proposed changes on progress schedule and coordination.
 - 14. Other business relating to work.
- C. Record minutes and distribute copies within two days after meeting to participants, with two copies to Architect, Owner, participants, and those affected by decisions made.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3.03 CONSTRUCTION PROGRESS SCHEDULE

- A. Within 10 days after date of the Agreement, submit preliminary schedule defining planned operations for the first 60 days of work, with a general outline for remainder of work.
- B. Submit updated schedule with each Application for Payment.

3.04 REQUESTS FOR INTERPRETATION (RFI)

- A. Definition: A request seeking one of the following:
 - 1. An interpretation, amplification, or clarification of some requirement of Contract Documents arising from inability to determine from them the exact material, process, or system to be installed; or when the elements of construction are required to occupy the same space (interference); or when an item of work is described differently at more than one place in Contract Documents.
 - 2. A resolution to an issue which has arisen due to field conditions and affects design intent.
- B. Whenever possible, request clarifications at the next appropriate project progress meeting, with response entered into meeting minutes, rendering unnecessary the issuance of a formal RFI.
- C. Preparation: Prepare an RFI immediately upon discovery of a need for interpretation of Contract Documents. Failure to submit a RFI in a timely manner is not a legitimate cause for claiming additional costs or delays in execution of the work.
 - 1. Prepare a separate RFI for each specific item.
- D. Reason for the RFI: Prior to initiation of an RFI, carefully study all Contract Documents to confirm that information sufficient for their interpretation is definitely not included.
 - 1. Include in each request Contractor's signature attesting to good faith effort to determine from Contract Documents information requiring interpretation.
 - 2. Unacceptable Uses for RFIs: Do not use RFIs to request the following:
 - a. Approval of submittals (use procedures specified elsewhere in this section).
 - b. Approval of substitutions (see Section - 01 6000 - Product Requirements)
 - c. Changes that entail change in Contract Time and Contract Sum (comply with provisions of the Conditions of the Contract).
 - d. Different methods of performing work than those indicated in the Contract Drawings and Specifications (comply with provisions of the Conditions of the Contract).
 - 3. Improper RFIs: Requests not prepared in compliance with requirements of this section, and/or missing key information required to render an actionable response. They will be returned without a response, with an explanatory notation.
 - 4. Frivolous RFIs: Requests regarding information that is clearly indicated on, or reasonably inferable from, Contract Documents, with no additional input required to clarify the question. They will be returned without a response, with an explanatory notation.
 - a. The Owner reserves the right to assess the Contractor for the costs (on time-and-materials basis) incurred by the Architect, and any of its consultants, due to processing of such RFIs.
- E. Content: Include identifiers necessary for tracking the status of each RFI, and information necessary to provide an actionable response.
- F. Attachments: Include sketches, coordination drawings, descriptions, photos, submittals, and other information necessary to substantiate the reason for the request.
- G. RFI Log: Prepare and maintain a tabular log of RFIs for the duration of the project.
 - 1. Indicate current status of every RFI. Update log promptly and on a regular basis.
 - 2. Note dates of when each request is made, and when a response is received.
 - 3. Highlight items requiring priority or expedited response.
 - 4. Highlight items for which a timely response has not been received to date.
- H. Review Time: Architect will respond and return RFIs to Contractor within seven calendar days of receipt. For the purpose of establishing the start of the mandated response period, RFIs received after 12:00 noon will be considered as having been received on the following regular working day.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1. Response period may be shortened or lengthened for specific items, subject to mutual agreement, and recorded in a timely manner in progress meeting minutes.
- I. Responses: Content of answered RFIs will not constitute in any manner a directive or authorization to perform extra work or delay the project. If in Contractor's belief it is likely to lead to a change to Contract Sum or Contract Time, promptly issue a notice to this effect, and follow up with an appropriate Change Order request to Owner.
 1. Response may include a request for additional information, in which case the original RFI will be deemed as having been answered, and an amended one is to be issued forthwith. Identify the amended RFI with an R suffix to the original number.
 2. Do not extend applicability of a response to specific item to encompass other similar conditions, unless specifically so noted in the response.
 3. Upon receipt of a response, promptly review and distribute it to all affected parties, and update the RFI Log.
 4. Notify Architect within seven calendar days if an additional or corrected response is required by submitting an amended version of the original RFI, identified as specified above.

3.05 SUBMITTAL SCHEDULE

- A. Submit to Architect for review a schedule for submittals in tabular format.
 1. Coordinate with Contractor's construction schedule and schedule of values.
 2. Format schedule to allow tracking of status of submittals throughout duration of construction.
 3. Arrange information to include scheduled date for initial submittal, specification number and title, submittal category (for review or for information), description of item of work covered, and role and name of subcontractor.

3.06 SUBMITTALS FOR REVIEW

- A. When the following are specified in individual sections, submit them for review:
 1. Product data.
 2. Shop drawings.
 3. Samples for selection.
 4. Samples for verification.
- B. Submit to Architect for review for the limited purpose of checking for compliance with information given and the design concept expressed in Contract Documents.
- C. Samples will be reviewed for aesthetic, color, or finish selection.
- D. After review, provide copies and distribute in accordance with SUBMITTAL PROCEDURES article below and for record documents purposes described in Section 01 7800 - Closeout Submittals.

3.07 SUBMITTALS FOR INFORMATION

- A. When the following are specified in individual sections, submit them for information:
 1. Design data.
 2. Certificates.
 3. Test reports.
 4. Inspection reports.
 5. Manufacturer's instructions.
 6. Manufacturer's field reports.
 7. Other types indicated.
- B. Submit for Architect's knowledge as contract administrator or for Owner.

3.08 SUBMITTALS FOR PROJECT CLOSEOUT

- A. Submit Correction Punch List for Substantial Completion.
- B. Submit Final Correction Punch List for Substantial Completion.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- C. When the following are specified in individual sections, submit them at project closeout in compliance with requirements of Section 01 7800 - Closeout Submittals:
 - 1. Project record documents.
 - 2. Operation and maintenance data.
 - 3. Warranties.
 - 4. Bonds.
 - 5. Other types as indicated.
- D. Submit for Owner's benefit during and after project completion.

3.09 NUMBER OF COPIES OF SUBMITTALS

- A. Electronic Documents: Submit one electronic copy in PDF format; an electronically-marked up file will be returned. Create PDFs at native size and right-side up; illegible files will be rejected.
- B. Samples: Submit the number specified in individual specification sections; one of which will be retained by Architect.
 - 1. After review, produce duplicates.
 - 2. Retained samples will not be returned to Contractor unless specifically so stated.

3.10 SUBMITTAL PROCEDURES

- A. General Requirements:
 - 1. Use a single transmittal for related items.
 - 2. Transmit using approved form.
 - a. Use form generated by Electronic Document Submittal Service software.
 - 3. Sequentially identify each item. For revised submittals use original number and a sequential numerical suffix.
 - 4. Identify: Project; Contractor; subcontractor or supplier; pertinent drawing and detail number; and specification section number and article/paragraph, as appropriate on each copy.
 - 5. Provide space for Contractor and Architect review stamps.
 - 6. When revised for resubmission, identify all changes made since previous submission.

3.11 SUBMITTAL REVIEW

- A. Submittals for Review: Architect will review each submittal, and approve, or take other appropriate action.
- B. Submittals for Information: Architect will acknowledge receipt and review. See below for actions to be taken.
- C. Architect's actions will be reflected by marking each returned submittal using virtual stamp on electronic submittals.
- D. Architect's and consultants' actions on items submitted for review:
 - 1. Authorizing purchasing, fabrication, delivery, and installation:
 - a. "Approved", or language with same legal meaning.
 - b. "Approved as Noted, Resubmission not required", or language with same legal meaning.
 - 1) At Contractor's option, submit corrected item, with review notations acknowledged and incorporated.
 - c. "Approved as Noted, Resubmit for Record", or language with same legal meaning.
 - 2. Not Authorizing fabrication, delivery, and installation:
- E. Architect's and consultants' actions on items submitted for information:
 - 1. Items for which no action was taken:
 - a. "Received" - to notify the Contractor that the submittal has been received for record only.
 - 2. Items for which action was taken:
 - a. "Reviewed" - no further action is required from Contractor.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 01 3216
CONSTRUCTION PROGRESS SCHEDULE

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Preliminary schedule.
- B. Construction progress schedule, bar chart type.

1.02 RELATED SECTIONS

- A. Section 01 1000 - Summary: Work sequence.

1.03 REFERENCE STANDARDS

- A. AGC (CPSM) - Construction Planning and Scheduling Manual; 2004.
- B. M-H (CPM) - CPM in Construction Management - Project Management with CPM; 2015.

1.04 SUBMITTALS

- A. Within 10 days after date of Agreement, submit preliminary schedule.
- B. If preliminary schedule requires revision after review, submit revised schedule within 10 days.
- C. Submit updated schedule with each Application for Payment.
- D. Submit under transmittal letter form specified in Section 01 3000 - Administrative Requirements.

1.05 QUALITY ASSURANCE

- A. Scheduler: Contractor's personnel or specialist Consultant specializing in CPM scheduling with one years minimum experience in scheduling construction work of a complexity comparable to this Project, and having use of computer facilities capable of delivering a detailed graphic printout within 48 hours of request.

1.06 SCHEDULE FORMAT

- A. Listings: In chronological order according to the start date for each activity. Identify each activity with the applicable specification section number.
- B. Sheet Size: Multiples of 8-1/2 x 11 inches (216 x 280 mm).
- C. Scale and Spacing: To allow for notations and revisions.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 PRELIMINARY SCHEDULE

- A. Prepare preliminary schedule in the form of a horizontal bar chart.

3.02 CONTENT

- A. Show complete sequence of construction by activity, with dates for beginning and completion of each element of construction.
- B. Identify each item by specification section number.
- C. Include conferences and meetings in schedule.
- D. Show accumulated percentage of completion of each item, and total percentage of Work completed, as of the first day of each month.
- E. Provide legend for symbols and abbreviations used.

3.03 BAR CHARTS

- A. Include a separate bar for each major portion of Work or operation.
- B. Identify the first work day of each week.

3.04 REVIEW AND EVALUATION OF SCHEDULE

- A. Participate in joint review and evaluation of schedule with Architect at each submittal.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Evaluate project status to determine work behind schedule and work ahead of schedule.
- C. After review, revise as necessary as result of review, and resubmit within 10 days.

3.05 UPDATING SCHEDULE

- A. Maintain schedules to record actual start and finish dates of completed activities.
- B. Indicate progress of each activity to date of revision, with projected completion date of each activity.
- C. Annotate diagrams to graphically depict current status of Work.
- D. Identify activities modified since previous submittal, major changes in Work, and other identifiable changes.
- E. Indicate changes required to maintain Date of Substantial Completion.
- F. Submit reports required to support recommended changes.

3.06 DISTRIBUTION OF SCHEDULE

- A. Distribute copies of updated schedules to Contractor's project site file, to subcontractors, suppliers, Architect, Owner, and other concerned parties.
- B. Instruct recipients to promptly report, in writing, problems anticipated by projections indicated in schedules.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 01 4000
QUALITY REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Submittals.
- B. Quality assurance.
- C. References and standards.
- D. Testing and inspection agencies and services.
- E. Control of installation.
- F. Tolerances.
- G. Defect Assessment.

1.02 RELATED REQUIREMENTS

- A. Document 00 3100 - Available Project Information: Soil investigation data.
- B. Document 00 7200 - General Conditions: Inspections and approvals required by public authorities.
- C. Section 01 4216 - Definitions.

1.03 REFERENCE STANDARDS

- A. ASTM C1021 - Standard Practice for Laboratories Engaged in Testing of Building Sealants; 2008 (Reapproved 2014).
- B. ASTM C1077 - Standard Practice for Agencies Testing Concrete and Concrete Aggregates for Use in Construction and Criteria for Testing Agency Evaluation; 2017.
- C. ASTM D3740 - Standard Practice for Minimum Requirements for Agencies Engaged in the Testing and/or Inspection of Soil and Rock as Used in Engineering Design and Construction; 2019.
- D. ASTM E543 - Standard Specification for Agencies Performing Nondestructive Testing; 2015.
- E. ASTM E699 - Standard Specification for Agencies Involved in Testing, Quality Assurance, and Evaluating of Manufactured Building Components; 2016.

1.04 DEFINITIONS

- A. Contractor's Quality Control Plan: Contractor's management plan for executing the Contract for Construction.
- B. Contractor's Professional Design Services: Design of some aspect or portion of the project by party other than the design professional of record. Provide these services as part of the Contract for Construction.
 - 1. Design Services Types Required:
- C. Design Data: Design-related, signed and sealed drawings, calculations, specifications, certifications, shop drawings and other submittals provided by Contractor, and prepared directly by, or under direct supervision of, appropriately licensed design professional.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Design Data: Submit for Architect's knowledge as contract administrator for the limited purpose of assessing compliance with information given and the design concept expressed in the Contract Documents, or for Owner's information.
- C. Test Reports: After each test/inspection, promptly submit two copies of report to Architect and to Contractor.
 - 1. Include:
 - a. Date issued.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- b. Project title and number.
 - c. Name of inspector.
 - d. Date and time of sampling or inspection.
 - e. Identification of product and specifications section.
 - f. Location in the Project.
 - g. Type of test/inspection.
 - h. Date of test/inspection.
 - i. Results of test/inspection.
 - j. Compliance with Contract Documents.
 - k. When requested by Architect, provide interpretation of results.
- D. Certificates: When specified in individual specification sections, submit certification by the manufacturer and Contractor or installation/application subcontractor to Architect, in quantities specified for Product Data.
- 1. Indicate material or product complies with or exceeds specified requirements. Submit supporting reference data, affidavits, and certifications as appropriate.
 - 2. Certificates may be recent or previous test results on material or product, but must be acceptable to Architect.
- E. Manufacturer's Instructions: When specified in individual specification sections, submit printed instructions for delivery, storage, assembly, installation, start-up, adjusting, and finishing, for the Owner's information. Indicate special procedures, perimeter conditions requiring special attention, and special environmental criteria required for application or installation.

1.06 REFERENCES AND STANDARDS

- A. For products and workmanship specified by reference to a document or documents not included in the Project Manual, also referred to as reference standards, comply with requirements of the standard, except when more rigid requirements are specified or are required by applicable codes.
- B. Comply with reference standard of date of issue current on date of Contract Documents, except where a specific date is established by applicable code.
- C. Obtain copies of standards where required by product specification sections.
- D. Maintain copy at project site during submittals, planning, and progress of the specific work, until Substantial Completion.
- E. Should specified reference standards conflict with Contract Documents, request clarification from Architect before proceeding.
- F. Neither the contractual relationships, duties, or responsibilities of the parties in Contract nor those of Architect shall be altered from Contract Documents by mention or inference otherwise in any reference document.

PART 3 EXECUTION

2.01 CONTROL OF INSTALLATION

- A. Monitor quality control over suppliers, manufacturers, products, services, site conditions, and workmanship, to produce work of specified quality.
- B. Comply with manufacturers' instructions, including each step in sequence.
- C. Should manufacturers' instructions conflict with Contract Documents, request clarification from Architect before proceeding.
- D. Comply with specified standards as minimum quality for the work except where more stringent tolerances, codes, or specified requirements indicate higher standards or more precise workmanship.
- E. Have work performed by persons qualified to produce required and specified quality.
- F. Verify that field measurements are as indicated on shop drawings or as instructed by the manufacturer.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- G. Secure products in place with positive anchorage devices designed and sized to withstand stresses, vibration, physical distortion, and disfigurement.

2.02 TOLERANCES

- A. Monitor fabrication and installation tolerance control of products to produce acceptable Work. Do not permit tolerances to accumulate.
- B. Comply with manufacturers' tolerances. Should manufacturers' tolerances conflict with Contract Documents, request clarification from Architect before proceeding.
- C. Adjust products to appropriate dimensions; position before securing products in place.

2.03 TESTING AND INSPECTION

- A. Testing Agency Duties:
 - 1. Provide qualified personnel at site. Cooperate with Architect and Contractor in performance of services.
 - 2. Perform specified sampling and testing of products in accordance with specified standards.
 - 3. Ascertain compliance of materials and mixes with requirements of Contract Documents.
 - 4. Promptly notify Architect and Contractor of observed irregularities or non-compliance of Work or products.
 - 5. Perform additional tests and inspections required by Architect.
 - 6. Submit reports of all tests/inspections specified.
- B. Limits on Testing/Inspection Agency Authority:
 - 1. Agency may not release, revoke, alter, or enlarge on requirements of Contract Documents.
 - 2. Agency may not approve or accept any portion of the Work.
 - 3. Agency may not assume any duties of Contractor.
 - 4. Agency has no authority to stop the Work.
- C. Contractor Responsibilities:
 - 1. Deliver to agency at designated location, adequate samples of materials proposed to be used that require testing, along with proposed mix designs.
 - 2. Cooperate with laboratory personnel, and provide access to the Work and to manufacturers' facilities.
 - 3. Provide incidental labor and facilities:
 - a. To provide access to Work to be tested/inspected.
 - b. To obtain and handle samples at the site or at source of Products to be tested/inspected.
 - c. To facilitate tests/inspections.
 - d. To provide storage and curing of test samples.
 - 4. Notify Architect and laboratory 24 hours prior to expected time for operations requiring testing/inspection services.
 - 5. Employ services of an independent qualified testing laboratory and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.
 - 6. Arrange with Owner's agency and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.
- D. Re-testing required because of non-compliance with specified requirements shall be performed by the same agency on instructions by Architect.
- E. Re-testing required because of non-compliance with specified requirements shall be paid for by Contractor.

2.04 DEFECT ASSESSMENT

- A. Replace Work or portions of the Work not complying with specified requirements.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 01 4216

DEFINITIONS

PART 1 GENERAL

1.01 SUMMARY

- A. Other definitions are included in individual specification sections.

1.02 DEFINITIONS

- A. Furnish: To supply, deliver, unload, and inspect for damage.
- B. Install: To unpack, assemble, erect, apply, place, finish, cure, protect, clean, start up, and make ready for use.
- C. Product: Material, machinery, components, equipment, fixtures, and systems forming the work result. Not materials or equipment used for preparation, fabrication, conveying, or erection and not incorporated into the work result. Products may be new, never before used, or re-used materials or equipment.
- D. Project Manual: The book-sized volume that includes the procurement requirements (if any), the contracting requirements, and the specifications.
- E. Provide: To furnish and install.
- F. Supply: Same as Furnish.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 01 5000

TEMPORARY FACILITIES AND CONTROLS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Temporary utilities.
- B. Temporary sanitary facilities.
- C. Temporary Controls: Barriers, enclosures, and fencing.
- D. Security requirements.
- E. Vehicular access and parking.
- F. Waste removal facilities and services.
- G. Project identification sign.
- H. Field offices.

1.02 RELATED REQUIREMENTS

- A. Section 01 5813 - Temporary Project Signage.

1.03 TEMPORARY UTILITIES

- A. Provide and pay for all electrical power, lighting, water, heating and cooling, and ventilation required for construction purposes.
- B. Use trigger-operated nozzles for water hoses, to avoid waste of water.

1.04 TEMPORARY SANITARY FACILITIES

- A. Provide and maintain required facilities and enclosures. Provide at time of project mobilization.
- B. Maintain daily in clean and sanitary condition.

1.05 BARRIERS

- A. Provide barriers to prevent unauthorized entry to construction areas, to prevent access to areas that could be hazardous to workers or the public, to allow for owner's use of site and to protect existing facilities and adjacent properties from damage from construction operations and demolition.
- B. Protect non-owned vehicular traffic, stored materials, site, and structures from damage.

1.06 FENCING

- A. Construction: Contractor's option.
- B. Provide 6 foot (1.8 m) high fence around construction site; equip with vehicular and pedestrian gates with locks.

1.07 INTERIOR ENCLOSURES

- A. Provide temporary partitions and ceilings as indicated to separate work areas from Owner-occupied areas, to prevent penetration of dust and moisture into Owner-occupied areas, and to prevent damage to existing materials and equipment.
- B. Construction: Framing and reinforced polyethylene sheet materials with closed joints and sealed edges at intersections with existing surfaces:

1.08 SECURITY

- A. Provide security and facilities to protect Work, existing facilities, and Owner's operations from unauthorized entry, vandalism, or theft.
- B. Coordinate with Owner's security program.

1.09 VEHICULAR ACCESS AND PARKING

- A. Coordinate access and haul routes with governing authorities and Owner.
- B. Provide and maintain access to fire hydrants, free of obstructions.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- C. Provide means of removing mud from vehicle wheels before entering streets.
- D. Provide temporary parking areas to accommodate construction personnel. When site space is not adequate, provide additional off-site parking.

1.10 WASTE REMOVAL

- A. See Section 01 7419 - Construction Waste Management and Disposal, for additional requirements.
- B. Provide waste removal facilities and services as required to maintain the site in clean and orderly condition.
- C. Provide containers with lids. Remove trash from site periodically.
- D. If materials to be recycled or re-used on the project must be stored on-site, provide suitable non-combustible containers; locate containers holding flammable material outside the structure unless otherwise approved by the authorities having jurisdiction.
- E. Open free-fall chutes are not permitted. Terminate closed chutes into appropriate containers with lids.

1.11 PROJECT IDENTIFICATION

- A. Provide project identification sign of design and construction indicated on drawings.
- B. Erect on site at location indicated.
- C. No other signs are allowed without Owner permission except those required by law.

1.12 FIELD OFFICES

- A. Office: Weathertight, with lighting, electrical outlets, heating, cooling equipment, and equipped with sturdy furniture, drawing rack, and drawing display table.
- B. Locate offices a minimum distance of 30 feet (10 m) from existing and new structures.

1.13 REMOVAL OF UTILITIES, FACILITIES, AND CONTROLS

- A. Remove temporary utilities, equipment, facilities, materials, prior to Date of Substantial Completion inspection.
- B. Clean and repair damage caused by installation or use of temporary work.
- C. Restore new permanent facilities used during construction to specified condition.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 01 6000
PRODUCT REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. General product requirements.
- B. Transportation, handling, storage and protection.
- C. Product option requirements.
- D. Substitution limitations.
- E. Maintenance materials, including extra materials, spare parts, tools, and software.

1.02 RELATED REQUIREMENTS

- A. Section 01 2500 - Substitution Procedures: Substitutions made during procurement and/or construction phases.
- B. Section 01 4000 - Quality Requirements: Product quality monitoring.
- C. Section 01 6116 - Volatile Organic Compound (VOC) Content Restrictions: Requirements for VOC-restricted product categories.
- D. Section 01 7419 - Construction Waste Management and Disposal: Waste disposal requirements potentially affecting product selection, packaging and substitutions.

1.03 REFERENCE STANDARDS

- A. BIFMA e3 - Furniture Sustainability Standard; Business and Institutional Furniture Manufacturers Association; 2019.
- B. EN 15804 - Sustainability of construction works - Environmental product declarations - Core rules for the product category of construction products; 2014.
- C. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- D. NSF 332 - Sustainability Assessment for Resilient Floor Coverings; 2015.

1.04 SUBMITTALS

- A. Proposed Products List: Submit list of major products proposed for use, with name of manufacturer, trade name, and model number of each product.
 - 1. Submit within 15 days after date of Agreement.
 - 2. For products specified only by reference standards, list applicable reference standards.
- B. Product Data Submittals: Submit manufacturer's standard published data. Mark each copy to identify applicable products, models, options, and other data. Supplement manufacturers' standard data to provide information specific to this Project.
- C. Shop Drawing Submittals: Prepared specifically for this Project; indicate utility and electrical characteristics, utility connection requirements, and location of utility outlets for service for functional equipment and appliances.
- D. Sample Submittals: Illustrate functional and aesthetic characteristics of the product, with integral parts and attachment devices. Coordinate sample submittals for interfacing work.
 - 1. For selection from standard finishes, submit samples of the full range of the manufacturer's standard colors, textures, and patterns.

PART 2 PRODUCTS

2.01 NEW PRODUCTS

- A. Provide new products unless specifically required or permitted by Contract Documents.
- B. Use of products having any of the following characteristics is not permitted:
 - 1. Made using or containing CFC's or HCFC's.
 - 2. Made of wood from newly cut old growth timber.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3. Containing lead, cadmium, or asbestos.
- C. Where other criteria are met, Contractor shall give preference to products that:
 1. If used on interior, have lower emissions, as defined in Section 01 6116.
 2. If wet-applied, have lower VOC content, as defined in Section 01 6116.
 3. Have longer documented life span under normal use.
 4. Result in less construction waste. See Section 01 7419

2.02 PRODUCT OPTIONS

- A. Products Specified by Reference Standards or by Description Only: Use any product meeting those standards or description.
- B. Products Specified by Naming One or More Manufacturers: Use a product of one of the manufacturers named and meeting specifications, no options or substitutions allowed.
- C. Products Specified by Naming One or More Manufacturers with a Provision for Substitutions: Submit a request for substitution for any manufacturer not named.

2.03 MAINTENANCE MATERIALS

- A. Furnish extra materials, spare parts, tools, and software of types and in quantities specified in individual specification sections.
- B. Deliver to Project site; obtain receipt prior to final payment.

PART 3 EXECUTION

3.01 SUBSTITUTION LIMITATIONS

- A. See Section 01 2500 - Substitution Procedures.

3.02 TRANSPORTATION AND HANDLING

- A. Package products for shipment in manner to prevent damage; for equipment, package to avoid loss of factory calibration.
- B. If special precautions are required, attach instructions prominently and legibly on outside of packaging.
- C. Coordinate schedule of product delivery to designated prepared areas in order to minimize site storage time and potential damage to stored materials.
- D. Transport and handle products in accordance with manufacturer's instructions.
- E. Transport materials in covered trucks to prevent contamination of product and littering of surrounding areas.
- F. Promptly inspect shipments to ensure that products comply with requirements, quantities are correct, and products are undamaged.
- G. Provide equipment and personnel to handle products by methods to prevent soiling, disfigurement, or damage, and to minimize handling.
- H. Arrange for the return of packing materials, such as wood pallets, where economically feasible.

3.03 STORAGE AND PROTECTION

- A. Designate receiving/storage areas for incoming products so that they are delivered according to installation schedule and placed convenient to work area in order to minimize waste due to excessive materials handling and misapplication. See Section 01 7419.
- B. Store and protect products in accordance with manufacturers' instructions.
- C. Store with seals and labels intact and legible.
- D. Store sensitive products in weathertight, climate-controlled enclosures in an environment favorable to product.
- E. For exterior storage of fabricated products, place on sloped supports above ground.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- F. Protect products from damage or deterioration due to construction operations, weather, precipitation, humidity, temperature, sunlight and ultraviolet light, dirt, dust, and other contaminants.
- G. Comply with manufacturer's warranty conditions, if any.
- H. Cover products subject to deterioration with impervious sheet covering. Provide ventilation to prevent condensation and degradation of products.
- I. Prevent contact with material that may cause corrosion, discoloration, or staining.
- J. Provide equipment and personnel to store products by methods to prevent soiling, disfigurement, or damage.
- K. Arrange storage of products to permit access for inspection. Periodically inspect to verify products are undamaged and are maintained in acceptable condition.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 01 7000
EXECUTION AND CLOSEOUT REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Examination, preparation, and general installation procedures.
- B. Requirements for alterations work, including selective demolition, _____.
- C. Pre-installation meetings.
- D. Cleaning and protection.
- E. Starting of systems and equipment.
- F. Demonstration and instruction of Owner personnel.
- G. Closeout procedures, including Contractor's Correction Punch List, except payment procedures.
- H. General requirements for maintenance service.

1.02 RELATED REQUIREMENTS

- A. Section 01 1000 - Summary: Limitations on working in existing building; continued occupancy; work sequence; identification of salvaged and relocated materials.
- B. Section 01 3000 - Administrative Requirements: Submittals procedures, Electronic document submittal service.
- C. Section 01 4000 - Quality Requirements: Testing and inspection procedures.
- D. Section 01 5000 - Temporary Facilities and Controls: Temporary exterior enclosures.
- E. Section 01 5000 - Temporary Facilities and Controls: Temporary interior partitions.
- F. Section 01 5100 - Temporary Utilities: Temporary heating, cooling, and ventilating facilities.
- G. Section 01 7419 - Construction Waste Management and Disposal: Additional procedures for trash/waste removal, recycling, salvage, and reuse.
- H. Section 01 7800 - Closeout Submittals: Project record documents, operation and maintenance data, warranties, and bonds.
- I. Section 02 4100 - Demolition: Demolition of whole structures and parts thereof; site utility demolition.
- J. Section 07 8400 - Firestopping.

1.03 REFERENCE STANDARDS

- A. NFPA 241 - Standard for Safeguarding Construction, Alteration, and Demolition Operations; 2019.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Demolition Plan: Submit demolition plan as specified by OSHA and local authorities.
 - 1. Indicate extent of demolition, removal sequence, bracing and shoring, and location and construction of barricades and fences. Include design drawings and calculations for bracing and shoring.
 - 2. Include a summary of safety procedures.
- C. Cutting and Patching: Submit written request in advance of cutting or alteration that affects:
 - 1. Structural integrity of any element of Project.
 - 2. Integrity of weather exposed or moisture resistant element.
 - 3. Efficiency, maintenance, or safety of any operational element.
 - 4. Visual qualities of sight exposed elements.
 - 5. Work of Owner or separate Contractor.
- D. Project Record Documents: Accurately record actual locations of capped and active utilities.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1.05 QUALIFICATIONS

- A. For demolition work, employ a firm specializing in the type of work required.
 - 1. Minimum of 3 years of documented experience.
- B. For surveying work, employ a land surveyor registered in New York and acceptable to Architect. Submit evidence of surveyor's Errors and Omissions insurance coverage in the form of an Insurance Certificate. Employ only individual(s) trained and experienced in collecting and recording accurate data relevant to ongoing construction activities,
- C. For design of temporary shoring and bracing, employ a Professional Engineer experienced in design of this type of work and licensed in New York.

1.06 PROJECT CONDITIONS

- A. Use of explosives is not permitted.
- B. Ventilate enclosed areas to assist cure of materials, to dissipate humidity, and to prevent accumulation of dust, fumes, vapors, or gases.
- C. Dust Control: Execute work by methods to minimize raising dust from construction operations. Provide positive means to prevent air-borne dust from dispersing into atmosphere and over adjacent areas.
- D. Noise Control: Provide methods, means, and facilities to minimize noise produced by construction operations.
- E. Pollution Control: Provide methods, means, and facilities to prevent contamination of soil, water, and atmosphere from discharge of noxious, toxic substances, and pollutants produced by construction operations. Comply with federal, state, and local regulations.

1.07 COORDINATION

- A. Coordinate scheduling, submittals, and work of the various sections of the Project Manual to ensure efficient and orderly sequence of installation of interdependent construction elements, with provisions for accommodating items installed later.
- B. Notify affected utility companies and comply with their requirements.
- C. Verify that utility requirements and characteristics of new operating equipment are compatible with building utilities. Coordinate work of various sections having interdependent responsibilities for installing, connecting to, and placing in service, such equipment.
- D. Coordinate space requirements, supports, and installation of mechanical and electrical work that are indicated diagrammatically on drawings. Follow routing indicated for pipes, ducts, and conduit, as closely as practicable; place runs parallel with lines of building. Utilize spaces efficiently to maximize accessibility for other installations, for maintenance, and for repairs.
- E. In finished areas except as otherwise indicated, conceal pipes, ducts, and wiring within the construction. Coordinate locations of fixtures and outlets with finish elements.
- F. Coordinate completion and clean-up of work of separate sections.
- G. After Owner occupancy of premises, coordinate access to site for correction of defective work and work not in accordance with Contract Documents, to minimize disruption of Owner's activities.

PART 2 PRODUCTS

2.01 PATCHING MATERIALS

- A. New Materials: As specified in product sections; match existing products and work for patching and extending work.
- B. Type and Quality of Existing Products: Determine by inspecting and testing products where necessary, referring to existing work as a standard.
- C. Product Substitution: For any proposed change in materials, submit request for substitution described in Section 01 6000 - Product Requirements.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that existing site conditions and substrate surfaces are acceptable for subsequent work. Start of work means acceptance of existing conditions.
- B. Verify that existing substrate is capable of structural support or attachment of new work being applied or attached.
- C. Examine and verify specific conditions described in individual specification sections.
- D. Take field measurements before confirming product orders or beginning fabrication, to minimize waste due to over-ordering or misfabrication.
- E. Verify that utility services are available, of the correct characteristics, and in the correct locations.
- F. Prior to Cutting: Examine existing conditions prior to commencing work, including elements subject to damage or movement during cutting and patching. After uncovering existing work, assess conditions affecting performance of work. Beginning of cutting or patching means acceptance of existing conditions.

3.02 PREPARATION

- A. Clean substrate surfaces prior to applying next material or substance.
- B. Seal cracks or openings of substrate prior to applying next material or substance.
- C. Apply manufacturer required or recommended substrate primer, sealer, or conditioner prior to applying any new material or substance in contact or bond.

3.03 PREINSTALLATION MEETINGS

- A. When required in individual specification sections, convene a preinstallation meeting at the site prior to commencing work of the section.
- B. Require attendance of parties directly affecting, or affected by, work of the specific section.
- C. Notify Architect four days in advance of meeting date.
- D. Prepare agenda and preside at meeting:
 - 1. Review conditions of examination, preparation and installation procedures.
 - 2. Review coordination with related work.
- E. Record minutes and distribute copies within two days after meeting to participants, with two copies to Architect, Owner, participants, and those affected by decisions made.

3.04 LAYING OUT THE WORK

- A. Verify locations of survey control points prior to starting work.
- B. Promptly notify Architect of any discrepancies discovered.
- C. Protect survey control points prior to starting site work; preserve permanent reference points during construction.
- D. Promptly report to Architect the loss or destruction of any reference point or relocation required because of changes in grades or other reasons.
- E. Replace dislocated survey control points based on original survey control. Make no changes without prior written notice to Architect.
- F. Utilize recognized engineering survey practices.
- G. Establish elevations, lines and levels. Locate and lay out by instrumentation and similar appropriate means:
 - 1. Site improvements including pavements; stakes for grading, fill and topsoil placement; utility locations, slopes, and invert elevations.
 - 2. Grid or axis for structures.
 - 3. Building foundation, column locations, ground floor elevations.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- H. Periodically verify layouts by same means.
- I. Maintain a complete and accurate log of control and survey work as it progresses.

3.05 GENERAL INSTALLATION REQUIREMENTS

- A. Install products as specified in individual sections, in accordance with manufacturer's instructions and recommendations, and so as to avoid waste due to necessity for replacement.
- B. Make vertical elements plumb and horizontal elements level, unless otherwise indicated.
- C. Install equipment and fittings plumb and level, neatly aligned with adjacent vertical and horizontal lines, unless otherwise indicated.
- D. Make consistent texture on surfaces, with seamless transitions, unless otherwise indicated.
- E. Make neat transitions between different surfaces, maintaining texture and appearance.

3.06 ALTERATIONS

- A. Drawings showing existing construction and utilities are based on casual field observation and existing record documents only.
 - 1. Verify that construction and utility arrangements are as indicated.
 - 2. Report discrepancies to Architect before disturbing existing installation.
 - 3. Beginning of alterations work constitutes acceptance of existing conditions.
- B. Remove existing work as indicated and as required to accomplish new work.
 - 1. Remove items indicated on drawings.
 - 2. Relocate items indicated on drawings.
 - 3. Where new surface finishes are to be applied to existing work, perform removals, patch, and prepare existing surfaces as required to receive new finish; remove existing finish if necessary for successful application of new finish.
 - 4. Where new surface finishes are not specified or indicated, patch holes and damaged surfaces to match adjacent finished surfaces as closely as possible.
- C. Services (Including but not limited to HVAC, Plumbing, Fire Protection, Electrical, and Telecommunications): Remove, relocate, and extend existing systems to accommodate new construction.
 - 1. Maintain existing active systems that are to remain in operation; maintain access to equipment and operational components; if necessary, modify installation to allow access or provide access panel.
 - 2. Where existing systems or equipment are not active and Contract Documents require reactivation, put back into operational condition; repair supply, distribution, and equipment as required.
 - 3. Where existing active systems serve occupied facilities but are to be replaced with new services, maintain existing systems in service until new systems are complete and ready for service.
 - a. Disable existing systems only to make switchovers and connections; minimize duration of outages.
 - b. Provide temporary connections as required to maintain existing systems in service.
 - 4. Verify that abandoned services serve only abandoned facilities.
 - 5. Remove abandoned pipe, ducts, conduits, and equipment, including those above accessible ceilings; remove back to source of supply where possible, otherwise cap stub and tag with identification; patch holes left by removal using materials specified for new construction.
- D. Protect existing work to remain.
 - 1. Prevent movement of structure; provide shoring and bracing if necessary.
 - 2. Perform cutting to accomplish removals neatly and as specified for cutting new work.
 - 3. Repair adjacent construction and finishes damaged during removal work.
- E. Adapt existing work to fit new work: Make as neat and smooth transition as possible.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- F. Patching: Where the existing surface is not indicated to be refinished, patch to match the surface finish that existed prior to cutting. Where the surface is indicated to be refinished, patch so that the substrate is ready for the new finish.
- G. Refinish existing surfaces as indicated:
 - 1. Where rooms or spaces are indicated to be refinished, refinish all visible existing surfaces to remain to the specified condition for each material, with a neat transition to adjacent finishes.
 - 2. If mechanical or electrical work is exposed accidentally during the work, re-cover and refinish to match.
- H. Clean existing systems and equipment.
- I. Remove demolition debris and abandoned items from alterations areas and dispose of off-site; do not burn or bury.
- J. Do not begin new construction in alterations areas before demolition is complete.
- K. Comply with all other applicable requirements of this section.

3.07 CUTTING AND PATCHING

- A. Whenever possible, execute the work by methods that avoid cutting or patching.
- B. See Alterations article above for additional requirements.
- C. Perform whatever cutting and patching is necessary to:
 - 1. Complete the work.
 - 2. Fit products together to integrate with other work.
 - 3. Provide openings for penetration of mechanical, electrical, and other services.
 - 4. Match work that has been cut to adjacent work.
 - 5. Repair areas adjacent to cuts to required condition.
 - 6. Repair new work damaged by subsequent work.
 - 7. Remove samples of installed work for testing when requested.
 - 8. Remove and replace defective and non-complying work.
- D. Execute work by methods that avoid damage to other work and that will provide appropriate surfaces to receive patching and finishing. In existing work, minimize damage and restore to original condition.
- E. Employ original installer to perform cutting for weather exposed and moisture resistant elements, and sight exposed surfaces.
- F. Cut rigid materials using masonry saw or core drill. Pneumatic tools not allowed without prior approval.
- G. Restore work with new products in accordance with requirements of Contract Documents.
- H. Fit work air tight to pipes, sleeves, ducts, conduit, and other penetrations through surfaces.
- I. At penetrations of fire rated walls, partitions, ceiling, or floor construction, completely seal voids with fire rated material in accordance with Section 07 8400, to full thickness of the penetrated element.
- J. Patching:
 - 1. Finish patched surfaces to match finish that existed prior to patching. On continuous surfaces, refinish to nearest intersection or natural break. For an assembly, refinish entire unit.
 - 2. Match color, texture, and appearance.
 - 3. Repair patched surfaces that are damaged, lifted, discolored, or showing other imperfections due to patching work. If defects are due to condition of substrate, repair substrate prior to repairing finish.

3.08 PROGRESS CLEANING

- A. Maintain areas free of waste materials, debris, and rubbish. Maintain site in a clean and orderly condition.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Remove debris and rubbish from pipe chases, plenums, attics, crawl spaces, and other closed or remote spaces, prior to enclosing the space.
- C. Broom and vacuum clean interior areas prior to start of surface finishing, and continue cleaning to eliminate dust.
- D. Collect and remove waste materials, debris, and trash/rubbish from site periodically and dispose off-site; do not burn or bury.

3.09 PROTECTION OF INSTALLED WORK

- A. Protect installed work from damage by construction operations.
- B. Provide special protection where specified in individual specification sections.
- C. Provide temporary and removable protection for installed products. Control activity in immediate work area to prevent damage.
- D. Provide protective coverings at walls, projections, jambs, sills, and soffits of openings.
- E. Protect finished floors, stairs, and other surfaces from traffic, dirt, wear, damage, or movement of heavy objects, by protecting with durable sheet materials.
- F. Prohibit traffic or storage upon waterproofed or roofed surfaces. If traffic or activity is necessary, obtain recommendations for protection from waterproofing or roofing material manufacturer.
- G. Remove protective coverings when no longer needed; reuse or recycle coverings if possible.

3.10 SYSTEM STARTUP

- A. Coordinate schedule for start-up of various equipment and systems.
- B. Verify that each piece of equipment or system has been checked for proper lubrication, drive rotation, belt tension, control sequence, and for conditions that may cause damage.
- C. Verify tests, meter readings, and specified electrical characteristics agree with those required by the equipment or system manufacturer.
- D. Verify that wiring and support components for equipment are complete and tested.
- E. Execute start-up under supervision of applicable Contractor personnel and manufacturer's representative in accordance with manufacturers' instructions.
- F. Submit a written report that equipment or system has been properly installed and is functioning correctly.

3.11 DEMONSTRATION AND INSTRUCTION

- A. Demonstrate start-up, operation, control, adjustment, trouble-shooting, servicing, maintenance, and shutdown of each item of equipment at scheduled time, at equipment location.
- B. For equipment or systems requiring seasonal operation, perform demonstration for other season within six months.
- C. Provide a qualified person who is knowledgeable about the Project to perform demonstration and instruction of Owner's personnel.

3.12 ADJUSTING

- A. Adjust operating products and equipment to ensure smooth and unhindered operation.

3.13 FINAL CLEANING

- A. Use cleaning materials that are nonhazardous.
- B. Clean interior and exterior glass, surfaces exposed to view; remove temporary labels, stains and foreign substances, polish transparent and glossy surfaces, vacuum carpeted and soft surfaces.
- C. Remove all labels that are not permanent. Do not paint or otherwise cover fire test labels or nameplates on mechanical and electrical equipment.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- D. Clean equipment and fixtures to a sanitary condition with cleaning materials appropriate to the surface and material being cleaned.
- E. Clean filters of operating equipment.
- F. Clean debris from roofs, gutters, downspouts, scuppers, overflow drains, area drains, and drainage systems.
- G. Clean site; sweep paved areas, rake clean landscaped surfaces.
- H. Remove waste, surplus materials, trash/rubbish, and construction facilities from the site; dispose of in legal manner; do not burn or bury.

3.14 CLOSEOUT PROCEDURES

- A. Make submittals that are required by governing or other authorities.
- B. Accompany Project Coordinator on preliminary inspection to determine items to be listed for completion or correction in the Contractor's Correction Punch List for Contractor's Notice of Substantial Completion.
- C. Notify Architect when work is considered ready for Architect's Substantial Completion inspection.
- D. Submit written certification containing Contractor's Correction Punch List, that Contract Documents have been reviewed, work has been inspected, and that work is complete in accordance with Contract Documents and ready for Architect's Substantial Completion inspection.
- E. Conduct Substantial Completion inspection and create Final Correction Punch List containing Architect's and Contractor's comprehensive list of items identified to be completed or corrected and submit to Architect.
- F. Correct items of work listed in Final Correction Punch List and comply with requirements for access to Owner-occupied areas.
- G. Notify Architect when work is considered finally complete and ready for Architect's Substantial Completion final inspection.
- H. Complete items of work determined by Architect listed in executed Certificate of Substantial Completion.

3.15 MAINTENANCE

- A. Provide service and maintenance of components indicated in specification sections.
- B. Maintenance Period: As indicated in specification sections or, if not indicated, not less than one year from the Date of Substantial Completion or the length of the specified warranty, whichever is longer.
- C. Examine system components at a frequency consistent with reliable operation. Clean, adjust, and lubricate as required.
- D. Include systematic examination, adjustment, and lubrication of components. Repair or replace parts whenever required. Use parts produced by the manufacturer of the original component.
- E. Maintenance service shall not be assigned or transferred to any agent or subcontractor without prior written consent of the Owner.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 01 7419

CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL

PART 1 GENERAL

1.01 WASTE MANAGEMENT REQUIREMENTS

- A. Owner requires that this project generate the least amount of trash and waste possible.
- B. Employ processes that ensure the generation of as little waste as possible due to error, poor planning, breakage, mishandling, contamination, or other factors.
- C. Minimize trash/waste disposal in landfills; reuse, salvage, or recycle as much waste as economically feasible.
- D. Required Recycling, Salvage, and Reuse: The following may not be disposed of in landfills or by incineration:
 - 1. Aluminum and plastic beverage containers.
 - 2. Corrugated cardboard.
 - 3. Wood pallets.
 - 4. Clean dimensional wood.
 - 5. Land clearing debris, including brush, branches, logs, and stumps; see Section 31 1000 - Site Clearing for use options.
 - 6. Metals, including packaging banding, metal studs, sheet metal, structural steel, piping, reinforcing bars, door frames, and other items made of steel, iron, galvanized steel, stainless steel, aluminum, copper, zinc, lead, brass, and bronze.
- E. Contractor shall submit periodic Waste Disposal Reports; all landfill disposal, incineration, recycling, salvage, and reuse must be reported regardless of to whom the cost or savings accrues; use the same units of measure on all reports.
- F. Methods of trash/waste disposal that are not acceptable are:
 - 1. Burning on the project site.
 - 2. Burying on the project site.
 - 3. Dumping or burying on other property, public or private.
 - 4. Other illegal dumping or burying.
- G. Regulatory Requirements: Contractor is responsible for knowing and complying with regulatory requirements, including but not limited to Federal, state and local requirements, pertaining to legal disposal of all construction and demolition waste materials.

1.02 RELATED REQUIREMENTS

- A. Section 01 1000 - Summary: List of items to be salvaged from the existing building for relocation in project or for Owner.
- B. Section 01 3000 - Administrative Requirements: Additional requirements for project meetings, reports, submittal procedures, and project documentation.
- C. Section 01 5000 - Temporary Facilities and Controls: Additional requirements related to trash/waste collection and removal facilities and services.
- D. Section 01 6000 - Product Requirements: Waste prevention requirements related to delivery, storage, and handling.
- E. Section 01 7000 - Execution and Closeout Requirements: Trash/waste prevention procedures related to demolition, cutting and patching, installation, protection, and cleaning.
- F. Section 31 1000 - Site Clearing: Handling and disposal of land clearing debris.

1.03 DEFINITIONS

- A. Clean: Untreated and unpainted; not contaminated with oils, solvents, caulk, or the like.
- B. Construction and Demolition Waste: Solid wastes typically including building materials, packaging, trash, debris, and rubble resulting from construction, remodeling, repair and demolition operations.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- C. Hazardous: Exhibiting the characteristics of hazardous substances, i.e., ignitibility, corrosivity, toxicity or reactivity.
- D. Nonhazardous: Exhibiting none of the characteristics of hazardous substances, i.e., ignitibility, corrosivity, toxicity, or reactivity.
- E. Nontoxic: Neither immediately poisonous to humans nor poisonous after a long period of exposure.
- F. Recyclable: The ability of a product or material to be recovered at the end of its life cycle and remanufactured into a new product for reuse by others.
- G. Recycle: To remove a waste material from the project site to another site for remanufacture into a new product for reuse by others.
- H. Recycling: The process of sorting, cleansing, treating and reconstituting solid waste and other discarded materials for the purpose of using the altered form. Recycling does not include burning, incinerating, or thermally destroying waste.
- I. Return: To give back reusable items or unused products to vendors for credit.
- J. Reuse: To reuse a construction waste material in some manner on the project site.
- K. Salvage: To remove a waste material from the project site to another site for resale or reuse by others.
- L. Sediment: Soil and other debris that has been eroded and transported by storm or well production run-off water.
- M. Source Separation: The act of keeping different types of waste materials separate beginning from the first time they become waste.
- N. Toxic: Poisonous to humans either immediately or after a long period of exposure.
- O. Trash: Any product or material unable to be reused, returned, recycled, or salvaged.
- P. Waste: Extra material or material that has reached the end of its useful life in its intended use. Waste includes salvageable, returnable, recyclable, and reusable material.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Waste Disposal Reports: Submit at specified intervals, with details of quantities of trash and waste, means of disposal or reuse, and costs; show both totals to date and since last report.
 - 1. Submit updated Report with each Application for Progress Payment; failure to submit Report will delay payment.
 - 2. Submit Report on a form acceptable to Owner.
 - 3. Landfill Disposal: Include the following information:
 - a. Identification of material.
 - b. Amount, in tons or cubic yards (cubic meters), of trash/waste material from the project disposed of in landfills.
 - c. State the identity of landfills, total amount of tipping fees paid to landfill, and total disposal cost.
 - d. Include manifests, weight tickets, receipts, and invoices as evidence of quantity and cost.
 - 4. Incinerator Disposal: Include the following information:
 - a. Identification of material.
 - b. Amount, in tons or cubic yards (cubic meters), of trash/waste material from the project delivered to incinerators.
 - c. State the identity of incinerators, total amount of fees paid to incinerator, and total disposal cost.
 - d. Include manifests, weight tickets, receipts, and invoices as evidence of quantity and cost.
 - 5. Recycled and Salvaged Materials: Include the following information for each:

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- a. Identification of material, including those retrieved by installer for use on other projects.
 - b. Amount, in tons or cubic yards (cubic meters), date removed from the project site, and receiving party.
 - c. Transportation cost, amount paid or received for the material, and the net total cost or savings of salvage or recycling each material.
 - d. Include manifests, weight tickets, receipts, and invoices as evidence of quantity and cost.
 - e. Certification by receiving party that materials will not be disposed of in landfills or by incineration.
6. Material Reused on Project: Include the following information for each:
- a. Identification of material and how it was used in the project.
 - b. Amount, in tons or cubic yards (cubic meters).
 - c. Include weight tickets as evidence of quantity.
7. Other Disposal Methods: Include information similar to that described above, as appropriate to disposal method.

PART 3 EXECUTION

2.01 WASTE MANAGEMENT PROCEDURES

- A. See Section 01 3000 for additional requirements for project meetings, reports, submittal procedures, and project documentation.
- B. See Section 01 5000 for additional requirements related to trash/waste collection and removal facilities and services.
- C. See Section 01 6000 for waste prevention requirements related to delivery, storage, and handling.
- D. See Section 01 7000 for trash/waste prevention procedures related to demolition, cutting and patching, installation, protection, and cleaning.

2.02 WASTE MANAGEMENT PLAN IMPLEMENTATION

- A. Manager: Designate an on-site person or persons responsible for instructing workers and overseeing and documenting results of the Waste Management Plan.
- B. Communication: Distribute copies of the Waste Management Plan to job site foreman, each subcontractor, Owner, and Architect.
- C. Instruction: Provide on-site instruction of appropriate separation, handling, and recycling, salvage, reuse, and return methods to be used by all parties at the appropriate stages of the project.
- D. Meetings: Discuss trash/waste management goals and issues at project meetings.
 1. Prebid meeting.
 2. Preconstruction meeting.
 3. Regular job-site meetings.
- E. Facilities: Provide specific facilities for separation and storage of materials for recycling, salvage, reuse, return, and trash disposal, for use by all contractors and installers.
 1. Provide containers as required.
 2. Provide adequate space for pick-up and delivery and convenience to subcontractors.
 3. Keep recycling and trash/waste bin areas neat and clean and clearly marked in order to avoid contamination of materials.
- F. Hazardous Wastes: Separate, store, and dispose of hazardous wastes according to applicable regulations.
- G. Recycling: Separate, store, protect, and handle at the site identified recyclable waste products in order to prevent contamination of materials and to maximize recyclability of identified materials. Arrange for timely pickups from the site or deliveries to recycling facility in order to prevent contamination of recyclable materials.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- H. Reuse of Materials On-Site: Set aside, sort, and protect separated products in preparation for reuse.
- I. Salvage: Set aside, sort, and protect products to be salvaged for reuse off-site.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 01 7800
CLOSEOUT SUBMITTALS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Project Record Documents.
- B. Operation and Maintenance Data.
- C. Warranties and bonds.

1.02 RELATED REQUIREMENTS

- A. Section 00 7200 - General Conditions and 00 7300 - Supplementary Conditions: Performance bond and labor and material payment bonds, warranty, and correction of work.
- B. Section 01 3000 - Administrative Requirements: Submittals procedures, shop drawings, product data, and samples.
- C. Section 01 7000 - Execution and Closeout Requirements: Contract closeout procedures.
- D. Individual Product Sections: Specific requirements for operation and maintenance data.
- E. Individual Product Sections: Warranties required for specific products or Work.

1.03 SUBMITTALS

- A. Project Record Documents: Submit documents to Architect with claim for final Application for Payment.
- B. Operation and Maintenance Data:
 - 1. For equipment, or component parts of equipment put into service during construction and operated by Owner, submit completed documents within ten days after acceptance.
 - 2. Submit one copy of completed documents 15 days prior to final inspection. This copy will be reviewed and returned after final inspection, with Architect comments. Revise content of all document sets as required prior to final submission.
 - 3. Submit two sets of revised final documents in final form within 10 days after final inspection.
- C. Warranties and Bonds:
 - 1. For equipment or component parts of equipment put into service during construction with Owner's permission, submit documents within 10 days after acceptance.
 - 2. Make other submittals within 10 days after Date of Substantial Completion, prior to final Application for Payment.
 - 3. For items of Work for which acceptance is delayed beyond Date of Substantial Completion, submit within 10 days after acceptance, listing the date of acceptance as the beginning of the warranty period.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 PROJECT RECORD DOCUMENTS

- A. Maintain on site one set of the following record documents; record actual revisions to the Work:
 - 1. Drawings.
 - 2. Specifications.
 - 3. Addenda.
 - 4. Change Orders and other modifications to the Contract.
- B. Ensure entries are complete and accurate, enabling future reference by Owner.
- C. Store record documents separate from documents used for construction.
- D. Record information concurrent with construction progress.
- E. Specifications: Legibly mark and record at each product section description of actual products installed, including the following:

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1. Changes made by Addenda and modifications.
- F. Record Drawings: Legibly mark each item to record actual construction including:
 1. Field changes of dimension and detail.
 2. Details not on original Contract drawings.

3.02 OPERATION AND MAINTENANCE DATA

- A. Source Data: For each product or system, list names, addresses and telephone numbers of Subcontractors and suppliers, including local source of supplies and replacement parts.
- B. Product Data: Mark each sheet to clearly identify specific products and component parts, and data applicable to installation. Delete inapplicable information.
- C. Drawings: Supplement product data to illustrate relations of component parts of equipment and systems, to show control and flow diagrams. Do not use Project Record Documents as maintenance drawings.
- D. Typed Text: As required to supplement product data. Provide logical sequence of instructions for each procedure, incorporating manufacturer's instructions.

3.03 OPERATION AND MAINTENANCE DATA FOR MATERIALS AND FINISHES

- A. For Each Product, Applied Material, and Finish:
 1. Product data, with catalog number, size, composition, and color and texture designations.
 2. Information for re-ordering custom manufactured products.
- B. Instructions for Care and Maintenance: Manufacturer's recommendations for cleaning agents and methods, precautions against detrimental cleaning agents and methods, and recommended schedule for cleaning and maintenance.
- C. Moisture protection and weather-exposed products: Include product data listing applicable reference standards, chemical composition, and details of installation. Provide recommendations for inspections, maintenance, and repair.
- D. Additional information as specified in individual product specification sections.
- E. Where additional instructions are required, beyond the manufacturer's standard printed instructions, have instructions prepared by personnel experienced in the operation and maintenance of the specific products.

3.04 OPERATION AND MAINTENANCE DATA FOR EQUIPMENT AND SYSTEMS

- A. For Each Item of Equipment and Each System:
 1. Description of unit or system, and component parts.
 2. Identify function, normal operating characteristics, and limiting conditions.
 3. Include performance curves, with engineering data and tests.
 4. Complete nomenclature and model number of replaceable parts.
- B. Where additional instructions are required, beyond the manufacturer's standard printed instructions, have instructions prepared by personnel experienced in the operation and maintenance of the specific products.
- C. Panelboard Circuit Directories: Provide electrical service characteristics, controls, and communications; typed.
- D. Operating Procedures: Include start-up, break-in, and routine normal operating instructions and sequences. Include regulation, control, stopping, shut-down, and emergency instructions. Include summer, winter, and any special operating instructions.
- E. Maintenance Requirements: Include routine procedures and guide for preventative maintenance and trouble shooting; disassembly, repair, and reassembly instructions; and alignment, adjusting, balancing, and checking instructions.
- F. Provide servicing and lubrication schedule, and list of lubricants required.
- G. Include manufacturer's printed operation and maintenance instructions.
- H. Include sequence of operation by controls manufacturer.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- I. Provide original manufacturer's parts list, illustrations, assembly drawings, and diagrams required for maintenance.
- J. Provide control diagrams by controls manufacturer as installed.
- K. Provide Contractor's coordination drawings, with color coded piping diagrams as installed.
- L. Provide charts of valve tag numbers, with location and function of each valve, keyed to flow and control diagrams.
- M. Provide list of original manufacturer's spare parts, current prices, and recommended quantities to be maintained in storage.
- N. Include test and balancing reports.
- O. Additional Requirements: As specified in individual product specification sections.

3.05 ASSEMBLY OF OPERATION AND MAINTENANCE MANUALS

- A. Assemble operation and maintenance data into durable manuals for Owner's personnel use, with data arranged in the same sequence as, and identified by, the specification sections.
- B. Where systems involve more than one specification section, provide separate tabbed divider for each system.
- C. Binders: Commercial quality, 8-1/2 by 11 inch (216 by 280 mm) three D side ring binders with durable plastic covers; 2 inch (50 mm) maximum ring size. When multiple binders are used, correlate data into related consistent groupings.
- D. Cover: Identify each binder with typed or printed title OPERATION AND MAINTENANCE INSTRUCTIONS; identify title of Project; identify subject matter of contents.
- E. Project Directory: Title and address of Project; names, addresses, and telephone numbers of Architect, Consultants, Contractor and subcontractors, with names of responsible parties.
- F. Tables of Contents: List every item separated by a divider, using the same identification as on the divider tab; where multiple volumes are required, include all volumes Tables of Contents in each volume, with the current volume clearly identified.
- G. Dividers: Provide tabbed dividers for each separate product and system; identify the contents on the divider tab; immediately following the divider tab include a description of product and major component parts of equipment.
- H. Text: Manufacturer's printed data, or typewritten data on 20 pound paper.
- I. Drawings: Provide with reinforced punched binder tab. Bind in with text; fold larger drawings to size of text pages.
- J. Arrangement of Contents: Organize each volume in parts as follows:
 - 1. Project Directory.
 - 2. Table of Contents, of all volumes, and of this volume.
 - 3. Operation and Maintenance Data: Arranged by system, then by product category.
 - a. Source data.
 - b. Operation and maintenance data.
 - c. Field quality control data.
 - d. Photocopies of warranties and bonds.

3.06 WARRANTIES AND BONDS

- A. Obtain warranties and bonds, executed in duplicate by responsible Subcontractors, suppliers, and manufacturers, within 10 days after completion of the applicable item of work. Except for items put into use with Owner's permission, leave date of beginning of time of warranty until Date of Substantial completion is determined.
- B. Verify that documents are in proper form, contain full information, and are notarized.
- C. Co-execute submittals when required.
- D. Retain warranties and bonds until time specified for submittal.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- E. Include originals of each in operation and maintenance manuals, indexed separately on Table of Contents.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

**SECTION 02 4100
DEMOLITION**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Selective demolition of building elements for alteration purposes.

1.02 RELATED REQUIREMENTS

- A. Section 01 1000 - Summary: Limitations on Contractor's use of site and premises.
- B. Section 01 1000 - Summary: Sequencing and staging requirements.
- C. Section 01 5000 - Temporary Facilities and Controls: Site fences, security, protective barriers, and waste removal.
- D. Section 01 7000 - Execution and Closeout Requirements: Project conditions; protection of bench marks, survey control points, and existing construction to remain; reinstallation of removed products; temporary bracing and shoring.
- E. Section 01 7419 - Construction Waste Management and Disposal: Limitations on disposal of removed materials; requirements for recycling.

1.03 REFERENCE STANDARDS

- A. 29 CFR 1926 - U.S. Occupational Safety and Health Standards; current edition.
- B. NFPA 241 - Standard for Safeguarding Construction, Alteration, and Demolition Operations; 2019.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Demolition Plan: Submit demolition plan as specified by OSHA and local authorities.
 - 1. Indicate extent of demolition, removal sequence, bracing and shoring, and location and construction of barricades and fences.
 - 2. Identify demolition firm and submit qualifications.
 - 3. Include a summary of safety procedures.
- C. Project Record Documents: Accurately record actual locations of capped and active utilities and subsurface construction.

1.05 QUALITY ASSURANCE

- A. Demolition Firm Qualifications: Company specializing in the type of work required.
 - 1. Minimum of 3 years of documented experience.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Fill Material: As specified in Section 31 2323 - Fill.

PART 3 EXECUTION

3.01 SCOPE

- A. Remove Equipment & Fixtures per drawings, Save for reuse as indicated.
- B. Demolish & Remove portion of existing building as indicated within drawings.
- C. Cut, Terminate, and Remove utilities as indicated, work to include but is not limited to Mechanical, Electrical, Plumbing, & Fire Protection.

3.02 GENERAL PROCEDURES AND PROJECT CONDITIONS

- A. Comply with applicable codes and regulations for demolition operations and safety of adjacent structures and the public.
 - 1. Obtain required permits.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2. Take precautions to prevent catastrophic or uncontrolled collapse of structures to be removed; do not allow worker or public access within range of potential collapse of unstable structures.
 3. Provide, erect, and maintain temporary barriers and security devices.
 4. Conduct operations to minimize effects on and interference with adjacent structures and occupants.
 5. Do not close or obstruct roadways or sidewalks without permit.
 6. Conduct operations to minimize obstruction of public and private entrances and exits; do not obstruct required exits at any time; protect persons using entrances and exits from removal operations.
 7. Obtain written permission from owners of adjacent properties when demolition equipment will traverse, infringe upon or limit access to their property.
- B. Do not begin removal until receipt of notification to proceed from Owner.
- C. Protect existing structures and other elements that are not to be removed.
1. Provide bracing and shoring.
 2. Prevent movement or settlement of adjacent structures.
 3. Stop work immediately if adjacent structures appear to be in danger.
- D. Hazardous Materials: Comply with 29 CFR 1926 and state and local regulations.
- E. Partial Removal of Paving and Curbs: Neatly saw cut at right angle to surface.

3.03 EXISTING UTILITIES

- A. Coordinate work with utility companies; notify before starting work and comply with their requirements; obtain required permits.
- B. Protect existing utilities to remain from damage.
- C. Do not disrupt public utilities without permit from authority having jurisdiction.
- D. Do not close, shut off, or disrupt existing utility branches or take-offs that are in use without at least 3 days prior written notification to Owner.
- E. Locate and mark utilities to remain; mark using highly visible tags or flags, with identification of utility type; protect from damage due to subsequent construction, using substantial barricades if necessary.
- F. Remove exposed piping, valves, meters, equipment, supports, and foundations of disconnected and abandoned utilities.
- G. Prepare building demolition areas by disconnecting and capping utilities outside the demolition zone; identify and mark utilities to be subsequently reconnected, in same manner as other utilities to remain.

3.04 SELECTIVE DEMOLITION FOR ALTERATIONS

- A. Drawings showing existing construction and utilities are based on casual field observation and existing record documents only.
1. Verify that construction and utility arrangements are as indicated.
 2. Report discrepancies to Architect before disturbing existing installation.
 3. Beginning of demolition work constitutes acceptance of existing conditions that would be apparent upon examination prior to starting demolition.
- B. Remove existing work as indicated and as required to accomplish new work.
1. Remove items indicated on drawings.
- C. Services (Including but not limited to HVAC, Plumbing, Fire Protection, Electrical, Telecommunications, and Security): Remove existing systems and equipment as indicated.
1. Maintain existing active systems that are to remain in operation; maintain access to equipment and operational components.
 2. Where existing active systems serve occupied facilities but are to be replaced with new services, maintain existing systems in service until new systems are complete and ready for service.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3. Verify that abandoned services serve only abandoned facilities before removal.
 4. Remove abandoned pipe, ducts, conduits, and equipment, including those above accessible ceilings; remove back to source of supply where possible, otherwise cap stub and tag with identification.
- D. Protect existing work to remain.
1. Prevent movement of structure; provide shoring and bracing if necessary.
 2. Perform cutting to accomplish removals neatly and as specified for cutting new work.
 3. Repair adjacent construction and finishes damaged during removal work.
 4. Patch as specified for patching new work.

3.05 DEBRIS AND WASTE REMOVAL

- A. Remove debris, junk, and trash from site.
- B. Leave site in clean condition, ready for subsequent work.
- C. Clean up spillage and wind-blown debris from public and private lands.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 03 1000
CONCRETE FORMING AND ACCESSORIES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Formwork for cast-in place concrete, with bracing and anchorage.
- B. Openings for other work.
- C. Form accessories.

1.02 RELATED REQUIREMENTS

- A. Section 03 2000 - Concrete Reinforcing.
- B. Section 03 3000 - Cast-in-Place Concrete.
- C. Section 31 2316 - Excavation: Shoring and underpinning for excavation.

1.03 PRICE AND PAYMENT PROCEDURES

- A. See Section 01 2200 - Unit Prices, for additional unit price requirements.
- B. Measurement and payment of forming work will be by the unit price method.
- C. Formwork (Vertical Structures): Measure by the square foot (meter). Includes form materials, placement, placing accessories, stripping.
- D. Formwork (Horizontal Structures): Measure by the square foot (meter). Includes form materials, placement, placing accessories, stripping.

1.04 REFERENCE STANDARDS

- A. ACI 117 - Specifications for Tolerances for Concrete Construction and Materials; 2010 (Reapproved 2015).
- B. ACI 301 - Specifications for Structural Concrete; 2016.
- C. ACI 318 - Building Code Requirements for Structural Concrete and Commentary; 2014 (Errata 2018).
- D. ACI 347R - Guide to Formwork for Concrete; 2014, with Errata (2017).
- E. ASTM B221 - Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes; 2014.
- F. ASTM B221M - Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes (Metric); 2013.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Design Data: As required by authorities having jurisdiction.

1.06 QUALITY ASSURANCE

- A. Perform work of this section in accordance with Highways standards of the State of New York.
- B. Maintain one copy of each installation standard on site throughout the duration of concrete work.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Store prefabricated forms off ground in ventilated and protected manner to prevent deterioration from moisture.
- B. Protect plastic foam products from damage and exposure to sunlight.

PART 2 PRODUCTS

2.01 FORMWORK - GENERAL

- A. Provide concrete forms, accessories, shoring, and bracing as required to accomplish cast-in-place concrete work.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Design and construct concrete that complies with design with respect to shape, lines, and dimensions.
- C. Comply with applicable state and local codes with respect to design, fabrication, erection, and removal of formwork.
- D. Comply with relevant portions of ACI 347R, ACI 301, and ACI 318.
- E. Comply with Highways standards of the State of New York.

2.02 WOOD FORM MATERIALS

- A. Form Materials: At the discretion of the Contractor.

2.03 REMOVABLE PREFABRICATED FORMS

- A. Preformed Steel Forms: Minimum 16 gauge, 0.0598 inch (1.52 mm) thick, matched, tight fitting, stiffened to support weight of concrete without deflection detrimental to tolerances and appearance of finished surfaces.
- B. Preformed Aluminum Forms: ASTM B221 (ASTM B221M), 6061-T6 alloy, matched, tight fitting, stiffened to support weight of concrete without deflection detrimental to tolerances and appearance of finished surfaces.
- C. Preformed Plastic Forms: Thermoplastic polystyrene form liner, tight fitting, stiffened to support weight of concrete without deflection detrimental to tolerances and appearance of finished surfaces.
- D. Pan Type: Steel, of size and profile indicated.

2.04 FORMWORK ACCESSORIES

- A. Form Ties: Removable type, galvanized metal, fixed length, cone type, with waterproofing washer, free of defects that could leave holes larger than 1 inch (25 mm) in concrete surface.
- B. Form Release Agent: Capable of releasing forms from hardened concrete without staining or discoloring concrete or forming bugholes and other surface defects, compatible with concrete and form materials, and not requiring removal for satisfactory bonding of coatings to be applied.
 - 1. Composition: Colorless, reactive, water-based or solvent-based compound.
 - 2. Do not use materials containing diesel oil or petroleum-based compounds.
 - 3. VOC Content: In compliance with applicable local, State, and federal regulations.
- C. Nails, Spikes, Lag Bolts, Through Bolts, Anchorages: Sized as required, of sufficient strength and character to maintain formwork in place while placing concrete.
- D. Embedded Anchor Shapes, Plates, Angles and Bars: As specified in Section 05 1200.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify lines, levels and centers before proceeding with formwork. Ensure that dimensions agree with drawings.

3.02 ERECTION - FORMWORK

- A. Erect formwork, shoring and bracing to achieve design requirements, in accordance with requirements of ACI 301.
- B. Provide bracing to ensure stability of formwork. Shore or strengthen formwork subject to oversteering by construction loads.
- C. Align joints and make watertight. Keep form joints to a minimum.

3.03 APPLICATION - FORM RELEASE AGENT

- A. Apply form release agent on formwork in accordance with manufacturer's recommendations.

3.04 INSERTS, EMBEDDED PARTS, AND OPENINGS

- A. Provide formed openings where required for items to be embedded in passing through concrete work.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Coordinate with work of other sections in forming and placing openings, slots, reglets, recesses, sleeves, bolts, anchors, other inserts, and components of other work.
- C. Install accessories in accordance with manufacturer's instructions, so they are straight, level, and plumb. Ensure items are not disturbed during concrete placement.

3.05 FORM CLEANING

- A. Clean forms as erection proceeds, to remove foreign matter within forms.
- B. Clean formed cavities of debris prior to placing concrete.

3.06 FORMWORK TOLERANCES

- A. Construct formwork to maintain tolerances required by ACI 117, unless otherwise indicated.
- B. Construct permanent insulated foam panel formwork to maintain tolerances required by ACI 301.

3.07 FORM REMOVAL

- A. Do not remove forms or bracing until concrete has gained sufficient strength to carry its own weight and imposed loads.
- B. Loosen forms carefully. Do not wedge pry bars, hammers, or tools against finish concrete surfaces scheduled for exposure to view.
- C. Store removed forms to prevent damage to form materials or to fresh concrete. Discard damaged forms.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 03 2000
CONCRETE REINFORCING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Reinforcing steel for cast-in-place concrete.
- B. Supports and accessories for steel reinforcement.

1.02 RELATED REQUIREMENTS

- A. Section 03 1000 - Concrete Forming and Accessories.
- B. Section 03 3000 - Cast-in-Place Concrete.

1.03 PRICE AND PAYMENT PROCEDURES

- A. See Section 01 2200 - Unit Prices, for additional unit price requirements.

1.04 REFERENCE STANDARDS

- A. ACI 301 - Specifications for Structural Concrete; 2016.
- B. ACI SP-66 - ACI Detailing Manual; 2004.
- C. ASTM A615/A615M - Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement; 2020.
- D. ASTM A1064/A1064M - Standard Specification for Carbon-Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete; 2018a.
- E. CRSI (DA4) - Manual of Standard Practice; 2009.
- F. CRSI (P1) - Placing Reinforcing Bars; 2011.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.

1.06 QUALITY ASSURANCE

- A. Perform work of this section in accordance with ACI 301.

PART 2 PRODUCTS

2.01 REINFORCEMENT

- A. Reinforcing Steel: ASTM A615/A615M, Grade 60 (60,000 psi) (420 MPa).
 - 1. Plain billet-steel bars.
- B. Steel Welded Wire Reinforcement (WWR): Galvanized, deformed type; ASTM A1064/A1064M.
 - 1. Form: Flat Sheets.
 - 2. WWR Style: As indicated on drawings.
- C. Reinforcement Accessories:
 - 1. Tie Wire: Annealed, minimum 16 gauge, 0.0508 inch (1.29 mm).
 - 2. Chairs, Bolsters, Bar Supports, Spacers: Sized and shaped for adequate support of reinforcement during concrete placement.
 - 3. Provide stainless steel components for placement within 1-1/2 inches (38 mm) of weathering surfaces.

2.02 RE-BAR SPLICING:

- A. Coupler Systems: Mechanical devices for splicing reinforcing bars; capable of developing full steel reinforcing design strength in tension and compression.

2.03 FABRICATION

- A. Fabricate concrete reinforcing in accordance with CRSI (DA4) - Manual of Standard Practice.
- B. Locate reinforcing splices not indicated on drawings at point of minimum stress.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

PART 3 EXECUTION

3.01 PLACEMENT

- A. Place, support and secure reinforcement against displacement. Do not deviate from required position.
- B. Do not displace or damage vapor barrier.
- C. Accommodate placement of formed openings.
- D. Maintain concrete cover around reinforcing as follows:
 - 1. Beams: 1-1/2 inch (38 mm)
 - 2. Walls (exposed to weather or backfill): 1-1/2 inch (38 mm).
 - a. [2] inch ([50] mm). for #6 and larger bars.
 - 3. Footings and Concrete Formed Against Earth: 3 inch (75 mm).
 - a. All Bars.
 - 4. Slabs on Fill: 1-1/2 inch (38 mm).
- E. Comply with applicable code for concrete cover over reinforcement.
- F. Bond and ground all reinforcement to requirements of Section 26 0526.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 03 3000
CAST-IN-PLACE CONCRETE

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Floors and slabs on grade.
- B. Joint devices associated with concrete work.
- C. Concrete curing.

1.02 RELATED REQUIREMENTS

- A. Section 03 1000 - Concrete Forming and Accessories: Forms and accessories for formwork.
- B. Section 03 2000 - Concrete Reinforcing.
- C. Section 03 3511 - Concrete Floor Finishes: Densifiers, hardeners, applied coatings, and polishing.
- D. Section 07 9200 - Joint Sealants: Products and installation for sealants and joint fillers for saw cut joints and isolation joints in slabs.

1.03 PRICE AND PAYMENT PROCEDURES

- A. Cast-in-place concrete work will be paid for by the unit price method.
- B. See Section 01 2200 - Unit Prices, for additional unit price requirements.
- C. Concrete - Slab-on-Grade: Includes formwork as specified in Section 03 1000, reinforcement as specified in Section 03 2000, concrete, placement accessories, consolidating and leveling, troweling, and curing. Measurement by:
 - 1. Square foot (meter).
 - 2. Cubic yard (meter).
- D. Concrete - Miscellaneous Locations: Includes formwork as specified in Section 03 1000, reinforcement as specified in Section 03 2000, concrete, placement accessories, consolidating, and curing. Measurement by:
 - 1. Square foot (meter).
 - 2. Cubic yard (meter).

1.04 REFERENCE STANDARDS

- A. 10 CFR 431, Subpart K - Energy Efficiency Program for Certain Commercial and Industrial Equipment - Distribution Transformers; Current Edition.
- B. ACI 211.1 - Standard Practice for Selecting Proportions for Normal, Heavyweight, and Mass Concrete; 1991 (Reapproved 2009).
- C. ACI 301 - Specifications for Structural Concrete; 2016.
- D. ACI 302.1R - Guide to Concrete Floor and Slab Construction; 2015.
- E. ACI 304R - Guide for Measuring, Mixing, Transporting, and Placing Concrete; 2000 (Reapproved 2009).
- F. ACI 305R - Guide to Hot Weather Concreting; 2010.
- G. ACI 306R - Guide to Cold Weather Concreting; 2016.
- H. ACI 308R - Guide to External Curing of Concrete; 2016.
- I. ACI 318 - Building Code Requirements for Structural Concrete and Commentary; 2014 (Errata 2018).
- J. ACI 347R - Guide to Formwork for Concrete; 2014, with Errata (2017).
- K. ASTM A615/A615M - Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement; 2020.
- L. ASTM C33/C33M - Standard Specification for Concrete Aggregates; 2018.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- M. ASTM C39/C39M - Standard Test Method for Compressive Strength of Cylindrical Concrete Specimens; 2020.
- N. ASTM C94/C94M - Standard Specification for Ready-Mixed Concrete; 2020.
- O. ASTM C143/C143M - Standard Test Method for Slump of Hydraulic-Cement Concrete; 2015a.
- P. ASTM C150/C150M - Standard Specification for Portland Cement; 2020.
- Q. ASTM C171 - Standard Specification for Sheet Materials for Curing Concrete; 2016.
- R. ASTM C173/C173M - Standard Test Method for Air Content of Freshly Mixed Concrete by the Volumetric Method; 2016.
- S. ASTM C260/C260M - Standard Specification for Air-Entraining Admixtures for Concrete; 2010a (Reapproved 2016).
- T. ASTM C309 - Standard Specification for Liquid Membrane-Forming Compounds for Curing Concrete; 2019.
- U. ASTM C330/C330M - Standard Specification for Lightweight Aggregates for Structural Concrete; 2017a.
- V. ASTM C494/C494M - Standard Specification for Chemical Admixtures for Concrete; 2019.
- W. ASTM C618 - Standard Specification for Coal Fly Ash and Raw or Calcined Natural Pozzolan for Use in Concrete; 2019.
- X. ASTM C685/C685M - Standard Specification for Concrete Made by Volumetric Batching and Continuous Mixing; 2017.
- Y. ASTM C1240 - Standard Specification for Silica Fume Used in Cementitious Mixtures; 2020.
- Z. ASTM C1315 - Standard Specification for Liquid Membrane-Forming Compounds Having Special Properties for Curing and Sealing Concrete; 2019.
- AA. ASTM C1602/C1602M - Standard Specification for Mixing Water Used in the Production of Hydraulic Cement Concrete; 2012.
- AB. ASTM D994/D994M - Standard Specification for Preformed Expansion Joint Filler for Concrete (Bituminous Type); 2011 (Reapproved 2016).
- AC. ASTM D1752 - Standard Specification for Preformed Sponge Rubber Cork and Recycled PVC Expansion Joint Fillers for Concrete Paving and Structural Construction; 2018.
- AD. ASTM E1643 - Standard Practice for Selection, Design, Installation and Inspection of Water Vapor Retarders Used in Contact with Earth or Granular Fill Under Concrete Slabs; 2018a.
- AE. ASTM E1745 - Standard Specification for Plastic Water Vapor Retarders Used in Contact with Soil or Granular Fill under Concrete Slabs; 2017.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Submit manufacturers' data on manufactured products showing compliance with specified requirements and installation instructions.
 - 1. For curing compounds, provide data on method of removal in the event of incompatibility with floor covering adhesives.
- C. Mix Design: Submit proposed concrete mix design.
 - 1. Indicate proposed mix design complies with requirements of ACI 301, Section 4 - Concrete Mixtures.
 - 2. Indicate proposed mix design complies with requirements of ACI 318, Chapter 5 - Concrete Quality, Mixing and Placing.
- D. Samples: Submit samples of underslab vapor retarder to be used.
- E. Test Reports: Submit report for each test or series of tests specified.
- F. Manufacturer's Installation Instructions: For concrete accessories, indicate installation procedures and interface required with adjacent construction.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- G. Project Record Documents: Accurately record actual locations of embedded utilities and components that will be concealed from view upon completion of concrete work.
- H. Warranty: Submit manufacturer warranty and ensure forms have been completed in Owner's name and registered with manufacturer.

1.06 QUALITY ASSURANCE

- A. Perform work of this section in accordance with ACI 301 and ACI 318.
- B. Follow recommendations of ACI 305R when concreting during hot weather.
- C. Follow recommendations of ACI 306R when concreting during cold weather.
- D. For slabs required to include moisture vapor reducing admixture (MVRA), do not proceed with placement unless manufacturer's representative is present for every day of placement.

1.07 WARRANTY

- A. See Section 01 7800 - Closeout Submittals, for additional warranty requirements.
- B. Slabs with Moisture Vapor Reducing Admixture (MVRA): Provide warranty to cover cost of flooring failures due to moisture migration from slabs for life of the concrete.
 - 1. Include cost of repair or removal of failed flooring, placement of topical moisture remediation system, and replacement of flooring with comparable flooring system.
- C. Moisture Emission-Reducing Curing and Sealing Compound, Membrane-Forming: Provide warranty to cover cost of flooring delamination failures for 10 years.
 - 1. Include cost of repair or removal of failed flooring, remediation with a moisture vapor impermeable surface coating, and replacement of flooring with comparable flooring system.
- D. Moisture Emission-Reducing Curing and Sealing Compound, Penetrating: Provide non-prorated warranty to cover cost of flooring delamination failures for 20 years.
 - 1. Include cost of repair or removal of failed flooring, remediation with a moisture vapor impermeable surface coating, and replacement of flooring with comparable flooring system.

PART 2 PRODUCTS

2.01 FORMWORK

- A. Comply with requirements of Section 03 1000.

2.02 REINFORCEMENT MATERIALS

- A. Comply with requirements of Section 03 2000.

2.03 CONCRETE MATERIALS

- A. Cement: ASTM C150/C150M, Type I - Normal Portland type.
 - 1. Acquire cement for entire project from same source.
- B. Fine and Coarse Aggregates: ASTM C33/C33M.
 - 1. Acquire aggregates for entire project from same source.
- C. Lightweight Aggregate: ASTM C330/C330M.
- D. Fly Ash: ASTM C618, Class C or F.
- E. Calcined Pozzolan: ASTM C618, Class N.
- F. Silica Fume: ASTM C1240, proportioned in accordance with ACI 211.1.
- G. Water: ASTM C1602/C1602M; clean, potable, and not detrimental to concrete.

2.04 ADMIXTURES

- A. Do not use chemicals that will result in soluble chloride ions in excess of 0.1 percent by weight of cement.
- B. Air Entrainment Admixture: ASTM C260/C260M.
- C. High Range Water Reducing and Retarding Admixture: ASTM C494/C494M Type G.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- D. Accelerating Admixture: ASTM C494/C494M Type C.
- E. Water Reducing Admixture: ASTM C494/C494M Type A.
- F. Moisture Vapor Reducing Admixture (MVRA): Liquid, inorganic admixture free of volatile organic compounds (VOCs) and formulated to close capillary systems formed during curing to reduce moisture vapor emission and transmission with no adverse effect on concrete properties or finish flooring.
 - 1. Provide admixture in slabs to receive adhesively applied flooring.

2.05 ACCESSORY MATERIALS

- A. Underslab Vapor Retarder:
 - 1. Comply with requirements of Section 07 2600.
- B. Non-Shrink Cementitious Grout: Premixed compound consisting of non-metallic aggregate, cement, water reducing and plasticizing agents.
- C. Non-Shrink Epoxy Grout: Moisture-insensitive, two-part; consisting of epoxy resin, non-metallic aggregate, and activator.

2.06 BONDING AND JOINTING PRODUCTS

- A. Slab Isolation Joint Filler: 1/2 inch (13 mm) thick, height equal to slab thickness, with removable top section that will form 1/2 inch (13 mm) deep sealant pocket after removal.
- B. Slab Construction Joint Devices: Combination keyed joint form and screed, galvanized steel, with rectangular or round knockout holes for conduit or rebar to pass through joint form at 6 inches (150 mm) on center; ribbed steel stakes for setting.

2.07 CURING MATERIALS

- A. Evaporation Reducer: Liquid thin-film-forming compound that reduces rapid moisture loss caused by high temperature, low humidity, and high winds; intended for application immediately after concrete placement.
- B. Curing Compound, Naturally Dissipating: Clear, water-based, liquid membrane-forming compound; complying with ASTM C309.
- C. Curing and Sealing Compound, Moisture Emission-Reducing, Membrane-Forming: Liquid, membrane-forming, clear sealer, for application to newly-placed concrete; capable of providing adequate bond for flooring adhesives, initially and over the long term; with sufficient moisture vapor impermeability to prevent deterioration of flooring adhesives due to moisture emission.
 - 1. Use this product to cure and seal all slabs to receive adhesively applied flooring or roofing.
 - 2. Comply with ASTM C309 and ASTM C1315 Type I Class A.
 - 3. VOC Content: Less than 100 g/L.
- D. Curing and Sealing Compound, Moisture Emission-Reducing, Penetrating: Liquid for application to newly-placed concrete; capable of providing adequate bond for flooring adhesives, initially and over the long term; with sufficient moisture vapor impermeability to prevent deterioration of flooring adhesives due to moisture emission, moisture vapor emission, and alkalinity.
 - 1. Use this product to cure and seal all slabs to receive adhesively applied flooring or roofing.
 - 2. Compressive Strength of Treated Concrete: Equal to or greater than strength after 28-day water cure when tested according to ASTM C39/C39M.
 - 3. Comply with ASTM C309 and ASTM C1315 Type I Class A.
- E. Curing and Sealing Compound, High Gloss: Liquid, membrane-forming, clear, non-yellowing acrylic; complying with ASTM C1315 Type 1 Class A.
- F. Water: Potable, not detrimental to concrete.

2.08 CONCRETE MIX DESIGN

- A. Proportioning Normal Weight Concrete: Comply with ACI 211.1 recommendations.
- B. Concrete Strength: Establish required average strength for each type of concrete on the basis of field experience or trial mixtures, as specified in ACI 301.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1. For trial mixtures method, employ independent testing agency acceptable to Architect for preparing and reporting proposed mix designs.
- C. Admixtures: Add acceptable admixtures as recommended in ACI 211.1 and at rates recommended or required by manufacturer.
- D. Normal Weight Concrete:
 1. Slab & Sidewalks 10 CFR 431, Subpart K
 - a. Compressive Strength, when tested in accordance with ASTM C39/C39M at 28 days: 4,000 pounds per square inch (27.6 MPa).
 - b. Fly Ash Content: Maximum 15 percent of cementitious materials by weight.
 - c. Calcined Pozzolan Content: Maximum 10 percent of cementitious materials by weight.
 - d. Silica Fume Content: Maximum 5 percent of cementitious materials by weight.
 - e. Cement Content: Minimum 564 pounds per cubic yard (255 kg per cu m).
 - f. Water-Cement Ratio: Maximum 50 percent by weight.
 - g. Total Air Content: 4 percent, determined in accordance with ASTM C173/C173M.
 - h. Maximum Slump: 3 inches (75 mm).
 - i. Maximum Aggregate Size: 5/8 inch (16 mm).

2.09 MIXING

- A. On Project Site: Mix in drum type batch mixer, complying with ASTM C685/C685M. Mix each batch not less than 1-1/2 minutes and not more than 5 minutes.
- B. Transit Mixers: Comply with ASTM C94/C94M.
- C. Adding Water: If concrete arrives on-site with slump less than suitable for placement, do not add water that exceeds the maximum water-cement ratio or exceeds the maximum permissible slump.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify lines, levels, and dimensions before proceeding with work of this section.

3.02 PREPARATION

- A. Verify that forms are clean and free of rust before applying release agent.
- B. Coordinate placement of embedded items with erection of concrete formwork and placement of form accessories.
- C. Interior Slabs on Grade: Install vapor retarder under interior slabs on grade. Comply with ASTM E1643. Lap joints minimum 6 inches (150 mm). Seal joints, seams and penetrations watertight with manufacturer's recommended products and follow manufacturer's written instructions. Repair damaged vapor retarder before covering.
 1. Vapor Retarder Over Granular Fill: Install compactible granular fill before placing vapor retarder as indicated on drawings. Do not use sand.

3.03 PLACING CONCRETE

- A. Place concrete in accordance with ACI 304R.
- B. Place concrete for floor slabs in accordance with ACI 302.1R.
- C. Ensure reinforcement, inserts, waterstops, embedded parts, and formed construction joint devices will not be disturbed during concrete placement.
- D. Finish floors level and flat, unless otherwise indicated, within the tolerances specified below.

3.04 SLAB JOINTING

- A. Locate joints as indicated on drawings.
- B. Anchor joint fillers and devices to prevent movement during concrete placement.
- C. Isolation Joints: Use preformed joint filler with removable top section for joint sealant, total height equal to thickness of slab, set flush with top of slab.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3.05 SEPARATE FLOOR TOPPINGS

- A. Prior to placing floor topping, roughen substrate concrete surface and remove deleterious material. Broom and vacuum clean.
- B. Place required dividers, edge strips, reinforcing, and other items to be cast in.
- C. Apply bonding agent to substrate in accordance with manufacturer's instructions.

3.06 FLOOR FLATNESS AND LEVELNESS TOLERANCES

- A. Maximum Variation of Surface Flatness:
 - 1. Exposed Concrete Floors: 1/4 inch (6 mm) in 10 feet (3 m).
 - 2. Under Seamless Resilient Flooring: 1/4 inch (6 mm) in 10 feet (3 m).
 - 3. Under Carpeting: 1/4 inch (6 mm) in 10 feet (3 m).
- B. Correct the slab surface if tolerances are less than specified.
- C. Correct defects by grinding or by removal and replacement of the defective work. Areas requiring corrective work will be identified. Re-measure corrected areas by the same process.

3.07 CONCRETE FINISHING

- A. Repair surface defects, including tie holes, immediately after removing formwork.
- B. Unexposed Form Finish: Rub down or chip off fins or other raised areas 1/4 inch (6 mm) or more in height.
- C. Exposed Form Finish: Rub down or chip off and smooth fins or other raised areas 1/4 inch (6 mm) or more in height. Provide finish as follows:
 - 1. Smooth Rubbed Finish: Wet concrete and rub with carborundum brick or other abrasive, not more than 24 hours after form removal.
- D. Concrete Slabs: Finish to requirements of ACI 302.1R, and as follows:
 - 1. Other Surfaces to Be Left Exposed: Trowel as described in ACI 302.1R, minimizing burnish marks and other appearance defects.
- E. Concrete Polishing: See Section 03 3511.

3.08 CURING AND PROTECTION

- A. Comply with requirements of ACI 308R. Immediately after placement, protect concrete from premature drying, excessively hot or cold temperatures, and mechanical injury.
- B. Maintain concrete with minimal moisture loss at relatively constant temperature for period necessary for hydration of cement and hardening of concrete.
- C. Surfaces Not in Contact with Forms:
 - 1. Initial Curing: Start as soon as free water has disappeared and before surface is dry. Keep continuously moist for not less than three days by water ponding, water-saturated sand, water-fog spray, or saturated burlap.
 - 2. Final Curing: Begin after initial curing but before surface is dry.

3.09 FIELD QUALITY CONTROL

- A. Provide free access to concrete operations at project site and cooperate with appointed firm.
- B. Submit proposed mix design of each class of concrete to inspection and testing firm for review prior to commencement of concrete operations.
- C. Tests of concrete and concrete materials may be performed at any time to ensure compliance with specified requirements.
- D. Compressive Strength Tests: ASTM C39/C39M, for each test, mold and cure three concrete test cylinders. Obtain test samples for every 100 cubic yards (76 cu m) or less of each class of concrete placed.
- E. Take one additional test cylinder during cold weather concreting, cured on job site under same conditions as concrete it represents.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- F. Perform one slump test for each set of test cylinders taken, following procedures of ASTM C143/C143M.
- G. Slab Testing: Cooperate with manufacturer of specified moisture vapor reducing admixture (MVRA) to allow access for sampling and testing concrete for compliance with warranty requirements.

3.10 DEFECTIVE CONCRETE

- A. Defective Concrete: Concrete not complying with required lines, details, dimensions, tolerances or specified requirements.
- B. Repair or replacement of defective concrete will be determined by the Architect. The cost of additional testing shall be borne by Contractor when defective concrete is identified.
- C. Do not patch, fill, touch-up, repair, or replace exposed concrete except upon express direction of Architect for each individual area.

3.11 PROTECTION

- A. Do not permit traffic over unprotected concrete floor surface until fully cured.

3.12 SCHEDULE - CONCRETE TYPES AND FINISHES

- A. Refer to drawings for usage, see structural and architectural drawings for further information.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 03 3511
CONCRETE FLOOR FINISHES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Surface treatments for concrete floors and slabs.
- B. Liquid densifiers and hardeners.

1.02 RELATED REQUIREMENTS

- A. Section 03 3000 - Cast-in-Place Concrete: Finishing of concrete surface to tolerance; floating, troweling, and similar operations; curing.
- B. Section 03 3000 - Cast-in-Place Concrete: Curing compounds that also function as sealers.

1.03 ADMINISTRATIVE REQUIREMENTS

- A. Coordinate the work with concrete floor placement and concrete floor curing.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Manufacturer's published data on each finishing product, including information on compatibility of different products and limitations.
- C. Specimen Warranty: Manufacturer warranty.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Deliver materials in manufacturer's sealed packaging, including application instructions.

1.06 FIELD CONDITIONS

- A. Maintain light level equivalent to a minimum 200 W light source at 8 feet (2.5 m) above the floor surface over each 20 foot (6 m) square area of floor being finished.
- B. Do not finish floors until interior heating system is operational.
- C. Maintain ambient temperature of 50 degrees F (10 degrees C) minimum.

1.07 WARRANTY

- A. See Section 01 7800 - Closeout Submittals for additional warranty requirements.

PART 2 PRODUCTS

2.01 DENSIFIERS AND HARDENERS

- A. Liquid Densifier and Hardener: Penetrating chemical compound that reacts with concrete, filling the pores and dustproofing; for application to concrete after set.
 - 1. Products:
 - a. Substitutions: See Section 01 6000 - Product Requirements.

2.02 COATINGS

- A. Clear, Penetrating, Moisture Vapor-Resistant Coating: Vapor-resistant and pH-reducing coating recommended by manufacturer for new and existing concrete floors and slabs.
- B. Penetrating Sealer: Transparent, nonyellowing, water- or solvent-based coating.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that floor surfaces are acceptable to receive the work of this section.
- B. Verify that flaws in concrete have been patched and joints filled with methods and materials suitable for further finishes.

3.02 GENERAL

- A. Apply materials in accordance with manufacturer's instructions.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3.03 COATING APPLICATION

- A. Verify that surface is free of previous coatings, sealers, curing compounds, water repellents, laitance, efflorescence, fats, oils, grease, wax, soluble salts, residues from cleaning agents, and other impediments to adhesion.
- B. Protect adjacent non-coated areas from drips, overflow, and overspray; immediately remove excess material.
- C. Apply coatings in accordance with manufacturer's instructions, matching approved mock-ups for color, special effects, sealing and workmanship.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 05 1200
STRUCTURAL STEEL FRAMING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Structural steel framing members.

1.02 RELATED REQUIREMENTS

- A. Section 05 3100 - Steel Decking: Support framing for small openings in deck.

1.03 PRICE AND PAYMENT PROCEDURES

- A. See Section 01 2200 - Unit Prices, for additional unit price requirements.
- B. Structural Steel Framing:
 - 1. Basis of Measurement: By the ton (metric ton).
 - 2. Basis of Payment: Includes structural members fabricated, placed, and anchored.

1.04 REFERENCE STANDARDS

- A. AISC (MAN) - Steel Construction Manual; 2017.
- B. AISC 303 - Code of Standard Practice for Steel Buildings and Bridges; 2016.
- C. ASTM A36/A36M - Standard Specification for Carbon Structural Steel; 2014.
- D. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products; 2017.
- E. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware; 2016a.
- F. ASTM A242/A242M - Standard Specification for High-Strength Low-Alloy Structural Steel; 2013 (Reapproved 2018).
- G. ASTM A307 - Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60 000 PSI Tensile Strength; 2014.
- H. ASTM A514/A514M - Standard Specification for High-Yield-Strength, Quenched and Tempered Alloy Steel Plate, Suitable for Welding; 2018, with Editorial Revision (2019).
- I. ASTM A529/A529M - Standard Specification for High-Strength Carbon-Manganese Steel of Structural Quality; 2014.
- J. ASTM A1011/A1011M - Standard Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength; 2018a.
- K. AWS A2.4 - Standard Symbols for Welding, Brazing, and Nondestructive Examination; 2012.
- L. AWS D1.1/D1.1M - Structural Welding Code - Steel; 2015, with Errata (2016).
- M. SSPC-SP 3 - Power Tool Cleaning; 2018.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Shop Drawings:
 - 1. Indicate profiles, sizes, spacing, locations of structural members, openings, attachments, and fasteners.
 - 2. Connections not detailed.
 - 3. Indicate welded connections with AWS A2.4 welding symbols. Indicate net weld lengths.
- C. Fabricator Test Reports: Comply with ASTM A1011/A1011M.
- D. Designer's Qualification Statement.
- E. Fabricator's Qualification Statement.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1.06 QUALITY ASSURANCE

- A. Fabricate structural steel members in accordance with AISC (MAN) "Steel Construction Manual."
- B. Maintain one copy of each document on site.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Steel Angles and Plates: ASTM A36/A36M.
- B. Steel Shapes, Plates, and Bars: ASTM A242/A242M high-strength, corrosion-resistant structural steel.
- C. Steel Shapes, Plates, and Bars: ASTM A529/A529M high-strength, carbon-manganese structural steel, Grade 50.
- D. Steel Plate: ASTM A514/A514M.
- E. Structural Bolts and Nuts: Carbon steel, ASTM A307, Grade A and galvanized in compliance with ASTM A153/A153M, Class C.
- F. Welding Materials: AWS D1.1/D1.1M; type required for materials being welded.
- G. Shop and Touch-Up Primer: Fabricator's standard, complying with VOC limitations of authorities having jurisdiction.
- H. Touch-Up Primer for Galvanized Surfaces: Fabricator's standard, complying with VOC limitations of authorities having jurisdiction.

2.02 FABRICATION

- A. Shop fabricate to greatest extent possible.
- B. Fabricate connections for bolt, nut, and washer connectors.

2.03 FINISH

- A. Prepare structural component surfaces in accordance with SSPC-SP 3.
- B. Galvanize structural steel members to comply with ASTM A123/A123M. Provide minimum 1.7 oz/sq ft 530 g/sq m) galvanized coating.

2.04 SOURCE QUALITY CONTROL

- A. High-Strength Bolts: Provide testing and verification of shop-bolted connections in accordance with RCSC (HSBOLT) "Specification for Structural Joints Using High-Strength Bolts."
- B. Welded Connections: Visually inspect all shop-welded connections.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that conditions are appropriate for erection of structural steel and that the work may properly proceed.

3.02 ERECTION

- A. Erect structural steel in compliance with AISC 303.
- B. Allow for erection loads and provide sufficient temporary bracing to maintain structure in safe condition, plumb, and in true alignment until completion of erection and installation of permanent bracing.
- C. Field weld components indicated on shop drawings.
- D. After erection, prime welds, abrasions, and surfaces not shop primed, except surfaces to be in contact with concrete.

3.03 TOLERANCES

- A. Maximum Variation From Plumb: 1/4 inch (6 mm) per story, non-cumulative.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Maximum Offset From True Alignment: 1/4 inch (6 mm).

3.04 FIELD QUALITY CONTROL

- A. An independent testing agency will perform field quality control tests, as specified in Section 01 4000 - Quality Requirements.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 05 3100
STEEL DECKING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Roof deck.
- B. Supplementary framing for openings up to and including 18 inches (450 mm).
- C. Bearing plates and angles.
- D. Stud shear connectors.

1.02 RELATED REQUIREMENTS

- A. Section 05 1200 - Structural Steel Framing: Support framing for openings larger than 18 inches (450 mm) and shear stud connectors.
- B. Section 05 1200 - Structural Steel Framing: Placement of embedded steel anchors for bearing plates in cast-in-place concrete.

1.03 REFERENCE STANDARDS

- A. ASTM A36/A36M - Standard Specification for Carbon Structural Steel; 2014.
- B. ASTM A108 - Standard Specification for Steel Bar, Carbon and Alloy, Cold-Finished; 2018.
- C. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2020.
- D. ASTM A1008/A1008M - Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Bake Hardenable; 2018.
- E. AWS B2.1/B2.1M - Specification for Welding Procedure and Performance Qualification; 2014 (Amended 2015).
- F. AWS D1.1/D1.1M - Structural Welding Code - Steel; 2015, with Errata (2016).
- G. AWS D1.3/D1.3M - Structural Welding Code - Sheet Steel; 2018.
- H. FM DS 1-29 - Roof Deck Securement and Above-Deck Roof Components; 2016, with Editorial Revision (2020).
- I. IAS AC172 - Accreditation Criteria for Fabricator Inspection Programs for Structural Steel; 2018.
- J. SDI (DM) - Publication No.30, Design Manual for Composite Decks, Form Decks, and Roof Decks; 2007.
- K. SSPC-Paint 15 - Steel Joist Shop Primer/Metal Building Primer; 1999 (Ed. 2004).
- L. SSPC-Paint 20 - Zinc-Rich Primers (Type I, "Inorganic," and Type II, "Organic"); 2002 (Ed. 2004).
- M. UL (FRD) - Fire Resistance Directory; Current Edition.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittals procedures.
- B. Product Data: Provide deck profile characteristics, dimensions, structural properties, and finishes.
- C. Certificates: Certify that products furnished meet or exceed specified requirements.
- D. Welders' Qualification Statement: Welders' certificates in accordance with AWS B2.1/B2.1M and dated no more than 12 months before start of scheduled welding work.
- E. Designer's Qualification Statement.
- F. Fabricator's Qualification Statement: Provide documentation showing steel fabricator is accredited under IAS AC172.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1.05 QUALITY ASSURANCE

- A. Design deck layout, spans, fastening, and joints under direct supervision of a Professional Structural Engineer experienced in design of this work and licensed in New York.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Cut plastic wrap to encourage ventilation.
- B. Separate sheets and store deck on dry wood sleepers; slope for positive drainage.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Steel Deck:
 - 1. Canam Steel Corporation: www.canam-steeljoists.ws.
 - 2. Cordeck, Inc: www.cordeck.com/#sle.
 - 3. Nucor-Vulcraft Group: www.vulcraft.com/#sle.
 - 4. Substitutions: See Section 01 6000 - Product Requirements.

2.02 STEEL DECK

- A. All Deck Types: Select and design metal deck in accordance with SDI Design Manual.
 - 1. Calculate to structural working stress design and structural properties specified.
- B. Roof Deck: Non-composite type, fluted steel sheet:
 - 1. Galvanized Steel Sheet: ASTM A653/A653M, Structural Steel (SS), with G90/Z275 galvanized coating.
 - a. Grade as required to meet performance criteria.
 - 2. Minimum Base Metal Thickness: 20 gauge, 0.0359 inch (0.91 mm).
 - 3. Nominal Height: 1-1/2 inch (38 mm).
 - 4. End Joints: Lapped, welded.

2.03 ACCESSORY MATERIALS

- A. Bearing Plates and Angles: ASTM A36/A36M steel, galvanized per ASTM A123/A123M.
- B. Stud Shear Connectors: Made from ASTM A108 Grade 1015 bars.
- C. Welding Materials: AWS D1.1/D1.1M.
- D. Mechanical Fasteners: Steel; hex washer head, self-drilling, self-tapping.
- E. Weld Washers: Mild steel, uncoated, 3/4 inch (19 mm) outside diameter, 1/8 inch (3 mm) thick.
- F. Touch-Up Primer for Galvanized Surfaces: SSPC-Paint 20, complying with VOC limitations of authorities having jurisdiction.

2.04 FABRICATED DECK ACCESSORIES

- A. Sheet Metal Deck Accessories: Metal closure strips, wet concrete stops, and cover plates, 22 gauge, 0.0299 inch (0.76 mm) thick sheet steel; of profile and size as indicated; finished same as deck.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions prior to beginning work.

3.02 INSTALLATION

- A. Erect metal deck in accordance with SDI Design Manual and manufacturer's instructions. Align and level.
- B. On steel supports provide minimum 1-1/2 inch (38 mm) bearing.
- C. Fasten deck to steel support members at ends and intermediate supports at 12 inches (300 mm) on center maximum, parallel with the deck flute and at each transverse flute using methods specified.
 - 1. Welding: Use fusion welds through weld washers.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- 2. Place and secure special deep fluted sections for integral concrete bridging.
- D. Drive mechanical sidelap connectors completely through adjacent lapped sheets; positively engage adjacent sheets with minimum three-thread penetration.
- E. Weld deck in accordance with AWS D1.3/D1.3M.
- F. At deck openings from 6 inches (150 mm) to 18 inches (450 mm) in size, provide 2 by 2 by 1/4 inch (50 by 50 by 6 mm) steel angle reinforcement. Place angles perpendicular to flutes; extend minimum two flutes beyond each side of opening and fusion weld to deck at each flute.
- G. At deck openings greater than 18 inches (450 mm) in size, provide steel angle reinforcement as specified in Section 05 1200.
- H. Weld stud shear connectors through steel deck to structural members below.
- I. Immediately after welding deck and other metal components in position, coat welds, burned areas, and damaged surface coating, with touch-up primer.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 06 0573
WOOD TREATMENT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Site applied preservative treatment for wood materials.

1.02 RELATED REQUIREMENTS

- A. Section 01 6116 - Volatile Organic Compound (VOC) Content Restrictions .
- B. Section 06 1000 - Rough Carpentry: Factory treatment for wood products.

1.03 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide technical data on insulated sheathing, wood preservative materials, and application instructions.
- C. Warranty: Submit manufacturer warranty and ensure that forms have been completed in Owner's name and registered with manufacturer.

1.04 DELIVERY, STORAGE, AND HANDLING

- A. General: Cover wood products to protect against moisture. Support stacked products to prevent deformation and to allow air circulation.
- B. Fire Retardant Treated Wood: Prevent exposure to precipitation during shipping, storage, or installation.

1.05 WARRANTY

- A. See Section 01 7800 - Closeout Submittals, for additional warranty requirements.

PART 2 PRODUCTS

2.01 SITE-APPLIED WOOD TREATMENT

- A. Manufacturers:
 - 1. Nisus Corporation: www.nisuscorp.com/#sle.
 - 2. Substitutions: See Section 01 6000 - Product Requirements.
- B. Surface-Applied Wood Preservative:

PART 3 EXECUTION

3.01 PREPARATION

- A. Remove dust, dirt and other contaminants from treatment surfaces. Remove tarpaulins, dropcloths, strippable protective films, etc., from areas to be treated. Move equipment and stored materials that block or prevent product application.

3.02 INSTALLATION - GENERAL

- A. Provide temporary ventilation during and immediately after installation sufficient to remove indoor air contaminants.

3.03 SITE APPLIED WOOD TREATMENT

- A. Comply with manufacturers written mixing and installation instructions.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 06 1000
ROUGH CARPENTRY

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Structural dimension lumber framing.
- B. Non-structural dimension lumber framing.
- C. Rough opening framing for doors, windows, and roof openings.
- D. Underlayment.
- E. Roof-mounted curbs.
- F. Roofing nailers.
- G. Roofing cant strips.
- H. Preservative treated wood materials.
- I. Miscellaneous framing and sheathing.
- J. Concealed wood blocking, nailers, and supports.
- K. Miscellaneous wood nailers, furring, and grounds.

1.02 RELATED REQUIREMENTS

- A. Section 03 3000 - Cast-in-Place Concrete: Setting anchors in concrete.
- B. Section 07 7200 - Roof Accessories: Prefabricated roof curbs.
- C. Section 09 2116 - Gypsum Board Assemblies: Gypsum-based sheathing.

1.03 REFERENCE STANDARDS

- A. ANSI A208.1 - American National Standard for Particleboard; 2016.
- B. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware; 2016a.
- C. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2020.
- D. ASTM C557 - Standard Specification for Adhesives for Fastening Gypsum Wallboard to Wood Framing; 2003 (Reapproved 2017).
- E. ASTM C1177/C1177M - Standard Specification for Glass Mat Gypsum Substrate for Use as Sheathing; 2017.
- F. ASTM D2898 - Standard Test Methods for Accelerated Weathering of Fire-Retardant-Treated Wood for Fire Testing; 2010 (Reapproved 2017).
- G. ASTM D3498 - Standard Specification for Adhesives for Field-Gluing Wood Structural Panels (Plywood or Oriented Strand Board) to Wood Based Floor System Framing; 2019a.
- H. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2020.
- I. ASTM E96/E96M - Standard Test Methods for Water Vapor Transmission of Materials; 2016.
- J. AWC (WFCM) - Wood Frame Construction Manual for One- and Two-Family Dwellings; 2015.
- K. AWPA U1 - Use Category System: User Specification for Treated Wood; 2018.
- L. ICC-ES AC308 - Acceptance Criteria for Termite Physical Barrier Systems; 2014, with Editorial Revision (2017).
- M. PS 1 - Structural Plywood; 2009.
- N. PS 2 - Performance Standard for Wood-Based Structural-Use Panels; 2010.
- O. PS 20 - American Softwood Lumber Standard; 2020.
- P. SPIB (GR) - Grading Rules; 2014.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. General: Cover wood products to protect against moisture. Support stacked products to prevent deformation and to allow air circulation.
- B. Fire Retardant Treated Wood: Prevent exposure to precipitation during shipping, storage, and installation.

1.06 WARRANTY

- A. See Section 01 7800 - Closeout Submittals for additional warranty requirements.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. Dimension Lumber: Comply with PS 20 and requirements of specified grading agencies.
 - 1. If no species is specified, provide any species graded by the agency specified; if no grading agency is specified, provide lumber graded by any grading agency meeting the specified requirements.
 - 2. Grading Agency: Any grading agency whose rules are approved by the Board of Review, American Lumber Standard Committee (www.alsc.org) and who provides grading service for the species and grade specified; provide lumber stamped with grade mark unless otherwise indicated.
- B. Provide sustainably harvested wood; see Section 01 6000 - Product Requirements for requirements.
- C. Provide wood harvested within a 500 mile (805 km) radius of the project site.

2.02 DIMENSION LUMBER FOR CONCEALED APPLICATIONS

- A. Sizes: Nominal sizes as indicated on drawings, S4S.
- B. Moisture Content: S-dry or MC19.
- C. Stud Framing (2 by 2 through 2 by 6 (50 by 50 mm through 50 by 150 mm)):
 - 1. Species: Any allowed under referenced grading rules.
 - 2. Grade: No. 2.
- D. Joist, Rafter, and Small Beam Framing (2 by 6 through 4 by 16 (50 by 150 mm through 100 by 400 mm)):
 - 1. Machine stress-rated (MSR) as follows:
 - a. Fb-single (minimum extreme fiber stress in bending): 1350 psi (9,300 kPa).
 - b. E (minimum modulus of elasticity): 1,300,000 psi (8960 MPa).
 - 2. Species: Any allowed under grading rules.
- E. Miscellaneous Framing, Blocking, Nailers, Grounds, and Furring:
 - 1. Lumber: S4S, No. 2 or Standard Grade.
 - 2. Boards: Standard or No. 3.

2.03 EXPOSED DIMENSION LUMBER

- A. Sizes: Nominal sizes as indicated on drawings.
- B. Surfacing: S4S.
- C. Moisture Content: S-dry or MC19.

2.04 STRUCTURAL COMPOSITE LUMBER

- A. At Contractor's option, structural composite lumber may be substituted for concealed dimension lumber and timbers.
- B. Structural Composite Lumber: Factory fabricated beams, headers, and columns, of sizes and types indicated on drawings; structural capacity as published by manufacturer.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1. Columns: Use laminated veneer lumber, laminated strand lumber, or parallel strand lumber with manufacturer's published E (modulus of elasticity): 1,800,000 psi (12,410 MPa), minimum.
2. Beams: Use laminated veneer lumber, laminated strand lumber, or parallel strand lumber with manufacturer's published E (modulus of elasticity): 1,800,000 psi (12,410 MPa), minimum.
3. Headers Not Longer Than 48 inches (1220 mm): Use laminated veneer lumber, laminated strand lumber, or parallel strand lumber.

2.05 ACCESSORIES

- A. Fasteners and Anchors:
 1. Metal and Finish: Hot-dipped galvanized steel complying with ASTM A153/A153M for high humidity and preservative-treated wood locations, unfinished steel elsewhere.
 2. Drywall Screws: Bugle head, hardened steel, power driven type, length three times thickness of sheathing.
 3. Anchors: Toggle bolt type for anchorage to hollow masonry.
- B. Joist Hangers: Hot dipped galvanized steel, sized to suit framing conditions.
 1. For contact with preservative treated wood in exposed locations, provide minimum G185 (Z550) galvanizing complying with ASTM A653/A653M.
- C. Sill Gasket on Top of Foundation Wall: 1/4 inch (6 mm) thick, plate width, closed cell plastic foam from continuous rolls.
- D. Termite-Resistant Sill Plate Barrier: Self-adhesive, film-backed barrier with release sheet; adheres to concrete substrates and blocks termite access.
 1. Thickness: 68 mils (0.068 inch) (1.7 mm).
 2. Termite Resistance: 100 percent when tested in accordance with ICC-ES AC380.
- E. Sill Flashing: As specified in Section 07 6200.
- F. Subfloor Adhesives: Waterproof, air cure type, cartridge dispensed; adhesives designed for subfloor applications and complying with either ASTM C557 or ASTM D3498.
- G. Construction Adhesives: Adhesives complying with ASTM C557 or ASTM D3498.
- H. Water-Resistive Barrier: As specified in Section 07 2500.
- I. Building Paper: Water resistant Kraft paper.

2.06 FACTORY WOOD TREATMENT

- A. Treated Lumber and Plywood: Comply with requirements of AWPA U1 - Use Category System for wood treatments determined by use categories, expected service conditions, and specific applications.

PART 3 EXECUTION

3.01 INSTALLATION - GENERAL

- A. Select material sizes to minimize waste.
- B. Reuse scrap to the greatest extent possible; clearly separate scrap for use on site as accessory components, including: shims, bracing, and blocking.
- C. Where treated wood is used on interior, provide temporary ventilation during and immediately after installation sufficient to remove indoor air contaminants.

3.02 FRAMING INSTALLATION

- A. Set structural members level, plumb, and true to line. Discard pieces with defects that would lower required strength or result in unacceptable appearance of exposed members.
- B. Make provisions for temporary construction loads, and provide temporary bracing sufficient to maintain structure in true alignment and safe condition until completion of erection and installation of permanent bracing.
- C. Install structural members full length without splices unless otherwise specifically detailed.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- D. Comply with member sizes, spacing, and configurations indicated, and fastener size and spacing indicated, but not less than required by applicable codes and AWC (WFCM) Wood Frame Construction Manual.
- E. Install horizontal spanning members with crown edge up and not less than 1-1/2 inches (38 mm) of bearing at each end.
- F. Construct double joist headers at floor and ceiling openings and under wall stud partitions that are parallel to floor joists; use metal joist hangers unless otherwise detailed.
- G. Frame wall openings with two or more studs at each jamb; support headers on cripple studs.

3.03 BLOCKING, NAILERS, AND SUPPORTS

- A. Provide framing and blocking members as indicated or as required to support finishes, fixtures, specialty items, and trim.
- B. In framed assemblies that have concealed spaces, provide solid wood fireblocking as required by applicable local code, to close concealed draft openings between floors and between top story and roof/attic space; other material acceptable to code authorities may be used in lieu of solid wood blocking.
- C. In metal stud walls, provide continuous blocking around door and window openings for anchorage of frames, securely attached to stud framing.
- D. In walls, provide blocking attached to studs as backing and support for wall-mounted items, unless item can be securely fastened to two or more studs or other method of support is explicitly indicated.
- E. Where ceiling-mounting is indicated, provide blocking and supplementary supports above ceiling, unless other method of support is explicitly indicated.
- F. Provide the following specific non-structural framing and blocking:
 - 1. Cabinets and shelf supports.
 - 2. Wall brackets.
 - 3. Handrails.
 - 4. Grab bars.
 - 5. Towel and bath accessories.
 - 6. Wall-mounted door stops.
 - 7. Chalkboards and marker boards.
 - 8. Wall paneling and trim.
 - 9. Joints of rigid wall coverings that occur between studs.

3.04 ROOF-RELATED CARPENTRY

- A. Coordinate installation of roofing carpentry with deck construction, framing of roof openings, and roofing assembly installation.
- B. Provide wood curb at each roof opening except where prefabricated curbs are specified and where specifically indicated otherwise; form corners by alternating lapping side members.

3.05 INSTALLATION OF CONSTRUCTION PANELS

- A. Subflooring/Underlayment Combination: Glue and nail to framing; staples are not permitted.
- B. Subflooring: Glue and nail to framing; staples are not permitted.
- C. Roof Sheathing: Secure panels with long dimension perpendicular to framing members, with ends staggered and over firm bearing.
 - 1. Nail panels to framing; staples are not permitted.
- D. Wall Sheathing: Secure with long dimension perpendicular to wall studs, with ends over firm bearing and staggered, using nails, screws, or staples.
 - 1. Use plywood or other acceptable structural panels at building corners, for not less than 96 inches (2440 mm), measured horizontally.
 - 2. Provide inlet diagonal bracing at corners.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3. Place water-resistive barrier horizontally over wall sheathing, weather lapping edges and ends.
- E. Communications and Electrical Room Mounting Boards: Secure with screws to studs with edges over firm bearing; space fasteners at maximum 24 inches (610 mm) on center on all edges and into studs in field of board.
 1. At fire-rated walls, install board over wall board indicated as part of the fire-rated assembly.
 2. Where boards are indicated as full floor-to-ceiling height, install with long edge of board parallel to studs.
 3. Install adjacent boards without gaps.

3.06 SITE APPLIED WOOD TREATMENT

- A. Apply preservative treatment compatible with factory applied treatment at site-sawn cuts, complying with manufacturer's instructions.
- B. Allow preservative to dry prior to erecting members.

3.07 TOLERANCES

- A. Framing Members: 1/4 inch (6 mm) from true position, maximum.
- B. Surface Flatness of Floor: 1/8 inch in 10 feet (1 mm/m) maximum, and 1/4 inch in 30 feet (7 mm in 10 m) maximum.
- C. Variation from Plane (Other than Floors): 1/4 inch in 10 feet (2 mm/m) maximum, and 1/4 inch in 30 feet (7 mm in 10 m) maximum.

3.08 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.

3.09 CLEANING

- A. Waste Disposal: Comply with the requirements of Section 01 7419 - Construction Waste Management and Disposal.
 1. Comply with applicable regulations.
 2. Do not burn scrap on project site.
 3. Do not burn scraps that have been pressure treated.
 4. Do not send materials treated with pentachlorophenol, CCA, or ACA to co-generation facilities or "waste-to-energy" facilities.
- B. Do not leave any wood, shavings, sawdust, etc. on the ground or buried in fill.
- C. Prevent sawdust and wood shavings from entering the storm drainage system.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 06 1053
MISCELLANEOUS ROUGH CARPENTRY

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Roof-mounted curbs.
- B. Roofing nailers.
- C. Preservative treated wood materials.
- D. Fire retardant treated wood materials.
- E. Concealed wood blocking, nailers, and supports.
- F. Miscellaneous wood nailers, furring, and grounds.

1.02 RELATED REQUIREMENTS

- A. Section 01 6116 - Volatile Organic Compound (VOC) Content Restrictions.
- B. Section 07 7200 - Roof Accessories: Prefabricated roof curbs.
- C. Section 09 2116 - Gypsum Board Assemblies: Gypsum-based sheathing.

1.03 REFERENCE STANDARDS

- A. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware; 2016a.
- B. ASTM C557 - Standard Specification for Adhesives for Fastening Gypsum Wallboard to Wood Framing; 2003 (Reapproved 2017).
- C. ASTM D3498 - Standard Specification for Adhesives for Field-Gluing Wood Structural Panels (Plywood or Oriented Strand Board) to Wood Based Floor System Framing; 2019a.
- D. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2020.
- E. AWPA U1 - Use Category System: User Specification for Treated Wood; 2018.
- F. PS 20 - American Softwood Lumber Standard; 2020.
- G. SPIB (GR) - Grading Rules; 2014.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. General: Cover wood products to protect against moisture. Support stacked products to prevent deformation and to allow air circulation.
- B. Fire Retardant Treated Wood: Prevent exposure to precipitation during shipping, storage, and installation.

1.06 WARRANTY

- A. See Section 01 7800 - Closeout Submittals for additional warranty requirements.
- B. Correct defective work within a two-year period commencing on Date of Substantial Completion.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. Dimension Lumber: Comply with PS 20 and requirements of specified grading agencies.
 - 1. If no species is specified, provide species graded by the agency specified; if no grading agency is specified, provide lumber graded by grading agency meeting the specified requirements.
 - 2. Grading Agency: Grading agency whose rules are approved by the Board of Review, American Lumber Standard Committee (www.alsc.org) and who provides grading service

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

for the species and grade specified; provide lumber stamped with grade mark unless otherwise indicated.

2.02 DIMENSION LUMBER FOR CONCEALED APPLICATIONS

- A. Sizes: Nominal sizes as indicated on drawings, S4S.
- B. Moisture Content: S-dry or MC19.
- C. Miscellaneous Framing, Blocking, Nailers, Grounds, and Furring:
 - 1. Lumber: S4S, No.2 or Standard Grade.
 - 2. Boards: Standard or No.3.

2.03 ACCESSORIES

- A. Fasteners and Anchors:
 - 1. Metal and Finish: Hot-dipped galvanized steel complying with ASTM A153/A153M for high humidity and preservative-treated wood locations, unfinished steel elsewhere.
- B. Construction Adhesives: Adhesives complying with ASTM C557 or ASTM D3498.

2.04 FACTORY WOOD TREATMENT

- A. Treated Lumber and Plywood: Comply with requirements of AWPA U1 - Use Category System for wood treatments determined by use categories, expected service conditions, and specific applications.
- B. Fire Retardant Treatment:
 - 1. Interior Type A: AWPA U1, Use Category UCFA, Commodity Specification H, low temperature, low hygroscopic type, chemically treated and pressure impregnated; capable of providing a maximum flame spread index of 25 when tested in accordance with ASTM E84, with no evidence of significant combustion when test is extended for an additional 20 minutes.
 - a. Kiln dry wood after treatment to a maximum moisture content of 19 percent for lumber and 15 percent for plywood.
 - b. Treat rough carpentry items as indicated.
 - c. Do not use treated wood in applications exposed to weather or where the wood may become wet.

PART 3 EXECUTION

3.01 PREPARATION

- A. Coordinate installation of rough carpentry members specified in other sections.

3.02 INSTALLATION - GENERAL

- A. Select material sizes to minimize waste.
- B. Reuse scrap to the greatest extent possible; clearly separate scrap for use on site as accessory components, including: shims, bracing, and blocking.
- C. Where treated wood is used on interior, provide temporary ventilation during and immediately after installation sufficient to remove indoor air contaminants.

3.03 BLOCKING, NAILERS, AND SUPPORTS

- A. Provide framing and blocking members as indicated or as required to support finishes, fixtures, specialty items, and trim.
- B. In walls, provide blocking attached to studs as backing and support for wall-mounted items, unless item can be securely fastened to two or more studs or other method of support is explicitly indicated.
- C. Where ceiling-mounting is indicated, provide blocking and supplementary supports above ceiling, unless other method of support is explicitly indicated.

3.04 ROOF-RELATED CARPENTRY

- A. Coordinate installation of roofing carpentry with deck construction, framing of roof openings, and roofing assembly installation.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Provide wood curb at roof openings except where prefabricated curbs are specified and where specifically indicated otherwise. Form corners by alternating lapping side members.

3.05 SITE APPLIED WOOD TREATMENT

- A. Apply preservative treatment compatible with factory applied treatment at site-sawn cuts, complying with manufacturer's instructions.
- B. Allow preservative to dry prior to erecting members.

3.06 CLEANING

- A. Waste Disposal: See Section 01 7419 - Construction Waste Management and Disposal.
 - 1. Comply with applicable regulations.
 - 2. Do not burn scrap on project site.
 - 3. Do not burn scraps that have been pressure treated.
 - 4. Do not send materials treated with pentachlorophenol, CCA, or ACA to co-generation facilities or "waste-to-energy" facilities.
- B. Do not leave wood, shavings, sawdust, etc. on the ground or buried in fill.
- C. Prevent sawdust and wood shavings from entering the storm drainage system.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 06 8316
FIBERGLASS REINFORCED PANELING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fiberglass reinforced plastic panels.

1.02 RELATED REQUIREMENTS

- A. Section 01 6116 - Volatile Organic Compound (VOC) Content Restrictions.

1.03 DELIVERY, STORAGE, AND HANDLING

- A. Store panels flat, indoors, on a clean, dry surface. Remove packaging and allow panels to acclimate to room temperature for 48 hours prior to installation.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Fiberglass Reinforced Plastic Panels:
 - 1. Crane Composites, Inc: www.cranecomposites.com/#sle.
 - 2. Marlite, Inc: www.marlite.com/#sle.
 - 3. Nudo Products, Inc: www.nudo.com/#sle.
 - 4. Panolam Industries International, Inc; Panolam FRP: www.panolam.com/#sle.
 - 5. Substitutions: See Section 01 6000 - Product Requirements.

2.02 PANEL SYSTEMS

- A. Wall Panels:
 - 1. Panel Size: 4 by 8 feet (1.2 by 2.4 m).
 - 2. Panel Thickness: 0.10 inch (2.5 mm).
 - 3. Surface Design: Embossed.
 - 4. Color: As selected by owner through submittal process..
 - 5. Attachment Method: Mechanical fasteners concealed by trim, with sealant in joints.

2.03 MATERIALS

- A. Panels: Fiberglass reinforced plastic (FRP), complying with ASTM D5319.
 - 1. Surface Burning Characteristics: Maximum flame spread index of 25 and smoke developed index of 450; when system tested in accordance with ASTM E84.
- B. Sealant: Type recommended by panel manufacturer; white.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions and substrate flatness before starting work.
- B. Verify that substrate conditions are ready to receive the work of this section.

3.02 INSTALLATION - WALLS

- A. Install panels in accordance with manufacturer's instructions.
- B. Cut and drill panels with carbide tipped saw blades, drill bits, or snips.
- C. Apply adhesive to the back side of the panel using trowel as recommended by adhesive manufacturer.
- D. Apply panels to wall with seams plumb and pattern aligned with adjoining panels.
- E. Install panels with manufacturer's recommended gap for panel field and corner joints.
- F. Seal gaps at floor, ceiling, and between panels with applicable sealant to prevent moisture intrusion.
- G. Remove excess sealant after paneling is installed and prior to curing.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 07 2100
THERMAL INSULATION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Board insulation at over roof deck.

1.02 RELATED REQUIREMENTS

- A. Section 05 4000 - Cold-Formed Metal Framing: Board insulation as wall sheathing.
- B. Section 05 3100 - Steel Decking
- C. Section 06 1000 - Rough Carpentry: Supporting construction for batt insulation.

1.03 REFERENCE STANDARDS

- A. ASTM C423 - Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method; 2017.
- B. ASTM C518 - Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus; 2017.
- C. ASTM C557 - Standard Specification for Adhesives for Fastening Gypsum Wallboard to Wood Framing; 2003 (Reapproved 2017).
- D. ASTM C578 - Standard Specification for Rigid, Cellular Polystyrene Thermal Insulation; 2019.
- E. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2020.
- F. ASTM E1414/E1414M - Standard Test Method for Airborne Sound Attenuation Between Rooms Sharing a Common Ceiling Plenum; 2016.
- G. NFPA 285 - Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Non-Load-Bearing Wall Assemblies Containing Combustible Components; 2019.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.

1.05 FIELD CONDITIONS

- A. Do not install insulation adhesives when temperature or weather conditions are detrimental to successful installation.

PART 2 PRODUCTS

2.01 APPLICATIONS

- A. Insulation Over Roof Deck: Extruded polystyrene (XPS) board.

2.02 FOAM BOARD INSULATION MATERIALS

- A. Extruded Polystyrene (XPS) Board Insulation: Complies with ASTM C578 with either natural skin or cut cell surfaces.
 - 1. Type and Compressive Resistance: Type IV, 25 psi (173 kPa), minimum.
 - 2. Flame Spread Index (FSI): Class A - 0 to 25, when tested in accordance with ASTM E84.
 - 3. Smoke Developed Index (SDI): 450 or less, when tested in accordance with ASTM E84.
 - 4. Type and Thermal Resistance, R-value (RSI-value): Type IV, 5.0 (0.88) per 1 inch (25.4 mm) thickness at 75 degrees F (24 degrees C) mean temperature.
 - 5. Complies with fire resistance requirements indicated on drawings as part of an exterior non-load-bearing exterior wall assembly when tested in accordance with NFPA 285.
 - 6. Board Edges: Square.
 - 7. Type and Water Absorption: Type IV, 0.3 percent by volume, maximum, by total immersion.
 - 8. Manufacturers:
 - a. Dow Chemical Company; STYROFOAM HIGHLOAD 40:
www.dowbuildingsolutions.com/#sle.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- b. Owens Corning Corporation; FOAMULAR Extruded Polystyrene (XPS) Insulation:
www.ocbuildingspec.com/#sle.

2.03 ACCESSORIES

- A. Tape: Reinforced polyethylene film with acrylic pressure sensitive adhesive.
 - 1. Application: Sealing of interior circular penetrations, such as pipes or cables.
 - 2. Width: Are required for application.
- B. Flashing Tape: Special reinforced film with high performance adhesive.
 - 1. Application: Window and door opening flashing tape.
 - 2. Width: As required for application.
- C. Tape joints of rigid insulation in accordance with roofing and insulation manufacturers' instructions.
- D. Insulation Fasteners: Lengths of unfinished, 13 gauge, 0.072 inch (1.83 mm) high carbon spring steel with chisel or mitered tips, held in place by tension, length to suit insulation thickness and substrate, capable of securely supporting insulation in place.
- E. Adhesive: Gun grade, interior and exterior, and compatible with insulation and substrates; complies with ASTM C557.
 - 1. Application Temperature: 40 to 100 degrees F (5 to 38 degrees C) at contact surfaces.
 - 2. Volatile Organic Content (VOC): Less than 7 percent by weight.
 - 3. Manufacturers:

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that substrate, adjacent materials, and insulation materials are dry and that substrates are ready to receive insulation.
- B. Verify substrate surfaces are flat, free of honeycomb, fins, irregularities, or materials or substances that may impede adhesive bond.

3.02 BOARD INSTALLATION AT FOUNDATION PERIMETER

- A. Adhere a 6 inches (152 mm) wide strip of polyethylene sheet over construction, control, and expansion joints with double beads of adhesive each side of joint.
 - 1. Tape seal joints.
 - 2. Extend sheet full height of joint.
- B. Apply adhesive to back of boards:
 - 1. Three continuous beads per board length.
 - 2. Full bed 1/8 inch (3.2 mm) thick.
- C. Install boards horizontally on foundation perimeter.
 - 1. Place boards to maximize adhesive contact.
 - 2. Install in running bond pattern.
 - 3. Butt edges and ends tightly to adjacent boards and to protrusions.
- D. Extend boards over expansion joints, unbonded to foundation on one side of joint.
- E. Cut and fit insulation tightly to protrusions or interruptions to the insulation plane.

3.03 BATT INSTALLATION

- A. Trim insulation neatly to fit spaces. Insulate miscellaneous gaps and voids.
- B. Install with factory-applied vapor retarder membrane facing warm side of building spaces. Lap ends and side flanges of membrane over framing members.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.
- B. Coordination of Air Barrier Association of America (ABAA) Tests and Inspections:
 - 1. Provide testing and inspection required by ABAA Quality Assurance Program (QAP).

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2. Notify ABAA in writing of schedule for air barrier work, and allow adequate time for testing and inspection.
3. Cooperate with ABAA testing agency.
4. Allow access to air barrier work areas and staging.
5. Do not cover air barrier work until tested, inspected, and accepted.

3.05 PROTECTION

- A. Do not permit installed insulation to be damaged prior to its concealment.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 07 2600
UNDERSLAB VAPOR BARRIER

PART 1 GENERAL

SECTION INCLUDES

2.01 SHEET VAPOR BARRIER UNDER CONCRETE SLABS ON GRADE.

- A. RELATED REQUIREMENTS
 - 1. Section 03 1000 - Concrete Forming and Accessories: Forms and accessories for formwork.
 - 2. Section 03 2000 - Concrete Reinforcing.
 - 3. Section 03 3000 - Cast-in-Place Concrete: Preparation of subgrade, granular fill, placement of concrete.
- B. REFERENCE STANDARDS
 - 1. ASTM E1643 - Standard Practice for Selection, Design, Installation and Inspection of Water Vapor Retarders Used in Contact with Earth or Granular Fill Under Concrete Slabs; 2018a.
 - 2. ASTM E1745 - Standard Specification for Plastic Water Vapor Retarders Used in Contact with Soil or Granular Fill under Concrete Slabs; 2017.
- C. SUBMITTALS
 - 1. See Section 01 3000 - Administrative Requirements, for submittal procedures.
 - 2. Product Data: Submit manufacturers' data on manufactured products.
 - 3. Samples: Submit samples of underslab vapor barrier to be used.
 - 4. Manufacturer's Installation Instructions: Indicate installation procedures and interface required with adjacent construction.

PART 2 PRODUCTS

MATERIALS

4.01 UNDERSLAB VAPOR BARRIER:

- A. Water Vapor Permeance: Not more than 0.010 perms (0.6 ng/(s m² Pa)), maximum.
- B. Complying with ASTM E1745 Class A.
- C. Thickness: 10 mils (.254 mm).
- D. Basis of Design:
- E. Stego Industries LLC; Stego Wrap Vapor Barrier (10-mil): www.stegoindustries.com/#sle.

4.02 ACCESSORY PRODUCTS: VAPOR BARRIER MANUFACTURER'S RECOMMENDED TAPE, ADHESIVE, MASTIC, ETC., FOR SEALING SEAMS AND PENETRATIONS IN VAPOR BARRIER.

PART 3 EXECUTION

INSTALLATION

6.01 INSTALL VAPOR BARRIER IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS AND ASTM E1643.

6.02 INSTALL VAPOR BARRIER UNDER INTERIOR SLABS ON GRADE; LAP SHEET OVER FOOTINGS AND SEAL TO FOUNDATION WALLS.

- A. Lap joints minimum 6 inches (150 mm).

6.03 SEAL JOINTS, SEAMS AND PENETRATIONS WATERTIGHT WITH MANUFACTURER'S RECOMMENDED PRODUCTS AND FOLLOW MANUFACTURER'S WRITTEN INSTRUCTIONS.

6.04 NO PENETRATION OF VAPOR BARRIER IS ALLOWED EXCEPT FOR REINFORCING STEEL AND PERMANENT UTILITIES.

- A. Repair damaged vapor retarder before covering with other materials.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 07 5323

EPDM THERMOSET SINGLE-PLY ROOFING - CARLISLE

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Adhered roof system with ethylene propylene diene monomer (EPDM) roofing membrane.
- B. Ballasted roof system with ethylene propylene diene monomer (EPDM) roofing membrane.
- C. Insulation, flat and tapered.

1.02 RELATED REQUIREMENTS

- A. Section 05 3100 - Steel Decking.
- B. Section 06 1000 - Rough Carpentry: Wood nailers and curbs.
- C. Section 07 7100 - Roof Specialties: Prefabricated roofing expansion joint flashing.
- D. Section 07 7200 - Roof Accessories: Roof-mounted units; prefabricated curbs.
- E. Section 22 1006 - Plumbing Piping Specialties: Roof drains, sumps, and hoppers.

1.03 REFERENCE STANDARDS

- A. ASTM C578 - Standard Specification for Rigid, Cellular Polystyrene Thermal Insulation; 2019.
- B. ASTM D4637/D4637M - Standard Specification for EPDM Sheet Used in Single-Ply Roof Membrane; 2015.
- C. FM DS 1-29 - Roof Deck Securement and Above-Deck Roof Components; 2016, with Editorial Revision (2020).
- D. NRCA (RM) - The NRCA Roofing Manual; 2019.

PART 2 PRODUCTS

2.01 ROOFING APPLICATIONS

- A. EPDM Membrane Roofing: One ply membrane, ballasted, over insulation.
- B. Roofing Assembly Performance Requirements and Design Criteria:

2.02 ROOFING MEMBRANE AND ASSOCIATED MATERIALS

- A. Membrane:
 - 1. Material: Ethylene propylene diene monomer (EPDM); ASTM D4637/D4637M, Type I (non-reinforced).
 - 2. Thickness: 45 mil, 0.045 inch (1.1 mm), minimum.
 - 3. Sheet Width: Factory fabricated into largest sheets possible.
 - 4. Color: Black.
 - 5. Product:
 - a. Carlisle Sure-Seal.
- B. Seaming Materials: As recommended by membrane manufacturer.
- C. Flexible Flashing Material: Same material as membrane.
- D. Base Flashing: Provide waterproof, fully adhered base flashing system at all penetrations, plane transitions, and terminations.

2.03 INSULATION

- A. Extruded Polystyrene (XPS) Board Insulation: Complies with ASTM C578 with natural skin surface, drainage channels one face.
 - 1. Type and Compressive Resistance: Type IV, 25 psi (173 kPa), minimum.
 - 2. Tapered Board: Slope as required to match existing; minimum thickness 1/2 inch (13 mm); fabricate of fewest layers possible.

2.04 ACCESSORIES

- A. Prefabricated Flashing Accessories:

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1. Corners and Seams: Same material as membrane, in manufacturer's standard thicknesses.
 2. Penetrations: Same material as membrane, with manufacturer's standard cut-outs, rigid inserts, clamping rings, and flanges.
 3. Sealant Pockets: Same material as membrane, with manufacturer's standard accessories, in manufacturer's standard configuration.
 4. Sure-Seal Pressure-Sensitive Reinforced Universal Securement Strip (RUSS):
- B. Insulation Adhesive: Two component polyurethane, expanding foam.
1. Product:
 - a. Carlisle FAST 100.
 - b. Carlisle FAST 100 LV.
- C. Insulation Joint Tape: Glass fiber reinforced type as recommended by insulation manufacturer, compatible with roofing materials; 6 inches (152 mm) wide; self adhering.
- D. Insulation Fasteners: Appropriate for purpose intended and approved by roofing manufacturer.
1. Length as required for thickness of insulation material and penetration of deck substrate, with metal washers.
- E. Membrane Adhesive: As recommended by membrane manufacturer.
- F. Surface Conditioner for Adhesives: Compatible with membrane and adhesives.
- G. Sealants: As recommended by membrane manufacturer.
- H. Cleaner: Manufacturer's standard, clear, solvent-based cleaner.
- I. Edgings and Terminations: Manufacturer's standard edge and termination accessories.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that surfaces and site conditions are ready to receive work.
- B. Verify deck is supported and secure.
- C. Verify deck is clean and smooth, flat, free of depressions, waves, or projections, properly sloped and suitable for installation of roof system.
- D. Verify deck surfaces are dry and free of snow or ice.
- E. Verify that roof openings, curbs, and penetrations through roof are solidly set, and cant strips are in place.

3.02 PREPARATION, GENERAL

- A. Clean substrate thoroughly prior to roof application.

3.03 INSTALLATION - GENERAL

- A. Perform work in accordance with manufacturer's instructions and NRCA (RM) applicable requirements.
- B. Do not apply roofing membrane during unsuitable weather.
- C. Do not apply roofing membrane when ambient temperature is outside the temperature range recommended by manufacturer.
- D. Do not apply roofing membrane to damp or frozen deck surface or when precipitation is expected or occurring.
- E. Do not expose materials vulnerable to water or sun damage in quantities greater than can be weatherproofed the same day.

3.04 INSULATION APPLICATION

- A. Apply vapor retarder to deck surface with adhesive in accordance with manufacturer's instructions.
 1. Extend vapor retarder under cant strips and blocking to deck edge.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2. Install flexible flashing from vapor retarder to air seal material of wall construction, lap and seal to provide continuity of the air barrier plane.
- B. Ensure vapor retarder is clean and dry, continuous, and ready for application of insulation.
- C. Attachment of Insulation:
 1. Mechanically fasten insulation to deck in accordance with roofing manufacturer's instructions and Factory Mutual FM DS 1-29 requirements.
- D. Lay subsequent layers of insulation with joints staggered minimum 6 inches (152 mm) from joints of preceding layer.
- E. Lay boards with edges in moderate contact without forcing, and gap between boards no greater than 1/4 inch (6.4 mm). Cut insulation to fit neatly to perimeter blocking and around penetrations through roof.
- F. Tape joints of insulation in accordance with roofing and insulation manufacturers' instructions.
- G. Do not apply more insulation than can be completely waterproofed in the same day.

3.05 MEMBRANE APPLICATION

- A. Roll out membrane, free from wrinkles or tears. Place sheet into place without stretching.
- B. Shingle joints on sloped substrate in direction of drainage.
- C. Overlap edges and ends and seal seams by contact adhesive, minimum 3 inches (76 mm). Seal permanently waterproof.
- D. At intersections with vertical surfaces:
 1. Extend membrane over cant strips and up a minimum of 4 inches (102 mm) onto vertical surfaces.
 2. Fully adhere flexible flashing over membrane and up to nailing strips.
- E. Coordinate installation of roof drains and sumps and related flashings, locate field splices away from low areas and roof drains, and lap upslope sheet over downslope sheet.
- F. Daily Seal: Install daily seal per manufacturers instructions at the end of each work day. Prevent infiltration of water at incomplete flashings, terminations, and at unfinished membrane edges.

3.06 CLEANING

- A. See Section 01 7419 - Construction Waste Management and Disposal, for additional requirements.
- B. Remove bituminous markings from finished surfaces.
- C. In areas where finished surfaces are soiled by work of this section, consult manufacturer of surfaces for cleaning advice and conform to their documented instructions.
- D. Repair or replace defaced or damaged finishes caused by work of this section.

3.07 PROTECTION

- A. Protect installed roofing and flashings from construction operations.
- B. Where traffic must continue over finished roof membrane, protect surfaces using durable materials.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 07 6200
SHEET METAL FLASHING AND TRIM

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fabricated sheet metal items, including flashings, counterflashings, exterior penetrations, and other items indicated in Schedule.
- B. Sealants for joints within sheet metal fabrications.
- C. Precast concrete splash pads.

1.02 RELATED REQUIREMENTS

- A. Section 03 1000 - Concrete Forming and Accessories: Placement of recessed reglets in formwork.
- B. Section 06 1000 - Rough Carpentry: Wood nailers for sheet metal work.
- C. Section 07 7100 - Roof Specialties: Manufactured copings, flashings, and expansion joint covers.
- D. Section 07 7200 - Roof Accessories: Manufactured metal roof curbs.
- E. Section 07 9200 - Joint Sealants: Sealing non-lap joints between sheet metal fabrications and adjacent construction.

1.03 REFERENCE STANDARDS

- A. AAMA 611 - Voluntary Specification for Anodized Architectural Aluminum; 2014 (2015 Errata).
- B. AAMA 2605 - Voluntary Specification, Performance Requirements and Test Procedures for Superior Performing Organic Coatings on Aluminum Extrusions and Panels (with Coil Coating Appendix); 2017a.
- C. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2020.
- D. ASTM B209 - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate; 2014.
- E. ASTM B209M - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate (Metric); 2014.
- F. ASTM C920 - Standard Specification for Elastomeric Joint Sealants; 2018.
- G. ASTM D4586/D4586M - Standard Specification for Asphalt Roof Cement, Asbestos-Free; 2007 (Reapproved 2018).
- H. CDA A4050 - Copper in Architecture - Handbook; current edition.
- I. SMACNA (ASMM) - Architectural Sheet Metal Manual; 2012.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Preinstallation Meeting: Convene one week before starting work of this section.

1.05 QUALITY ASSURANCE

- A. Perform work in accordance with SMACNA (ASMM) and CDA A4050 requirements and standard details, except as otherwise indicated.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Stack material to prevent twisting, bending, and abrasion, and to provide ventilation. Slope metal sheets to ensure drainage.
- B. Prevent contact with materials that could cause discoloration or staining.

PART 2 PRODUCTS

2.01 SHEET MATERIALS

- A. Galvanized Steel: ASTM A653/A653M, with G90/Z275 zinc coating; minimum 24 gauge, (0.0239 inch) (0.61 mm) thick base metal.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Pre-Finished Galvanized Steel: ASTM A653/A653M, with G90/Z275 zinc coating; minimum 24 gauge, (0.0239) inch (0.61 mm) thick base metal, shop pre-coated with PVDF coating.
 - 1. PVDF (Polyvinylidene Fluoride) Coating: Superior Performance Organic Finish, AAMA 2605; multiple coat, thermally cured fluoropolymer finish system.
 - 2. Color: As selected by Architect/Owner from manufacturer's standard colors.
- C. Aluminum: ASTM B209 (ASTM B209M); 20 gauge, 0.032 inch (0.81 mm) thick; anodized finish of color as selected.
 - 1. Color Anodized Finish: AAMA 611 AA-M12C22A42/44 Class I integrally or electrolytically colored anodic coating not less than 0.7 mils (0.018 mm) thick.

2.02 FABRICATION

- A. Form sections true to shape, accurate in size, square, and free from distortion or defects.
- B. Form pieces in longest possible lengths.
- C. Hem exposed edges on underside 1/2 inch (13 mm); miter and seam corners.
- D. Form material with flat lock seams, except where otherwise indicated; at moving joints, use sealed lapped, bayonet-type or interlocking hooked seams.
- E. Fabricate corners from one piece with minimum 18 inch (450 mm) long legs; seam for rigidity, seal with sealant.
- F. Fabricate flashings to allow toe to extend 2 inches (50 mm) over roofing gravel. Return and brake edges.

2.03 ACCESSORIES

- A. Fasteners: Galvanized steel, with soft neoprene washers.
- B. Primer: Zinc chromate type.
- C. Concealed Sealants: Non-curing butyl sealant.
- D. Exposed Sealants: ASTM C920; elastomeric sealant, with minimum movement capability as recommended by manufacturer for substrates to be sealed; color to match adjacent material.
- E. Plastic Cement: ASTM D4586/D4586M, Type I.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify roof openings, curbs, pipes, sleeves, ducts, and vents through roof are solidly set, reglets in place, and nailing strips located.
- B. Verify roofing termination and base flashings are in place, sealed, and secure.

3.02 PREPARATION

- A. Install starter and edge strips, and cleats before starting installation.
- B. Back paint concealed metal surfaces with protective backing paint to a minimum dry film thickness of 15 mil (0.4 mm).

3.03 INSTALLATION

- A. Comply with drawing details.
- B. Secure flashings in place using concealed fasteners, and use exposed fasteners only where permitted..
- C. Apply plastic cement compound between metal flashings and felt flashings.
- D. Fit flashings tight in place; make corners square, surfaces true and straight in planes, and lines accurate to profiles.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for field inspection requirements.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Inspection will involve surveillance of work during installation to ascertain compliance with specified requirements.

3.05 SCHEDULE

- A. Fascia and Cornices:
- B. Coping, Cap, Parapet, Sill and Ledge Flashings:
- C. Flashings Associated with Shingle Roofing, including Valley, Hip, Ridge, Eave, Gutter Edge, Gable Edge, Chimney:
- D. Sheet Metal Roof Expansion Joint Covers, and Roof-to-Wall Joint Covers:
- E. Counterflashings at Curb-Mounted Roof Items, including skylights and roof hatches:
- F. Roofing Penetration Flashings, for Pipes, Structural Steel, and Equipment Supports:
- G. Termite Shields:

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 07 7200
ROOF ACCESSORIES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Curbs.
- B. Equipment rails.
- C. Roof penetrations mounting curbs.

1.02 RELATED REQUIREMENTS

- A. Section 05 3100 - Steel Decking.

1.03 REFERENCE STANDARDS

- A. 29 CFR 1910.29 - Fall Protection Systems and Falling Object Protection - Criteria and Practices; Current Edition.
- B. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products; 2017.
- C. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware; 2016a.
- D. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2020.
- E. ASTM B221 - Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes; 2014.
- F. MSS SP-58 - Pipe Hangers and Supports - Materials, Design, Manufacture, Selection, Application, and Installation; 2018.
- G. UL (DIR) - Online Certifications Directory; Current Edition.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Warranty Documentation:
 - 1. Submit manufacturer warranty.
 - 2. Ensure that forms have been completed in Owner's name and registered with manufacturer.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Store products in manufacturer's unopened packaging until ready for installation.
- B. Store products under cover and elevated above grade.

1.06 WARRANTY

- A. See Section 01 7800 - Closeout Submittals, for additional warranty requirements.

PART 2 PRODUCTS

2.01 ROOF CURBS

- A. Roof Curbs Mounting Assemblies: Factory fabricated hollow sheet metal construction, internally reinforced, and capable of supporting superimposed live and dead loads and designated equipment load with fully mitered and sealed corner joints welded or mechanically fastened, and integral counterflashing with top and edges formed to shed water.
 - 1. Roof Curb Mounting Substrate: Curb substrate consists of flat roof deck sheathing with insulation.
 - 2. Provide layouts and configurations indicated on drawings.
- B. Curbs Adjacent to Roof Openings: Provide curb on each side of opening, with top of curb horizontal for equipment mounting.
 - 1. Provide preservative treated wood nailers along top of curb.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2. Insulate inside curbs with 1-1/2 inch (38 mm) thick fiberglass insulation.
3. Height Above Finished Roof Surface: 8 inches (203 mm), minimum.
- C. Equipment Rail Curbs: Straight curbs on each side of equipment, with top of curbs horizontal and level with each other for equipment mounting.
- D. Equipment Support: Straight curbs on each side of equipment, with top of curbs parallel with metal roofing system and each other for equipment mounting.

2.02 NON-PENETRATING ROOFTOP SUPPORTS/ASSEMBLIES

- A. Non-Penetrating Rooftop Support/Assemblies: Manufacturer-engineered and factory-fabricated, with pedestal bases that rest on top of roofing membrane, and not requiring any attachment to roof structure and not penetrating roofing assembly.
 1. Design Loadings and Configurations: As required by applicable codes.
 2. Support Spacing and Base Sizes: As required to distribute load sufficiently to prevent indentation of roofing assembly.
 3. Steel Components: Stainless steel, or carbon steel hot-dip galvanized after fabrication in accordance with ASTM A123/A123M.
 4. Hardware, Bolts, Nuts, and Washers: Stainless steel, or carbon steel hot-dip galvanized after fabrication in accordance with ASTM A153/A153M.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Do not begin installation until substrates have been properly prepared.
- B. If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.

3.02 PREPARATION

- A. Clean surfaces thoroughly prior to installation.
- B. Prepare surfaces using methods recommended by manufacturer for achieving acceptable results for applicable substrate under project conditions.

3.03 INSTALLATION

- A. Install in accordance with manufacturer's instructions, in manner that maintains roofing system weather-tight integrity.

3.04 CLEANING

- A. Clean installed work to like-new condition.

3.05 PROTECTION

- A. Protect installed products until completion of project.
- B. Touch-up, repair or replace damaged products before Date of Substantial Completion.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 07 8400
FIRESTOPPING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Firestopping systems.
- B. Firestopping of joints and penetrations in fire resistance rated and smoke resistant assemblies, whether indicated on drawings or not, and other openings indicated.

1.02 RELATED REQUIREMENTS

- A. Section 01 6116 - Volatile Organic Compound (VOC) Content Restrictions.
- B. Section 07 0553 - Fire and Smoke Assembly Identification.
- C. Section 09 2116 - Gypsum Board Assemblies: Gypsum wallboard fireproofing.

1.03 REFERENCE STANDARDS

- A. ASTM E119 - Standard Test Methods for Fire Tests of Building Construction and Materials; 2020.
- B. ASTM E814 - Standard Test Method for Fire Tests of Penetration Firestop Systems; 2013a (Reapproved 2017).
- C. ASTM E1966 - Standard Test Method for Fire-Resistive Joint Systems; 2015 (Reapproved 2019).
- D. ASTM E2174 - Standard Practice for On-Site Inspection of Installed Firestop Systems; 2020a.
- E. ASTM E2393 - Standard Practice for On-Site Inspection of Installed Fire Resistive Joint Systems and Perimeter Fire Barriers; 2020.
- F. ITS (DIR) - Directory of Listed Products; current edition.
- G. FM 4991 - Approval Standard for Firestop Contractors; 2013.
- H. FM (AG) - FM Approval Guide; current edition.
- I. SCAQMD 1168 - Adhesive and Sealant Applications; 1989 (Amended 2017).
- J. UL 1479 - Standard for Fire Tests of Penetration Firestops; Current Edition, Including All Revisions.
- K. UL 2079 - Standard for Tests for Fire Resistance of Building Joint Systems; Current Edition, Including All Revisions.
- L. UL (DIR) - Online Certifications Directory; Current Edition.
- M. UL (FRD) - Fire Resistance Directory; Current Edition.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Schedule of Firestopping: List each type of penetration, fire rating of the penetrated assembly, and firestopping test or design number.
- C. Product Data: Provide data on product characteristics, performance ratings, and limitations.
- D. Manufacturer's Installation Instructions: Indicate preparation and installation instructions.

1.05 QUALITY ASSURANCE

- A. Fire Testing: Provide firestopping assemblies of designs that provide the scheduled fire ratings when tested in accordance with methods indicated.
 - 1. Listing in UL (FRD), FM (AG), or ITS (DIR) will be considered as constituting an acceptable test report.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- C. Installer Qualifications: Company specializing in performing the work of this section and:

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1.06 FIELD CONDITIONS

- A. Comply with firestopping manufacturer's recommendations for temperature and conditions during and after installation; maintain minimum temperature before, during, and for three days after installation of materials.
- B. Provide ventilation in areas where solvent-cured materials are being installed.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Firestopping Manufacturers:
 - 1. 3M Fire Protection Products: www.3m.com/firestop/#sle.
 - 2. Grabber Construction Products, Inc; GrabberGard EFC: www.grabberman.com/#sle.
 - 3. Hilti, Inc: www.us.hilti.com/#sle.
 - 4. Substitutions: See Section 01 6000 - Product Requirements.

2.02 MATERIALS

- A. Primers, Sleeves, Forms, Insulation, Packing, Stuffing, and Accessories: Provide type of materials as required for tested firestopping assembly.

2.03 FIRESTOPPING ASSEMBLY REQUIREMENTS

- A. Floor-to-Floor, Wall-to-Wall, and Wall-to-Floor Joints, Except Perimeter, Where Both Are Fire-Rated: Use system that has been tested according to ASTM E1966 or UL 2079 to have fire resistance F Rating equal to required fire rating of the assembly in which the joint occurs.
 - 1. Movement: Provide systems that have been tested to show movement capability as indicated.
 - 2. Air Leakage: Provide systems that have been tested to show L Rating as indicated.
 - 3. Listing by FM (AG), ITS (DIR), UL (DIR), or UL (FRD) in their certification directories will be considered evidence of successful testing.
- B. Through Penetration Firestopping: Use system that has been tested according to ASTM E814 to have fire resistance F Rating equal to required fire rating of penetrated assembly.
 - 1. Temperature Rise: Provide systems that have been tested to show T Rating as indicated.
 - 2. Air Leakage: Provide systems that have been tested to show L Rating as indicated.
 - 3. Listing by FM (AG), ITS (DIR), UL (DIR), or UL (FRD) in their certification directories will be considered evidence of successful testing.

2.04 FIRESTOPPING PENETRATIONS THROUGH FRAMED FLOORS

- A. Metallic Pipe, Conduit, and Tubing Penetrations in Framed Floors:
 - 1. 1 Hour Construction: UL System F-C-1053; Specified Technologies Inc. WF300 Intumescent Firestop Caulk (for wood frame construction).
 - 2. 1 Hour Construction: UL System F-C-1162; Specified Technologies Inc. Closet Flange Firestop Gasket.
- B. Non-Metallic Pipe, Conduit or Tubing in Framed Floors:
 - 1. 1 Hour Construction: UL System F-C-2014; Specified Technologies Inc. WF300 Intumescent Firestop Caulk (for wood frame construction).
 - 2. 1 Hour Construction: UL System F-C-2020; Specified Technologies Inc. LCC Intumescent Firestop Collars.
 - 3. 1 Hour Construction: UL System F-C-2020; Specified Technologies Inc. SSC collars.
 - 4. 1 Hour Construction: UL System F-C-2348; Specified Technologies Inc. RTC range-taking collar.
 - 5. 1 Hour Construction: UL System F-C-2402; Specified Technologies Inc. Closet Flange Firestop Gasket.
- C. Electrical Cable in Framed Floors:
 - 1. 1 Hour Construction: UL System F-C-3010; Specified Technologies Inc. WF300 Intumescent Firestop Caulk (for wood frame construction).
- D. Insulated Pipe in Framed Floors:

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1. 1 Hour Construction: UL System F-C-5043; Specified Technologies Inc. WF300 Intumescent Firestop Caulk (for wood frame construction).

2.05 FIRESTOPPING PENETRATIONS THROUGH GYPSUM BOARD WALLS

- A. Blank Openings:
 1. 1 Hour Construction: UL System W-L-0032; Specified Technologies Inc. FP Intumescent Firestop Plug.
 2. 1 Hour Construction: UL System W-L-0038; Specified Technologies Inc. FP Intumescent Firestop Plug.
 3. 1 Hour Construction: UL System W-L-3334; Hilti CP 653 Speed Sleeve.
- B. Penetrations By:
 1. Multiple Penetrations in Large Openings:
 - a. 1 Hour Construction: UL System W-L-1408; Hilti FS-ONE MAX Intumescent Firestop Sealant.
 - b. 1 Hour Construction: UL System W-L-8013; Hilti CFS-BL Firestop Block.
 - c. 1 Hour Construction: UL System W-L-8071; Hilti FS-ONE MAX Intumescent Firestop Sealant.
 - d. 1 Hour Construction: UL System W-L-8079; Hilti FS-ONE MAX Intumescent Firestop Sealant.
 2. Uninsulated Metallic Pipe, Conduit, and Tubing:
 - a. 1 Hour Construction: UL System W-L-1054; Hilti FS-ONE MAX Intumescent Firestop Sealant.
 - b. 1 Hour Construction: UL System W-L-1164; Hilti FS-ONE MAX Intumescent Firestop Sealant.
 - c. 1 Hour Construction: UL System W-L-1477; Specified Technologies Inc. EZ Firestop Grommet.
 3. Uninsulated Non-Metallic Pipe, Conduit, and Tubing:
 - a. 1 Hour Construction: UL System W-L-2074; Specified Technologies Inc. SSC collars.
 - b. 1 Hour Construction: UL System W-L-2078; Hilti CP 643N/644 Firestop Collar.
 - c. 1 Hour Construction: UL System W-L-2237; Specified Technologies Inc. LCC Intumescent Firestop Collars.
 - d. 1 Hour Construction: UL System W-L-2241; Specified Technologies Inc. WF300 Intumescent Firestop Caulk (for wood frame construction).
 4. Electrical Cables Not In Conduit:
 - a. 1 Hour Construction: UL System W-L-3358; Specified Technologies Inc. Ready Split Sleeve.
 - b. 1 Hour Construction: UL System W-L-3358; Specified Technologies Inc. Ready-Sleeve.
 - c. 1 Hour Construction: UL System W-L-3378; Specified Technologies Inc. EZ Firestop Grommet.
 - d. 1 Hour Construction: UL System W-L-3379; Specified Technologies Inc. EZ Firestop Grommet.
 - e. 1 Hour Construction: UL System W-L-3393; Hilti CFS-SL RK Retrofit Sleeve Kit for existing cables.
 - f. 1 Hour Construction: UL System W-L-3414; Hilti CFS-D Firestop Cable Disc.
 5. Insulated Pipes:
 - a. 1 Hour Construction: UL System W-L-5028; Hilti FS-ONE MAX Intumescent Firestop Sealant.
 - b. 1 Hour Construction: UL System W-L-5029; Hilti FS-ONE Intumescent Firestop Sealant.
 - c. 1 Hour Construction: UL System W-L-5121; Specified Technologies Inc. LCI Intumescent Firestop Sealant.
 - d. 1 Hour Construction: UL System W-L-5273; Specified Technologies Inc. LC Endothermic Firestop Sealant.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- e. 1 Hour Construction: UL System W-L-5298; Specified Technologies Inc. WF300 Intumescent Firestop Caulk (for wood frame construction).
- 6. HVAC Ducts, Insulated:
 - a. 1 Hour Construction: UL System W-L-7164; Specified Technologies Inc. FyreFlange HVAC Firestop Angle.
 - b. 1 Hour Construction: UL System W-L-7238; Specified Technologies Inc. FyreFlange HVAC Firestop Angle.
 - c. 1 Hour Construction: UL System W-L-7156; Hilti FS-ONE MAX Intumescent Firestop Sealant.

2.06 FIRESTOPPING SYSTEMS

- A. Firestopping: Any material meeting requirements.
 - 1. Fire Ratings: Use system that is listed by FM (AG), ITS (DIR), or UL (FRD) and tested in accordance with ASTM E814, ASTM E119, or UL 1479 with F Rating equal to fire rating of penetrated assembly and minimum T Rating Equal to F Rating and in compliance with other specified requirements.
- B. Firestopping Between Top of Partition Wall and Roof Slab: Fiber firestopping with smoke seal coating; UL Design No. to be submitted, F Rating 1 hour, provide at locations as indicated on drawings.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify openings are ready to receive the work of this section.

3.02 PREPARATION

- A. Clean substrate surfaces of dirt, dust, grease, oil, loose material, or other materials that could adversely affect bond of firestopping material.
- B. Remove incompatible materials that could adversely affect bond.

3.03 INSTALLATION

- A. Install materials in manner described in fire test report and in accordance with manufacturer's instructions, completely closing openings.
- B. Do not cover installed firestopping until inspected by authorities having jurisdiction.
- C. Install labeling required by code.

3.04 FIELD QUALITY CONTROL

- A. Independent Testing Agency: Inspection agency employed and paid by Owner, will examine penetration firestopping in accordance with ASTM E2174, and ASTM E2393.
- B. Repair or replace penetration firestopping and joints at locations where inspection results indicate firestopping or joints do not meet specified requirements.

3.05 CLEANING

- A. Clean adjacent surfaces of firestopping materials.

3.06 PROTECTION

- A. Protect adjacent surfaces from damage by material installation.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 07 9200
JOINT SEALANTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Joint backings and accessories.

1.02 RELATED REQUIREMENTS

- A. Section 01 6116 - Volatile Organic Compound (VOC) Content Restrictions: Additional requirements for sealants and primers.
- B. Section 07 8400 - Firestopping: Firestopping sealants.
- C. Section 09 3000 - Tiling: Sealant between tile and plumbing fixtures and at junctions with other materials and changes in plane.

1.03 REFERENCE STANDARDS

- A. ASTM C794 - Standard Test Method for Adhesion-In-Peel of Elastomeric Joint Sealants; 2018.
- B. ASTM C834 - Standard Specification for Latex Sealants; 2017.
- C. ASTM C919 - Standard Practice for Use of Sealants in Acoustical Applications; 2018.
- D. ASTM C920 - Standard Specification for Elastomeric Joint Sealants; 2018.
- E. ASTM C1087 - Standard Test Method for Determining Compatibility of Liquid-Applied Sealants with Accessories Used in Structural Glazing Systems; 2016.
- F. ASTM C1193 - Standard Guide for Use of Joint Sealants; 2016.
- G. ASTM C1248 - Standard Test Method for Staining of Porous Substrate by Joint Sealants; 2018.
- H. ASTM C1311 - Standard Specification for Solvent Release Sealants; 2014.
- I. ASTM C1330 - Standard Specification for Cylindrical Sealant Backing for Use with Cold Liquid-Applied Sealants; 2018.
- J. ASTM C1521 - Standard Practice for Evaluating Adhesion of Installed Weatherproofing Sealant Joints; 2019 (Reapproved 2020).
- K. SCAQMD 1168 - Adhesive and Sealant Applications; 1989 (Amended 2017).
- L. UL 263 - Standard for Fire Tests of Building Construction and Materials; Current Edition, Including All Revisions.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data for Sealants: Submit manufacturer's technical data sheets for each product to be used, that includes the following.
 - 1. Physical characteristics, including movement capability, VOC content, hardness, cure time, and color availability.
 - 2. List of backing materials approved for use with the specific product.
 - 3. Substrates that product is known to satisfactorily adhere to and with which it is compatible.
 - 4. Substrates the product should not be used on.
- C. Color Cards for Selection: Where sealant color is not specified, submit manufacturer's color cards showing standard colors available for selection.
- D. Preconstruction Laboratory Test Reports: Submit at least four weeks prior to start of installation.
- E. Preinstallation Field Adhesion Test Plan: Submit at least two weeks prior to start of installation.
- F. Preinstallation Field Adhesion Test Reports: Submit filled out Preinstallation Field Adhesion Test Reports log within 10 days after completion of tests; include bagged test samples and photographic records.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- B. Installer Qualifications: Company specializing in performing the work of this section and with at least three years of documented experience.
- C. Preconstruction Laboratory Testing: Arrange for sealant manufacturer(s) to test each combination of sealant, substrate, backing, and accessories.
 - 1. Adhesion Testing: In accordance with ASTM C794.
 - 2. Compatibility Testing: In accordance with ASTM C1087.
 - 3. Allow sufficient time for testing to avoid delaying the work.
 - 4. Deliver to manufacturer sufficient samples for testing.
 - 5. Report manufacturer's recommended corrective measures, if any, including primers or techniques not indicated in product data submittals.
 - 6. Testing is not required if sealant manufacturer provides data showing previous testing, not older than 24 months, that shows satisfactory adhesion, lack of staining, and compatibility.
- D. Preinstallation Field Adhesion Test Plan: Include destructive field adhesion testing of one sample of each combination of sealant type and substrate, except interior acrylic latex sealants, and include the following for each tested sample.
 - 1. Identification of testing agency.
 - 2. Preinstallation Field Adhesion Test Log Form: Include the following data fields, with known information filled out.
 - a. Test date.
 - b. Copy of test method documents.
 - c. Age of sealant upon date of testing.
 - d. Test results, modeled after the sample form in the test method document.
 - e. Indicate use of photographic record of test.
- E. Field Adhesion Test Procedures:
 - 1. Allow sealants to fully cure as recommended by manufacturer before testing.
 - 2. Have a copy of the test method document available during tests.
 - 3. Record the type of failure that occurred, other information required by test method, and the information required on the Field Quality Control Log.
 - 4. When performing destructive tests, also inspect the opened joint for proper installation characteristics recommended by manufacturer, and report any deficiencies.
 - 5. Deliver the samples removed during destructive tests in separate sealed plastic bags, identified with project, location, test date, and test results, to Owner.
 - 6. If any combination of sealant type and substrate does not show evidence of minimum adhesion or shows cohesion failure before minimum adhesion, report results to Architect.
- F. Destructive Field Adhesion Test: Test for adhesion in accordance with ASTM C1521, using Destructive Tail Procedure.
 - 1. Sample: At least 18 inches (457 mm) long.
 - 2. Minimum Elongation Without Adhesive Failure: Consider the tail at rest, not under any elongation stress; multiply the stated movement capability of the sealant in percent by two; then multiply 1 inch (25.4 mm) by that percentage; if adhesion failure occurs before the "1 inch mark" is that distance from the substrate, the test has failed.
 - 3. If either adhesive or cohesive failure occurs prior to minimum elongation, take necessary measures to correct conditions and re-test; record each modification to products or installation procedures.

1.06 WARRANTY

- A. See Section 01 7800 - Closeout Submittals, for additional warranty requirements.
- B. Correct defective work within a five year period after Date of Substantial Completion.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- C. Warranty: Include coverage for installed sealants and accessories that fail to achieve watertight seal , exhibit loss of adhesion or cohesion, or do not cure.

PART 2 PRODUCTS

2.01 JOINT SEALANT APPLICATIONS

- A. Scope:
 - 1. Interior Joints: Do not seal interior joints unless specifically indicated to be sealed. Interior joints to be sealed include, but are not limited to, the following items.
 - a. Joints between door, window, and other frames and adjacent construction.
 - b. Other joints indicated below.
 - 2. Do not seal the following types of joints.
 - a. Joints indicated to be treated with manufactured expansion joint cover or some other type of sealing device.
 - b. Joints where sealant is specified to be provided by manufacturer of product to be sealed.
 - c. Joints where installation of sealant is specified in another section.
 - d. Joints between suspended panel ceilings/grid and walls.
- B. Interior Joints: Use non-sag polyurethane sealant, unless otherwise indicated.
 - 1. Joints between Fixtures in Wet Areas and Floors, Walls, and Ceilings: Mildew-resistant silicone sealant; white.
- C. Interior Wet Areas: Bathrooms, restrooms, kitchens, food service areas, and food processing areas; fixtures in wet areas include plumbing fixtures, food service equipment, countertops, cabinets, and other similar items.

2.02 JOINT SEALANTS - GENERAL

- A. Sealants and Primers: Provide products with levels of volatile organic compound (VOC) content as indicated in Section 01 6116.

2.03 ACCESSORIES

- A. Backing Tape: Self-adhesive polyethylene tape with surface that sealant will not adhere to and recommended by tape and sealant manufacturers for specific application.
- B. Masking Tape: Self-adhesive, nonabsorbent, non-staining, removable without adhesive residue, and compatible with surfaces adjacent to joints and sealants.
- C. Joint Cleaner: Non-corrosive and non-staining type, type recommended by sealant manufacturer; compatible with joint forming materials.
- D. Primers: Type recommended by sealant manufacturer to suit application; non-staining.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that joints are ready to receive work.
- B. Verify that backing materials are compatible with sealants.
- C. Preinstallation Adhesion Testing: Install a sample for each test location indicated in the test plan.
 - 1. Test each sample as specified in PART 1 under QUALITY ASSURANCE article.
 - 2. Notify Architect of date and time that tests will be performed, at least seven days in advance.
 - 3. Record each test on Preinstallation Adhesion Test Log as indicated.
 - 4. If any sample fails, review products and installation procedures, consult manufacturer, or take whatever other measures are necessary to ensure adhesion; re-test in a different location; if unable to obtain satisfactory adhesion, report to Architect.
 - 5. After completion of tests, remove remaining sample material and prepare joint for new sealant installation.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3.02 PREPARATION

- A. Remove loose materials and foreign matter that could impair adhesion of sealant.
- B. Clean joints, and prime as necessary, in accordance with manufacturer's instructions.
- C. Perform preparation in accordance with manufacturer's instructions and ASTM C1193.
- D. Mask elements and surfaces adjacent to joints from damage and disfigurement due to sealant work; be aware that sealant drips and smears may not be completely removable.

3.03 INSTALLATION

- A. Perform work in accordance with sealant manufacturer's requirements for preparation of surfaces and material installation instructions.
- B. Perform installation in accordance with ASTM C1193.
- C. Perform acoustical sealant application work in accordance with ASTM C919.
- D. Measure joint dimensions and size joint backers to achieve the following, unless otherwise indicated:
 - 1. Width/depth ratio of 2:1.
 - 2. Neck dimension no greater than 1/3 of the joint width.
 - 3. Surface bond area on each side not less than 75 percent of joint width.
- E. Install bond breaker backing tape where backer rod cannot be used.
- F. Install sealant free of air pockets, foreign embedded matter, ridges, and sags, and without getting sealant on adjacent surfaces.
- G. Do not install sealant when ambient temperature is outside manufacturer's recommended temperature range, or will be outside that range during the entire curing period, unless manufacturer's approval is obtained and instructions are followed.
- H. Nonsag Sealants: Tool surface concave, unless otherwise indicated; remove masking tape immediately after tooling sealant surface.

3.04 FIELD QUALITY CONTROL

- A. Perform field quality control inspection/testing as specified in PART 1 under QUALITY ASSURANCE article.
- B. Remove and replace failed portions of sealants using same materials and procedures as indicated for original installation.

3.05 POST-OCCUPANCY

- A. Post-Occupancy Inspection: Perform visual inspection of entire length of project sealant joints at a time that joints have opened to their greatest width; i.e. at low temperature in thermal cycle. Report failures immediately and repair.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 08 3100
ACCESS DOORS AND PANELS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Wall-mounted access units.
- B. Ceiling-mounted access units.

1.02 RELATED REQUIREMENTS

- A. Section 08 7100 - Door Hardware: Mortise cylinder and core hardware.
- B. Section 09 9123 - Interior Painting: Field paint finish.

1.03 REFERENCE STANDARDS

- A. ADA Standards - Americans with Disabilities Act (ADA) Standards for Accessible Design; 2010.
- B. ASTM A240/A240M - Standard Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications; 2019.
- C. ASTM A500/A500M - Standard Specification for Cold-Formed Welded and Seamless Carbon Steel Structural Tubing in Rounds and Shapes; 2020.
- D. ASTM B26/B26M - Standard Specification for Aluminum-Alloy Sand Castings; 2018, with Editorial Revision.
- E. ASTM B209 - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate; 2014.
- F. ASTM B211/B211M - Standard Specification for Aluminum and Aluminum-Alloy Rolled or Cold Finished Bar, Rod, and Wire; 2019.
- G. ITS (DIR) - Directory of Listed Products; current edition.
- H. UL (FRD) - Fire Resistance Directory; Current Edition.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide sizes, types, finishes, hardware, scheduled locations, and details of adjoining work.
- C. Shop Drawings: Indicate exact position of each access door and/or panel unit.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- B. Installer Qualifications: Company specializing in performing work of the type specified and with at least three years documented experience.

PART 2 PRODUCTS

2.01 ACCESS DOORS AND PANELS ASSEMBLIES

- A. Wall-Mounted Units:
 - 1. Location: As indicated on drawings.
 - 2. Panel Material: Aluminum.
 - 3. Size: As indicated on drawings.
 - 4. Door/Panel: Hinged, standard duty, with tool-operated spring or cam lock and no handle.
 - 5. Gypsum Board Mounting Criteria: Provide drywall bead frame with door surface flush with wall surface.
- B. Ceiling-Mounted Units:
 - 1. Location: As indicated on drawings.
 - 2. Panel Material: Aluminum.
 - 3. Size - Lay-In Grid Ceilings: To match module of ceiling grid.
 - 4. Size - Other Ceilings: 20 by 30 inches (500 by 750 mm).

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2.02 WALL AND CEILING MOUNTED ACCESS UNITS

- A. Manufacturers:
 - 1. Babcock Davis Products Inc: www.Babcock Davis.com/
 - 2. Substitutions: See Section 01 6000 - Product Requirements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that rough openings are correctly sized and located.
- B. Begin installation only after substrates have been properly prepared, and if the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.

3.02 PREPARATION

- A. Clean surfaces thoroughly prior to proceeding with this work.
- B. Prepare surfaces using methods recommended by manufacturer for applicable substrates in accordance with project conditions.

3.03 INSTALLATION

- A. Install units in accordance with manufacturer's instructions.
- B. Install frames plumb and level in openings, and secure units rigidly in place.
- C. Position units to provide convenient access to concealed equipment when necessary.

3.04 SCHEDULE

- A. See Architectural Plans & Door/Door Hardware Schedules for locations & type.
- B. See Following Specification sheets.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 09 0561

COMMON WORK RESULTS FOR FLOORING PREPARATION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. This section applies to floors identified in Contract Documents that are receiving the following types of floor coverings:
 - 1. Epoxy Coating
- B. Removal of existing floor coverings.
- C. Preparation of new and existing concrete floor slabs for installation of floor coverings.
- D. Testing of concrete floor slabs for moisture and alkalinity (pH).

1.02 RELATED REQUIREMENTS

- A. Section 01 2300 - Alternates: Bid pricing for remediation treatments if required.
- B. Section 01 4000 - Quality Requirements: Additional requirements relating to testing agencies and testing.
- C. Section 01 7419 - Construction Waste Management and Disposal: Handling of existing floor coverings removed.
- D. Section 03 3000 - Cast-in-Place Concrete: Moisture emission reducing curing and sealing compound for slabs to receive adhered flooring, to prevent moisture content-related flooring failures; to remain in place, not to be removed.
- E. Section 03 3000 - Cast-in-Place Concrete: Concrete admixture for slabs to receive adhered flooring, to prevent moisture content-related flooring failures.

1.03 PRICE AND PAYMENT PROCEDURES

- A. Alternate for Alternate Flooring Adhesive: Do not include the cost of the alternate adhesive in the base bid; state on the bid form the total additional cost for the alternate adhesive, installed, in the event such remediation is required.
- B. Alternate for Remedial Floor Coating or Sheet Membrane: Do not include the cost of floor coating or underlayment in the base bid; state on the bid form the total additional cost for the floor coating, installed, in the event such remediation is required.

1.04 REFERENCE STANDARDS

- A. ASTM F710 - Standard Practice for Preparing Concrete Floors to Receive Resilient Flooring; 2019, with Editorial Revision (2020).
- B. ASTM F1869 - Standard Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride; 2016a.
- C. ASTM F2170 - Standard Test Method for Determining Relative Humidity in Concrete Floor Slabs Using in situ Probes; 2019a.
- D. RFCI (RWP) - Recommended Work Practices for Removal of Resilient Floor Coverings; 2011.

1.05 ADMINISTRATIVE REQUIREMENTS

- A. Coordinate scheduling of cleaning and testing, so that preliminary cleaning has been completed for at least 24 hours prior to testing.

1.06 SUBMITTALS

- A. Visual Observation Report: For existing floor coverings to be removed.
- B. Floor Covering and Adhesive Manufacturers' Product Literature: For each specific combination of substrate, floor covering, and adhesive to be used; showing:
 - 1. Moisture and alkalinity (pH) limits and test methods.
 - 2. Manufacturer's required bond/compatibility test procedure.
- C. Testing Agency's Report:

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1. Description of areas tested; include floor plans and photographs if helpful.
 2. Summary of conditions encountered.
 3. Moisture and alkalinity (pH) test reports.
 4. Copies of specified test methods.
 5. Recommendations for remediation of unsatisfactory surfaces.
 6. Submit report directly to Owner.
 7. Submit report not more than two business days after conclusion of testing.
- D. Adhesive Bond and Compatibility Test Report.
- E. Copy of RFCI (RWP).

1.07 QUALITY ASSURANCE

- A. Moisture and alkalinity (pH) testing will be performed by an independent testing agency employed and paid by Owner.
- B. Testing Agency Qualifications: Independent testing agency experienced in the types of testing specified.
1. Submit evidence of experience consisting of at least 3 test reports of the type required, with project Owner's project contact information.
- C. Contractor's Responsibility Relating to Independent Agency Testing:
1. Provide access for and cooperate with testing agency.
 2. Confirm date of start of testing at least 10 days prior to actual start.
 3. Allow at least 4 business days on site for testing agency activities.
 4. Achieve and maintain specified ambient conditions.
 5. Notify Owner when specified ambient conditions have been achieved and when testing will start.

1.08 DELIVERY, STORAGE, AND HANDLING

- A. Deliver, store, handle, and protect products in accordance with manufacturer's instructions and recommendations.
- B. Deliver materials in manufacturer's packaging; include installation instructions.
- C. Keep materials from freezing.

1.09 FIELD CONDITIONS

- A. Maintain ambient temperature in spaces where concrete testing is being performed, and for at least 48 hours prior to testing, at not less than 65 degrees F (18 degrees C) or more than 85 degrees F (30 degrees C).
- B. Maintain relative humidity in spaces where concrete testing is being performed, and for at least 48 hours prior to testing, at not less than 40 percent and not more than 60 percent.

PART 2 PRODUCTS

2.01 MATERIALS

PART 3 EXECUTION

3.01 CONCRETE SLAB PREPARATION

- A. Perform following operations in the order indicated:
1. Preliminary cleaning.
 2. Moisture vapor emission tests; 3 tests in the first 1000 square feet (100 square meters) and one test in each additional 1000 square feet (100 square meters), unless otherwise indicated or required by flooring manufacturer.
 3. Internal relative humidity tests; in same locations as moisture vapor emission tests, unless otherwise indicated.
 4. Alkalinity (pH) tests; in same locations as moisture vapor emission tests, unless otherwise indicated.
 5. Specified remediation, if required.
 6. Patching, smoothing, and leveling, as required.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

7. Other preparation specified.
8. Adhesive bond and compatibility test.
9. Protection.

3.02 REMOVAL OF EXISTING FLOOR COVERINGS

- A. Comply with local, State, and federal regulations and recommendations of RFCI Recommended Work Practices for Removal of Resilient Floor Coverings, as applicable to floor covering being removed.
- B. Dispose of removed materials in accordance with local, State, and federal regulations and as specified.

3.03 MOISTURE VAPOR EMISSION TESTING

- A. Where the floor covering manufacturer's requirements conflict with either the referenced test method or this specification, comply with the manufacturer's requirements.
- B. Where this specification conflicts with the referenced test method, comply with the requirements of this section.
- C. Test in accordance with ASTM F1869 and as follows.
- D. Plastic sheet test and mat bond test may not be substituted for the specified ASTM test method, as those methods do not quantify the moisture content sufficiently.
- E. In the event that test values exceed floor covering manufacturer's limits, perform remediation as indicated. In the absence of manufacturer limits, perform remediation if test values exceed 3 pounds per 1000 square feet (1.4 kg per 93 square meters) per 24 hours.
- F. Report: Report the information required by the test method.

3.04 INTERNAL RELATIVE HUMIDITY TESTING

- A. Where the floor covering manufacturer's requirements conflict with either the referenced test method or this specification, comply with the manufacturer's requirements.
- B. Where this specification conflicts with the referenced test method, comply with the requirements of this section.
- C. Test in accordance with ASTM F2170 Procedure A and as follows.
- D. Testing with electrical impedance or resistance apparatus may not be substituted for the specified ASTM test method, as the values determined are not comparable to the ASTM test values and do not quantify the moisture content sufficiently.
- E. In the event that test values exceed floor covering manufacturer's limits, perform remediation as indicated. In the absence of manufacturer limits, perform remediation if any test value exceeds 75 percent relative humidity.
- F. Report: Report the information required by the test method.

3.05 ALKALINITY TESTING

- A. Where the floor covering manufacturer's requirements conflict with either the referenced test method or this specification, comply with the manufacturer's requirements.
- B. In the event that test values exceed floor covering manufacturer's limits, perform remediation as indicated. In the absence of manufacturer limits, perform remediation if alkalinity (pH) test value is over 10.

3.06 PREPARATION

- A. See individual floor covering section(s) for additional requirements.
- B. Comply with requirements and recommendations of floor covering manufacturer.
- C. Fill and smooth surface cracks, grooves, depressions, control joints and other non-moving joints, and other irregularities with patching compound.
- D. Do not fill expansion joints, isolation joints, or other moving joints.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3.07 ADHESIVE BOND AND COMPATIBILITY TESTING

- A. Comply with requirements and recommendations of floor covering manufacturer.

3.08 PROTECTION

- A. Cover prepared floors with building paper or other durable covering.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 09 2116
GYPSUM BOARD ASSEMBLIES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Performance criteria for gypsum board assemblies.
- B. Metal stud wall framing.
- C. Metal channel ceiling framing.
- D. Gypsum sheathing.
- E. Gypsum wallboard.
- F. Joint treatment and accessories.

1.02 RELATED REQUIREMENTS

- A. Section 06 1000 - Rough Carpentry: Building framing and sheathing.
- B. Section 06 1000 - Rough Carpentry: Wood blocking product and execution requirements.
- C. Section 07 2100 - Thermal Insulation: Acoustic insulation.
- D. Section 07 8400 - Firestopping: Top-of-wall assemblies at fire-resistance-rated walls.
- E. Section 07 9200 - Joint Sealants: Sealing acoustical gaps in construction other than gypsum board or plaster work.
- F. Section 09 2216 - Non-Structural Metal Framing.

1.03 REFERENCE STANDARDS

- A. ANSI A108.11 - American National Standard Specifications for Interior Installation of Cementitious Backer Units; 2018.
- B. ASTM C423 - Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method; 2017.
- C. ASTM C475/C475M - Standard Specification for Joint Compound and Joint Tape for Finishing Gypsum Board; 2017.
- D. ASTM C557 - Standard Specification for Adhesives for Fastening Gypsum Wallboard to Wood Framing; 2003 (Reapproved 2017).
- E. ASTM C645 - Standard Specification for Nonstructural Steel Framing Members; 2018.
- F. ASTM C665 - Standard Specification for Mineral-Fiber Blanket Thermal Insulation for Light Frame Construction and Manufactured Housing; 2017.
- G. ASTM C754 - Standard Specification for Installation of Steel Framing Members to Receive Screw-Attached Gypsum Panel Products; 2020.
- H. ASTM C840 - Standard Specification for Application and Finishing of Gypsum Board; 2019b.
- I. ASTM C1002 - Standard Specification for Steel Self-Piercing Tapping Screws for Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs; 2018.
- J. ASTM C1047 - Standard Specification for Accessories For Gypsum Wallboard and Gypsum Veneer Base; 2019.
- K. ASTM C1178/C1178M - Standard Specification for Coated Glass Mat Water-Resistant Gypsum Backing Panel; 2018.
- L. ASTM C1396/C1396M - Standard Specification for Gypsum Board; 2017.
- M. ASTM D3273 - Standard Test Method for Resistance to Growth of Mold on the Surface of Interior Coatings in an Environmental Chamber; 2016.
- N. ASTM E413 - Classification for Rating Sound Insulation; 2016.
- O. ASTM E1264 - Standard Classification for Acoustical Ceiling Products; 2019.
- P. GA-216 - Application and Finishing of Gypsum Panel Products; 2016.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- Q. GA-600 - Fire Resistance Design Manual; 2015.
- R. ICC (IBC) - International Building Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- S. UL (FRD) - Fire Resistance Directory; Current Edition.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data on metal framing, gypsum board, accessories, and joint finishing system.
- C. Installer's Qualification Statement.

1.05 QUALITY ASSURANCE

- A. Installer Qualifications: Company specializing in performing gypsum board installation and finishing, with minimum 5 years of experience.

PART 2 PRODUCTS

2.01 GYPSUM BOARD ASSEMBLIES

- A. Provide completed assemblies complying with ASTM C840 and GA-216.
 - 1. See PART 3 for finishing requirements.

2.02 METAL FRAMING MATERIALS

- A. Non-structural Steel Framing for Application of Gypsum Board: As specified in Section 09 2216.

2.03 BOARD MATERIALS

- A. Manufacturers - Gypsum-Based Board:
 - 1. CertainTeed Corporation: www.certainteed.com/#sle.
 - 2. Georgia-Pacific Gypsum: www.gpgypsum.com/#sle.
 - 3. USG Corporation: www.usg.com/#sle.
 - 4. Substitutions: See Section 01 6000 - Product Requirements.
- B. Gypsum Wallboard: Paper-faced gypsum panels as defined in ASTM C1396/C1396M; sizes to minimize joints in place; ends square cut.
 - 1. Application: Use for vertical surfaces and ceilings, unless otherwise indicated.
 - 2. Mold Resistance: Score of 10, when tested in accordance with ASTM D3273.
 - a. Mold-resistant board is required whenever board is being installed before the building is enclosed and conditioned.
 - b. Mold resistant board is also required within toilet rooms and around all plumbing/water..
 - 3. At Assemblies Indicated with Fire-Resistance Rating: Use type required by indicated tested assembly; if no tested assembly is indicated, use Type X board, UL or WH listed.
 - 4. Thickness:
 - a. Vertical Surfaces: 5/8 inch (16 mm).
 - b. Ceilings: 5/8 inch (16 mm).
- C. Abuse Resistant Wallboard:
 - 1. Application: High-traffic areas indicated.
 - 2. Mold Resistance: Score of 10, when tested in accordance with ASTM D3273.
 - 3. Type: Fire-resistance-rated Type X, UL or WH listed.
 - 4. Thickness: 5/8 inch (16 mm).
 - 5. Edges: Tapered.
- D. Impact Resistant Wallboard:
 - 1. Application: High-traffic areas indicated.
 - 2. Mold Resistance: Score of 10, when tested in accordance with ASTM D3273.
 - 3. Type: Fire-resistance-rated Type X, UL or WH listed.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

4. Thickness: 5/8 inch (16 mm).
5. Edges: Tapered.
- E. Backing Board For Wet Areas: One of the following products:
 1. Application: Surfaces behind tile in wet areas including tub and shower surrounds, shower ceilings, and _____.
 2. Glass Mat Faced Board: Coated glass mat water-resistant gypsum backing panel as defined in ASTM C1178/C1178M.
 - a. Regular Type: Thickness 5/8 inch (29 mm).
 - b. Fire-Resistance-Rated Type: Type X core, thickness 5/8 inch (16 mm).
 - c. Products:
 - 1) Georgia-Pacific Gypsum; DensShield Tile Backer: www.gpgypsum.com/#sle.
 - 2) Substitutions: See Section 01 6000 - Product Requirements.

2.04 GYPSUM WALLBOARD ACCESSORIES

- A. Beads, Joint Accessories, and Other Trim: ASTM C1047, rigid plastic, galvanized steel, or rolled zinc, unless noted otherwise.
- B. Joint Materials: ASTM C475/C475M and as recommended by gypsum board manufacturer for project conditions.
 1. Fiberglass Tape: 2 inch (50 mm) wide, coated glass fiber tape for joints and corners, except as otherwise indicated.
 2. Paper Tape: 2 inch (50 mm) wide, creased paper tape for joints and corners, except as otherwise indicated.
 3. Joint Compound: Drying type, vinyl-based, ready-mixed.
 4. Joint Compound: Setting type, field-mixed.
- C. Finishing Compound: Surface coat and primer, takes the place of skim coating.
- D. High Build Drywall Surfer: Vinyl acrylic latex-based coating for spray application, designed to take the place of skim coating and separate paint primer in achieving Level 5 finish.
- E. Screws for Fastening of Gypsum Panel Products to Cold-Formed Steel Studs Less than 0.033 inches (0.84 mm) in Thickness and Wood Members: ASTM C1002; self-piercing tapping screws, corrosion-resistant.
- F. Adhesive for Attachment to Wood, ASTM C557 and Metal:

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that project conditions are appropriate for work of this section to commence.

3.02 FRAMING INSTALLATION

- A. Metal Framing: Install in accordance with ASTM C754 and manufacturer's instructions.
- B. Suspended Ceilings and Soffits: Space framing and furring members as indicated.
- C. Studs: Space studs at 16 inches on center (at 406 mm on center).
 1. Extend partition framing to structure where indicated and to ceiling in other locations.
 2. Partitions Terminating at Ceiling: Attach ceiling runner securely to ceiling track in accordance with manufacturer's instructions.
 3. Partitions Terminating at Structure: Attach top runner to structure, maintain clearance between top of studs and structure, and connect studs to track using specified mechanical devices in accordance with manufacturer's instructions; verify free movement of top of stud connections; do not leave studs unattached to track.
- D. Acoustic Furring: Install resilient channels at maximum 24 inches (600 mm) on center. Locate joints over framing members.
- E. Blocking: Install wood blocking for support of:
 1. Framed openings.
 2. Wall-mounted cabinets.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3. Plumbing fixtures.
4. Toilet partitions.
5. Toilet accessories.
6. Wall-mounted door hardware.

3.03 ACOUSTIC ACCESSORIES INSTALLATION

- A. Acoustic Insulation: Place tightly within spaces, around cut openings, behind and around electrical and mechanical items within partitions, and tight to items passing through partitions.
- B. Sound Isolation Tape: Apply to vertical studs and top and bottom tracks/runners in accordance with manufacturer's instructions.
- C. Acoustic Sealant: Install in accordance with manufacturer's instructions.
 1. Place one bead continuously on substrate before installation of perimeter framing members.
 2. Place continuous bead at perimeter of each layer of gypsum board.

3.04 BOARD INSTALLATION

- A. Comply with ASTM C840, GA-216, and manufacturer's instructions. Install to minimize butt end joints, especially in highly visible locations.
- B. Single-Layer Nonrated: Install gypsum board in most economical direction, with ends and edges occurring over firm bearing.
 1. Exception: Tapered edges to receive joint treatment at right angles to framing.
- C. Fire-Resistance-Rated Construction: Install gypsum board in strict compliance with requirements of assembly listing.
- D. Exposed Gypsum Board in Interior Wet Areas: Seal joints, cut edges, and holes with water-resistant sealant.
- E. Installation on Metal Framing: Use screws for attachment of gypsum board except face layer of nonrated double-layer assemblies, which may be installed by means of adhesive lamination.
- F. Installation on Wood Framing: For rated assemblies, comply with requirements of listing authority. For nonrated assemblies, install as follows:
 1. Single-Layer Applications: Adhesive application.

3.05 INSTALLATION OF TRIM AND ACCESSORIES

- A. Control Joints: Place control joints consistent with lines of building spaces and as indicated.
- B. Corner Beads: Install at external corners, using longest practical lengths.
- C. Edge Trim: Install at locations where gypsum board abuts dissimilar materials.

3.06 JOINT TREATMENT

- A. Paper Faced Gypsum Board: Use paper joint tape, embed with drying type joint compound and finish with drying type joint compound.
- B. Finish gypsum board in accordance with levels defined in ASTM C840, as follows:
 1. Level 5: Walls and ceilings to receive semi-gloss or gloss paint finish and other areas specifically indicated.
 2. Level 4: Walls and ceilings to receive paint finish or wall coverings, unless otherwise indicated.
 3. Level 3: Walls to receive textured wall finish.
 4. Level 2: In utility areas, behind cabinetry, and on backing board to receive tile finish.
 5. Level 1: Fire-resistance-rated wall areas above finished ceilings, whether or not accessible in the completed construction.
- C. Tape, fill, and sand exposed joints, edges, and corners to produce smooth surface ready to receive finishes.
 1. Feather coats of joint compound so that camber is maximum 1/32 inch (0.8 mm).
 2. Taping, filling, and sanding are not required at surfaces behind adhesive applied ceramic tile and fixed cabinetry.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- 3. Taping, filling, and sanding are not required at base layer of double-layer applications.
- D. Where Level 5 finish is indicated, spray apply high build drywall surfacer over entire surface after joints have been properly treated; achieve a flat and tool mark-free finish.
- E. Fill and finish joints and corners of cementitious backing board as recommended by manufacturer.

3.07 TOLERANCES

- A. Maximum Variation of Finished Gypsum Board Surface from True Flatness: 1/8 inch in 10 feet (3 mm in 3 m) in any direction.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 09 2216

NON-STRUCTURAL METAL FRAMING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Resilient Channels, provide
- B. Metal partition, ceiling, and soffit framing.
- C. Framing accessories.

1.02 RELATED REQUIREMENTS

- A. Section 06 1000 - Rough Carpentry: Wood blocking within stud framing.
- B. Section 06 1000 - Rough Carpentry: Wall sheathing.
- C. Section 07 9200 - Joint Sealants: Sealing acoustical gaps in construction other than gypsum board or plaster work.
- D. Section 09 2116 - Gypsum Board Assemblies: Metal studs for gypsum board partition framing.
- E. Section 09 2116 - Gypsum Board Assemblies: Execution requirements for anchors for attaching work of this section.

1.03 REFERENCE STANDARDS

- A. ASTM C645 - Standard Specification for Nonstructural Steel Framing Members; 2018.
- B. ASTM C754 - Standard Specification for Installation of Steel Framing Members to Receive Screw-Attached Gypsum Panel Products; 2020.
- C. ASTM C1002 - Standard Specification for Steel Self-Piercing Tapping Screws for Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs; 2018.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Shop Drawings:
 - 1. Indicate prefabricated work, component details, stud layout, framed openings, anchorage to structure, acoustic details, type and location of fasteners, accessories, and items of other related work.
 - 2. Describe method for securing studs to tracks, splicing, and for blocking and reinforcement of framing connections.
- C. Product Data: Provide data describing framing member materials and finish, product criteria, load charts, and limitations.
- D. Product Data: Provide manufacturer's data on partition head to structure connectors, showing compliance with requirements.

1.05 QUALITY ASSURANCE

- A. Installer Qualifications: Company specializing in performing the work of this section with minimum five years documented experience and approved by manufacturer.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Metal Framing, Connectors, and Accessories:
 - 1. CEMCO: www.cemcosteel.com/#sle.
 - 2. ClarkDietrich: www.clarkdietrich.com/#sle.
 - 3. SCAFCO Corporation: www.scafco.com/#sle.
 - 4. Substitutions: See Section 01 6000 - Product Requirements.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2.02 FRAMING MATERIALS

- A. Non-Loadbearing Framing System Components: ASTM C645; galvanized sheet steel, of size and properties necessary to comply with ASTM C754 for the spacing indicated, with maximum deflection of wall framing of $L/240$ at 5 psf ($L/240$ at 240 Pa).

2.03 FABRICATION

- A. Fabricate assemblies of framed sections to sizes and profiles required.
- B. Fit, reinforce, and brace framing members to suit design requirements.

PART 3 EXECUTION

3.01 INSTALLATION OF STUD FRAMING

- A. Extend partition framing to structure where indicated and to ceiling in other locations.
- B. Partitions Terminating at Ceiling: Attach ceiling runner securely to ceiling track in accordance with manufacturer's instructions.
- C. Align and secure top and bottom runners at 24 inches (600 mm) on center.
- D. Fit runners under and above openings; secure intermediate studs to same spacing as wall studs.
- E. Align stud web openings horizontally.
- F. Secure studs to tracks using crimping method. Do not weld.
- G. Fabricate corners using a minimum of three studs.
- H. Install double studs at wall openings, door and window jambs, not more than 2 inches (50 mm) from each side of openings.
- I. Coordinate installation of bucks, anchors, and blocking with electrical, mechanical, and other work to be placed within or behind stud framing.

3.02 CEILING AND SOFFIT FRAMING

- A. Comply with requirements of ASTM C754.
- B. Install furring after work above ceiling or soffit is complete. Coordinate the location of hangers with other work.
- C. Install furring independent of walls, columns, and above-ceiling work.
- D. Securely anchor hangers to structural members or embed them in structural slab. Space hangers as required to limit deflection to criteria indicated. Use rigid hangers at exterior soffits.
- E. Space main carrying channels at maximum 72 inch (1 800 mm) on center, and not more than 6 inches (150 mm) from wall surfaces. Lap splice securely.
- F. Securely fix carrying channels to hangers to prevent turning or twisting and to transmit full load to hangers.
- G. Place furring channels perpendicular to carrying channels, not more than 2 inches (50 mm) from perimeter walls, and rigidly secure. Lap splices securely.

3.03 TOLERANCES

- A. Maximum Variation From True Position: 1/8 inch in 10 feet (3 mm in 3 m).
- B. Maximum Variation From Plumb: 1/8 inch in 10 feet (3 mm in 3 m).

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 09 5100
ACOUSTICAL CEILINGS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Suspended metal grid ceiling system.
- B. Suspended plastic grid ceiling system.
- C. Acoustical units.

1.02 RELATED REQUIREMENTS

- A. Section 03 3000 - Cast-in-Place Concrete: Placement of special anchors or inserts for suspension system.
- B. Section 05 3100 - Steel Decking: Placement of special anchors or inserts for suspension system.
- C. Section 07 2100 - Thermal Insulation: Acoustical insulation.
- D. Section 26 5100 - Interior Lighting: Light fixtures in ceiling system.

1.03 REFERENCE STANDARDS

- A. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2020.
- B. ASTM C635/C635M - Standard Specification for the Manufacture, Performance, and Testing of Metal Suspension Systems for Acoustical Tile and Lay-in Panel Ceilings; 2017.
- C. ASTM E1264 - Standard Classification for Acoustical Ceiling Products; 2019.
- D. UL (FRD) - Fire Resistance Directory; Current Edition.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Sequence work to ensure acoustical ceilings are not installed until building is enclosed, sufficient heat is provided, dust generating activities have terminated, and overhead work is completed, tested, and approved.
- B. Do not install acoustical units until after interior wet work is dry.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Acoustic Tiles/Panels:
 - 1. Crane Composites: www.cranecomposites.com
 - 2. USG Corporation: www.usg.com/ceilings/#sle.
 - 3. Substitutions: See Section 01 6000 - Product Requirements.
- B. Suspension Systems:
 - 1. Crane Composites: www.cranecomposites.com
 - 2. USG Corporation: www.usg.com/ceilings/#sle.
 - 3. Substitutions: See Section 01 6000 - Product Requirements.

2.02 PERFORMANCE REQUIREMENTS

2.03 ACOUSTICAL UNITS

- A. Acoustical Panels: Laminated Moisture Resistant Gypsum sheathing with scrubbable finish, with the following characteristics:
 - 1. Classification: ASTM E1264 Type IX.
 - 2. Size: 24 by 48 inch (610 by 1219 mm).
 - 3. Thickness: 3/4 inch (19 mm).
 - 4. Smooth Finish: Front, Edges, & Back of panels
 - 5. Panels meet USDA/FSIS requirements for food processing areas.
 - 6. Panel Edge: Square.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

7. Suspension System: Exposed grid. Washable, meeting Health Department requirements for commercial kitchens

2.04 SUSPENSION SYSTEM(S)

- A. Fiberglass Reinforced Ceiling System - General:
1. Materials:
 - a. Fiberglass;
 2. Exposed Suspension System: high strength pultruded FRP ceiling grid system designed specifically to provide solutions for environments prone to moisture and corrosion.
 - a. Structural Classification: Intermediate-duty, when tested in accordance with ASTM C635/C635M.
 - b. Meets Class A finish requirements: Flame spread of less than 25, smoke developed less than 450 per ASTM E-84 latest version.
 - c. Meets USDA/FSIS requirements.
 - d. Profile: Tee; 1.5 inch (38.1 mm) face width.
 - e. Color: Color selected by Owner through submittal process.
 - f. Products:
 - 1) Crane Composites; Sani Grid Ceiling Grid Ssystem: www.cranecomposites.com
 - 2) Substitutions: See Section 01 6000 - Product Requirements.
- B. Metal Suspension Systems - General: Complying with ASTM C635/C635M; die cut and interlocking components, with perimeter moldings, hold down clips, stabilizer bars, clips, and splices as required.
1. Materials:
 - a. Steel Grid: ASTM A653/A653M, G30 coating, unless otherwise indicated.
 1. Exposed Suspension System: Hot-dipped galvanized steel grid with aluminum cap.
 - a. Structural Classification: Intermediate-duty, when tested in accordance with ASTM C635/C635M.
 - b. Meets Class A finish requirements: Flame spread of less than 25, smoke developed less than 450 per ASTM E-84 latest version.
 - c. Meets USDA/FSIS requirements.
 - d. Profile: Tee; 15/16 inch (24 mm) face width.
 - e. Finish: Baked enamel.
 - f. Color: Color selected by Owner through submittal process.
 - g. Products:
 - 1) USG Corporation; USG Donn Brand CE 15/16 inch Acoustical Suspension System: : www.usg.com/ceilings/#sle.
 - 2) Substitutions: See Section 01 6000 - Product Requirements.

2.05 ACCESSORIES

- A. Support Channels and Hangers: Galvanized steel; size and type to suit application, seismic requirements, and ceiling system flatness requirement specified.
- B. Hanger Wire: 12 gauge, 0.08 inch (2 mm) galvanized steel wire.
- C. Hold-Down Clips: Manufacturer's standard clips to suit application.
- D. Perimeter Moldings: Same metal and finish as grid.
 1. Angle Molding: L-shaped, for mounting at same elevation as face of grid.
- E. Gypsum Board: Fire rated type; 5/8 inch (16 mm) thick, ends and edges square, paper faced.
- F. Touch-up Paint: Type and color to match acoustical and grid units.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify that layout of hangers will not interfere with other work.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3.02 PREPARATION

- A. Install after major above-ceiling work is complete.
- B. Coordinate the location of hangers with other work.

3.03 INSTALLATION - SUSPENSION SYSTEM

- A. Rigidly secure system, including integral mechanical and electrical components, for maximum deflection of 1:360.
- B. Perimeter Molding: Install at intersection of ceiling and vertical surfaces and at junctions with other interruptions.
 - 1. Use longest practical lengths.
- C. Suspension System, Non-Seismic: Hang suspension system independent of walls, columns, ducts, pipes and conduit. Where carrying members are spliced, avoid visible displacement of face plane of adjacent members.
- D. Where ducts or other equipment prevent the regular spacing of hangers, reinforce the nearest affected hangers and related carrying channels to span the extra distance.
- E. Do not support components on main runners or cross runners if weight causes total dead load to exceed deflection capability.
- F. Support fixture loads using supplementary hangers located within 6 inches (152 mm) of each corner, or support components independently.
- G. Do not eccentrically load system or induce rotation of runners.

3.04 INSTALLATION - ACOUSTICAL UNITS

- A. Install acoustical units in accordance with manufacturer's instructions.
- B. Fit acoustical units in place, free from damaged edges or other defects detrimental to appearance and function.
- C. Fit border trim neatly against abutting surfaces.
- D. Install acoustical units level, in uniform plane, and free from twist, warp, and dents.
- E. Cutting Acoustical Units:
 - 1. Cut to fit irregular grid and perimeter edge trim.
 - 2. Make field cut edges of same profile as factory edges.
 - 3. Double cut and field paint exposed reveal edges.

3.05 TOLERANCES

- A. Maximum Variation from Flat and Level Surface: 1/8 inch in 10 feet (3 mm in 3 m).
- B. Maximum Variation from Plumb of Grid Members Caused by Eccentric Loads: 2 degrees.

3.06 SCHEDULE

- A. See reflected ceiling plan for usage.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 09 6700
FLUID-APPLIED FLOORING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fluid-applied flooring and base.

1.02 RELATED REQUIREMENTS

- A. Section 01 6116 - Volatile Organic Compound (VOC) Content Restrictions.
- B. Section 09 0561 - Common Work Results for Flooring Preparation: Removal of existing floor coverings, cleaning, and preparation.
- C. Section 09 0561 - Common Work Results for Flooring Preparation: Concrete slab moisture and alkalinity testing and remediation procedures.
- D. Section 22 1006 - Plumbing Piping Specialties: Recessed plumbing access cover frames.

1.03 REFERENCE STANDARDS

- A. ICRI 310.2R - Selecting and Specifying Concrete Surface Preparation for Sealers, Coatings, Polymer Overlays, and Concrete Repair; 2013.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section with minimum three years documented experience.
- B. Applicator Qualifications: Company specializing in performing the work of this section.
 - 1. Minimum 5 years of documented experience.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Store resin materials in a dry, secure area.
- B. Store materials for three days prior to installation in area of installation to achieve temperature stability.

1.06 FIELD CONDITIONS

- A. Maintain minimum temperature in storage area of 55 degrees F (13 degrees C).
- B. Store materials in area of installation for minimum period of 24 hours prior to installation.
- C. Maintain ambient temperature required by manufacturer 72 hours prior to, during, and 24 hours after installation of materials.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Fluid-Applied Flooring:
 - 1. SPARTACOTE, a division of LATICRETE International, Inc; spartacote: www.laticrete.com/#sle.
 - 2. Sherwin-Williams Company; Armorseal: www.protective.sherwin-williams.com/#sle.
 - 3. Sika Corporation: www.sikafloorusa.com/#sle.
 - 4. Substitutions: See Section 01 6000 - Product Requirements.

2.02 FLUID-APPLIED FLOORING SYSTEMS

- A. Fluid-Applied Flooring: Epoxy base coat(s), polyurethane top coat, no aggregate.
 - 1. System Thickness: 40 mils (1 mm), nominal, dry film thickness (DFT).
 - 2. Metallic Pigment: Mica powder.
 - 3. Texture: Smooth.
 - 4. Sheen: High gloss.
 - 5. Color: As selected by Owner through submittal process.
 - 6. Products:

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- a. PPG Flooring; Concrete Epoxy Primer Clear FLR900-0, Low Gloss, with Self-Leveling Epoxy FLR600 Series, High Gloss, and Wear Resistant Urethane FLR400-0, Satin: www.ppgpaints.com/#sle and www.ppgpmc.com/home.aspx/#sle.
 - b. Sherwin-Williams Company; Armorseal 100% Solids Epoxy/Polyurethane: www.protective.sherwin-williams.com/#sle.
 - c. Substitutions: See Section 01 6000 - Product Requirements.
- B. Fluid-Applied Flooring: Epoxy, with aggregate.
- 1. Aggregate: Silica sand.
 - 2. System Thickness: 15 mils (0.38 mm), nominal, dry film thickness (DFT).
 - 3. Texture: Smooth.
 - 4. Sheen: High gloss.
 - 5. Slip resistant for high traffic area of kitchen floor.
 - 6. Products:
 - a. PPG Flooring; Concrete Epoxy Primer Clear FLR900-0, Low Gloss, with Self-Leveling Epoxy FLR600 Series, High Gloss, and Epoxy Siloxane FLR450-0 Series, Satin: www.ppgpaints.com/#sle and www.ppgpmc.com/home.aspx/#sle.
 - b. Sherwin-Williams Company; Armorseal 100% Solids Epoxy: www.protective.sherwin-williams.com/#sle.
 - c. SPARTACOTE, a division of LATICRETE International, Inc; SPARTACOTE General Primer and SL Topping: www.laticrete.com/#sle.
 - d. Substitutions: See Section 01 6000 - Product Requirements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that subfloor surfaces are smooth and flat within the tolerances specified for that type of work and are ready to receive flooring.
- B. Verify that wall surfaces are smooth and flat within the tolerances specified for that type of work, are dust-free, and are ready to receive flooring.
- C. Verify that subfloor surfaces are dust-free and free of substances that could impair bonding of materials to subfloor surfaces.
- D. Cementitious Subfloor Surfaces: Verify that substrates are ready for fluid-applied flooring installation by testing for moisture and alkalinity (pH).
 - 1. Obtain instructions if test results are not within limits recommended by fluid-applied flooring manufacturer.
 - 2. Follow moisture and alkalinity remediation procedures in Section 09 0561.
- E. Verify that required floor-mounted utilities are in correct location.

3.02 PREPARATION

- A. Remove subfloor ridges and bumps. Fill low spots, cracks, joints, holes, and other defects with subfloor filler.
- B. Prepare concrete surfaces according to ICRI 310.2R.
- C. Apply, trowel, and float filler to achieve smooth, flat, hard surface. Grind irregularities above the surface level. Prohibit traffic until filler is cured.
- D. Vacuum clean substrate.
- E. Apply primer to surfaces required by flooring manufacturer.

3.03 INSTALLATION - ACCESSORIES

- A. Install cant strips at base of walls where flooring is to be extended up wall as base.

3.04 INSTALLATION - FLOORING

- A. Apply in accordance with manufacturer's instructions.
- B. Apply each coat to minimum thickness required by manufacturer.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- C. Finish to smooth level surface.

3.05 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.

3.06 PROTECTION

- A. Prohibit traffic on floor finish for 48 hours after installation.
- B. Barricade area to protect flooring until fully cured.

3.07 SCHEDULE

- A. Kitchen: Type A
 - 1. Color selected by owner through submittal process.
- B. Kitchen Circulation paths: Type A with aggregate.
 - 1. Color to match Type A.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 09 9123
INTERIOR PAINTING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Surface preparation.
- B. Field application of paints.
- C. Scope: Finish interior surfaces exposed to view, unless fully factory-finished and unless otherwise indicated.
 - 1. Surfaces inside cabinets.
 - 2. Prime surfaces to receive wall coverings.
 - 3. Mechanical and Electrical:
 - a. In finished areas, paint insulated and exposed pipes, conduit, boxes, insulated and exposed ducts, hangers, brackets, collars and supports, mechanical equipment, and electrical equipment, unless otherwise indicated.
 - b. In finished areas, paint shop-primed items.
 - c. Paint interior surfaces of air ducts and convactor and baseboard heating cabinets that are visible through grilles and louvers with one coat of flat black paint to visible surfaces.
 - d. Paint dampers exposed behind louvers, grilles, and convactor and baseboard cabinets to match face panels.
- D. Do Not Paint or Finish the Following Items:
 - 1. Items factory-finished unless otherwise indicated; materials and products having factory-applied primers are not considered factory finished.
 - 2. Items indicated to receive other finishes.
 - 3. Items indicated to remain unfinished.
 - 4. Fire rating labels, equipment serial number and capacity labels, bar code labels, and operating parts of equipment.
 - 5. Floors, unless specifically indicated.
 - 6. Brick, architectural concrete, cast stone, integrally colored plaster and stucco.
 - 7. Glass.
 - 8. Concealed pipes, ducts, and conduits.

1.02 RELATED REQUIREMENTS

- A. Section 06 8316 - Fiberglass Reinforced Paneling
- B. Section 22 0553 - Identification for Plumbing Piping and Equipment: Painted identification.
- C. Section 26 0553 - Identification for Electrical Systems: Painted identification.

1.03 DEFINITIONS

- A. Comply with ASTM D16 for interpretation of terms used in this section.

1.04 REFERENCE STANDARDS

- A. ASTM D16 - Standard Terminology for Paint, Related Coatings, Materials, and Applications; 2016.
- B. ASTM D4258 - Standard Practice for Surface Cleaning Concrete for Coating; 2005 (Reapproved 2017).
- C. CARB (SCM) - Suggested Control Measure for Architectural Coatings; California Air Resources Board; 2007.
- D. MPI (APL) - Master Painters Institute Approved Products List; Master Painters and Decorators Association; Current Edition.
- E. MPI (APSM) - Master Painters Institute Architectural Painting Specification Manual; Current Edition.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- F. SCAQMD 1113 - Architectural Coatings; 1977 (Amended 2016).
- G. SSPC V1 (PM1) - Good Painting Practice: Painting Manual, Volume 1; 2016.
- H. SSPC-SP 1 - Solvent Cleaning; 2015, with Editorial Revision (2016).
- I. SSPC-SP 6 - Commercial Blast Cleaning; 2007.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide complete list of products to be used, with the following information for each:
 - 1. Manufacturer's name, product name and/or catalog number, and general product category (e.g. "alkyd enamel").
 - 2. MPI product number (e.g. MPI #47).
 - 3. Cross-reference to specified paint system(s) product is to be used in; include description of each system.

1.06 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified, with minimum three years documented experience.
- B. Applicator Qualifications: Company specializing in performing the type of work specified with minimum three years experience and approved by manufacturer.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Deliver products to site in sealed and labeled containers; inspect to verify acceptability.
- B. Container Label: Include manufacturer's name, type of paint, brand name, lot number, brand code, coverage, surface preparation, drying time, cleanup requirements, color designation, and instructions for mixing and reducing.
- C. Paint Materials: Store at minimum ambient temperature of 45 degrees F (7 degrees C) and a maximum of 90 degrees F (32 degrees C), in ventilated area, and as required by manufacturer's instructions.

1.08 FIELD CONDITIONS

- A. Do not apply materials when surface and ambient temperatures are outside the temperature ranges required by the paint product manufacturer.
- B. Follow manufacturer's recommended procedures for producing best results, including testing of substrates, moisture in substrates, and humidity and temperature limitations.
- C. Provide lighting level of 80 ft candles (860 lx) measured mid-height at substrate surface.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Provide paints and finishes used in any individual system from the same manufacturer; no exceptions.
- B. Primer Sealers: Same manufacturer as top coats.
 - 1. Behr Process Corporation: www.behr.com/#sle.
 - 2. PPG Paints: www.ppgpaints.com/#sle.
 - 3. Sherwin-Williams Company: www.sherwin-williams.com/#sle.
- C. Substitutions: See Section 01 6000 - Product Requirements.

2.02 PAINTS AND FINISHES - GENERAL

- A. Paints and Finishes: Ready mixed, unless intended to be a field-catalyzed paint.
 - 1. Provide paints and finishes of a soft paste consistency, capable of being readily and uniformly dispersed to a homogeneous coating, with good flow and brushing properties, and capable of drying or curing free of streaks or sags.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2. Supply each paint material in quantity required to complete entire project's work from a single production run.
 3. Do not reduce, thin, or dilute paint or finishes or add materials unless such procedure is specifically described in manufacturer's product instructions.
- B. Flammability: Comply with applicable code for surface burning characteristics.
- C. Sheens: Provide the sheens specified; where sheen is not specified, sheen will be selected later by Architect from the manufacturer's full line.
- D. Colors: To be selected from manufacturer's full range of available colors.
1. Selection to be made by Architect after award of contract.
 2. In finished areas, finish pipes, ducts, conduit, and equipment the same color as the wall/ceiling they are mounted on/under.

2.03 PAINT SYSTEMS - INTERIOR

- A. Interior Surfaces to be Primed Unless Otherwise Indicated: Including gypsum board, uncoated steel, shop primed steel, and galvanized steel.
1. Two coats primer under F.R.P.
 2. Primer: As recommended by top coat manufacturer for specific substrate.

2.04 PRIMERS

- A. Primers: Provide the following unless other primer is required or recommended by manufacturer of top coats.
1. Interior Latex Primer Sealer; MPI #50.
 - a. Products:
 - 1) Behr Premium Plus Interior Drywall Primer and Sealer [No. 73]. (MPI #50)
 - 2) PPG Paints Speedhide Zero Interior Latex Sealer, 6-4900XI. (MPI #50)
 - 3) Substitutions: Section 01 6000 - Product Requirements.

2.05 ACCESSORY MATERIALS

- A. Accessory Materials: Provide primers, sealers, cleaning agents, cleaning cloths, sanding materials, and clean-up materials as required for final completion of painted surfaces.
- B. Patching Material: Latex filler.
- C. Fastener Head Cover Material: Latex filler.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that surfaces are ready to receive work as instructed by the product manufacturer.
- B. Examine surfaces scheduled to be finished prior to commencement of work. Report any condition that may potentially effect proper application.
- C. Test shop-applied primer for compatibility with subsequent cover materials.
- D. Measure moisture content of surfaces using an electronic moisture meter. Do not apply finishes unless moisture content of surfaces are below the following maximums:
1. Gypsum Wallboard: 12 percent.

3.02 PREPARATION

- A. Clean surfaces thoroughly and correct defects prior to application.
- B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.
- C. Remove or mask surface appurtenances, including electrical plates, hardware, light fixture trim, escutcheons, and fittings, prior to preparing surfaces or finishing.
- D. Seal surfaces that might cause bleed through or staining of topcoat.
- E. Masonry:
- F. Gypsum Board: Fill minor defects with filler compound. Spot prime defects after repair.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

G. Galvanized Surfaces:

H. Ferrous Metal:

1. Solvent clean according to SSPC-SP 1.
2. Shop-Primed Surfaces: Sand and scrape to remove loose primer and rust. Feather edges to make touch-up patches inconspicuous. Clean surfaces with solvent. Prime bare steel surfaces. Re-prime entire shop-primed item.
3. Remove rust, loose mill scale, and other foreign substances using methods recommended in writing by paint manufacturer and blast cleaning according to SSPC-SP 6 "Commercial Blast Cleaning". Protect from corrosion until coated.

3.03 APPLICATION

- A. Remove unfinished louvers, grilles, covers, and access panels on mechanical and electrical components and paint separately.
- B. Apply products in accordance with manufacturer's written instructions and recommendations in "MPI Architectural Painting Specification Manual".
- C. Do not apply finishes to surfaces that are not dry. Allow applied coats to dry before next coat is applied.
- D. Apply each coat to uniform appearance in thicknesses specified by manufacturer.
- E. Vacuum clean surfaces of loose particles. Use tack cloth to remove dust and particles just prior to applying next coat.
- F. Reinstall electrical cover plates, hardware, light fixture trim, escutcheons, and fittings removed prior to finishing.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for general requirements for field inspection.

3.05 CLEANING

- A. Collect waste material that could constitute a fire hazard, place in closed metal containers, and remove daily from site.

3.06 PROTECTION

3.07 COLOR SCHEDULE

- A. See Architectural Room Finish Schedule.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 11 4000
FOODSERVICE EQUIPMENT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Foodservice equipment.
- B. Connections to utilities.

1.02 RELATED REQUIREMENTS

- A. Section 23 3813 - Commercial-Kitchen Hoods: Range and dishwasher hoods for commercial kitchens.

1.03 REFERENCE STANDARDS

- A. FM (AG) - FM Approval Guide; current edition.
- B. ITS (DIR) - Directory of Listed Products; current edition.
- C. NEMA MG 1 - Motors and Generators; 2018.
- D. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- E. NFPA 96 - Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations; 2017.
- F. NSF 2 - Food Equipment; 2019.
- G. SMACNA (KVS) - Kitchen Ventilation Systems and Food Service Equipment Fabrication and Installation Guidelines; 2001.
- H. UL (DIR) - Online Certifications Directory; Current Edition.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Preinstallation Meeting: Convene one week before starting work of this section.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data on appliances; indicate configuration, sizes, materials, finishes, locations, and utility service connection locations, service characteristics, and wiring diagrams.
- C. Warranty: Submit manufacturer warranty and ensure forms have been completed in Owner's name and registered with manufacturer.

1.06 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacture of standard products of the type specified.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. All kitchen equipment shall be purchased by owner. It shall be the responsibility of the general contractor to receive, store and move into position all equipment.
- B. Equipment hook-up and testing shall be by third party contractor hired by owner.
- C. General contractor to coordinate final move with owner and third party equipment installer.
- D. Store products clear of floor in a manner to prevent damage.
- E. Coordinate size of access and route to place of installation.

1.08 WARRANTY

- A. See Section 01 7800 - Closeout Submittals, for additional warranty requirements.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Foodservice Equipment:

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1. Refer to schedule at end of this section.

2.02 REGULATORY REQUIREMENTS

- A. Comply with applicable codes for utility requirements.
- B. Products Requiring Electrical Connection: Listed and classified by FM (AG), ITS (DIR), UL (DIR), or testing agency acceptable to local authorities having jurisdiction as suitable for the purpose specified and indicated.

2.03 EQUIPMENT

- A. Equipment Schedule:
 1. Refer to schedule at end of this section.
- B. Installation Accessories: Provide rough-in hardware, supports and connections, attachment devices, closure trim, and accessories as required for complete installation.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify ventilation outlets, service connections, and supports are correct and in required location.
- B. Verify that electric power is available and of the correct characteristics.

3.02 INSTALLATION

- A. General contractor to move equipment into position, Installation, utility hook-up, start-up, and testing shall be by third party equipment installer. Third Party equipment installer hired by owner under separate contract
- B. Install items in accordance with manufacturers' instructions.
- C. Insulate to prevent electrolysis between dissimilar metals.

3.03 EXISTING EQUIPMENT

- A. Obtain, move, store, and re-install equipment, ready for utility connection.
- B. Do work in cooperation with Owner so that normal function of services is minimally interrupted.
- C. Clean and re-furbish existing equipment to be re-used to original condition.
- D. Where required, remove existing equipment from site for repairs or alterations; handle carefully and return in "like new" condition.
- E. Re-used Equipment: Refer to schedule on drawings for re-used equipment.

3.04 ADJUSTING

- A. Adjust equipment and apparatus to ensure proper working order and conditions.
- B. Remove and replace equipment creating excessive noise or vibration.

3.05 CLEANING

- A. Remove masking or protective covering from stainless steel and other finished surfaces.
- B. Wash and clean equipment.
- C. Polish glass, plastic, hardware, accessories, fixtures, and fittings.

3.06 CLOSEOUT ACTIVITIES

- A. At completion of work, provide qualified and trained personnel to demonstrate operation of each item of equipment and instruct Owner in operating procedures and maintenance.
 1. Test equipment prior to demonstration.

3.07 PROTECTION

- A. Remove protective coverings from prefinished work.
- B. Protect finished work from damage.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3.08 FOODSERVICE EQUIPMENT SCHEDULE

- A. See Following specification sheets as well as schedules within drawings.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 22 0529

HANGERS AND SUPPORTS FOR PLUMBING PIPING AND EQUIPMENT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Support and attachment components for equipment, piping, and other plumbing work.

1.02 RELATED REQUIREMENTS

- A. Section 03 3000 - Cast-in-Place Concrete: Concrete equipment pads.

1.03 REFERENCE STANDARDS

- A. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products; 2017.
- B. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware; 2016a.
- C. ASTM A36/A36M - Standard Specification for Carbon Structural Steel; 2014.
- D. ASTM A47/A47M - Standard Specification for Ferritic Malleable Iron Castings; 1999, with Editorial Revision (2018).
- E. ASTM B633 - Standard Specification for Electrodeposited Coatings of Zinc on Iron and Steel; 2019.
- F. MFMA-4 - Metal Framing Standards Publication; 2004.
- G. MSS SP-58 - Pipe Hangers and Supports - Materials, Design, Manufacture, Selection, Application, and Installation; 2018.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate sizes and arrangement of supports and bases with the actual equipment and components to be installed.
 - 2. Coordinate the work with other trades to provide additional framing and materials required for installation.
 - 3. Coordinate compatibility of support and attachment components with mounting surfaces at the installed locations.
 - 4. Coordinate the arrangement of supports with ductwork, piping, equipment and other potential conflicts installed under other sections or by others.
 - 5. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.
- B. Sequencing:
 - 1. Do not install products on or provide attachment to concrete surfaces until concrete has fully cured in accordance with Section 03 3000.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for metal channel (strut) framing systems, nonpenetrating rooftop supports, post-installed concrete and masonry anchors, and thermal insulated pipe supports.
- C. Shop Drawings: Include details for fabricated hangers and supports where materials or methods other than those indicated are proposed for substitution.

1.06 QUALITY ASSURANCE

- A. Comply with applicable building code.
- B. Installer Qualifications for Powder-Actuated Fasteners (when specified): Certified by fastener system manufacturer with current operator's license.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- C. Product Listing Organization Qualifications: An organization recognized by OSHA as a Nationally Recognized Testing Laboratory (NRTL) and acceptable to authorities having jurisdiction.

PART 2 PRODUCTS

2.01 SUPPORT AND ATTACHMENT COMPONENTS

- A. General Requirements:
1. Provide all required hangers, supports, anchors, fasteners, fittings, accessories, and hardware as necessary for the complete installation of plumbing work.
 2. Provide products listed, classified, and labeled as suitable for the purpose intended, where applicable.
 3. Where support and attachment component types and sizes are not indicated, select in accordance with manufacturer's application criteria as required for the load to be supported. Include consideration for vibration, equipment operation, and shock loads where applicable.
 4. Steel Components: Use corrosion resistant materials suitable for the environment where installed.
 - a. Zinc-Plated Steel: Electroplated in accordance with ASTM B633.
 - b. Galvanized Steel: Hot-dip galvanized after fabrication in accordance with ASTM A123/A123M or ASTM A153/A153M.
- B. Metal Channel (Strut) Framing Systems:
1. Comply with MFMA-4.
- C. Hanger Rods: Threaded zinc-plated steel unless otherwise indicated.
- D. Pipe Supports:
1. Liquid Temperatures Up To 122 degrees F (50 degrees C):
 - a. Overhead Support: MSS SP-58 Types 1, 3 through 12.
 - b. Support From Below: MSS SP-58 Types 35 through 38.
- E. Pipe Stanchions: For pipe runs, use stanchions of same type and material where vertical adjustment is required for stationary pipe.
1. Material: Malleable iron, ASTM A47/A47M; or carbon steel, ASTM A36/A36M.
 2. Provide coated or plated saddles to isolate steel hangers from dissimilar metal tube or pipe.
- F. Riser Clamps:
1. Provide copper plated clamps for copper tubing support.
 2. For insulated pipe runs, provide two bolt-type clamps designed for installation under insulation.
- G. Insulation Clamps: Two bolt-type clamps designed for installation under insulation.
- H. Pipe Hangers: For a given pipe run, use hangers of the same type and material.
1. Material: Malleable iron, ASTM A47/A47M; or carbon steel, ASTM A36/A36M.
 2. Provide coated or plated hangers to isolate steel hangers from dissimilar metal tube or pipe.
- I. Anchors and Fasteners:
1. Unless otherwise indicated and where not otherwise restricted, use the anchor and fastener types indicated for the specified applications.
- J. Pipe Installation Accessories:
1. Copper Pipe Supports:
 2. PEX Pipe Supports:
 3. Thermal Insulated Pipe Supports:
 4. Overhead Pipe Supports:
 5. Inserts and Clamps:

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that mounting surfaces are ready to receive support and attachment components.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Provide independent support from building structure. Do not provide support from piping, ductwork, conduit, or other systems.
- C. Unless specifically indicated or approved by Architect, do not provide support from suspended ceiling support system or ceiling grid.
- D. Unless specifically indicated or approved by Architect, do not provide support from roof deck.
- E. Do not penetrate or otherwise notch or cut structural members without approval of Structural Engineer.
- F. Equipment Support and Attachment:
 - 1. Use metal fabricated supports or supports assembled from metal channel (strut) to support equipment as required.
 - 2. Use metal channel (strut) secured to studs to support equipment surface-mounted on hollow stud walls when wall strength is not sufficient to resist pull-out.
 - 3. Use metal channel (strut) to support surface-mounted equipment in wet or damp locations to provide space between equipment and mounting surface.
 - 4. Securely fasten floor-mounted equipment. Do not install equipment such that it relies on its own weight for support.
- G. Secure fasteners according to manufacturer's recommended torque settings.
- H. Remove temporary supports.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.
- B. Inspect support and attachment components for damage and defects.
- C. Repair cuts and abrasions in galvanized finishes using zinc-rich paint recommended by manufacturer. Replace components that exhibit signs of corrosion.
- D. Correct deficiencies and replace damaged or defective support and attachment components.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 22 0553

IDENTIFICATION FOR PLUMBING PIPING AND EQUIPMENT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Nameplates.
- B. Tags.
- C. Pipe markers.
- D. Ceiling tacks.

1.02 RELATED REQUIREMENTS

- A. Section 09 9123 - Interior Painting: Identification painting.

1.03 REFERENCE STANDARDS

- A. ASME A13.1 - Scheme for the Identification of Piping Systems; 2015.
- B. ASTM D709 - Standard Specification for Laminated Thermosetting Materials; 2017.

PART 2 PRODUCTS

2.01 IDENTIFICATION APPLICATIONS

- A. Piping: Tags.
- B. Tanks: Nameplates.
- C. Valves: Tags and ceiling tacks where located above lay-in ceiling.

2.02 NAMEPLATES

- A. Description: Laminated three-layer plastic with engraved letters.
 - 1. Letter Color: White.
 - 2. Letter Height: 1/4 inch (6 mm).
 - 3. Background Color: Black.
 - 4. Plastic: Comply with ASTM D709.

2.03 TAGS

- A. Plastic Tags: Laminated three-layer plastic with engraved black letters on light contrasting background color. Tag size minimum 1-1/2 inch (40 mm) diameter.
- B. Valve Tag Chart: Typewritten letter size list in anodized aluminum frame.

2.04 PIPE MARKERS

- A. Comply with ASME A13.1.
- B. Plastic Pipe Markers: Factory fabricated, flexible, semi- rigid plastic, preformed to fit around pipe or pipe covering; minimum information indicating flow direction arrow and identification of fluid being conveyed.
- C. Plastic Tape Pipe Markers: Flexible, vinyl film tape with pressure sensitive adhesive backing and printed markings.

2.05 CEILING TACKS

- A. Description: Steel with 3/4 inch (20 mm) diameter color coded head.
- B. Color code as follows:
 - 1. HVAC Equipment: Yellow.
 - 2. Fire Dampers and Smoke Dampers: Red.
 - 3. Plumbing Valves: Green.
 - 4. Heating/Cooling Valves: Blue.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

PART 3 EXECUTION

3.01 PREPARATION

- A. Degrease and clean surfaces to receive adhesive for identification materials.
- B. Prepare surfaces in accordance with Section 09 9123 for stencil painting.

3.02 INSTALLATION

- A. Install plastic nameplates with corrosive-resistant mechanical fasteners, or adhesive. Apply with sufficient adhesive to ensure permanent adhesion and seal with clear lacquer.
- B. Install tags with corrosion resistant chain.
- C. Install plastic pipe markers in accordance with manufacturer's instructions.
- D. Install plastic tape pipe markers complete around pipe in accordance with manufacturer's instructions.
- E. Install underground plastic pipe markers 6 to 8 inches (150 to 200 mm) below finished grade, directly above buried pipe.
- F. Locate ceiling tacks to locate valves or dampers above lay-in panel ceilings. Locate in corner of panel closest to equipment.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 22 0716
PLUMBING EQUIPMENT INSULATION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Equipment insulation.
- B. Flexible removable and reusable blanket insulation.
- C. Covering.

1.02 RELATED REQUIREMENTS

- A. Section 09 9123 - Interior Painting: Painting insulation covering.
- B. Section 22 0553 - Identification for Plumbing Piping and Equipment.
- C. Section 22 1005 - Plumbing Piping: Placement of hangers and hanger inserts.

1.03 REFERENCE STANDARDS

- A. ASTM C195 - Standard Specification for Mineral Fiber Thermal Insulating Cement; 2007 (Reapproved 2013).
- B. ASTM C518 - Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus; 2017.
- C. ASTM C553 - Standard Specification for Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications; 2013 (Reapproved 2019).
- D. ASTM C592 - Standard Specification for Mineral Fiber Blanket Insulation and Blanket-Type Pipe Insulation (Metal-Mesh Covered) (Industrial Type); 2016.
- E. ASTM C612 - Standard Specification for Mineral Fiber Block and Board Thermal Insulation; 2014 (Reapproved 2019).
- F. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2020.
- G. UL 723 - Standard for Test for Surface Burning Characteristics of Building Materials; Current Edition, Including All Revisions.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide product description, thermal characteristics, list of materials and thickness for equipment scheduled.
- C. Manufacturer's Instructions: Indicate installation procedures that ensure acceptable workmanship and installation standards will be achieved.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with not less than three years of documented experience.
- B. Applicator Qualifications: Company specializing in performing the type of work specified in this section and approved by manufacturer.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Accept materials on site in original factory packaging, labeled with manufacturer's identification, including product density and thickness.
- B. Protect insulation from weather and construction traffic, dirt, water, chemical, and mechanical damage, by storing in original wrapping.

1.07 FIELD CONDITIONS

- A. Maintain ambient temperatures and conditions required by manufacturers of adhesives, mastics, and insulation cements.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Maintain temperature during and after installation for minimum period of 24 hours.

PART 2 PRODUCTS

2.01 REGULATORY REQUIREMENTS

- A. Surface Burning Characteristics: Flame spread index/Smoke developed index of 25/50, maximum, when tested in accordance with ASTM E84 or UL 723.

2.02 JACKETS

- A. PVC Plastic:

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that equipment has been tested before applying insulation materials.
- B. Verify that surfaces are clean and dry, with foreign material removed.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Factory Insulated Equipment: Do not insulate.
- C. Exposed Equipment: Locate insulation and cover seams in least visible locations.
- D. Apply insulation close to equipment by grooving, scoring, and beveling insulation. Fasten insulation to equipment with studs, pins, clips, adhesive, wires, or bands.
- E. Fill joints, cracks, seams, and depressions with bedding compound to form smooth surface. On cold equipment, use vapor barrier cement.
- F. For fiberglass insulated equipment containing fluids below ambient temperature, provide vapor barrier jackets, factory-applied or field-applied, and finish with glass cloth and vapor barrier adhesive.
- G. Equipment in Mechanical Equipment Rooms or Finished Spaces: Finish with canvas jacket sized for finish painting.
- H. Cover glass fiber insulation with metal mesh and finish with heavy coat of insulating cement.
- I. Equipment Requiring Access for Maintenance, Repair, or Cleaning: Install insulation so it can be easily removed and replaced without damage.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 22 0719
PLUMBING PIPING INSULATION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Piping insulation.
- B. Jackets and accessories.

1.02 RELATED REQUIREMENTS

- A. Section 22 1005 - Plumbing Piping: Placement of hangers and hanger inserts.
- B. Section 23 2300 - Refrigerant Piping: Placement of inserts.

1.03 REFERENCE STANDARDS

- A. ASTM C177 - Standard Test Method for Steady-State Heat Flux Measurements and Thermal Transmission Properties by Means of the Guarded-Hot-Plate Apparatus; 2019.
- B. ASTM C518 - Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus; 2017.
- C. ASTM C534/C534M - Standard Specification for Preformed Flexible Elastomeric Cellular Thermal Insulation in Sheet and Tubular Form; 2020.
- D. ASTM C547 - Standard Specification for Mineral Fiber Pipe Insulation; 2019.
- E. ASTM C552 - Standard Specification for Cellular Glass Thermal Insulation; 2017, with Editorial Revision (2018).
- F. ASTM C795 - Standard Specification for Thermal Insulation for Use in Contact with Austenitic Stainless Steel; 2008 (Reapproved 2018).
- G. ASTM D1056 - Standard Specification for Flexible Cellular Materials-Sponge or Expanded Rubber; 2014.
- H. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2020.
- I. ASTM E96/E96M - Standard Test Methods for Water Vapor Transmission of Materials; 2016.
- J. UL 723 - Standard for Test for Surface Burning Characteristics of Building Materials; Current Edition, Including All Revisions.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide product description, thermal characteristics, list of materials and thickness for each service, and locations.

PART 2 PRODUCTS

2.01 REGULATORY REQUIREMENTS

- A. Surface Burning Characteristics: Flame spread index/Smoke developed index of 25/50, maximum, when tested in accordance with ASTM E84 or UL 723.

2.02 GLASS FIBER

- A. Manufacturers:
 - 1. CertainTeed Corporation: www.certainteed.com/#sle.
 - 2. Johns Manville Corporation: www.jm.com/#sle.
 - 3. Owens Corning Corporation; Fiberglas Pipe Insulation ASJ: www.ocbuildingspec.com/#sle.
- B. Insulation: ASTM C547 and ASTM C795; rigid molded, noncombustible.
 - 1. K (Ksi) Value: ASTM C177, 0.24 at 75 degrees F (0.035 at 24 degrees C).
 - 2. Maximum Service Temperature: 850 degrees F (454 degrees C).
 - 3. Maximum Moisture Absorption: 0.2 percent by volume.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2.03 POLYETHYLENE

- A. Manufacturers:
 - 1. Armacell LLC: www.armacell.us/#sle.
 - 2. Substitutions: See Section 01 6000 - Product Requirements.
- B. Insulation: Flexible closed-cell polyethylene tubing, slit lengthwise for installation, complying with applicable requirements of ASTM D1056.
 - 1. K (Ksi) Value: ASTM C177; 0.25 at 75 degrees F (0.036 at 24 degrees C).
 - 2. Maximum Service Temperature: 200 degrees F (93 degrees C).
 - 3. Density: 2 lb/cu ft (32 kg/cu m).
 - 4. Maximum Moisture Absorption: 1.0 percent by volume.
 - 5. Moisture Vapor Permeability: 0.05 perm inch (0.073 ng/Pa s m), when tested in accordance with ASTM E96/E96M.
 - 6. Connection: Contact adhesive.

2.04 FLEXIBLE ELASTOMERIC CELLULAR INSULATION

- A. Manufacturers:
 - 1. Aeroflex USA, Inc; Aerocel Stay-Seal with Protape (SSPT): www.aeroflexusa.com/#sle.
 - 2. Armacell LLC; AP Armaflex: www.armacell.us/#sle.
 - 3. Substitutions: See Section 01 6000 - Product Requirements.
- B. Insulation: Preformed flexible elastomeric cellular rubber insulation complying with ASTM C534/C534M Grade 1; use molded tubular material wherever possible.
 - 1. Minimum Service Temperature: Minus 40 degrees F (Minus 40 degrees C).
 - 2. Maximum Service Temperature: 220 degrees F (104 degrees C).
 - 3. Connection: Waterproof vapor barrier adhesive.

2.05 JACKETS

- A. PVC Plastic.
 - 1. Jacket: One piece molded type fitting covers and sheet material, off-white color.
 - a. Minimum Service Temperature: 0 degrees F (Minus 18 degrees C).
 - b. Maximum Service Temperature: 150 degrees F (66 degrees C).
 - c. Moisture Vapor Permeability: 0.002 perm inch (0.0029 ng/Pa s m), maximum, when tested in accordance with ASTM E96/E96M.
 - d. Thickness: 10 mil (0.25 mm).
 - e. Connections: Brush on welding adhesive.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that piping has been tested before applying insulation materials.
- B. Verify that surfaces are clean and dry, with foreign material removed.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Exposed Piping: Locate insulation and cover seams in least visible locations.
- C. Insulated pipes conveying fluids below ambient temperature: Insulate entire system including fittings, valves, unions, flanges, strainers, flexible connections, pump bodies, and expansion joints.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 22 1005
PLUMBING PIPING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Pipe, pipe fittings, specialties, and connections for piping systems.
 - 1. Sanitary sewer.
 - 2. Chemical resistant sewer.
 - 3. Domestic water.
 - 4. Storm water.
 - 5. Flanges, unions, and couplings.
 - 6. Pipe hangers and supports.
 - 7. Valves.
 - 8. Check.
 - 9. Water pressure reducing valves.
 - 10. Relief valves.
 - 11. Strainers.

1.02 RELATED REQUIREMENTS

- A. Section 07 8400 - Firestopping.
- B. Section 08 3100 - Access Doors and Panels.
- C. Section 09 9113 - Exterior Painting.
- D. Section 09 9123 - Interior Painting.
- E. Section 22 0553 - Identification for Plumbing Piping and Equipment.
- F. Section 22 0719 - Plumbing Piping Insulation.
- G. Section 26 0583 - Wiring Connections: Electrical characteristics and wiring connections.
- H. Section 31 2316 - Excavation.
- I. Section 31 2323 - Fill.
- J. Section 33 0110.58 - Disinfection of Water Utility Piping Systems.

1.03 REFERENCE STANDARDS

- A. ANSI Z21.22 - American National Standard for Relief Valves and Automatic Gas Shutoff Devices for Hot Water Supply Systems; 2015.
- B. ANSI Z223.1 - National Fuel Gas Code; 2016.
- C. ASME B16.18 - Cast Copper Alloy Solder Joint Pressure Fittings; 2018.
- D. ASME B16.22 - Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings; 2018.
- E. ASME B31.1 - Power Piping; 2018.
- F. ASME B31.9 - Building Services Piping; 2017.
- G. ASME BPVC-IV - Boiler and Pressure Vessel Code, Section IV - Rules for Construction of Heating Boilers; 2019.
- H. ASSE 1003 - Performance Requirements for Water Pressure Reducing Valves for Domestic Water Distribution Systems; 2009.
- I. ASTM A53/A53M - Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless; 2018.
- J. ASTM A234/A234M - Standard Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High Temperature Service; 2019.
- K. ASTM B32 - Standard Specification for Solder Metal; 2008 (Reapproved 2014).
- L. ASTM B42 - Standard Specification for Seamless Copper Pipe, Standard Sizes; 2020.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- M. ASTM B88 - Standard Specification for Seamless Copper Water Tube; 2020.
- N. ASTM B88M - Standard Specification for Seamless Copper Water Tube (Metric); 2020.
- O. ASTM B813 - Standard Specification for Liquid and Paste Fluxes for Soldering of Copper and Copper Alloy Tube; 2016.
- P. ASTM B828 - Standard Practice for Making Capillary Joints by Soldering of Copper and Copper Alloy Tube and Fittings; 2016.
- Q. ASTM D1785 - Standard Specification for Poly(Vinyl Chloride) (PVC) Plastic Pipe, Schedules 40, 80, and 120; 2015, with Editorial Revision (2018).
- R. ASTM D2241 - Standard Specification for Poly (Vinyl Chloride) (PVC) Pressure-Rated Pipe (SDR Series); 2015.
- S. ASTM D2466 - Standard Specification for Poly(Vinyl Chloride) (PVC) Plastic Pipe Fittings, Schedule 40; 2017.
- T. ASTM D2564 - Standard Specification for Solvent Cements for Poly(Vinyl Chloride) (PVC) Plastic Piping Systems; 2012 (Reapproved 2018).
- U. ASTM D2665 - Standard Specification for Poly(Vinyl Chloride) (PVC) Plastic Drain, Waste, and Vent Pipe and Fittings; 2014.
- V. ASTM D2855 - Standard Practice for the Two-Step (Primer & Solvent Cement) Method of Joining Poly (Vinyl Chloride) (PVC) or Chlorinated Poly (Vinyl Chloride) (CPVC) Pipe and Piping Components with Tapered Sockets; 2015.
- W. ASTM D3034 - Standard Specification for Type PSM Poly(Vinyl Chloride) (PVC) Sewer Pipe and Fittings; 2016.
- X. ASTM F708 - Standard Practice for Design and Installation of Rigid Pipe Hangers; 1992, with Editorial Revision (2018).
- Y. ASTM F876 - Standard Specification for Crosslinked Polyethylene (PEX) Tubing; 2019a.
- Z. ASTM F877 - Standard Specification for Crosslinked Polyethylene (PEX) Hot- and Cold-Water Distribution Systems; 2020.
- AA. ASTM F1281 - Standard Specification for Crosslinked Polyethylene/Aluminum/Crosslinked Polyethylene (PEX-AL-PEX) Pressure Pipe; 2017.
- AB. ASTM F1960 - Standard Specification for Cold Expansion Fittings with PEX Reinforcing Rings for Use with Cross-linked Polyethylene (PEX) and Polyethylene of Raised Temperature (PE-RT) Tubing; 2019a.
- AC. AWWA C105/A21.5 - Polyethylene Encasement for Ductile-Iron Pipe Systems; 2010.
- AD. AWWA C110/A21.10 - Ductile-Iron and Gray-Iron Fittings; 2012.
- AE. AWWA C111/A21.11 - Rubber-Gasket Joints for Ductile-Iron Pressure Pipe and Fittings; 2017.
- AF. AWWA C151/A21.51 - Ductile-Iron Pipe, Centrifugally Cast; 2017, with Errata (2018).
- AG. AWWA C550 - Protective Interior Coatings for Valves and Hydrants; 2017.
- AH. AWWA C651 - Disinfecting Water Mains; 2014.
- AI. MSS SP-58 - Pipe Hangers and Supports - Materials, Design, Manufacture, Selection, Application, and Installation; 2018.
- AJ. MSS SP-67 - Butterfly Valves; 2017.
- AK. MSS SP-70 - Cast Iron Gate Valves, Flanged and Threaded Ends; 2011.
- AL. MSS SP-71 - Cast Iron Swing Check Valves, Flanged and Threaded Ends; 2018.
- AM. MSS SP-80 - Bronze Gate, Globe, Angle and Check Valves; 2013.
- AN. MSS SP-110 - Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends; 2010.
- AO. NSF 61 - Drinking Water System Components - Health Effects; 2019.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

AP. NSF 372 - Drinking Water System Components - Lead Content; 2016.

AQ. PPI TR-4 - PPI Listing of Hydrostatic Design Basis (HDB), Hydrostatic Design Stress (HDS), Strength Design Basis (SDB), Pressure Design Basis (PDB), and Minimum Required Strength (MRS) Ratings For Thermoplastic Piping Materials or Pipe; 2017.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data on pipe materials, pipe fittings, valves, and accessories. Provide manufacturers catalog information. Indicate valve data and ratings.
- C. Project Record Documents: Record actual locations of valves.

1.05 QUALITY ASSURANCE

- A. Perform work in accordance with applicable codes.
- B. Valves: Manufacturer's name and pressure rating marked on valve body.
- C. Identify pipe with marking including size, ASTM material classification, ASTM specification, potable water certification, water pressure rating.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Accept valves on site in shipping containers with labeling in place. Inspect for damage.
- B. Provide temporary protective coating on cast iron and steel valves.
- C. Provide temporary end caps and closures on piping and fittings. Maintain in place until installation.
- D. Protect piping systems from entry of foreign materials by temporary covers, completing sections of the work, and isolating parts of completed system.

1.07 FIELD CONDITIONS

- A. Do not install underground piping when bedding is wet or frozen.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. Potable Water Supply Systems: Provide piping, pipe fittings, and solder and flux (if used), that comply with NSF 61 and NSF 372 for maximum lead content; label pipe and fittings.

2.02 SANITARY SEWER PIPING, BURIED BEYOND 5 FEET (1500 MM) OF BUILDING

- A. SDR-35 PVC Pipe: ASTM D2665 or ASTM D3034.
 - 1. Fittings: PVC.
 - 2. Joints: Solvent welded, with ASTM D2564 solvent cement.

2.03 SANITARY SEWER PIPING, BURIED WITHIN 5 FEET (1500 MM) OF BUILDING

- A. PVC Pipe:: ASTM D2665 or ASTM D3034.
 - 1. Fittings: PVC.
 - 2. Joints: Solvent welded, with ASTM D2564 solvent cement.

2.04 SANITARY SEWER PIPING, ABOVE GRADE

- A. PVC Pipe: ASTM D1785 Schedule 40, or ASTM D2241 SDR 26 with not less than 150 psi (1034 kPa) pressure rating.
 - 1. Fittings: ASTM D2466, PVC.
 - 2. Joints: Solvent welded, with ASTM D2564 solvent cement.

2.05 DOMESTIC WATER PIPING, BURIED BEYOND 5 FEET (1500 MM) OF BUILDING

- A. CL52 Ductile Iron Pipe: AWWA C151/A21.51.
 - 1. Fittings: AWWA C110/A21.10, ductile or gray iron, standard thickness.
 - 2. Joints: AWWA C111/A21.11, styrene-butadiene rubber (SBR) or vulcanized SBR gasket with 3/4 inch (19 mm) diameter rods.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. C900 DR14 PVC: AWWA C900

2.06 DOMESTIC WATER PIPING, BURIED WITHIN 5 FEET (1500 MM) OF BUILDING

- A. CTS 200 PSI HDPE

2.07 DOMESTIC WATER PIPING, ABOVE GRADE

- A. Copper Tube: ASTM B88 (ASTM B88M), Type K (A), Drawn (H).
1. Fittings: ASME B16.18, cast copper alloy or ASME B16.22, wrought copper and bronze.
 2. Joints: ASTM B32, alloy Sn95 solder.
 3. Mechanical Press Sealed Fittings: Double-pressed type, NSF 61 and NSF 372 approved or certified, utilizing EPDM, nontoxic, synthetic rubber sealing elements.
- B. Cross-Linked Polyethylene (PEX) Pipe: ASTM F876 or ASTM F877.
1. PPI TR-4 Pressure Design Basis:
 2. Fittings: Brass and copper.
 3. Fittings: Brass and engineered polymer (EP) ASTM F1960.
 4. Joints: Mechanical compression fittings.
 5. Joints: ASTM F1960 cold-expansion fittings.

2.08 STORM WATER PIPING, BURIED BEYOND 5 FEET (1500 MM) OF BUILDING

- A. ADS N-12 ST: ASTM F2648
1. Fitting: ASTM F2306
 2. Joints: ASTM F2306
- B. HDPE: ASTM F2619
1. Fitting: ASTM 2619M
 2. Joints: ASTM 2619M

2.09 STORM WATER PIPING, BURIED WITHIN 5 FEET (1500 MM) OF BUILDING

- A. ADS N-12 ST: ASTM F2648
1. Fitting: ASTM 2619M
 2. Joints: ASTM 2619M
- B. HDPE: ASTM F2619
1. Fitting: ASTM 2619M
 2. Joints: ASTM 2619M

2.10 STORM WATER PIPING, ABOVE GRADE

- A. ADS N-12 ST: ASTM F2648
1. Fitting: ASTM 2619M
 2. Joints: ASTM 2619M
 3. Smooth wall
- B. HDPE: ASTM F2619
1. Fitting: ASTM 2619M
 2. Joints: ASTM 2619M
 3. Smooth wall

2.11 NATURAL GAS PIPING, BURIED BEYOND 5 FEET (1500 MM) OF BUILDING

- A. Steel Pipe: ASTM A53/A53M Schedule 40 black.
1. Fittings: ASTM A234/A234M, wrought steel welding type, with AWWA C105/A21.5 polyethylene jacket or double layer, half-lapped 10 mil (0.25 mm) polyethylene tape.
 2. Joints: ASME B31.1, welded.

2.12 NATURAL GAS PIPING, BURIED WITHIN 5 FEET (1500 MM) OF BUILDING

- A. Steel Pipe: ASTM A53/A53M Schedule 40 black.
1. Fittings: ASTM A234/A234M, wrought steel welding type.
 2. Joints: ASME B31.1, welded.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3. Jacket: AWWA C105/A21.5 polyethylene jacket or double layer, half-lapped 10 mil (0.25 mm) polyethylene tape.

2.13 NATURAL GAS PIPING, ABOVE GRADE

2.14 PIPE HANGERS AND SUPPORTS

- A. Provide hangers and supports that comply with MSS SP-58.
 1. If type of hanger or support for a particular situation is not indicated, select appropriate type using MSS SP-58 recommendations.
 2. Overhead Supports: Individual steel rod hangers attached to structure or to trapeze hangers.
 3. Trapeze Hangers: Welded steel channel frames attached to structure.
 4. Vertical Pipe Support: Steel riser clamp.

2.15 BALL VALVES

- A. Construction, 4 Inches (100 mm) and Smaller: MSS SP-110, Class 150, 400 psi (2760 kPa) CWP, bronze or ductile iron body, 304 stainless steel or chrome plated brass ball, regular port, teflon seats and stuffing box ring, blow-out proof stem, lever handle with balancing stops, threaded or grooved ends with union.

2.16 BUTTERFLY VALVES

- A. Construction 1-1/2 Inches (40 mm) and Larger: MSS SP-67, 200 psi (1380 kPa) CWP, cast or ductile iron body, nickel-plated ductile iron disc, resilient replaceable EPDM seat, wafer ends, extended neck, 10 position lever handle.
- B. Provide gear operators for valves 8 inches (150 mm) and larger, and chain-wheel operators for valves mounted over 8 feet (2400 mm) above floor.

2.17 PIPING SPECIALTIES

2.18 WATER PRESSURE REDUCING VALVES

- A. Over 2 Inches (50 mm):
 1. ASSE 1003, cast iron body with interior lining complying with AWWA C550, bronze fitted, elastomeric diaphragm and seat disc, flanged.

2.19 RELIEF VALVES

- A. Pressure:
 1. ANSI Z21.22, AGA certified, bronze body, teflon seat, steel stem and springs, automatic, direct pressure actuated.
- B. Temperature and Pressure:
 1. ANSI Z21.22, AGA certified, bronze body, teflon seat, stainless steel stem and springs, automatic, direct pressure actuated, temperature relief maximum 210 degrees F (98.9 degrees C), capacity ASME BPVC-IV certified and labelled.

2.20 STRAINERS

- A. Size 2 Inches (50 mm) and Under:
 1. Threaded brass body for 175 psi (1200 kPa) CWP, Y pattern with 1/32 inch (0.8 mm) stainless steel perforated screen.
 2. Class 150, threaded bronze body 300 psi (2070 kPa) CWP, Y pattern with 1/32 inch (0.8 mm) stainless steel perforated screen.
- B. Size 5 inch (125 mm) and Larger:
 1. Class 125, flanged iron body, basket pattern with 1/8 inch (3.2 mm) stainless steel perforated screen.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that excavations are to required grade, dry, and not over-excavated.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3.02 PREPARATION

- A. Ream pipe and tube ends. Remove burrs. Bevel plain end ferrous pipe.
- B. Remove scale and dirt, on inside and outside, before assembly.
- C. Prepare piping connections to equipment with flanges or unions.

3.03 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Route piping in orderly manner and maintain gradient. Route parallel and perpendicular to walls.
- C. Install piping to maintain headroom, conserve space, and not interfere with use of space.
- D. Group piping whenever practical at common elevations.
- E. Provide clearance in hangers and from structure and other equipment for installation of insulation and access to valves and fittings.
- F. Provide access where valves and fittings are not exposed.
- G. Provide support for utility meters in accordance with requirements of utility companies.
- H. Excavate in accordance with Section 31 2316.
- I. Backfill in accordance with Section 31 2323.
- J. Install valves with stems upright or horizontal, not inverted. Refer to Section 22 0523.
- K. Install water piping to ASME B31.9.
- L. Copper Pipe and Tube: Make soldered joints in accordance with ASTM B828, using specified solder, and flux meeting ASTM B813; in potable water systems use flux also complying with NSF 61 and NSF 372.
- M. PVC Pipe: Make solvent-welded joints in accordance with ASTM D2855.
- N. Inserts:
 - 1. Provide inserts for placement in concrete formwork.
 - 2. Provide inserts for suspending hangers from reinforced concrete slabs and sides of reinforced concrete beams.
 - 3. Provide hooked rod to concrete reinforcement section for inserts carrying pipe over 4 inches (100 mm).
 - 4. Where concrete slabs form finished ceiling, locate inserts flush with slab surface.
 - 5. Where inserts are omitted, drill through concrete slab from below and provide through-bolt with recessed square steel plate and nut above slab.
- O. Pipe Hangers and Supports:
 - 1. Install in accordance with ASME B31.9.
 - 2. Install hangers to provide minimum 1/2 inch (15 mm) space between finished covering and adjacent work.
 - 3. Place hangers within 12 inches (300 mm) of each horizontal elbow.
 - 4. Use hangers with 1-1/2 inch (40 mm) minimum vertical adjustment. Design hangers for pipe movement without disengagement of supported pipe.
 - 5. Support vertical piping at every other floor. Support riser piping independently of connected horizontal piping.
 - 6. Where several pipes can be installed in parallel and at same elevation, provide multiple or trapeze hangers.
 - 7. Provide copper plated hangers and supports for copper piping.
 - 8. Prime coat exposed steel hangers and supports. Hangers and supports located in crawl spaces, pipe shafts, and suspended ceiling spaces are not considered exposed.
- P. When installing more than one piping system material, ensure system components are compatible and joined to ensure the integrity of the system. Provide necessary joining fittings. Ensure flanges, union, and couplings for servicing are consistently provided.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3.04 APPLICATION

3.05 TOLERANCES

- A. Drainage Piping: Establish invert elevations within 1/2 inch (10 mm) vertically of location indicated and slope to drain at minimum of 1/4 inch per foot (1:50) slope.
- B. Water Piping: Slope at minimum of 1/32 inch per foot (1:400) and arrange to drain at low points.

3.06 DISINFECTION OF DOMESTIC WATER PIPING SYSTEM

- A. Prior to starting work, verify system is complete, flushed, and clean.
- B. Ensure acidity (pH) of water to be treated is between 7.4 and 7.6 by adding alkali (caustic soda or soda ash) or acid (hydrochloric).
- C. Inject disinfectant, free chlorine in liquid, powder, tablet, or gas form throughout system to obtain 50 to 80 mg/L residual.
- D. Bleed water from outlets to ensure distribution and test for disinfectant residual at minimum 15 percent of outlets.
- E. Maintain disinfectant in system for 24 hours.
- F. If final disinfectant residual tests less than 25 mg/L, repeat treatment.
- G. Flush disinfectant from system until residual equal to that of incoming water or 1.0 mg/L.

3.07 SERVICE CONNECTIONS

- A. Provide new sanitary sewer services. Before commencing work, check invert elevations required for sewer connections, confirm inverts and ensure that these can be properly connected with slope for drainage and cover to avoid freezing.
- B. Provide new water service complete with approved reduced pressure backflow preventer and water meter with by-pass valves, pressure reducing valve, and sand strainer.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 22 1006
PLUMBING PIPING SPECIALTIES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Drains.
- B. Cleanouts.
- C. Air vents.
- D. Floor drain trap seals.
- E. Domestic water distribution manifolds.

1.02 RELATED REQUIREMENTS

- A. Section 01 1000 - Summary: Product requirements for Owner furnished kitchen equipment.
- B. Section 22 1005 - Plumbing Piping.
- C. Section 22 4000 - Plumbing Fixtures.

1.03 REFERENCE STANDARDS

- A. ADA Standards - Americans with Disabilities Act (ADA) Standards for Accessible Design; 2010.
- B. ASME A112.6.3 - Floor and Trench Drains; 2019.
- C. NSF 2 - Food Equipment; 2019.
- D. NSF 61 - Drinking Water System Components - Health Effects; 2019.
- E. NSF 372 - Drinking Water System Components - Lead Content; 2016.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide component sizes, rough-in requirements, service sizes, and finishes.
- C. Shop Drawings: Indicate dimensions, weights, and placement of openings and holes.
- D. Certificates: Certify that grease interceptors meet or exceed specified requirements.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the Products specified in this section with not less than three years documented experience.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Accept specialties on site in original factory packaging. Inspect for damage.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. Specialties in Potable Water Supply Systems: Provide products that comply with NSF 61 and NSF 372 for maximum lead content.
- B. See Equipment Schedule as well as Plumbing Fixture Schedule for full list of all products.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Extend cleanouts to finished floor or wall surface. Lubricate threaded cleanout plugs with mixture of graphite and linseed oil. Ensure clearance at cleanout for rodding of drainage system.
- C. Encase exterior cleanouts in concrete flush with grade.
- D. Install floor cleanouts at elevation to accommodate finished floor.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- E. Install approved potable water protection devices on plumbing lines where contamination of domestic water may occur; on boiler feed water lines, janitor rooms, fire sprinkler systems, premise isolation, irrigation systems, flush valves, interior and exterior hose bibbs.
- F. Pipe relief from backflow preventer to nearest drain.
- G. Install water hammer arrestors complete with accessible isolation valve on hot and cold water supply piping to lavatory sinks, washing machine outlets, or _____.
- H. Install air chambers on hot and cold water supply piping to each fixture or group of fixtures (each washroom). Fabricate same size as supply pipe or 3/4 inch (20 mm) minimum, and minimum 18 inches (450 mm) long.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 22 4000
PLUMBING FIXTURES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Lavatories.
- B. Sinks.
- C. Service sinks.
- D. Mop sinks.
- E. Under-lavatory pipe supply covers.
- F. Bathtubs.
- G. Showers.
- H. Mop Sinks

1.02 RELATED REQUIREMENTS

- A. Section 07 9200 - Joint Sealants: Sealing joints between fixtures and walls and floors.
- B. Section 12 3600 - Countertops: Preparation of counters for sinks and lavatories.
- C. Section 22 1005 - Plumbing Piping.
- D. Section 22 3000 - Plumbing Equipment.
- E. Section 26 0583 - Wiring Connections: Electrical characteristics and wiring connections.

1.03 REFERENCE STANDARDS

- A. ADA Standards - Americans with Disabilities Act (ADA) Standards for Accessible Design; 2010.
- B. ASHRAE Std 18 - Methods of Testing for Rating Drinking-Water Coolers with Self-Contained Mechanical Refrigeration; 2013.
- C. ASME A112.6.1M - Supports for Off-the-Floor Plumbing Fixtures for Public Use; 1997 (Reaffirmed 2017).
- D. ASME A112.18.1 - Plumbing Supply Fittings; 2018, with Errata.
- E. ASME A112.18.9 - Protectors/Insulators for Exposed Waste and Supplies on Accessible Fixtures; 2011 (Reaffirmed 2017).
- F. ASME A112.19.2 - Ceramic Plumbing Fixtures; 2018.
- G. ASME A112.19.3 - Stainless Steel Plumbing Fixtures; 2017.
- H. ASME A112.19.4M - Porcelain Enameled Formed Steel Plumbing Fixtures; 1994 (R2009).
- I. ASME A112.19.5 - Flush Valves and Spuds for Water Closets, Urinals, and Tanks; 2017.
- J. ASTM C1822 - Standard Specification for Insulating Covers on Accessible Lavatory Piping; 2015.
- K. IAPMO Z124 - Plastic Plumbing Fixtures; 2017.
- L. ICC A117.1 - Accessible and Usable Buildings and Facilities; 2017.
- M. ISFA 2-01 - Classification and Standards for Solid Surfacing Material; 2013.
- N. NSF 61 - Drinking Water System Components - Health Effects; 2019.
- O. NSF 372 - Drinking Water System Components - Lead Content; 2016.
- P. UL (DIR) - Online Certifications Directory; Current Edition.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide catalog illustrations of fixtures, sizes, rough-in dimensions, utility sizes, trim, and finishes.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- C. Manufacturer's Instructions: Indicate installation methods and procedures.
- D. Warranty: Submit manufacturer warranty and ensure forms have been completed in Owner's name and registered with manufacturer.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the type of products specified in this section, with minimum three years of documented experience.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Accept fixtures on site in factory packaging. Inspect for damage.
- B. Protect installed fixtures from damage by securing areas and by leaving factory packaging in place to protect fixtures and prevent use.

1.07 WARRANTY

- A. See Section 01 7800 - Closeout Submittals, for additional warranty requirements.
- B. Provide five year manufacturer warranty for electric water cooler.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. Potable Water Systems: Provide plumbing fittings and faucets that comply with NSF 61 and NSF 372 for maximum lead content; label pipe and fittings.
- B. Water Efficiency: EPA WaterSense label is required for all water closets, urinals, lavatory faucets, and showerheads.

2.02 REGULATORY REQUIREMENTS

- A. Comply with applicable codes for installation of plumbing systems.
- B. Comply with UL (DIR) requirements.
- C. Perform work in accordance with local health department regulations.
- D. Provide certificate of compliance from Authority Having Jurisdiction indicating approval of installation.

2.03 UNDER-LAVATORY PIPE SUPPLY COVERS

- A. Manufacturers:
 - 1. Truebro Lav Guard, <https://ipscorp.com/plumbing/brands/truebro/>
 - 2. TrueBro Basin Guard, <https://ipscorp.com/plumbing/brands/truebro/>
 - 3. Substitutions: See Section 01 6000 - Product Requirements.
- B. General:
 - 1. Insulate exposed drainage piping including hot, cold and tempered water supplies under lavatories or sinks per ADA Standards.
 - 2. Construction: 1/8 inch (3.2 mm) PVC with antimicrobial, antifungal and UV resistant properties.
 - a. Comply with ASME A112.18.9 for covers on accessible lavatory piping.
 - b. Comply with ICC A117.1.
 - 3. Color: High gloss white.
 - 4. Fasteners: Reusable, snap-locking fasteners with no sharp or abrasive external surfaces. No cable ties allowed.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that walls and floor finishes are prepared and ready for installation of fixtures.

3.02 PREPARATION

- A. Rough-in fixture piping connections in accordance with minimum sizes indicated in fixture rough-in schedule for particular fixtures.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3.03 INSTALLATION

- A. Install each fixture with trap, easily removable for servicing and cleaning.
- B. Install components level and plumb.
- C. Install and secure fixtures in place with wall supports and bolts.

3.04 INTERFACE WITH WORK OF OTHER SECTIONS

- A. Review millwork shop drawings. Confirm location and size of fixtures and openings before rough-in and installation.

3.05 ADJUSTING

- A. Adjust stops or valves for intended water flow rate to fixtures without splashing, noise, or overflow.

3.06 CLEANING

- A. Clean plumbing fixtures and equipment.
- B. See Section 01 7419 - Construction Waste Management and Disposal, for additional requirements.

3.07 PROTECTION

- A. Protect installed products from damage due to subsequent construction operations.
- B. Repair or replace damaged products before Date of Substantial Completion.

3.08 SCHEDULES

- A. See Drawings and Schedules; Kitchen Equipment & Plumbing Fixtures.
- B. Fixture Rough-In
 - 1. See schematics and fixture specification sheets

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 23 0130.51
HVAC AIR-DISTRIBUTION SYSTEM CLEANING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Cleaning of HVAC duct system, equipment, and related components.

1.02 RELATED REQUIREMENTS

1.03 DEFINITIONS

- A. HVAC System: For purposes of this section, the surfaces to be cleaned include all interior surfaces of the heating, air-conditioning and ventilation system from the points where the air enters the system to the points where the air is discharged from the system, including the inside of air distribution equipment, coils, and condensate drain pans; see NADCA ACR for more details.
 - 1. Above-ceiling plenum for supply air is required to be cleaned.
 - 2. Above-ceiling plenum for return air is required to be cleaned.
 - 3. Makeup air system is required to be cleaned.
 - 4. Exhaust-only system is required to be cleaned.

1.04 REFERENCE STANDARDS

- A. NADCA ACR - Assessment, Cleaning and Restoration of HVAC Systems; 2013.
- B. UL 181 - Standard for Factory-Made Air Ducts and Air Connectors; current edition, including all revisions.
- C. UL 181A - Closure Systems for Use with Rigid Air Ducts; Current Edition, Including All Revisions.

1.05 QUALITY ASSURANCE

- A. Information Available to Contractor: No existing system documentation is available.

PART 2 PRODUCTS

2.01 TOOLS AND EQUIPMENT

- A. Vacuum Devices and Other Tools: Exceptionally clean, in good working order, and sealed when brought into the facility.
- B. Vacuum Devices That Exhaust Air Inside Building, Including Hand-Held and Wet Vacuums: Equipped with HEPA filtration with 99.97 percent collection efficiency for minimum 0.3-micron size particles and DOP test number.
- C. Vacuum Devices That Exhaust Air Outside Building, Including Truck- and Trailer-Mounted Types: Equipped with particulate collection including adequate filtration to contain debris removed from the HVAC system; exhausted in manner that prevents contaminant re-entry to building; compliant with applicable regulations as to outdoor environmental contamination.

2.02 SURFACE TREATMENTS

- A. Anti-Microbial Materials: EPA registered specifically for use on non-porous HVAC system surfaces and applied per manufacturer's instructions.

PART 3 EXECUTION

3.01 PROJECT CONDITIONS

- A. Comply with applicable federal, state, and local requirements.
- B. Perform cleaning, inspection, and remediation in accordance with the recommendations of NADCA "Assessment, Cleaning and Restoration of HVAC Systems" (ACR) and as specified herein.
- C. Where NADCA ACR uses the terms "recommended", "highly recommended", or "ideally" in regard to a certain procedure or activity, do that unless it is clearly inapplicable to the project.
- D. Take precautions to prevent introduction of additional hazards into occupied spaces.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- E. Obtain Owner's approval of proposed temporary locations for large equipment.
- F. Designate a decontamination area and obtain Owner's approval.
- G. When portions of the facility are to remain occupied or in operation during cleaning activities, provide adequate controls or containment to prevent access to spaces being cleaned by unauthorized persons and provide detailed instructions to Owner as to these controls or containment.
- H. If unforeseen mold or other biological contamination is encountered, notify Architect immediately, identifying areas affected and extent and type of contamination.

3.02 EXAMINATION

- A. Inspect the system as required to determine appropriate methods, tools, equipment, and protection.
- B. Start of cleaning work constitutes acceptance of existing conditions.
- C. When concealed spaces are later made accessible, examine and document interior conditions prior to beginning cleaning.
- D. Document all instances of mold growth, rodent droppings, other biological hazards, and damaged system components.

3.03 PREPARATION

- A. When cleaning work might adversely affect life safety systems, including fire and smoke detection, alarm, and control, coordinate scheduling and testing and inspection procedures with authorities having jurisdiction.
- B. Ensure that electrical components that might be adversely affected by cleaning are de-energized, locked out, and protected prior to beginning work.
- C. Air-Volume Control Devices: Mark the original position of dampers and other air-directional mechanical devices inside the HVAC system prior to starting cleaning.
- D. Access to Concealed Spaces: Use existing service openings and make additional service openings as required to accomplish cleaning and inspection.
 - 1. Do not cut openings in non-HVAC components without obtaining the prior approval of Owner.
 - 2. Make new openings in HVAC components in accordance with NADCA Standard 05; do not compromise the structural integrity of the system.
 - 3. Do not cut service openings into flexible duct; disconnect at ends for cleaning and inspection.
- E. Ceiling Tile: Lay-in ceiling tile may be removed to gain access to HVAC systems during the cleaning process; protect tile from damage and reinstall upon completion; replace damaged tile.

3.04 CLEANING

- A. Use any cleaning method recommended by NADCA ACR unless otherwise specified; do not use methods prohibited by NADCA ACR, or that will damage HVAC components or other work, or that will significantly alter the integrity of the system.
- B. Obtain Owner's approval before using wet cleaning methods; ensure that drainage is adequate before beginning.
- C. Ducts: Mechanically clean all portions of ducts.
- D. Hoses, Cables, and Extension Rods: Clean using suitable sanitary damp wipes at the time they are being removed or withdrawn from their normal position.
- E. Registers, Diffusers, and Grilles: When removing, take care to prevent containment exposure due to accumulated debris.
- F. Coils: Follow NADCA ACR completely including measuring static pressure drop before and after cleaning; do not remove refrigeration coils from system to clean; report coils that are permanently impacted.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- G. Collect debris removed during cleaning; ensure that debris is not dispersed outside the HVAC system during the cleaning process.
- H. Store contaminated tools and equipment in polyethylene bags until cleaned in the designated decontamination area.

3.05 REPAIR

- A. Repair openings cut in the ventilation system so that they do not significantly alter the airflow or adversely impact the facility's indoor air quality.
- B. At insulated ducts and components, accomplish repairs in such a manner as to achieve the equivalent thermal value.
- C. Reseal new openings in accordance with NADCA Standard 05.
- D. Reseal rigid fiber glass duct systems using closure techniques that comply with UL 181 or UL 181A.
- E. When new openings are intended to be capable of being re-opened in the future, clearly mark them and report their locations to Owner in project report documents.

3.06 FIELD QUALITY CONTROL

- A. Ensure that the following field quality control activities are completed prior to application of any treatments or coatings and prior to returning HVAC system to normal operation.
- B. Visually inspect all portions of the cleaned components; if not visibly clean as defined in NADCA ACR, re-clean and reinspect.
- C. Coils: Cleaning must restore the coil pressure drop to within 10 percent of the coil's original installed pressure drop; if original pressure drop is not known, coil will be considered clean if free of foreign matter and chemical residue based on visual inspection.
- D. Notify Architect when cleaned components are ready for inspection.
- E. When directed, re-clean components until they pass.
- F. Submit evidence that all portions of the system required to be cleaned have been cleaned satisfactorily.

3.07 ANTI-MICROBIAL TREATMENT

- A. When directed, apply anti-microbial treatment to internal surfaces.
- B. Apply anti-microbial agent after removal of surface deposits and debris.
- C. Apply anti-microbial treatments and coatings in strict accordance with the manufacturer's written recommendations and EPA registration listing.
- D. Spray coatings directly onto interior ductwork surfaces; do not "fog" into air stream.

3.08 ADJUSTING

- A. After satisfactory completion of field quality control activities, restore adjustable devices to original settings, including, but not limited to, dampers, air directional devices, valves, fuses, and circuit breakers.

3.09 WASTE MANAGEMENT

- A. Double-bag waste and debris in 6 mil, 0.006 inch (0.1524 mm) thick polyethylene plastic bags.
- B. Dispose of debris off-site in accordance with applicable federal, state and local requirements.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 23 0529

HANGERS AND SUPPORTS FOR HVAC PIPING AND EQUIPMENT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Support and attachment components for equipment, piping, and other HVAC/hydronic work.

1.02 RELATED REQUIREMENTS

- A. Section 03 3000 - Cast-in-Place Concrete: Concrete equipment pads.

1.03 REFERENCE STANDARDS

- A. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products; 2017.
- B. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware; 2016a.
- C. ASTM A36/A36M - Standard Specification for Carbon Structural Steel; 2014.
- D. ASTM A47/A47M - Standard Specification for Ferritic Malleable Iron Castings; 1999, with Editorial Revision (2018).
- E. ASTM B633 - Standard Specification for Electrodeposited Coatings of Zinc on Iron and Steel; 2019.
- F. ASTM D635 - Standard Test Method for Rate of Burning and/or Extent and Time of Burning of Plastics in a Horizontal Position; 2018.
- G. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2020.
- H. ASTM E96/E96M - Standard Test Methods for Water Vapor Transmission of Materials; 2016.
- I. MFMA-4 - Metal Framing Standards Publication; 2004.
- J. MSS SP-58 - Pipe Hangers and Supports - Materials, Design, Manufacture, Selection, Application, and Installation; 2018.
- K. NFPA 101 - Life Safety Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- L. UL 723 - Standard for Test for Surface Burning Characteristics of Building Materials; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate sizes and arrangement of supports and bases with the actual equipment and components to be installed.
 - 2. Coordinate the work with other trades to provide additional framing and materials required for installation.
 - 3. Coordinate compatibility of support and attachment components with mounting surfaces at the installed locations.
 - 4. Coordinate the arrangement of supports with ductwork, piping, equipment and other potential conflicts installed under other sections or by others.
 - 5. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.
- B. Sequencing:
 - 1. Do not install products on or provide attachment to concrete surfaces until concrete has fully cured in accordance with Section 03 3000.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for channel (strut) framing systems, nonpenetrating rooftop supports, post-installed concrete and masonry anchors, and thermal insulated pipe supports.
 - 1. Fiberglass Channel (Strut) Framing Systems: Include requirements for strength derating according to ambient temperature.
- C. Shop Drawings: Include details for fabricated hangers and supports where materials or methods other than those indicated are proposed for substitution.

1.06 QUALITY ASSURANCE

- A. Comply with applicable building code.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store products in accordance with manufacturer's instructions.

PART 2 PRODUCTS

2.01 SUPPORT AND ATTACHMENT COMPONENTS

- A. General Requirements:
 - 1. Provide all required hangers, supports, anchors, fasteners, fittings, accessories, and hardware as necessary for the complete installation of plumbing work.
 - 2. Provide products listed, classified, and labeled as suitable for the purpose intended, where applicable.
 - 3. Where support and attachment component types and sizes are not indicated, select in accordance with manufacturer's application criteria as required for the load to be supported. Include consideration for vibration, equipment operation, and shock loads where applicable.
 - 4. Do not use wire, chain, perforated pipe strap, or wood for permanent supports unless specifically indicated or permitted.
 - 5. Steel Components: Use corrosion resistant materials suitable for the environment where installed.
 - a. Indoor Dry Locations: Use zinc-plated steel or approved equivalent unless otherwise indicated.
 - b. Outdoor and Damp or Wet Indoor Locations: Use galvanized steel, stainless steel, or approved equivalent unless otherwise indicated.
 - c. Zinc-Plated Steel: Electroplated in accordance with ASTM B633.
 - d. Galvanized Steel: Hot-dip galvanized after fabrication in accordance with ASTM A123/A123M or ASTM A153/A153M.
- B. Metal Channel (Strut) Framing Systems: Factory-fabricated continuous-slot metal channel (strut) and associated fittings, accessories, and hardware required for field-assembly of supports.
 - 1. Comply with MFMA-4.
 - 2. Comply with SMAIA.
- C. Fiberglass Channel (Strut) Framing Systems: Factory-fabricated continuous-slot fiberglass channel (strut) and associated fittings, accessories, and hardware required for field-assembly of supports.
 - 1. Flammability: Fire retardant with NFPA 101, Class A flame spread index (maximum of 25) when tested in accordance with ASTM E84; self-extinguishing in accordance with ASTM D635.
- D. Hanger Rods: Threaded zinc-plated steel unless otherwise indicated.
 - 1. Minimum Size, Unless Otherwise Indicated or Required:
 - a. Equipment Supports: 1/2 inch (13 mm) diameter.
 - b. Piping up to 1 inch (27 mm) nominal: 1/4 inch (6 mm) diameter.
 - c. Piping larger than 1 inch (27 mm) nominal: 3/8 inch (10 mm) diameter.
- E. Thermal Insulated Pipe Supports:
 - 1. General Construction and Requirements:

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- a. Insulated pipe supports to be provided at hanger, support, and guide locations on pipe requiring insulation or additional support.
- b. Surface Burning Characteristics: Flame spread index/smoke developed index of 5/30, maximum, when tested in accordance with ASTM E84 or UL 723.
- c. Pipe supports to be provided for nominally sized, 1/2 inch to 30 inch (12.7 mm to 762 mm) iron pipes.
- d. Insulation inserts to consist of rigid polyisocyanurate (urethane) insulation surrounded by a 360 degree, PVC jacketing.
- 2. PVC Jacket:
 - a. Pipe insulation protection shields to be provided with a ball bearing hinge and locking seam.
 - b. Moisture Vapor Transmission: 0.0071 perm inch (0.0092 ng/Pa s m), when tested in accordance with ASTM E96/E96M.
 - c. Thickness: 60 mil (1.524 mm).
- F. Pipe Supports:
 - 1. Liquid Temperatures Up To 122 degrees F (50 degrees C):
 - a. Overhead Support: MSS SP-58 Types 1, 3 through 12.
 - b. Support From Below: MSS SP-58 Types 35 through 38.
 - 2. Operating Temperatures from 122 to 446 degrees F (50 to 230 degrees C):
 - a. Overhead Support: MSS SP-58 Type 1 or 3 through 12, with appropriate saddle of MSS SP-58 Type 40 for insulated pipe.
 - b. Roller Support: MSS SP-58 Types 41 or 43 through 46, with appropriate saddle of MSS SP-58 Type 39 for insulated pipe.
 - c. Sliding Support: MSS SP-58 Types 35 through 38.
- G. Pipe Stanchions: For pipe runs, use stanchions of same type and material where vertical adjustment is required for stationary pipe.
 - 1. Material: Malleable iron, ASTM A47/A47M; or carbon steel, ASTM A36/A36M.
 - 2. Provide coated or plated saddles to isolate steel hangers from dissimilar metal tube or pipe.
- H. Offset Pipe Clamps: Double-leg design two-piece pipe clamp.
- I. Strut Clamps: Two-piece pipe clamp.
- J. Insulation Clamps: Two bolt-type clamps designed for installation under insulation.
- K. Pipe Hangers: For a given pipe run, use hangers of the same type and material.
 - 1. Material: Malleable iron, ASTM A47/A47M; or carbon steel, ASTM A36/A36M.
 - 2. Provide coated or plated hangers to isolate steel hangers from dissimilar metal tube or pipe.
- L. Anchors and Fasteners:
 - 1. Unless otherwise indicated and where not otherwise restricted, use the anchor and fastener types indicated for the specified applications.
 - 2. Steel: Use beam clamps, machine bolts, or welded threaded studs.
 - 3. Sheet Metal: Use sheet metal screws.
 - 4. Wood: Use wood screws.
- M. Pipe Installation Accessories:
 - 1. Copper Pipe Supports:
 - 2. Thermal Insulated Pipe Supports:
 - 3. Overhead Pipe Supports:
 - 4. Plenum Pipe Supports:

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that mounting surfaces are ready to receive support and attachment components.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Provide independent support from building structure. Do not provide support from piping, ductwork, conduit, or other systems.
- C. Unless specifically indicated or approved by Architect, do not provide support from suspended ceiling support system or ceiling grid.
- D. Unless specifically indicated or approved by Architect, do not provide support from roof deck.
- E. Do not penetrate or otherwise notch or cut structural members without approval of Structural Engineer.
- F. Provide thermal insulated pipe supports complete with hangers and accessories. Install thermal insulated pipe supports during the installation of the piping system.
- G. Equipment Support and Attachment:
 - 1. Use metal fabricated supports or supports assembled from metal channel (strut) to support equipment as required.
 - 2. Use metal channel (strut) secured to studs to support equipment surface-mounted on hollow stud walls when wall strength is not sufficient to resist pull-out.
 - 3. Use metal channel (strut) to support surface-mounted equipment in wet or damp locations to provide space between equipment and mounting surface.
 - 4. Securely fasten floor-mounted equipment. Do not install equipment such that it relies on its own weight for support.
- H. Secure fasteners according to manufacturer's recommended torque settings.
- I. Remove temporary supports.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.
- B. Inspect support and attachment components for damage and defects.
- C. Repair cuts and abrasions in galvanized finishes using zinc-rich paint recommended by manufacturer. Replace components that exhibit signs of corrosion.
- D. Correct deficiencies and replace damaged or defective support and attachment components.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 23 0553

IDENTIFICATION FOR HVAC PIPING AND EQUIPMENT

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Nameplates.
- B. Tags.
- C. Adhesive-backed duct markers.
- D. Pipe markers.
- E. Ceiling tacks.

1.02 RELATED REQUIREMENTS

- A. Section 09 9123 - Interior Painting: Identification painting.

1.03 REFERENCE STANDARDS

- A. ASME A13.1 - Scheme for the Identification of Piping Systems; 2015.
- B. ASTM D709 - Standard Specification for Laminated Thermosetting Materials; 2017.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. List: Submit list of wording, symbols, letter size, and color coding for mechanical identification.
- C. Chart and Schedule: Submit valve chart and schedule, including valve tag number, location, function, and valve manufacturer's name and model number.
- D. Product Data: Provide manufacturers catalog literature for each product required.

PART 2 PRODUCTS

2.01 IDENTIFICATION APPLICATIONS

- A. Air Handling Units: Nameplates.
- B. Air Terminal Units: Tags.
- C. Automatic Controls: Tags. Key to control schematic.
- D. Dampers: Ceiling tacks, where located above lay-in ceiling.
- E. Ductwork: Nameplates.
- F. Heat Transfer Equipment: Nameplates.
- G. Instrumentation: Tags.
- H. Piping: Tags.
- I. Pumps: Nameplates.
- J. Relays: Tags.
- K. Thermostats: Nameplates.
- L. Valves: Tags and ceiling tacks where located above lay-in ceiling.

2.02 NAMEPLATES

- A. Manufacturers:
 - 1. Advanced Graphic Engraving, LLC: www.advancedgraphicengraving.com/#sle.
 - 2. Brimar Industries, Inc: www.pipemarker.com/#sle.
 - 3. Craftmark Pipe Markers: www.craftmarkid.com/#sle.
 - 4. Substitutions: See Section 01 6000 - Product Requirements.
- B. Letter Color: White.
- C. Letter Height: 1/4 inch (6 mm).
- D. Background Color: Black.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- E. Plastic: Comply with ASTM D709.

2.03 TAGS

- A. Manufacturers:
1. Advanced Graphic Engraving: www.advancedgraphicengraving.com/#sle.
 2. Brady Corporation: www.bradycorp.com/#sle.
 3. Brimar Industries, Inc: www.pipemarker.com/#sle.
 4. Substitutions: See Section 01 6000 - Product Requirements.
- B. Plastic Tags: Laminated three-layer plastic with engraved black letters on light contrasting background color. Tag size minimum 1-1/2 inch (40 mm) diameter.
- C. Metal Tags: Brass with stamped letters; tag size minimum 1-1/2 inch (40 mm) diameter with smooth edges.

2.04 PIPE MARKERS

- A. Color: Comply with ASME A13.1.
- B. Plastic Pipe Markers: Factory fabricated, flexible, semi- rigid plastic, preformed to fit around pipe or pipe covering; minimum information indicating flow direction arrow and identification of fluid being conveyed.
- C. Plastic Tape Pipe Markers: Flexible, vinyl film tape with pressure sensitive adhesive backing and printed markings.

2.05 CEILING TACKS

- A. Description: Steel with 3/4 inch (20 mm) diameter color coded head.
- B. Color code as follows:
1. HVAC Equipment: Yellow.
 2. Fire Dampers and Smoke Dampers: Red.
 3. Heating/Cooling Valves: Blue.

PART 3 EXECUTION

3.01 PREPARATION

- A. Degrease and clean surfaces to receive adhesive for identification materials.

3.02 INSTALLATION

- A. Install nameplates with corrosive-resistant mechanical fasteners, or adhesive. Apply with sufficient adhesive to ensure permanent adhesion and seal with clear lacquer.
- B. Install tags with corrosion resistant chain.
- C. Install plastic pipe markers in accordance with manufacturer's instructions.
- D. Install plastic tape pipe markers complete around pipe in accordance with manufacturer's instructions.
- E. Install underground plastic pipe markers 6 to 8 inches (150 to 200 mm) below finished grade, directly above buried pipe.
- F. Use tags on piping 3/4 inch (20 mm) diameter and smaller.
1. Identify service, flow direction, and pressure.
 2. Install in clear view and align with axis of piping.
 3. Locate identification not to exceed 20 feet (6 m) on straight runs including risers and drops, adjacent to each valve and Tee, at each side of penetration of structure or enclosure, and at each obstruction.
- G. Install ductwork with plastic nameplates. Identify with air handling unit identification number and area served. Locate identification at air handling unit, at each side of penetration of structure or enclosure, and at each obstruction.
- H. Locate ceiling tacks to locate valves or dampers above lay-in panel ceilings. Locate in corner of panel closest to equipment.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3.03 SCHEDULE

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 23 0593

TESTING, ADJUSTING, AND BALANCING FOR HVAC

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Testing, adjustment, and balancing of air systems.
- B. Testing, adjustment, and balancing of refrigerating systems.
- C. Measurement of final operating condition of HVAC systems.
- D. Commissioning activities.

1.02 RELATED REQUIREMENTS

- A. Section 01 4000 - Quality Requirements: Employment of testing agency and payment for services.

1.03 REFERENCE STANDARDS

- A. AABC (NSTSB) - AABC National Standards for Total System Balance, 7th Edition; 2016.
- B. ASHRAE Std 111 - Measurement, Testing, Adjusting, and Balancing of Building HVAC Systems; 2008 (Reaffirmed 2017).
- C. NEBB (TAB) - Procedural Standards for Testing Adjusting and Balancing of Environmental Systems; 2015, with Errata (2017).
- D. SMACNA (TAB) - HVAC Systems Testing, Adjusting and Balancing; 2002.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. TAB Plan: Submit a written plan indicating the testing, adjusting, and balancing standard to be followed and the specific approach for each system and component.
 - 1. Include at least the following in the plan:
 - a. List of all air flow, water flow, sound level, system capacity and efficiency measurements to be performed and a description of specific test procedures, parameters, formulas to be used.
 - b. Copy of field checkout sheets and logs to be used, listing each piece of equipment to be tested, adjusted and balanced with the data cells to be gathered for each.
 - c. Discussion of what notations and markings will be made on the duct and piping drawings during the process.
 - d. Final test report forms to be used.
 - e. Procedures for formal deficiency reports, including scope, frequency and distribution.
- C. Control System Coordination Reports: Communicate in writing to the controls installer all setpoint and parameter changes made or problems and discrepancies identified during TAB that affect, or could affect, the control system setup and operation.
- D. Final Report: Indicate deficiencies in systems that would prevent proper testing, adjusting, and balancing of systems and equipment to achieve specified performance.
 - 1. Revise TAB plan to reflect actual procedures and submit as part of final report.
 - 2. Submit draft copies of report for review prior to final acceptance of Project. Provide final copies for Architect and for inclusion in operating and maintenance manuals.
 - 3. Include actual instrument list, with manufacturer name, serial number, and date of calibration.
 - 4. Form of Test Reports: Where the TAB standard being followed recommends a report format use that; otherwise, follow ASHRAE Std 111.
 - 5. Units of Measure: Report data in both I-P (inch-pound) and SI (metric) units.
- E. Project Record Documents: Record actual locations of flow measuring stations and balancing valves and rough setting.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 GENERAL REQUIREMENTS

- A. Perform total system balance in accordance with one of the following:
 - 1. SMACNA (TAB).
 - 2. Maintain at least one copy of the standard to be used at project site at all times.
- B. Begin work after completion of systems to be tested, adjusted, or balanced and complete work prior to Substantial Completion of the project.
- C. Where HVAC systems and/or components interface with life safety systems, including fire and smoke detection, alarm, and control, coordinate scheduling and testing and inspection procedures with the authorities having jurisdiction.
- D. TAB Agency Qualifications:
 - 1. Company specializing in the testing, adjusting, and balancing of systems specified in this section.

3.02 EXAMINATION

- A. Verify that systems are complete and operable before commencing work. Ensure the following conditions:
 - 1. Systems are started and operating in a safe and normal condition.
 - 2. Temperature control systems are installed complete and operable.
 - 3. Proper thermal overload protection is in place for electrical equipment.
 - 4. Final filters are clean and in place. If required, install temporary media in addition to final filters.
 - 5. Duct systems are clean of debris.
 - 6. Fans are rotating correctly.
 - 7. Fire and volume dampers are in place and open.
 - 8. Access doors are closed and duct end caps are in place.
 - 9. Air outlets are installed and connected.
 - 10. Duct system leakage is minimized.
 - 11. Service and balance valves are open.
- B. Beginning of work means acceptance of existing conditions.

3.03 PREPARATION

- A. Provide instruments required for testing, adjusting, and balancing operations. Make instruments available to Architect to facilitate spot checks during testing.
- B. Provide additional balancing devices as required.

3.04 ADJUSTMENT TOLERANCES

- A. Air Handling Systems: Adjust to within plus or minus 5 percent of design for supply systems and plus or minus 10 percent of design for return and exhaust systems.
- B. Air Outlets and Inlets: Adjust total to within plus 10 percent and minus 5 percent of design to space. Adjust outlets and inlets in space to within plus or minus 10 percent of design.

3.05 RECORDING AND ADJUSTING

- A. Ensure recorded data represents actual measured or observed conditions.
- B. Permanently mark settings of valves, dampers, and other adjustment devices allowing settings to be restored. Set and lock memory stops.
- C. After adjustment, take measurements to verify balance has not been disrupted or that such disruption has been rectified.
- D. Leave systems in proper working order, replacing belt guards, closing access doors, closing doors to electrical switch boxes, and restoring thermostats to specified settings.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3.06 AIR SYSTEM PROCEDURE

- A. Adjust air handling and distribution systems to provide required or design supply, return, and exhaust air quantities at site altitude.
- B. Measure air quantities at air inlets and outlets.
- C. Adjust distribution system to obtain uniform space temperatures free from objectionable drafts and noise.
- D. Measure static air pressure conditions on air supply units, including filter and coil pressure drops, and total pressure across the fan. Make allowances for 50 percent loading of filters.
- E. Adjust outside air automatic dampers, outside air, return air, and exhaust dampers for design conditions.
- F. Measure temperature conditions across outside air, return air, and exhaust dampers to check leakage.
- G. Where modulating dampers are provided, take measurements and balance at extreme conditions. Balance variable volume systems at maximum air flow rate, full cooling, and at minimum air flow rate, full heating.

3.07 WATER SYSTEM PROCEDURE

- A. Adjust water systems to provide required or design quantities.

3.08 COMMISSIONING

- A. Perform prerequisites prior to starting commissioning activities.
- B. Fill out Prefunctional Checklists for:
 - 1. Air side systems.
 - 2. Water side systems.
- C. Furnish to the Commissioning Authority, upon request, any data gathered but not shown in the final TAB report.
- D. Re-check a random sample equivalent to 50 percent of the final TAB report data as directed by Commissioning Authority.
 - 1. Original TAB agency shall execute the re-checks, witnessed by the Commissioning Authority.
 - 2. Use the same test instruments as used in the original TAB work.
 - 3. Failure of more than 10 percent of the re-checked items of a given system shall result in the rejection of the system TAB report; rebalance the system, provide a new system TAB report, and repeat random re-checks.
 - 4. For purposes of re-check, failure is defined as follows:
 - a. Air Flow of Supply and Return: Deviation of more than 10 percent of instrument reading.
 - b. Minimum Outside Air Flow: Deviation of more than 20 percent of instrument reading; for inlet vane or VFD OSA compensation system using linear proportional control, deviation of more than 30 percent at intermediate supply flow.
 - c. Temperatures: Deviation of more than one degree F (0.5 degree C).
 - d. Air and Water Pressures: Deviation of more than 10 percent of full scale of test instrument reading.
 - e. Sound Pressures: Deviation of more than 3 decibels, with consideration for variations in background noise.
 - 5. For purposes of re-check, a whole system is defined as one in which inaccuracies will have little or no impact on connected systems; for example, the air distribution system served by one air handler or the hydronic chilled water supply system served by a chiller or the condenser water system.
- E. In the presence of the Commissioning Authority, verify that:
 - 1. Final settings of all valves, splitters, dampers and other adjustment devices have been permanently marked.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2. The air system is being controlled to the lowest possible static pressure while still meeting design loads, less diversity; this shall include a review of TAB methods, established control setpoints, and physical verification of at least one leg from fan to diffuser having all balancing dampers wide open and that during full cooling of all terminal units taking off downstream of the static pressure sensor, the terminal unit on the critical leg has its damper 90 percent or more open.
3. The water system is being controlled to the lowest possible pressure while still meeting design loads, less diversity; this shall include a review of TAB methods, established control setpoints, and physical verification of at least one leg from the pump to the coil having all balancing valves wide open and that during full cooling the cooling coil valve of that leg is 90 percent or more open.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 23 0713
DUCT INSULATION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Duct insulation.

1.02 RELATED REQUIREMENTS

- A. Section 01 6116 - Volatile Organic Compound (VOC) Content Restrictions.
- B. Section 07 8400 - Firestopping.
- C. Section 09 9113 - Exterior Painting: Painting insulation jackets.
- D. Section 09 9123 - Interior Painting: Painting insulation jackets.
- E. Section 22 0553 - Identification for Plumbing Piping and Equipment.
- F. Section 23 0553 - Identification for HVAC Piping and Equipment.
- G. Section 23 3100 - HVAC Ducts and Casings: Glass fiber ducts.

1.03 REFERENCE STANDARDS

- A. ASTM C518 - Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus; 2017.
- B. ASTM C553 - Standard Specification for Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications; 2013 (Reapproved 2019).
- C. ASTM C612 - Standard Specification for Mineral Fiber Block and Board Thermal Insulation; 2014 (Reapproved 2019).
- D. ASTM C916 - Standard Specification for Adhesives for Duct Thermal Insulation; 2020.
- E. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2020.
- F. ASTM E96/E96M - Standard Test Methods for Water Vapor Transmission of Materials; 2016.
- G. SMACNA (DCS) - HVAC Duct Construction Standards Metal and Flexible; 2005 (Revised 2009).
- H. UL 723 - Standard for Test for Surface Burning Characteristics of Building Materials; Current Edition, Including All Revisions.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide product description, thermal characteristics, list of materials and thickness for each service, and locations.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products of the type specified in this section with not less than three years of documented experience.
- B. Applicator Qualifications: Company specializing in performing the type of work specified in this section, with minimum 3 years of experience and approved by manufacturer.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Accept materials on site in original factory packaging, labelled with manufacturer's identification, including product density and thickness.
- B. Protect insulation from weather and construction traffic, dirt, water, chemical, and mechanical damage, by storing in original wrapping.

1.07 FIELD CONDITIONS

- A. Maintain ambient temperatures and conditions required by manufacturers of adhesives, mastics, and insulation cements.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Maintain temperature during and after installation for minimum period of 24 hours.

PART 2 PRODUCTS

2.01 REGULATORY REQUIREMENTS

- A. Surface Burning Characteristics: Flame spread index/Smoke developed index of 25/50, maximum, when tested in accordance with ASTM E84 or UL 723.

2.02 GLASS FIBER, FLEXIBLE

- A. Manufacturer:
1. CertainTeed Corporation: www.certainteed.com/#sle.
 2. Johns Manville; Mlcro FSK series: www.jm.com/#sle.
 3. Knauf Insulation: www.knaufinsulation.com/#sle.
 4. Owens Corning Corporation: www.ocbuildingspec.com/#sle.
 5. Substitutions: See Section 01 6000 - Product Requirements.
- B. Insulation: ASTM C553; flexible, noncombustible blanket.
1. Facing: FSK.
 2. Thickness: 13" minimum (R=8.3) in conditioned space.
 3. Thickness: 4-1/2" minimum (R=12.0) in unconditioned spaces
 4. K (Ksi) value: 0.23 & 0.22 at 75 degrees F (.35 at 24 degrees C), when tested in accordance with ASTM C518.
 5. Maximum Service Temperature: 250 degrees F (121 degrees C).
 6. Maximum Water Vapor Absorption: 5.0 percent by weight.
- C. Vapor Barrier Jacket:
1. Kraft paper with glass fiber yarn and bonded to aluminized film.
 2. Moisture Vapor Permeability: 0.02 perm inch (0.029 ng/Pa s m), when tested in accordance with ASTM E96/E96M.
 3. Secure with pressure sensitive tape.
- D. Vapor Barrier Tape:
1. Kraft paper reinforced with glass fiber yarn and bonded to aluminized film, with pressure sensitive rubber based adhesive.

2.03 GLASS FIBER, RIGID

- A. Insulation: ASTM C612; rigid, noncombustible blanket.
1. K (Ksi) Value: 0.24 at 75 degrees F (0.036 at 24 degrees C), when tested in accordance with ASTM C518.
 2. Maximum Water Vapor Absorption: 5.0 percent.
 3. Maximum Density: 8.0 lb/cu ft (128 kg/cu m).
- B. Vapor Barrier Jacket:
1. Kraft paper with glass fiber yarn and bonded to aluminized film.
 2. Moisture Vapor Permeability: 0.02 perm inch (0.029 ng/Pa s m), when tested in accordance with ASTM E96/E96M.
 3. Secure with pressure sensitive tape.
- C. Vapor Barrier Tape:
1. Kraft paper reinforced with glass fiber yarn and bonded to aluminized film, with pressure sensitive rubber based adhesive.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Test ductwork for design pressure prior to applying insulation materials.
- B. Verify that surfaces are clean, foreign material removed, and dry.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Install in accordance with NAIMA National Insulation Standards.
- C. Insulated Ducts Conveying Air Below & Above Ambient Temperature:
 - 1. Provide insulation with vapor barrier jackets.
 - 2. Finish with tape and vapor barrier jacket.
 - 3. Continue insulation through walls, sleeves, hangers, and other duct penetrations.
 - 4. Insulate entire system, including fittings, joints, flanges, fire dampers, flexible connections, and expansion joints.

3.03 SCHEDULES

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 23 0719
HVAC PIPING INSULATION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Piping insulation.
- B. Flexible removable and reusable blanket insulation.
- C. Jackets and accessories.
- D. Engineered wall outlet seals and refrigerant piping insulation protection.

1.02 RELATED REQUIREMENTS

- A. Section 01 6116 - Volatile Organic Compound (VOC) Content Restrictions.
- B. Section 07 8400 - Firestopping.
- C. Section 09 9123 - Interior Painting: Painting insulation jacket.
- D. Section 22 1005 - Plumbing Piping: Placement of hangers and hanger inserts.
- E. Section 23 2300 - Refrigerant Piping: Placement of inserts.

1.03 REFERENCE STANDARDS

- A. ASTM C547 - Standard Specification for Mineral Fiber Pipe Insulation; 2019.
- B. ASTM C552 - Standard Specification for Cellular Glass Thermal Insulation; 2017, with Editorial Revision (2018).
- C. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2020.
- D. UL 723 - Standard for Test for Surface Burning Characteristics of Building Materials; Current Edition, Including All Revisions.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the Products specified in this section with not less than three years of documented experience.
- B. Applicator Qualifications: Company specializing in performing the type of work specified in this section with minimum three years of experience.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Accept materials on site, labeled with manufacturer's identification, product density, and thickness.

1.07 FIELD CONDITIONS

- A. Maintain ambient conditions required by manufacturers of each product.
- B. Maintain temperature before, during, and after installation for minimum of 24 hours.

PART 2 PRODUCTS

2.01 REGULATORY REQUIREMENTS

- A. Surface Burning Characteristics: Flame spread index/Smoke developed index of 25/50, maximum, when tested in accordance with ASTM E84 or UL 723.

2.02 GLASS FIBER, FLEXIBLE

- A. Manufacturers:
 - 1. Manson Insulation.
- B. Insulation
 - 1. ASTM C547; Type, Type IV

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2. ASTM C585
 3. MIL-DTL-32585; Type I, Form 4, Facing A and D
 4. UL/ULC Classified
- C. Vapor Barrier Jacket:
1. UL 723/ASTM E84
 2. CGSB 51-GP-52M
 3. ASTM C1136; Type I, II
 4. NFPA 90A and 90B
- D. Fittings & Covers;
1. Use Proto 25/50 Rated (ASTM E84) PVC Fitting Covers, applying PVC fittings per Proto's Data Sheet.
 2. Fittings should be insulated to same thickness as the
 3. adjoining insulation.
 4. Apply fittings per manufacturer's instructions.
 5. When required by specification, a hard insert of sufficient length should be used to avoid compression of the insulation.
- E. Vapor Barrier Tape:
1. Tie Wire: Annealed steel, 16 gage, 0.0508 inch diameter (1.29 mm diameter).

PART 3 EXECUTION

3.01 EXAMINATION

- A. Test piping for design pressure, liquid tightness, and continuity prior to applying insulation materials.
- B. Verify that surfaces are clean and dry, with foreign material removed.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Install in accordance with NAIMA National Insulation Standards.
- C. Exposed Piping: Locate insulation and cover seams in least visible locations.
- D. Insulated Pipes Conveying Fluids Below Ambient Temperature:
 1. Insulate entire system, including fittings, valves, unions, flanges, strainers, flexible connections, pump bodies, and expansion joints.
- E. Glass Fiber Insulated Pipes Conveying Fluids Below Ambient Temperature:
 1. Provide vapor barrier jackets, factory-applied or field-applied; secure with self-sealing longitudinal laps and butt strips with pressure sensitive adhesive. Secure with outward clinch expanding staples and vapor barrier mastic.
 2. Insulate fittings, joints, and valves with molded insulation of like material and thickness as adjacent pipe. Finish with glass cloth and vapor barrier adhesive or PVC fitting covers.
- F. For hot piping conveying fluids 140 degrees F (60 degrees C) or less, do not insulate flanges and unions at equipment, but bevel and seal ends of insulation.
- G. Glass Fiber Insulated Pipes Conveying Fluids Above Ambient Temperature:
 1. Provide standard jackets, with or without vapor barrier, factory-applied, or field-applied. Secure with self-sealing longitudinal laps and butt strips with pressure-sensitive adhesive. Secure with outward clinch expanding staples.
 2. Insulate fittings, joints, and valves with insulation of like material and thickness as adjoining pipe. Finish with glass cloth and adhesive or PVC fitting covers.
- H. Continue insulation through walls, sleeves, pipe hangers, and other pipe penetrations. Finish at supports, protrusions, and interruptions. At fire separations, refer to Section 07 8400.
- I. Pipe Exposed in Mechanical Equipment Rooms or Finished Spaces (less than 10 feet (3 meters) above finished floor): Finish with canvas jacket sized for finish painting.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 23 0913

INSTRUMENTATION AND CONTROL DEVICES FOR HVAC

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Control Valves:
 - 1. Ball valves and actuators.
- B. Dampers.
- C. Damper Operators:
- D. Thermostats:
 - 1. Electric room thermostats.
 - 2. Room thermostat accessories.
- E. Flow Sensors:

1.02 RELATED REQUIREMENTS

- A. Section 23 3300 - Air Duct Accessories: Installation of automatic dampers.
- B. Section 26 0583 - Wiring Connections: Electrical characteristics and wiring connections.
- C. Section 26 2726 - Wiring Devices: Elevation of exposed components.

1.03 REFERENCE STANDARDS

- A. AMCA 500-D - Laboratory Methods of Testing Dampers for Rating; 2018.
- B. ANSI C12.1 - Electric Meters - Code for Electricity Metering; 2016.
- C. ANSI C12.10 - Physical Aspects of Watthour Meters - Safety Standard; 2011.
- D. ANSI C12.20 - American National Standard for Electricity Meters - 0.2 and 0.5 Accuracy Classes; 2015.
- E. ANSI/FCI 70-2 - Control Valve Seat Leakage; 2013.
- F. NEMA DC 3 - Residential Controls - Electrical Wall-Mounted Room Thermostats; 2013.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Preinstallation Meeting: Conduct a preinstallation meeting one week before starting work of this section; require attendance by all affected installers.
- B. Sequencing: Ensure that utility connections are achieved in an orderly and expeditious manner.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide description and engineering data for each control system component. Include sizing as requested. Provide data for each system component and software module.
- C. Shop Drawings: Indicate complete operating data, system drawings, wiring diagrams, and written detailed operational description of sequences. Submit schedule of valves indicating size, flow, and pressure drop for each valve. For automatic dampers indicate arrangement, velocities, and static pressure drops for each system.
- D. Manufacturer's Instructions: Provide for all manufactured components.
- E. Operation and Maintenance Data: Include inspection period, cleaning methods, recommended cleaning materials, and calibration tolerances.
- F. Project Record Documents: Record actual locations of control components, including panels, thermostats, and sensors. Accurately record actual location of control components, including panels, thermostats, and sensors.

1.06 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the Products specified in this section with minimum three years documented experience.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Installer Qualifications: Company specializing in performing the work of this section with minimum three years experience approved by manufacturer.

1.07 WARRANTY

- A. See Section 01 7800 - Closeout Submittals, for additional warranty requirements.
- B. Correct defective work within a five year period after Substantial Completion.
- C. Provide five year manufacturer's warranty for control air compressors.

PART 2 PRODUCTS

2.01 EQUIPMENT - GENERAL

- A. Products Requiring Electrical Connection: Listed and classified by Underwriters Laboratories Inc., as suitable for the purpose specified and indicated.

2.02 CONTROL VALVES

- A. Ball Valves and Actuators:
1. Service: Use for brine (30 percent glycol), chilled water, hot water, or steam at 15 to 25 psig (104.4 to 172.4).
 2. Flow Characteristic: Include 2-way and 3-way diverting operation configured to fail normally closed (NC).
 3. Replacements in Kind: Provide pressure-independent type.
 4. Rangeability: 500 to 1.
 5. ANSI Rating: Class 150.
 6. Leakage: Class IV (0.1 percent of rated capacity) per ANSI/FCI 70-2.
 7. Body Size:
 - a. Service Temperature:
 - 1) Fluid Side: 0 to 284 degrees F (0 to 140 degrees C) liquid or 25 psig (172.4 kPa) steam.
 - 2) Ambient Side: From minus 4 to 122 degrees F (minus 20 to 50 degrees C).
 8. Actuator Requirements:
 - a. Assembly: Factory-mounted.
 - b. Input: 0 to 5 VDC configured for proportional control.
 - c. Accessories: Provide with valve position indicator and manual override.

2.03 DAMPERS

- A. Performance: Test in accordance with AMCA 500-D.
- B. Frames: Galvanized steel, welded or riveted with corner reinforcement, minimum 12 gage, 0.1046 inch (2.66 mm).
- C. Blades: Galvanized steel, maximum blade size 8 inches (200 mm) wide, 48 inches (1200 mm) long, minimum 22 gage, 0.0299 inch (0.76 mm), attached to minimum 1/2 inch (13 mm) shafts with set screws.
- D. Jamb Seals: Spring stainless steel.
- E. Leakage: Less than one percent based on approach velocity of 2000 ft per min (10 m per sec) and 4 inches wg (1.0 kPa).
- F. Maximum Pressure Differential: 6 inches wg (1.5 kPa).
- G. Temperature Limits: Minus 40 to 200 degrees F (Minus 40 to 93 degrees C).

2.04 DAMPER OPERATORS

- A. General: Provide smooth proportional control with sufficient power for air velocities 20 percent greater than maximum design velocity and to provide tight seal against maximum system pressures. Provide spring return for two position control and for fail safe operation.
1. Provide sufficient number of operators to achieve unrestricted movement throughout damper range.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2.05 THERMOSTATS

- A. Electric Room Thermostats:
 - 1. Type: NEMA DC 3, 24 volts, with setback/setup temperature control.
 - 2. Service: Cooling and heating.
 - 3. Covers: Locking with set point adjustment, with thermometer.
- B. Room Thermostat Accessories:
 - 1. Thermostat Covers: Brushed aluminum.
 - 2. Insulating Bases: For thermostats located on exterior walls.
 - 3. Thermostat Guards: Metal mounted on separate base.
 - 4. Adjusting Key: As required for device.
 - 5. Aspirating Boxes: Where indicated for thermostats requiring flush installation.

2.06 FLOW SENSORS

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify that systems are ready to receive work.
- C. Beginning of installation means installer accepts existing conditions.
- D. Sequence work to ensure installation of components is complementary to installation of similar components in other systems.
- E. Coordinate installation of system components with installation of mechanical systems equipment such as air handling units and air terminal units.
- F. Ensure installation of components is complementary to installation of similar components.
- G. Coordinate installation of system components with installation of mechanical systems equipment such as air handling units and air terminal units.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Supply instrument air from compressor units through filter, pressure reducing valve, pressure relief valve, with pressure gauges, and shutoff and bypass valves.
- C. Install pressure reducing stations consisting of pressure reducing valve, particle filter, valve bypass, pressure gauge on inlet and outlet, and pressure relief valve.
- D. Check and verify location of thermostats with plans and room details before installation. Locate 60 inches (1500 mm) above floor. Align with lighting switches and humidistats. Refer to Section 26 2726.
- E. Provide guards on thermostats in entrances.
- F. Provide mixing dampers of opposed blade construction arranged to mix streams. Provide pilot positioners on mixed air damper motors.
- G. Install damper motors on outside of duct in warm areas. Do not install motors in locations at outdoor temperatures.
- H. Provide conduit and electrical wiring in accordance with Section 26 0583. Electrical material and installation shall be in accordance with appropriate requirements of Division 26.

3.03 MAINTENANCE

- A. See Section 01 7000 - Execution and Closeout Requirements, for additional requirements relating to maintenance service.
- B. Provide service and maintenance of control system for one year from Date of Substantial Completion.
- C. Provide complete service of controls systems, including call backs, and submit written report of each service call.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3.04 SCHEDULES

- A. See Drawings; Plumbing, Fire Protection, Mechanical, Fire Alarm, & Electrical

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 23 1126
FACILITY LIQUEFIED-PETROLEUM GAS PIPING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Pipe, pipe fittings, valves, and connections for propane gas piping systems.

1.02 RELATED REQUIREMENTS

- A. Section 07 8400 - Firestopping.
- B. Section 08 3100 - Access Doors and Panels.

1.03 REFERENCE STANDARDS

- A. ANSI Z21.18/CSA 6.3 - Gas Appliance Pressure Regulators; 2019.
- B. ANSI Z21.80/CSA 6.22 - Line Pressure Regulators; 2019.
- C. ANSI Z223.1 - National Fuel Gas Code; 2016.
- D. ASME BPVC-IX - Qualification Standard for Welding, Brazing, and Fusing Procedures; Welders; Brazers; and Welding, Brazing, and Fusing Operators - Welding Brazing and Fusing Qualifications; 2019.
- E. ASME B16.3 - Malleable Iron Threaded Fittings: Classes 150 and 300; 2016.
- F. ASME B31.1 - Power Piping; 2018.
- G. ASME B31.9 - Building Services Piping; 2017.
- H. ASTM A53/A53M - Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless; 2018.
- I. ASTM A234/A234M - Standard Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High Temperature Service; 2019.
- J. ASTM F708 - Standard Practice for Design and Installation of Rigid Pipe Hangers; 1992, with Editorial Revision (2018).
- K. AWS D1.1/D1.1M - Structural Welding Code - Steel; 2015, with Errata (2016).
- L. AWWA C105/A21.5 - Polyethylene Encasement for Ductile-Iron Pipe Systems; 2010.
- M. MSS SP-58 - Pipe Hangers and Supports - Materials, Design, Manufacture, Selection, Application, and Installation; 2018.
- N. MSS SP-78 - Cast Iron Plug Valves, Flanged and Threaded Ends; 2011.
- O. MSS SP-110 - Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends; 2010.
- P. NFPA 58 - Liquefied Petroleum Gas Code; 2020.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.

1.05 QUALITY ASSURANCE

- A. Perform work in accordance with applicable codes.
- B. Valves: Manufacturer's name and pressure rating marked on valve body.
- C. Welding Materials and Procedures: Comply with ASME BPVC-IX and applicable state labor regulations.
- D. Welder Qualifications: Certified in accordance with ASME BPVC-IX.
- E. Identify pipe with marking including size, ASTM material classification, and ASTM specification.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Accept valves on site in shipping containers with labeling in place. Inspect for damage.
- B. Provide temporary protective coating on cast iron and steel valves.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- C. Provide temporary end caps and closures on piping and fittings. Maintain in place until installation.
- D. Protect piping systems from entry of foreign materials by temporary covers, completing sections of the work, and isolating parts of completed system.

1.07 FIELD CONDITIONS

- A. Do not install underground piping when bedding is wet or frozen.

PART 2 PRODUCTS

2.01 PROPANE GAS PIPING, BURIED BEYOND 5 FEET (1500 MM) OF BUILDING

- A. Steel Pipe: ASTM A53/A53M Schedule 40 black.
 - 1. Fittings: ASTM A234/A234M, wrought steel welding type, with AWWA C105/A21.5 polyethylene jacket or double layer, half-lapped 10 mil (0.25 mm) polyethylene tape.
 - 2. Joints: ASME B31.1, welded.

2.02 PROPANE GAS PIPING, BURIED WITHIN 5 FEET (1500 MM) OF BUILDING

- A. Steel Pipe: ASTM A53/A53M Schedule 40 black.
 - 1. Fittings: ASTM A234/A234M, wrought steel welding type, with AWWA C105/A21.5 polyethylene jacket or double layer, half-lapped 10 mil (0.25 mm) polyethylene tape.
 - 2. Joints: ASME B31.1, welded.

2.03 PROPANE GAS PIPING, ABOVE GRADE

- A. Steel Pipe: ASTM A53/A53M Schedule 40 black.
 - 1. Fittings: ASME B16.3, malleable iron, or ASTM A234/A234M, wrought steel welding type.
 - 2. Joints: NFPA 58, threaded or welded to ASME B31.1.

2.04 FLANGES, UNIONS, AND COUPLINGS

- A. Unions for Pipe Sizes 3 Inches (80 mm) and Under:
 - 1. Ferrous Pipe: Class 150 malleable iron threaded unions.
- B. Flanges for Pipe Size Over 1 Inch (25 mm):
 - 1. Ferrous Pipe: Class 150 malleable iron threaded or forged steel slip-on flanges; preformed neoprene gaskets.

2.05 PIPE HANGERS AND SUPPORTS

- A. Provide hangers and supports that comply with MSS SP-58.
 - 1. If type of hanger or support for a particular situation is not indicated, select appropriate type using MSS SP-58 recommendations.
 - 2. Overhead Supports: Individual steel rod hangers attached to structure or to trapeze hangers.
 - 3. Trapeze Hangers: Welded steel channel frames attached to structure.
 - 4. Vertical Pipe Support: Steel riser clamp.

2.06 LINE PRESSURE REGULATORS AND APPLIANCE REGULATORS INDICATORS

- A. Manufacturers:
 - 1. Substitutions: See Section 01 6000 - Product Requirements.
- B. Compliance Requirements:
 - 1. Appliance Regulator: ANSI Z21.18/CSA 6.3.
 - 2. Line Pressure Regulator: ANSI Z21.80/CSA 6.22.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that excavations are to required grade, dry, and not over-excavated.

3.02 PREPARATION

- A. Ream pipe and tube ends. Remove burrs. Bevel plain end ferrous pipe.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Remove scale and dirt, on inside and outside, before assembly.
- C. Prepare piping connections to equipment with flanges or unions.

3.03 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Pipe Hangers and Supports:
 - 1. Install in accordance with ASME B31.9.
 - 2. Install hangers to provide minimum 1/2 inch (15 mm) space between finished covering and adjacent work.
 - 3. Place hangers within 12 inches (300 mm) of each horizontal elbow.
 - 4. Use hangers with 1-1/2 inch (40 mm) minimum vertical adjustment. Design hangers for pipe movement without disengagement of supported pipe.
 - 5. Support vertical piping at every floor. Support riser piping independently of connected horizontal piping.
 - 6. Where several pipes can be installed in parallel and at same elevation, provide multiple or trapeze hangers.
 - 7. Provide hangers adjacent to motor driven equipment with vibration isolation; see Section 23 0548.

3.04 APPLICATION

- A. Install unions downstream of valves and at equipment or apparatus connections.
- B. Install brass male adapters each side of valves in copper piped system. Solder adapters to pipe.
- C. Install gate valves for shut-off and to isolate equipment, part of systems, or vertical risers.
- D. Install globe valves for throttling, bypass, or manual flow control services.
- E. Provide plug valves in natural gas systems for shut-off service.

3.05 SERVICE CONNECTIONS

- A. Provide new gas service complete with gas meter and regulators in accordance with Section 33 5216. Gas service distribution piping to have initial minimum pressure of 7 inch wg (1.75 kPa). Provide regulators on each line serving gravity type appliances, sized in accordance with equipment.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 23 3100
HVAC DUCTS AND CASINGS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Metal ductwork.
- B. Nonmetal ductwork.
- C. Casing and plenums.
- D. Kitchen hood ductwork.
- E. Duct cleaning.

1.02 RELATED REQUIREMENTS

- A. Section 01 6116 - Volatile Organic Compound (VOC) Content Restrictions.
- B. Section 09 9123 - Interior Painting: Weld priming, paint or coating.
- C. Section 23 0713 - Duct Insulation: External insulation and duct liner.
- D. Section 23 3300 - Air Duct Accessories.
- E. Section 23 3700 - Air Outlets and Inlets.

1.03 REFERENCE STANDARDS

- A. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2020.
- B. ASTM A1008/A1008M - Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Bake Hardenable; 2018.
- C. ASTM A1011/A1011M - Standard Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength; 2018a.
- D. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2020.
- E. NFPA 90A - Standard for the Installation of Air-Conditioning and Ventilating Systems; 2018.
- F. NFPA 90B - Standard for the Installation of Warm Air Heating and Air-Conditioning Systems; 2018.
- G. NFPA 96 - Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations; 2017.
- H. SMACNA (DCS) - HVAC Duct Construction Standards Metal and Flexible; 2005 (Revised 2009).
- I. SMACNA (KVS) - Kitchen Ventilation Systems and Food Service Equipment Fabrication and Installation Guidelines; 2001.
- J. UL 181 - Standard for Factory-Made Air Ducts and Air Connectors; current edition, including all revisions.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data for duct materials.
- C. Shop Drawings: Indicate duct fittings, particulars such as gages, sizes, welds, and configuration prior to start of work for Ducts systems.
- D. Manufacturer's Certificate: Certify that installation of glass fiber ductwork meet or exceed specified requirements.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the type of products specified in this section, with minimum three years of documented experience, and approved by manufacturer.
- B. Installer Qualifications: Company specializing in performing the type of work specified in this section, with minimum three years of documented experience.

1.06 FIELD CONDITIONS

- A. Do not install duct sealants when temperatures are less than those recommended by sealant manufacturers.
- B. Maintain temperatures within acceptable range during and after installation of duct sealants.

PART 2 PRODUCTS

2.01 DUCT ASSEMBLIES

- A. Regulatory Requirements: Construct ductwork to comply with NFPA 90A standards.
- B. Ducts: Galvanized steel, unless otherwise indicated.
- C. Low Pressure Supply (System with Cooling Coils): 1/2 inch w.g. (125 Pa) pressure class, galvanized steel.
- D. General Exhaust: 1/2 inch w.g. (125 Pa) pressure class, galvanized steel.

2.02 MATERIALS

- A. Galvanized Steel for Ducts: Hot-dipped galvanized steel sheet, ASTM A653/A653M FS Type B, with G60/Z180 coating.
- B. Gasket Tape: Provide butyl rubber gasket tape for a flexible seal between transfer duct connector (TDC), transverse duct flange (TDF), applied flange connections, and angle rings connections.

2.03 DUCTWORK FABRICATION

- A. Fabricate and support in accordance with SMACNA (DCS) and as indicated.
- B. Provide duct material, gages, reinforcing, and sealing for operating pressures indicated.
- C. Increase duct sizes gradually, not exceeding 15 degrees divergence wherever possible; maximum 30 degrees divergence upstream of equipment and 45 degrees convergence downstream.
- D. Fabricate continuously welded round and oval duct fittings in accordance with SMACNA (DCS).

2.04 MANUFACTURED DUCTWORK AND FITTINGS

2.05 CASINGS

- A. Fabricate casings in accordance with SMACNA (DCS) and construct for operating pressures indicated.
- B. Mount floor mounted casings on 4 inch (100 mm) high concrete curbs. At floor, rivet panels on 8 inch (200 mm) centers to angles. Where floors are acoustically insulated, provide liner of galvanized 18 gage, 0.0478 inch (1.21 mm) expanded metal mesh supported at 12 inch (300 mm) centers, turned up 12 inches (300 mm) at sides with sheet metal shields.
- C. Reinforce door frames with steel angles tied to horizontal and vertical plenum supporting angles. Install hinged access doors where indicated or required for access to equipment for cleaning and inspection.

2.06 KITCHEN HOOD EXHAUST DUCTWORK

- A. Fabricate in accordance with ductwork manufacturer's installation instructions, SMACNA (DCS), SMACNA (KVS), and NFPA 96.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install, support, and seal ducts in accordance with SMACNA (DCS).
- B. Install in accordance with manufacturer's instructions.
- C. During construction provide temporary closures of metal or taped polyethylene on open ductwork to prevent construction dust from entering ductwork system.
- D. Flexible Ducts: Connect to metal ducts with adhesive.
- E. Duct sizes indicated are inside clear dimensions. For lined ducts, maintain sizes inside lining.
- F. Locate ducts with sufficient space around equipment to allow normal operating and maintenance activities.
- G. Use double nuts and lock washers on threaded rod supports.
- H. At exterior wall louvers, seal duct to louver frame and install blank-out panels.

3.02 CLEANING

- A. See Section 01 7419 - Construction Waste Management and Disposal, for additional requirements.
- B. Clean duct system and force air at high velocity through duct to remove accumulated dust. To obtain sufficient air, clean half the system at a time. Protect equipment that could be harmed by excessive dirt with temporary filters, or bypass during cleaning.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 23 3300
AIR DUCT ACCESSORIES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Air turning devices/extractors.
- B. Backdraft dampers - metal.
- C. Volume control dampers.
- D. Miscellaneous products:
 - 1. Damper operators.

1.02 RELATED REQUIREMENTS

- A. Section 07 8400 - Firestopping.
- B. Section 23 3100 - HVAC Ducts and Casings.
- C. Section 23 3700 : Pressure regulating damper assemblies
- D. Section 23 3600 - Air Terminal Units: Pressure regulating damper assemblies.
- E. Section 26 0583 - Wiring Connections: Electrical characteristics and wiring connections.

1.03 REFERENCE STANDARDS

- A. AMCA 500-D - Laboratory Methods of Testing Dampers for Rating; 2018.
- B. NFPA 90A - Standard for the Installation of Air-Conditioning and Ventilating Systems; 2018.
- C. NFPA 96 - Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations; 2017.
- D. SMACNA (DCS) - HVAC Duct Construction Standards Metal and Flexible; 2005 (Revised 2009).
- E. UL 555 - Standard for Fire Dampers; Current Edition, Including All Revisions.
- F. UL 555C - Standard for Safety Ceiling Dampers; 2014 (Revised 2017).
- G. UL 555S - Standard for Smoke Dampers; Current Edition, Including All Revisions.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the type of products specified in this section, with minimum three years of documented experience.
- B. Products Requiring Electrical Connection: Listed and classified by Underwriters Laboratories Inc. as suitable for the purpose specified and indicated.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Protect dampers from damage to operating linkages and blades.

PART 2 PRODUCTS

2.01 AIR TURNING DEVICES/EXTRACTORS

- A. Multi-blade device with blades aligned in short dimension; steel construction; with individually adjustable blades, mounting straps.
- B. Multi-blade device with radius blades attached to pivoting frame and bracket, steel construction, with push-pull operator strap.

2.02 BACKDRAFT DAMPERS - METAL

- A. Gravity Backdraft Dampers, Size 18 by 18 inches (450 by 450 mm) or Smaller, Furnished with Air Moving Equipment: Air moving equipment manufacturer's standard construction.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Multi-Blade, Parallel Action Gravity Balanced Backdraft Dampers: Galvanized steel, with center pivoted blades of maximum 6 inch (150 mm) width, with felt or flexible vinyl sealed edges, linked together in rattle-free manner with 90 degree stop, steel ball bearings, and plated steel pivot pin; adjustment device to permit setting for varying differential static pressure.
- C. Motor Operated Backdraft.

2.03 BACKDRAFT DAMPERS - FABRIC

- A. Fabric Backdraft Dampers: Factory-fabricated.
 - 1. Blades: Neoprene coated fabric material.
 - 2. Birdscreen: 1/2 inch (12 mm) nominal mesh of galvanized steel or aluminum.
 - 3. Maximum Velocity: 1000 fpm (5 mps) face velocity.

2.04 VOLUME CONTROL DAMPERS

- A. Fabricate in accordance with SMACNA (DCS) and as indicated.
- B. Single Blade Dampers:
 - 1. Fabricate for duct sizes up to 6 by 30 inch (150 by 760 mm).
- C. Multi-Blade Damper: Fabricate of opposed blade pattern with maximum blade sizes 8 by 72 inch (200 by 1825 mm). Assemble center and edge crimped blades in prime coated or galvanized channel frame with suitable hardware.
 - 1. Blade: 18 gage, 0.0478 inch (1.21 mm), minimum.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install accessories in accordance with manufacturer's instructions, NFPA 90A, and follow SMACNA (DCS). Refer to Section 23 3100 for duct construction and pressure class.
- B. Provide backdraft dampers on exhaust fans or exhaust ducts nearest to outside and where indicated.
- C. Provide duct access doors for inspection and cleaning before and after filters, coils, fans, automatic dampers, at fire dampers, combination fire and smoke dampers, and elsewhere as indicated. Provide for cleaning kitchen exhaust ducts in accordance with NFPA 96. Provide minimum 8 by 8 inch (200 by 200 mm) size for hand access, size for shoulder access, and as indicated. Provide 4 by 4 inch (100 by 100 mm) for balancing dampers only. Review locations prior to fabrication.
- D. Provide fire dampers, combination fire and smoke dampers, and smoke dampers at locations indicated, where ducts and outlets pass through fire rated components, and where required by Authorities Having Jurisdiction. Install with required perimeter mounting angles, sleeves, breakaway duct connections, corrosion resistant springs, bearings, bushings and hinges.
- E. Provide balancing dampers on high velocity systems where indicated. Refer to Section 23 3600 - Air Terminal Units.
- F. Provide balancing dampers on duct take-off to diffusers, grilles, and registers, regardless of whether dampers are specified as part of the diffuser, grille, or register assembly.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 23 3700
AIR OUTLETS AND INLETS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Diffusers:
 - 1. Rectangular ceiling diffusers.
- B. Registers/grilles:
 - 1. Ceiling-mounted, exhaust and return register/grilles.
 - 2. Ceiling-mounted, supply register/grilles.
 - 3. Wall-mounted, supply register/grilles.
 - 4. Wall-mounted, exhaust and return register/grilles.
- C. Door grilles.

1.02 RELATED REQUIREMENTS

- A. Section 09 9123 - Interior Painting: Painting of ducts visible behind outlets and inlets.
- B. Add Section 23 3100 HVAC Ducts and Ceilings.

1.03 REFERENCE STANDARDS

- A. AHRI 880 (I-P) - Performance Rating of Air Terminals; 2017.
- B. AMCA 500-L - Laboratory Methods of Testing Louvers for Rating; 2015.
- C. AMCA 511 - Certified Ratings Program for Air Control Devices; 2010.
- D. ASHRAE Std 70 - Method of Testing the Performance of Air Outlets and Inlets; 2006 (Reaffirmed 2011).
- E. ASHRAE Std 130 - Methods of Testing Air Terminal Units; 2016.
- F. UL 2518 - Standard for Safety Air Dispersion Systems; Current Edition, Including All Revisions.
- G. NFPA 90B - Standard for the Installation of Warm Air Heating and Air-Conditioning Systems; 2018.
- H. SMACNA (ASMM) - Architectural Sheet Metal Manual; 2012.
- I. SMACNA (DCS) - HVAC Duct Construction Standards Metal and Flexible; 2005 (Revised 2009).

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data for equipment required for this project. Review outlets and inlets as to size, finish, and type of mounting prior to submission. Submit schedule of outlets and inlets showing type, size, location, application, and noise level.

1.05 QUALITY ASSURANCE

- A. Test and rate air outlet and inlet performance in accordance with ASHRAE Std 70.
- B. Test and rate louver performance in accordance with AMCA 500-L.
- C. Manufacturer Qualifications: Company specializing in manufacturing the type of products specified in this section, with minimum three years of documented experience.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. American Louver Company; ALC Grilles and Registers: www.americanlouver.com/#sle.
- B. Price Industries: www.price-hvac.com/#sle.
- C. Ruskin Company: www.ruskin.com/#sle.
- D. Substitutions: See Section 01 6000 - Product Requirements.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2.02 RECTANGULAR CEILING DIFFUSERS

- A. Type: Provide square, stamped, multi-core, square, adjustable pattern, stamped, multi-core, square and rectangular, multi-louvered, square and rectangular, adjustable pattern, and multi-louvered diffuser to discharge air in 360 degree, one way, two way, three way, and four way pattern with sectorizing baffles where indicated.
- B. Connections: Round and rectangle, per schedule.
- C. Frame: Provide surface mount, snap-in, inverted T-bar, and spline type. In plaster ceilings, provide plaster frame and ceiling frame.
- D. Fabrication: Steel with baked enamel finish.
- E. Color: As selected by Architect from manufacturer's standard range.

2.03 CEILING SUPPLY REGISTERS/GRILLES

- A. Type: Streamlined and individually adjustable curved blades to discharge air along face of grille, one-way deflection.
- B. Frame: 1-1/4 inch (32 mm) margin with countersunk screw mounting and gasket.
- C. Color: As selected by Architect from manufacturer's standard range.
- D. Damper: Integral, gang-operated, opposed blade type with removable key operator, operable from face.

2.04 CEILING EXHAUST AND RETURN REGISTERS/GRILLES

- A. Type: Streamlined blades, 3/4 inch (19 mm) minimum depth, 3/4 inch (19 mm) maximum spacing, with blades set at 45 degrees, vertical face.
- B. Frame: 1-1/4 inch (32 mm) margin with countersunk screw mounting.
- C. Fabrication: Steel with 20 gage, 0.0359 inch (0.91 mm) minimum frames and 22 gage, 0.0299 inch (0.76 mm) minimum blades, steel and aluminum with 20 gage, 0.0359 inch (0.91 mm) minimum frame, or aluminum extrusions, with factory baked enamel finish.
- D. Color: To be selected by Architect from manufacturer's standard range.
- E. Damper: Integral, gang-operated, opposed blade type with removable key operator, operable from face where not individually connected to exhaust fans.

2.05 WALL SUPPLY REGISTERS/GRILLES

- A. Type: Streamlined and individually adjustable blades, 3/4 inch (19 mm) minimum depth, 3/4 inch (19 mm) maximum spacing with spring or other device to set blades, vertical face, single deflection.
- B. Fabrication: Steel with 20 gage, 0.0359 inch (0.91 mm) minimum frames and 22 gage, 0.0299 inch (0.76 mm) minimum blades, steel and aluminum with 20 gage, 0.0359 inch (0.91 mm) minimum frame, or aluminum extrusions, with factory baked enamel finish.
- C. Fabrication: Steel extrusions with factory clear lacquer finish.
- D. Color: To be selected by Architect from manufacturer's standard range.
- E. Damper: Integral, gang-operated opposed blade type with removable key operator, operable from face.

2.06 WALL EXHAUST AND RETURN REGISTERS/GRILLES

- A. Type: Streamlined blades, 3/4 inch (19 mm) minimum depth, 3/4 inch (19 mm) maximum spacing, with spring or other device to set blades, vertical face.
- B. Frame: 1-1/4 inch (32 mm) margin with countersunk screw mounting.
- C. Color: To be selected by Architect from manufacturer's standard range.
- D. Damper: Integral, gang-operated, opposed blade type with removable key operator, operable from face.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2.07 DOOR GRILLES

- A. Type: V-shaped louvers of 20 gage, 0.0359 inch (0.91 mm) thick steel, 1 inch (25 mm) deep on 1/2 inch (13 mm) centers.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Check location of outlets and inlets and make necessary adjustments in position to comply with architectural features, symmetry, and lighting arrangement.
- C. Install diffusers to ductwork with air tight connection.
- D. Provide balancing dampers on duct take-off to diffusers, and grilles and registers, despite whether dampers are specified as part of the diffuser, or grille and register assembly.
- E. Paint ductwork visible behind air outlets and inlets matte black. Refer to Section 09 9123.

3.02 AIR OUTLET AND INLET SCHEDULE

- A. See Mechanical Drawings.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 23 3813
COMMERCIAL-KITCHEN HOODS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Cooking hoods.
- B. Condensate (dishwashing) hoods.

1.02 RELATED REQUIREMENTS

- A. Section 11 4000 - Foodservice Equipment: General provisions for hoods.
- B. Section 22 1006 - Plumbing Piping Specialties: Floor drains for indirect discharge.
- C. Section 22 1006 - Plumbing Piping Specialties: Electrically-operated gas valve for cooking equipment.
- D. Section 26 0583 - Wiring Connections: Connections to building power system.

1.03 REFERENCE STANDARDS

- A. ASTM A666 - Standard Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar; 2015.
- B. NFPA 96 - Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations; 2017.
- C. SMACNA (KVS) - Kitchen Ventilation Systems and Food Service Equipment Fabrication and Installation Guidelines; 2001.
- D. UL 710 - Standard for Exhaust Hoods for Commercial Cooking Equipment; Current Edition, Including All Revisions.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Manufacturer's data sheets on each product to be used, including:
 - 1. Preparation instructions and recommendations.
 - 2. Storage and handling requirements and recommendations.
 - 3. Installation instructions, adjusting and balancing methods.
- C. Test Reports for Grease Extracting Hoods: Provide test reports substantiating exhaust volume ratings and grease extraction performance.
- D. Operation and Maintenance Data.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications:
 - 1. For grease extracting hoods, able to provide test data showing performance of hoods to be provided.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Store products in manufacturer's unopened packaging until ready for installation.

PART 2 PRODUCTS

2.01 HOOD TO BE PURCHASED BY OWNER, CONTRACTOR TO RECEIVE, STORE AND INSTALL.

- A. Contractor to coordinate with Owner.

2.02 HOOD APPLICATIONS

- A. Dishwashing Machine Hoods: Custom-fabricated condensate hood to fit machine.
 - 1. Make-up and exhaust ducts extending 6 inches (150 mm) above ceiling for connection by others.
 - 2. Existing dishwasher to be reused in new position & area.
 - 3. Hood Configuration and Size to be reutilized at new location.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

4. Ducting and roof penetration to be evaluated for reuse.
5. Modification to existing duct will be required by extending to connect to existing roof penetration.

2.03 HOOD CONSTRUCTION

- A. Provide products that comply with NFPA 96, the requirements and recommendations of SMACNA (KVS), and the requirements of the Authorities Having Jurisdiction.
- B. Cooking Hoods: Provide Type I hoods, with all external joints and seams continuously welded, liquid-tight, and all internal joints, seams, and attachments sealed liquid-tight and grease-tight.
 1. Provide fire extinguishing system for all cooking hoods.
 2. Provide complete assemblies listed and labeled by UL under UL 710 for its intended use.
- C. Condensate Hoods: Provide Type II hoods with all joints and seams liquid-tight.
 1. Inside the bottom perimeter provide an integral formed condensate gutter:
 2. Gutter Dimensions: 3 inches (75 mm) wide with one inch (25 mm) flange turned up at 45 degree angle.
 3. Drain: Stainless steel, one inch (25 mm) diameter, located in back corner of gutter.
 4. Pipe drain to nearest sink drainboard or floor drain.
- D. Construction: Materials, inside and out, are stainless steel complying with ASTM A666, Type 304, stretcher leveled; unless otherwise indicated.
 1. Sheet Thickness: 18 gauge, 0.048 inch (1.22 mm), minimum.
 2. Fabrication: Fabricate each individual hood in one piece, with all welds ground and finished to match (inside and out); fabricate flat surfaces exposed to view as double-pan formed panels with internal stiffener members.
 3. Finish on Surfaces Exposed to View: No.4 (brushed directional); provide stainless steel faces on all sides exposed to view.
 4. Finish on Concealed Surfaces: No.4 or No.2B (dull, matte).
 5. Duct Collars: For exhaust and make-up air openings, provide duct collar welded to hood unit; minimum of 8 inches (200 mm) extension from top or back face of unit, with minimum one inch (25 mm) 90 degree flange, unless otherwise indicated.
 6. Access Panels: Provide removable or hinged access panels sufficient for maintenance and replacement of operating components inside unit; maximum width of 40 inches (1000 mm).
 7. Supports: Stainless steel mounting brackets, struts, and threaded hanger rods.
 - a. Hanger Rods: 3/8 inch (9 mm) diameter, minimum.
 - b. Hanger Spacing: 48 inches (1220 mm) on center, maximum.
 - c. Attachment to Structure: Mechanical fittings or inserts, stainless steel.
- E. Exhaust Air Volume Control: For balancing; provide either built-in volume control damper or separate damper in exhaust duct.
- F. Make-Up Air System: Provide volume damper at inlet, accessible for balancing.
 1. Diffusers: Louvered register with opposed blade dampers.
 2. Plenum: Insulated with one inch (25 mm) thick foil-face fiberglass insulation, on inside of plenum.
- G. Fire Dampers: All stainless steel, positive closing with fully-enclosed spring assist.
 1. Reset Handle: Reset after actuation by pull handle located not more than 84 inches (2100 mm) above finished floor and not requiring removal of access panel.
 2. Fail-safe actuation by fusible link rated at 286 degrees F (141 degrees C).
 3. Additional actuation as specified.
 4. Provide fire dampers at exhaust outlets and make-up air inlets.

2.04 GREASE EXTRACTING HOODS

- A. Grease Extracting Hoods: Pre-engineered, factory-fabricated standard products; high-velocity centrifugal grease extraction without requiring filters, cartridges, moving parts, removable parts, or constantly running water, with grease collected in gutter piped to drain, and as specified above.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1. Performance: Remove 95 percent of extraneous matter in air stream at rated air velocity; provide substantiation.
2. Grease Extracting Baffles: Non-removable, adjustable for balancing.
3. Access Panels: Provide removable panels, with handles, for access to exhaust plenum for cleaning.
4. Label: Provide permanent label indicating rated exhaust performance.

2.05 HOOD ACCESSORIES

- A. Fire Extinguishing Systems:
 1. Fire extinguishing system to comply with NFPA 96.
 2. Exposed Piping Under Hood: Stainless steel or chrome plated.
 3. Exposed Piping Outside Hood: Not permitted.
 4. Nozzles: Stainless steel or chrome plated brass.
 5. Electrical Components: Provide all components required for properly operating system, including but not limited to wiring, raceways, contactors, circuit breakers, switches and solenoids.
 6. Manual Actuators: Wall-mounted pull stations; provide one near each hood and one near exit door.
- B. Controls:
 1. Fans: Provide manual push button controls for starting and stopping fans and labeled indicator lights showing fan status.
 2. Fans: Provide controls for fan operation by time clock, programmable by the week, capable of maintaining time cycle after operation of manual push buttons.
 3. Cooking Equipment: Provide manual shutoff and reset button located where indicated; combine with fire extinguishing actuation.
 4. Fire Dampers: Provide thermostatic actuation of fire damper at 350 degrees F (176 degrees C) air temperature in exhaust duct; upon actuation of fire damper, automatically:
 - a. Shut off fans serving that hood.
 - b. Shut off fuel source to equipment under hood; actuate solenoid gas valves provided as part of gas piping work.
 - c. Shut off electric power to equipment under hood; actuate contactors or switches provided as part of electrical work.
 - d. Signal building fire alarm system; normally-open contacts.
 5. Fire Extinguishing System: Provide automatic actuation complying with NFPA 96; provide local and remote manual actuating stations clearly labeled "Hood Fire Protection"; upon actuation of fire extinguishing system, automatically:
 - a. Shut off fans serving that hood.
 - b. Shut off fuel source to equipment under hood; actuate solenoid gas valves provided as part of gas piping work.
 - c. Shut off electric power to equipment under hood; actuate contactors or switches provided as part of electrical work.
 - d. Signal building fire alarm system; normally-open contacts.
- C. Control Panels: Factory assembled and pre-wired, ready for utility connections.
 1. UL listed for use with specific hood.
 2. Provide a single control panel combining all control functions for a particular hood, unless otherwise indicated.
 3. Provide a single control panel for each group of hoods served by a single exhaust fan.
 4. Enclosures: Flush-mounted; stainless steel, to match hood.
 5. Provide indicator lights on control panel door showing status of fans and power supply.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that overhead supports are installed in correct locations.
- B. Do not begin installation until substrates have been properly prepared.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- C. If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.

3.02 PREPARATION

- A. Clean surfaces thoroughly prior to installation.
- B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.

3.03 INSTALLATION

- A. Install in accordance with manufacturer's instructions and NFPA 96.
- B. Install hoods level and plumb, securely fastened, with seismic restraints as specified, and free of vibration during normal operation.
- C. Weld hood duct collars to ductwork, liquid-tight.
- D. Connect to utilities.

3.04 SYSTEM STARTUP

- A. Obtain the services of the manufacturer's representative experienced in the installation, adjustment, and operation of the equipment to supervise the starting and adjusting of equipment.
- B. Prepare equipment for startup, start and operate equipment for sufficient period to verify proper operation; correct equipment not operating correctly.
- C. Demonstrate operation to Owner's designated personnel.
- D. Report deficiencies in writing to Architect.

3.05 CLOSEOUT ACTIVITIES

- A. Conduct training of Owner's designated personnel in the operation and maintenance of equipment.
- B. Perform at least 2 hours of training, for minimum of 2 people, at project site.
- C. Arrange training sessions with Owner at least 2 weeks in advance.
- D. Have operation and maintenance data on hand for training sessions.

3.06 CLEANING

- A. Clean surfaces of equipment.

3.07 PROTECTION

- A. Protect installed products until completion of project.
- B. Touch-up, repair or replace damaged products before Date of Substantial Completion.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 26 0519

LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Single conductor building wire.
- B. Nonmetallic-sheathed cable.
- C. Underground feeder and branch-circuit cable.
- D. Service entrance cable.
- E. Armored cable.
- F. Metal-clad cable.
- G. Wiring connectors.
- H. Electrical tape.
- I. Heat shrink tubing.
- J. Oxide inhibiting compound.
- K. Wire pulling lubricant.
- L. Cable ties.
- M. Firestop sleeves.

1.02 RELATED REQUIREMENTS

- A. Section 07 8400 - Firestopping.
- B. Section 26 0526 - Grounding and Bonding for Electrical Systems: Additional requirements for grounding conductors and grounding connectors.
- C. Section 26 0553 - Identification for Electrical Systems: Identification products and requirements.
- D. Section 28 4600 - Fire Detection and Alarm: Fire alarm system conductors and cables.
- E. Section 31 2316 - Excavation.
- F. Section 31 2316.13 - Trenching: Excavating, bedding, and backfilling.
- G. Section 31 2323 - Fill: Bedding and backfilling.

1.03 REFERENCE STANDARDS

- A. ASTM B3 - Standard Specification for Soft or Annealed Copper Wire; 2013 (Reapproved 2018).
- B. ASTM B8 - Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft; 2011 (Reapproved 2017).
- C. ASTM B33 - Standard Specification for Tin-Coated Soft or Annealed Copper Wire for Electrical Purposes; 2010, with Editorial Revision (2020).
- D. ASTM B787/B787M - Standard Specification for 19 Wire Combination Unilay-Stranded Copper Conductors for Subsequent Insulation; 2004 (Reapproved 2020).
- E. ASTM D3005 - Standard Specification for Low-Temperature Resistant Vinyl Chloride Plastic Pressure-Sensitive Electrical Insulating Tape; 2017.
- F. FS A-A-59544 - Cable and Wire, Electrical (Power, Fixed Installation); Federal Specification; 2008a (Validated 2019).
- G. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2015.
- H. NECA 104 - Recommended Practice for Installing Aluminum Building Wire and Cable; 2012.
- I. NECA 120 - Standard for Installing Armored Cable (AC) and Metal-Clad Cable (MC); 2012.
- J. NECA 121 - Standard for Installing Nonmetallic-Sheathed Cable (Type NM-B) and Underground Feeder and Branch-Circuit Cable (Type UF); 2007.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- K. NEMA WC 70 - Power Cables Rated 2000 Volts or Less for the Distribution of Electrical Energy; 2009.
- L. NETA ATS - Acceptance Testing Specifications for Electrical Power Equipment and Systems; 2017.
- M. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- N. UL 4 - Armored Cable; Current Edition, Including All Revisions.
- O. UL 44 - Thermoset-Insulated Wires and Cables; Current Edition, Including All Revisions.
- P. UL 83 - Thermoplastic-Insulated Wires and Cables; Current Edition, Including All Revisions.
- Q. UL 486A-486B - Wire Connectors; Current Edition, Including All Revisions.
- R. UL 486C - Splicing Wire Connectors; Current Edition, Including All Revisions.
- S. UL 486D - Sealed Wire Connector Systems; Current Edition, Including All Revisions.
- T. UL 493 - Thermoplastic-Insulated Underground Feeder and Branch-Circuit Cables; Current Edition, Including All Revisions.
- U. UL 510 - Polyvinyl Chloride, Polyethylene, and Rubber Insulating Tape; Current Edition, Including All Revisions.
- V. UL 719 - Nonmetallic-Sheathed Cables; Current Edition, Including All Revisions.
- W. UL 854 - Service-Entrance Cables; Current Edition, Including All Revisions.
- X. UL 1277 - Electrical Power and Control Tray Cables with Optional Optical-Fiber Members; Current Edition, Including All Revisions.
- Y. UL 1569 - Metal-Clad Cables; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate sizes of raceways, boxes, and equipment enclosures installed under other sections with the actual conductors to be installed, including adjustments for conductor sizes increased for voltage drop.
 - 2. Coordinate with electrical equipment installed under other sections to provide terminations suitable for use with the conductors to be installed.
 - 3. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for conductors and cables, including detailed information on materials, construction, ratings, listings, and available sizes, configurations, and stranding.
- C. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.
- D. Project Record Documents: Record actual installed circuiting arrangements. Record actual routing for underground circuits.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.
- C. Product Listing Organization Qualifications: An organization recognized by OSHA as a Nationally Recognized Testing Laboratory (NRTL) and acceptable to authorities having jurisdiction.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store conductors and cables in accordance with manufacturer's instructions.

1.08 FIELD CONDITIONS

- A. Do not install or otherwise handle thermoplastic-insulated conductors at temperatures lower than 14 degrees F (-10 degrees C), unless otherwise permitted by manufacturer's instructions. When installation below this temperature is unavoidable, notify Architect and obtain direction before proceeding with work.

PART 2 PRODUCTS

2.01 CONDUCTOR AND CABLE APPLICATIONS

- A. Do not use conductors and cables for applications other than as permitted by NFPA 70 and product listing.
- B. Provide single conductor building wire installed in suitable raceway unless otherwise indicated, permitted, or required.
- C. Nonmetallic-sheathed cable is permitted only as follows:
 - 1. Where not otherwise restricted, may be used:
 - a. For branch circuit wiring in dry locations within one- and two-family dwellings and their attached or detached garages, and their storage buildings.
 - b. For branch circuit wiring in dry locations within multifamily dwellings permitted to be of Types III, IV, and V construction.
 - 2. In addition to other applicable restrictions, may not be used:
 - a. Where exposed to view.
 - b. Where exposed to damage.
 - c. For damp, wet, or corrosive locations.
- D. Underground feeder and branch-circuit cable is permitted only as follows:
 - 1. Where not otherwise restricted, may be used:
 - a. For damp, wet, or corrosive locations as a substitute for NFPA 70, Type NMC nonmetallic-sheathed cable, when nonmetallic-sheathed cable is permitted.
- E. Service entrance cable is permitted only as follows:
 - 1. Where not otherwise restricted, may be used:
 - a. For underground service entrance, installed in raceway.
- F. Armored cable is permitted only as follows:
 - 1. Where not otherwise restricted, may be used:
 - a. Where concealed above accessible ceilings for final connections from junction boxes to luminaires.
 - b. Where concealed in hollow stud walls, above accessible ceilings, and under raised floors for branch circuits up to 20 A.
 - c. For general purpose, non-essential electrical systems in non-hazardous patient care areas of health care facilities, when provided with additional insulated grounding conductor for redundant grounding.
- G. Metal-clad cable is permitted only as follows:
 - 1. Where not otherwise restricted, may be used:
 - a. Where concealed above accessible ceilings for final connections from junction boxes to luminaires.
 - b. Where concealed in hollow stud walls, above accessible ceilings, and under raised floors for branch circuits up to 20 A.
- H. Manufactured wiring systems are to be reviewed through submittal process.

2.02 CONDUCTOR AND CABLE GENERAL REQUIREMENTS

- A. Provide products that comply with requirements of NFPA 70.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Provide products listed, classified, and labeled as suitable for the purpose intended.
- C. Unless specifically indicated to be excluded, provide all required conduit, boxes, wiring, connectors, etc. as required for a complete operating system.
- D. Comply with NEMA WC 70.
- E. Thermoplastic-Insulated Conductors and Cables: Listed and labeled as complying with UL 83.
- F. Thermoset-Insulated Conductors and Cables: Listed and labeled as complying with UL 44.
- G. Conductor Material:
 - 1. Copper Conductors: Soft drawn annealed, 98 percent conductivity, uncoated copper conductors complying with ASTM B3, ASTM B8, or ASTM B787/B787M unless otherwise indicated.
 - 2. Tinned Copper Conductors: Comply with ASTM B33.
- H. Conductor Color Coding:
 - 1. Color code conductors as indicated unless otherwise required by the authority having jurisdiction. Maintain consistent color coding throughout project.
 - 2. Color Coding Method: Integrally colored insulation.
 - 3. Color Code:
 - a. 480Y/277 V, 3 Phase, 4 Wire System:
 - 1) Phase A: Brown.
 - 2) Phase B: Orange.
 - 3) Phase C: Yellow.
 - 4) Neutral/Grounded: Gray.
 - b. 208Y/120 V, 3 Phase, 4 Wire System:
 - 1) Phase A: Black.
 - 2) Phase B: Red.
 - 3) Phase C: Blue.
 - 4) Neutral/Grounded: White.
 - c. 240/120 V High-Leg Delta, 3 Phase, 4 Wire System:
 - 1) Phase A: Black.
 - 2) Phase B (High-Leg): Orange.
 - 3) Phase C: Blue.
 - 4) Neutral/Grounded: White.
 - d. 240/120 V, 1 Phase, 3 Wire System:
 - 1) Phase A: Black.
 - 2) Phase B: Red.
 - 3) Neutral/Grounded: White.
 - e. Equipment Ground, All Systems: Green.
 - f. Isolated Ground, All Systems: Green with yellow stripe.

2.03 SINGLE CONDUCTOR BUILDING WIRE

- A. Description: Single conductor insulated wire.
- B. Conductor Stranding:
 - 1. Feeders and Branch Circuits:
 - a. Size 10 AWG and Smaller: Solid.
 - b. Size 8 AWG and Larger: Stranded.
 - 2. Control Circuits: Stranded.
- C. Insulation Voltage Rating: 600 V.
- D. Insulation:
 - 1. Copper Building Wire: Type THHN/THWN or THHN/THWN-2, except as indicated below.
 - a. Size 4 AWG and Larger: Type XHHW-2.
 - b. Installed Underground: Type XHHW-2.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2.04 NONMETALLIC-SHEATHED CABLE

- A. Description: NFPA 70, Type NM multiple-conductor cable listed and labeled as complying with UL 719, Type NM-B.
- B. Conductor Stranding:
 - 1. Size 10 AWG and Smaller: Solid.
 - 2. Size 8 AWG and Larger: Stranded.
- C. Insulation Voltage Rating: 600 V.

2.05 UNDERGROUND FEEDER AND BRANCH-CIRCUIT CABLE

- A. Description: NFPA 70, Type UF multiple-conductor cable listed and labeled as complying with UL 493, Type UF-B.
- B. Provide equipment grounding conductor unless otherwise indicated.
- C. Conductor Stranding:
 - 1. Size 10 AWG and Smaller: Solid.
 - 2. Size 8 AWG and Larger: Stranded.
- D. Insulation Voltage Rating: 600 V.

2.06 SERVICE ENTRANCE CABLE

- A. Service Entrance Cable for Underground Use: NFPA 70, Type USE single-conductor cable listed and labeled as complying with UL 854, Type USE-2, and with UL 44, Type RHH/RHW-2.
- B. Conductor Stranding: Stranded.
- C. Insulation Voltage Rating: 600 V.

2.07 ARMORED CABLE

- A. Description: NFPA 70, Type AC cable listed and labeled as complying with UL 4, and listed for use in classified firestop systems to be used.
- B. Conductor Stranding:
 - 1. Size 10 AWG and Smaller: Solid.
 - 2. Size 8 AWG and Larger: Stranded.
- C. Insulation Voltage Rating: 600 V.
- D. Insulation: Type THHN.
- E. Grounding: Combination of interlocking armor and integral bonding wire.
- F. Armor: Steel, interlocked tape.

2.08 METAL-CLAD CABLE

- A. Description: NFPA 70, Type MC cable listed and labeled as complying with UL 1569, and listed for use in classified firestop systems to be used.
- B. Conductor Stranding:
 - 1. Size 10 AWG and Smaller: Solid.
 - 2. Size 8 AWG and Larger: Stranded.
- C. Insulation Voltage Rating: 600 V.
- D. Insulation: Type THHN, THHN/THWN, or THHN/THWN-2.
- E. Grounding: Full-size integral equipment grounding conductor.
- F. Armor: Steel, interlocked tape.

2.09 WIRING CONNECTORS

- A. Description: Wiring connectors appropriate for the application, suitable for use with the conductors to be connected, and listed as complying with UL 486A-486B or UL 486C as applicable.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2.10 ACCESSORIES

- A. Electrical Tape:
 - 1. Vinyl Color Coding Electrical Tape: Integrally colored to match color code indicated; listed as complying with UL 510; minimum thickness of 7 mil (0.18 mm); resistant to abrasion, corrosion, and sunlight; suitable for continuous temperature environment up to 221 degrees F (105 degrees C).
 - 2. Vinyl Insulating Electrical Tape: Complying with ASTM D3005 and listed as complying with UL 510; minimum thickness of 7 mil (0.18 mm); resistant to abrasion, corrosion, and sunlight; conformable for application down to 0 degrees F (-18 degrees C) and suitable for continuous temperature environment up to 221 degrees F (105 degrees C).
- B. Heat Shrink Tubing: Heavy-wall, split-resistant, with factory-applied adhesive; rated 600 V; suitable for direct burial applications; listed as complying with UL 486D.
- C. Oxide Inhibiting Compound: Listed; suitable for use with the conductors or cables to be installed.
- D. Wire Pulling Lubricant: Listed; suitable for use with the conductors or cables to be installed and suitable for use at the installation temperature.
- E. Cable Ties: Material and tensile strength rating suitable for application.
- F. Sealing Systems for Roof Penetrations: Premanufactured components and accessories as required to preserve integrity of roofing system and maintain roof warranty; suitable for cables and roofing system to be installed; designed to accommodate existing penetrations where applicable.
- G. Firestop Sleeves: Listed; provide as required to preserve fire resistance rating of building elements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that interior of building has been protected from weather.
- B. Verify that work likely to damage wire and cable has been completed.
- C. Verify that raceways, boxes, and equipment enclosures are installed and are properly sized to accommodate conductors and cables in accordance with NFPA 70.
- D. Verify that field measurements are as indicated.
- E. Verify that conditions are satisfactory for installation prior to starting work.

3.02 PREPARATION

- A. Clean raceways thoroughly to remove foreign materials before installing conductors and cables.

3.03 INSTALLATION

- A. Circuiting Requirements:
 - 1. Unless dimensioned, circuit routing indicated is diagrammatic.
 - 2. When circuit destination is indicated without specific routing, determine exact routing required.
 - 3. Arrange circuiting to minimize splices.
 - 4. Maintain separation of wiring for emergency systems in accordance with NFPA 70.
 - 5. Circuiting Adjustments: Unless otherwise indicated, when branch circuits are indicated as separate, combining them together in a single raceway is not permitted.
 - 6. Common Neutrals: Unless otherwise indicated, sharing of neutral/grounded conductors among up to three single phase branch circuits of different phases installed in the same raceway is not permitted. Provide dedicated neutral/grounded conductor for each individual branch circuit.
 - 7. Provide oversized neutral/grounded conductors where indicated and as specified below.
 - a. Provide 200 percent rated neutral for feeders fed from K-rated transformers.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- b. Provide 200 percent rated neutral for feeders serving panelboards with 200 percent rated neutral bus.
- B. Install products in accordance with manufacturer's instructions.
- C. Perform work in accordance with NECA 1 (general workmanship).
- D. Install nonmetallic-sheathed cable (Type NM-B) in accordance with NECA 121.
- E. Install underground feeder and branch-circuit cable (Type UF-B) in accordance with NECA 121.
- F. Install armored cable (Type AC) in accordance with NECA 120.
- G. Install metal-clad cable (Type MC) in accordance with NECA 120.
- H. Installation in Raceway:
 - 1. Tape ends of conductors and cables to prevent infiltration of moisture and other contaminants.
 - 2. Pull all conductors and cables together into raceway at same time.
 - 3. Do not damage conductors and cables or exceed manufacturer's recommended maximum pulling tension and sidewall pressure.
 - 4. Use suitable wire pulling lubricant where necessary, except when lubricant is not recommended by the manufacturer.
- I. Paralleled Conductors: Install conductors of the same length and terminate in the same manner.
- J. Secure and support conductors and cables in accordance with NFPA 70 using suitable supports and methods approved by the authority having jurisdiction. Provide independent support from building structure. Do not provide support from raceways, piping, ductwork, or other systems.
- K. Terminate cables using suitable fittings.
 - 1. Armored Cable (Type AC):
 - a. Use listed fittings and anti-short, insulating bushings.
 - b. Cut cable armor only using specialized tools to prevent damaging conductors or insulation. Do not use hacksaw or wire cutters to cut armor.
 - 2. Metal-Clad Cable (Type MC):
 - a. Use listed fittings.
 - b. Cut cable armor only using specialized tools to prevent damaging conductors or insulation. Do not use hacksaw or wire cutters to cut armor.
- L. Install conductors with a minimum of 12 inches (300 mm) of slack at each outlet.
- M. Neatly train and bundle conductors inside boxes, wireways, panelboards and other equipment enclosures.
- N. Group or otherwise identify neutral/grounded conductors with associated ungrounded conductors inside enclosures in accordance with NFPA 70.
- O. Make wiring connections using specified wiring connectors.
 - 1. Make splices and taps only in accessible boxes. Do not pull splices into raceways or make splices in conduit bodies or wiring gutters.
 - 2. Remove appropriate amount of conductor insulation for making connections without cutting, nicking or damaging conductors.
 - 3. Do not remove conductor strands to facilitate insertion into connector.
 - 4. Clean contact surfaces on conductors and connectors to suitable remove corrosion, oxides, and other contaminates. Do not use wire brush on plated connector surfaces.
- P. Insulate splices and taps that are made with uninsulated connectors using methods suitable for the application, with insulation and mechanical strength at least equivalent to unspliced conductors.
- Q. Insulate ends of spare conductors using vinyl insulating electrical tape.
- R. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 8400.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- S. Unless specifically indicated to be excluded, provide final connections to all equipment and devices, including those furnished by others, as required for a complete operating system.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.
- B. Inspect and test in accordance with NETA ATS, except Section 4.
- C. Perform inspections and tests listed in NETA ATS, Section 7.3.2. The insulation resistance test is required for all conductors. The resistance test for parallel conductors listed as optional is not required.
- D. Correct deficiencies and replace damaged or defective conductors and cables.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 26 0526

GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Grounding and bonding requirements.
- B. Conductors for grounding and bonding.
- C. Connectors for grounding and bonding.
- D. Ground bars.
- E. Ground rod electrodes.

1.02 RELATED REQUIREMENTS

- A. Section 09 6500 - Resilient Flooring: Static control flooring.
- B. Section 09 6900 - Access Flooring.
- C. Section 26 0519 - Low-Voltage Electrical Power Conductors and Cables: Additional requirements for conductors for grounding and bonding, including conductor color coding.
- D. Section 26 0553 - Identification for Electrical Systems: Identification products and requirements.
- E. Section 26 5600 - Exterior Lighting: Additional grounding and bonding requirements for pole-mounted luminaires.

1.03 REFERENCE STANDARDS

- A. IEEE 81 - IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Grounding System; 2012.
- B. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2015.
- C. NEMA GR 1 - Grounding Rod Electrodes and Grounding Rod Electrode Couplings; 2017.
- D. NETA ATS - Acceptance Testing Specifications for Electrical Power Equipment and Systems; 2017.
- E. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- F. NFPA 780 - Standard for the Installation of Lightning Protection Systems; 2020.
- G. UL 467 - Grounding and Bonding Equipment; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Verify exact locations of underground metal water service pipe entrances to building.
 - 2. Coordinate the work with other trades to provide steel reinforcement complying with specified requirements for concrete-encased electrode.
 - 3. For signal reference grids, coordinate the work with access flooring furnished in accordance with Section 09 6900.
 - 4. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.
- B. Sequencing:
 - 1. Do not install ground rod electrodes until final backfill and compaction is complete.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for grounding and bonding system components.
- C. Shop Drawings:

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- D. Project Record Documents: Record actual locations of grounding electrode system components and connections.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store products in accordance with manufacturer's instructions.

PART 2 PRODUCTS

2.01 GROUNDING AND BONDING REQUIREMENTS

- A. Do not use products for applications other than as permitted by NFPA 70 and product listing.
- B. Unless specifically indicated to be excluded, provide all required components, conductors, connectors, conduit, boxes, fittings, supports, accessories, etc. as necessary for a complete grounding and bonding system.
- C. Where conductor size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.
- D. Grounding System Resistance:
1. Achieve specified grounding system resistance under normally dry conditions unless otherwise approved by Architect. Precipitation within the previous 48 hours does not constitute normally dry conditions.
 2. Grounding Electrode System: Not greater than 5 ohms to ground, when tested according to IEEE 81 using "fall-of-potential" method.
 3. Between Grounding Electrode System and Major Electrical Equipment Frames, System Neutral, and Derived Neutral Points: Not greater than 0.5 ohms, when tested using "point-to-point" methods.
- E. Grounding Electrode System:
1. Provide connection to required and supplemental grounding electrodes indicated to form grounding electrode system.
 - a. Provide continuous grounding electrode conductors without splice or joint.
 - b. Install grounding electrode conductors in raceway where exposed to physical damage. Bond grounding electrode conductor to metallic raceways at each end with bonding jumper.
 2. Metal Underground Water Pipe(s):
 - a. Provide connection to underground metal domestic and fire protection (where present) water service pipe(s) that are in direct contact with earth for at least 10 feet (3.0 m) at an accessible location not more than 5 feet (1.5 m) from the point of entrance to the building.
 - b. Provide bonding jumper(s) around insulating joints/pipes as required to make pipe electrically continuous.
 - c. Provide bonding jumper around water meter of sufficient length to permit removal of meter without disconnecting jumper.
 3. Ground Rod Electrode(s):
 - a. Provide two electrodes unless otherwise indicated or required.
 - b. Space electrodes not less than 6 feet (2 m) from each other and any other ground electrode.
 4. Provide additional ground electrode(s) as required to achieve specified grounding electrode system resistance.
 5. Ground Bar: Provide ground bar, separate from service equipment enclosure, for common connection point of grounding electrode system bonding jumpers as permitted in NFPA 70. Connect grounding electrode conductor provided for service-supplied system grounding to this ground bar.
 - a. Ground Bar Size: 1/4 by 2 by 12 inches (6 by 50 by 300 mm) unless otherwise indicated or required.
 - b. Where ground bar location is not indicated, locate in accessible location as near as possible to service disconnect enclosure.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

6. Ground Riser: Provide common grounding electrode conductor not less than 3/0 AWG for tap connections to multiple separately derived systems as permitted in NFPA 70.
- F. Grounding for Separate Building or Structure Supplied by Feeder(s) or Branch Circuits:
 1. Provide grounding electrode system for each separate building or structure.
 2. Provide equipment grounding conductor routed with supply conductors.
 3. For each disconnecting means, provide grounding electrode conductor to connect equipment ground bus to grounding electrode system.
 4. Do not make any connections and remove any factory-installed jumpers between neutral (grounded) conductors and ground.
- G. Separately Derived System Grounding:
 1. Separately derived systems include, but are not limited to:
 - a. Transformers (except autotransformers such as buck-boost transformers).
 - b. Uninterruptible power supplies (UPS), when configured as separately derived systems.
 - c. Generators, when neutral is switched in the transfer switch.
 2. Provide grounding electrode conductor to connect derived system grounded conductor to nearest effectively grounded metal building frame. Unless otherwise indicated, make connection at neutral (grounded) bus in source enclosure.
 3. Provide bonding jumper to connect derived system grounded conductor to nearest metal building frame and nearest metal water piping in the area served by the derived system, where not already used as a grounding electrode for the derived system. Make connection at same location as grounding electrode conductor connection.
 4. Provide system bonding jumper to connect system grounded conductor to equipment ground bus. Make connection at same location as grounding electrode conductor connection. Do not make any other connections between neutral (grounded) conductors and ground on load side of separately derived system disconnect.
 5. Where the source and first disconnecting means are in separate enclosures, provide supply-side bonding jumper between source and first disconnecting means.

2.02 GROUNDING AND BONDING COMPONENTS

- A. General Requirements:
 1. Provide products listed, classified, and labeled as suitable for the purpose intended.
 2. Provide products listed and labeled as complying with UL 467 where applicable.
- B. Conductors for Grounding and Bonding, in Addition to Requirements of Section 26 0526:
 1. Use insulated copper conductors unless otherwise indicated.
 - a. Exceptions:
 - 1) Use bare copper conductors where installed underground in direct contact with earth.
 - 2) Use bare copper conductors where directly encased in concrete (not in raceway).
- C. Connectors for Grounding and Bonding:
 1. Description: Connectors appropriate for the application and suitable for the conductors and items to be connected; listed and labeled as complying with UL 467.
 2. Unless otherwise indicated, use exothermic welded connections for underground, concealed and other inaccessible connections.
 3. Unless otherwise indicated, use mechanical connectors, compression connectors, or exothermic welded connections for accessible connections.
- D. Ground Bars:
 1. Description: Copper rectangular ground bars with mounting brackets and insulators.
 2. Size: As indicated.
 3. Holes for Connections: As indicated or as required for connections to be made.
- E. Ground Rod Electrodes:
 1. Comply with NEMA GR 1.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2. Material: Copper-bonded (copper-clad) steel.
3. Size: 3/4 inch (19 mm) diameter by 10 feet (3.0 m) length, unless otherwise indicated.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that work likely to damage grounding and bonding system components has been completed.
- B. Verify that field measurements are as indicated.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Perform work in accordance with NECA 1 (general workmanship).
- C. Ground Rod Electrodes: Unless otherwise indicated, install ground rod electrodes vertically. Where encountered rock prohibits vertical installation, install at 45 degree angle or bury horizontally in trench at least 30 inches (750 mm) deep in accordance with NFPA 70 or provide ground plates.
- D. Make grounding and bonding connections using specified connectors.
 1. Remove appropriate amount of conductor insulation for making connections without cutting, nicking or damaging conductors. Do not remove conductor strands to facilitate insertion into connector.
 2. Remove nonconductive paint, enamel, or similar coating at threads, contact points, and contact surfaces.
 3. Exothermic Welds: Make connections using molds and weld material suitable for the items to be connected in accordance with manufacturer's recommendations.
 4. Mechanical Connectors: Secure connections according to manufacturer's recommended torque settings.
 5. Compression Connectors: Secure connections using manufacturer's recommended tools and dies.
- E. Identify grounding and bonding system components in accordance with Section 26 0553.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.
- B. Inspect and test in accordance with NETA ATS except Section 4.
- C. Perform inspections and tests listed in NETA ATS, Section 7.13.
- D. Perform ground electrode resistance tests under normally dry conditions. Precipitation within the previous 48 hours does not constitute normally dry conditions.
- E. Investigate and correct deficiencies where measured ground resistances do not comply with specified requirements.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 26 0529

HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Support and attachment requirements and components for equipment, conduit, cable, boxes, and other electrical work.

1.02 RELATED REQUIREMENTS

- A. Section 03 3000 - Cast-in-Place Concrete: Concrete equipment pads.
- B. Section 26 0533.13 - Conduit for Electrical Systems: Additional support and attachment requirements for conduits.
- C. Section 26 0533.16 - Boxes for Electrical Systems: Additional support and attachment requirements for boxes.
- D. Section 26 5100 - Interior Lighting: Additional support and attachment requirements for interior luminaires.
- E. Section 26 5600 - Exterior Lighting: Additional support and attachment requirements for exterior luminaires.

1.03 REFERENCE STANDARDS

- A. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products; 2017.
- B. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware; 2016a.
- C. ASTM B633 - Standard Specification for Electrodeposited Coatings of Zinc on Iron and Steel; 2019.
- D. MFMA-4 - Metal Framing Standards Publication; 2004.
- E. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2015.
- F. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- G. NFPA 101 - Life Safety Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate sizes and arrangement of supports and bases with the actual equipment and components to be installed.
 - 2. Coordinate the work with other trades to provide additional framing and materials required for installation.
 - 3. Coordinate compatibility of support and attachment components with mounting surfaces at the installed locations.
 - 4. Coordinate the arrangement of supports with ductwork, piping, equipment and other potential conflicts installed under other sections or by others.
 - 5. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.
- B. Sequencing:
 - 1. Do not install products on or provide attachment to concrete surfaces until concrete has fully cured in accordance with Section 03 3000.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1.06 QUALITY ASSURANCE

- A. Comply with NFPA 70.
- B. Comply with applicable building code.
- C. Maintain at the project site a copy of each referenced document that prescribes execution requirements.
- D. Installer Qualifications for Powder-Actuated Fasteners (when specified): Certified by fastener system manufacturer with current operator's license.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store products in accordance with manufacturer's instructions.

PART 2 PRODUCTS

2.01 SUPPORT AND ATTACHMENT COMPONENTS

- A. General Requirements:
 - 1. Provide all required hangers, supports, anchors, fasteners, fittings, accessories, and hardware as necessary for the complete installation of electrical work.
 - 2. Provide products listed, classified, and labeled as suitable for the purpose intended, where applicable.
 - 3. Where support and attachment component types and sizes are not indicated, select in accordance with manufacturer's application criteria as required for the load to be supported. Include consideration for vibration, equipment operation, and shock loads where applicable.
 - 4. Do not use products for applications other than as permitted by NFPA 70 and product listing.
 - 5. Steel Components: Use corrosion resistant materials suitable for the environment where installed.
 - a. Zinc-Plated Steel: Electroplated in accordance with ASTM B633.
 - b. Galvanized Steel: Hot-dip galvanized after fabrication in accordance with ASTM A123/A123M or ASTM A153/A153M.
- B. Conduit and Cable Supports: Straps, clamps, etc. suitable for the conduit or cable to be supported.
 - 1. Conduit Straps: One-hole or two-hole type; steel or malleable iron.
 - 2. Conduit Clamps: Bolted type unless otherwise indicated.
- C. Outlet Box Supports: Hangers, brackets, etc. suitable for the boxes to be supported.
- D. Metal Channel (Strut) Framing Systems: Factory-fabricated continuous-slot metal channel (strut) and associated fittings, accessories, and hardware required for field-assembly of supports.
 - 1. Comply with MFMA-4.
- E. Hanger Rods: Threaded zinc-plated steel unless otherwise indicated.
 - 1. Minimum Size, Unless Otherwise Indicated or Required:
 - a. Equipment Supports: 1/2 inch (13 mm) diameter.
 - b. Single Conduit up to 1 inch (27 mm) trade size: 1/4 inch (6 mm) diameter.
 - c. Single Conduit larger than 1 inch (27 mm) trade size: 3/8 inch (10 mm) diameter.
 - d. Outlet Boxes: 1/4 inch (6 mm) diameter.
 - e. Luminaires: 1/4 inch (6 mm) diameter.
- F. Anchors and Fasteners:
 - 1. Unless otherwise indicated and where not otherwise restricted, use the anchor and fastener types indicated for the specified applications.
 - 2. Concrete: Use preset concrete inserts, expansion anchors, or screw anchors.
 - 3. Wood: Use wood screws.
 - 4. Preset Concrete Inserts: Continuous metal channel (strut) and spot inserts specifically designed to be cast in concrete ceilings, walls, and floors.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- a. Comply with MFMA-4.
- b. Channel Material: Use galvanized steel.
- c. Manufacturer: Same as manufacturer of metal channel (strut) framing system.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that mounting surfaces are ready to receive support and attachment components.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Perform work in accordance with NECA 1 (general workmanship).
- C. Provide independent support from building structure. Do not provide support from piping, ductwork, or other systems.
- D. Unless specifically indicated or approved by Architect, do not provide support from suspended ceiling support system or ceiling grid.
- E. Unless specifically indicated or approved by Architect, do not provide support from roof deck.
- F. Do not penetrate or otherwise notch or cut structural members without approval of Structural Engineer.
- G. Equipment Support and Attachment:
 - 1. Use metal fabricated supports or supports assembled from metal channel (strut) to support equipment as required.
 - 2. Use metal channel (strut) secured to studs to support equipment surface-mounted on hollow stud walls when wall strength is not sufficient to resist pull-out.
 - 3. Use metal channel (strut) to support surface-mounted equipment in wet or damp locations to provide space between equipment and mounting surface.
 - 4. Securely fasten floor-mounted equipment. Do not install equipment such that it relies on its own weight for support.
- H. Preset Concrete Inserts: Use manufacturer provided closure strips to inhibit concrete seepage during concrete pour.
- I. Secure fasteners according to manufacturer's recommended torque settings.
- J. Remove temporary supports.
- K. Identify independent electrical component support wires above accessible ceilings (only where specifically indicated or permitted) with color distinguishable from ceiling support wires in accordance with NFPA 70.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.
- B. Inspect support and attachment components for damage and defects.
- C. Repair cuts and abrasions in galvanized finishes using zinc-rich paint recommended by manufacturer. Replace components that exhibit signs of corrosion.
- D. Correct deficiencies and replace damaged or defective support and attachment components.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 26 0533.13
CONDUIT FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Intermediate metal conduit (IMC).
- B. Electrical metallic tubing (EMT).
- C. Rigid polyvinyl chloride (PVC) conduit.
- D. Conduit fittings.
- E. Accessories.

1.02 RELATED REQUIREMENTS

- A. Section 03 3000 - Cast-in-Place Concrete: Concrete encasement of conduits.
- B. Section 07 8400 - Firestopping.
- C. Section 26 0519 - Low-Voltage Electrical Power Conductors and Cables: Metal clad cable (Type MC), armored cable (Type AC), and manufactured wiring systems, including uses permitted.
- D. Section 26 0526 - Grounding and Bonding for Electrical Systems.
 - 1. Includes additional requirements for fittings for grounding and bonding.
- E. Section 26 0529 - Hangers and Supports for Electrical Systems.
- F. Section 26 0533.16 - Boxes for Electrical Systems.
- G. Section 26 0553 - Identification for Electrical Systems: Identification products and requirements.
- H. Section 26 2100 - Low-Voltage Electrical Service Entrance: Additional requirements for electrical service conduits.
- I. Section 27 1000 - Structured Cabling: Additional requirements for communications systems conduits.
- J. Section 31 2316 - Excavation.
- K. Section 31 2316.13 - Trenching: Excavating, bedding, and backfilling.
- L. Section 31 2323 - Fill: Bedding and backfilling.

1.03 REFERENCE STANDARDS

- A. ANSI C80.1 - American National Standard for Electrical Rigid Steel Conduit (ERSC); 2015.
- B. ANSI C80.3 - American National Standard for Electrical Metallic Tubing -- Steel (EMT-S); 2015.
- C. ANSI C80.5 - American National Standard for Electrical Rigid Metal Conduit -- Aluminum (ERMC-A); 2015.
- D. ANSI C80.6 - American National Standard for Electrical Intermediate Metal Conduit (EIMC); 2018.
- E. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2015.
- F. NECA 101 - Standard for Installing Steel Conduits (Rigid, IMC, EMT); 2013.
- G. NECA 111 - Standard for Installing Nonmetallic Raceways (RNC, ENT, LFNC); 2017.
- H. NEMA FB 1 - Fittings, Cast Metal Boxes, and Conduit Bodies for Conduit, Electrical Metallic Tubing, and Cable; 2014.
- I. NEMA RN 1 - Polyvinyl-Chloride (PVC) Externally Coated Galvanized Rigid Steel Conduit and Intermediate Metal Conduit; 2018.
- J. NEMA TC 2 - Electrical Polyvinyl Chloride (PVC) Conduit; 2013.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- K. NEMA TC 3 - Polyvinyl Chloride (PVC) Fittings for Use with Rigid PVC Conduit and Tubing; 2016.
- L. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- M. UL 1 - Flexible Metal Conduit; Current Edition, Including All Revisions.
- N. UL 6 - Electrical Rigid Metal Conduit-Steel; Current Edition, Including All Revisions.
- O. UL 514B - Conduit, Tubing, and Cable Fittings; Current Edition, Including All Revisions.
- P. UL 651 - Schedule 40, 80, Type EB and A Rigid PVC Conduit and Fittings; Current Edition, Including All Revisions.
- Q. UL 797 - Electrical Metallic Tubing-Steel; Current Edition, Including All Revisions.
- R. UL 1203 - Explosion-Proof and Dust-Ignition-Proof Electrical Equipment for Use in Hazardous (Classified) Locations; Current Edition, Including All Revisions.
- S. UL 1242 - Electrical Intermediate Metal Conduit-Steel; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate minimum sizes of conduits with the actual conductors to be installed, including adjustments for conductor sizes increased for voltage drop.
 - 2. Coordinate the arrangement of conduits with structural members, ductwork, piping, equipment and other potential conflicts installed under other sections or by others.
 - 3. Verify exact conduit termination locations required for boxes, enclosures, and equipment installed under other sections or by others.
 - 4. Coordinate the work with other trades to provide roof penetrations that preserve the integrity of the roofing system and do not void the roof warranty.
 - 5. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.
- B. Sequencing:
 - 1. Do not begin installation of conductors and cables until installation of conduit is complete between outlet, junction and splicing points.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for conduits and fittings.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.
- B. Maintain at the project site a copy of each referenced document that prescribes execution requirements.
- C. Product Listing Organization Qualifications: An organization recognized by OSHA as a Nationally Recognized Testing Laboratory (NRTL) and acceptable to authorities having jurisdiction.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store conduit and fittings in accordance with manufacturer's instructions.

PART 2 PRODUCTS

2.01 CONDUIT APPLICATIONS

- A. Do not use conduit and associated fittings for applications other than as permitted by NFPA 70 and product listing.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Unless otherwise indicated and where not otherwise restricted, use the conduit types indicated for the specified applications. Where more than one listed application applies, comply with the most restrictive requirements. Where conduit type for a particular application is not specified, use galvanized steel rigid metal conduit.
- C. Underground:
 - 1. Under Slab on Grade: Use rigid PVC conduit, transition to intermediate metal conduit (IMC) where emerging from underground.
 - 2. Exterior, Direct-Buried: Use PVC-coated galvanized steel rigid metal conduit or rigid PVC conduit, transition to intermediate metal conduit (IMC) where emerging from underground.
 - 3. Exterior, Embedded Within Concrete: Use PVC-coated galvanized steel rigid metal conduit or rigid PVC conduit, transition to intermediate metal conduit (IMC) where emerging from underground.
 - 4. Where rigid polyvinyl (PVC) conduit is provided, transition to intermediate metal conduit (IMC) where emerging from underground.
- D. Embedded Within Concrete:
- E. Concealed Within Hollow Stud Walls: Use electrical metallic tubing (EMT).
- F. Interior, Damp or Wet Locations: Use intermediate metal conduit (IMC).
- G. Exposed, Interior, Not Subject to Physical Damage: Use electrical metallic tubing (EMT).
- H. Exposed, Interior, Subject to Physical Damage: Use intermediate metal conduit (IMC).
- I. Exposed, Exterior: Use intermediate metal conduit (IMC).
- J. Concealed, Exterior, Not Embedded in Concrete or in Contact With Earth: Use intermediate metal conduit (IMC).

2.02 CONDUIT REQUIREMENTS

- A. Communications Systems Conduits: Also comply with Section 27 1000.
- B. Fittings for Grounding and Bonding: Also comply with Section 26 0526.
- C. Provide all conduit, fittings, supports, and accessories required for a complete raceway system.
- D. Provide products listed, classified, and labeled as suitable for the purpose intended.
- E. Minimum Conduit Size, Unless Otherwise Indicated:
 - 1. Branch Circuits: 1/2 inch (16 mm) trade size.
 - 2. Branch Circuit Homeruns: 3/4 inch (21 mm) trade size.
 - 3. Control Circuits: 1/2 inch (16 mm) trade size.
 - 4. Flexible Connections to Luminaires: 3/8 inch (12 mm) trade size.
 - 5. Underground, Interior: 3/4 inch (21 mm) trade size.
 - 6. Underground, Exterior: 1 inch (27 mm) trade size.
- F. Where conduit size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.

2.03 INTERMEDIATE METAL CONDUIT (IMC)

- A. Description: NFPA 70, Type IMC galvanized steel intermediate metal conduit complying with ANSI C80.6 and listed and labeled as complying with UL 1242.
- B. Fittings:
 - 1. Manufacturers:
 - a. Bridgeport Fittings Inc: www.bptfittings.com/#sle.
 - b. O-Z/Gedney, a brand of Emerson Electric Co: www.emerson.com/#sle.
 - c. Thomas & Betts Corporation: www.tnb.com/#sle.
 - d. Substitutions: See Section 01 6000 - Product Requirements.
 - 2. Non-Hazardous Locations: Use fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
 - 3. Hazardous (Classified) Locations: Use fittings listed and labeled as complying with UL 1203 for the classification of the installed location.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

4. Material: Use steel or malleable iron.
 - a. Do not use die cast zinc fittings.
5. Connectors and Couplings: Use threaded type fittings only. Threadless set screw and compression (gland) type fittings are not permitted.

2.04 ELECTRICAL METALLIC TUBING (EMT)

- A. Manufacturers:
 1. Substitutions: See Section 01 6000 - Product Requirements.
- B. Description: NFPA 70, Type EMT steel electrical metallic tubing complying with ANSI C80.3 and listed and labeled as complying with UL 797.
- C. Fittings:
 1. Manufacturers:
 - a. Bridgeport Fittings Inc: www.bptfittings.com/#sle.
 - b. O-Z/Gedney, a brand of Emerson Electric Co: www.emerson.com/#sle.
 - c. Thomas & Betts Corporation: www.tnb.com/#sle.
 - d. Substitutions: See Section 01 6000 - Product Requirements.
 2. Description: Fittings complying with NEMA FB 1 and listed and labeled as complying with UL 514B.
 3. Material: Use steel or malleable iron.
 - a. Do not use die cast zinc fittings.
 4. Connectors and Couplings: Use compression (gland) or set-screw type.
 - a. Do not use set-screw type connectors and couplings.
 5. Damp or Wet Locations (where permitted): Use fittings listed for use in wet locations.
 6. Embedded Within Concrete (where permitted): Use fittings listed as concrete-tight. Fittings that require taping to be concrete-tight are acceptable.

2.05 RIGID POLYVINYL CHLORIDE (PVC) CONDUIT

- A. Manufacturers:
 1. Cantex Inc: www.cantexinc.com/#sle.
 2. Carlon, a brand of Thomas & Betts Corporation: www.carlon.com/#sle.
 3. JM Eagle: www.jmeagle.com/#sle.
 4. Substitutions: See Section 01 6000 - Product Requirements.
- B. Description: NFPA 70, Type PVC rigid polyvinyl chloride conduit complying with NEMA TC 2 and listed and labeled as complying with UL 651; Schedule 40 unless otherwise indicated, Schedule 80 where subject to physical damage; rated for use with conductors rated 90 degrees C.
- C. Fittings:
 1. Manufacturer: Same as manufacturer of conduit to be connected.
 2. Description: Fittings complying with NEMA TC 3 and listed and labeled as complying with UL 651; material to match conduit.

2.06 ACCESSORIES

- A. Corrosion Protection Tape: PVC-based, minimum thickness of 20 mil (0.51 mm).
- B. Conduit Joint Compound: Corrosion-resistant, electrically conductive; suitable for use with the conduit to be installed.
- C. Solvent Cement for PVC Conduit and Fittings: As recommended by manufacturer of conduit and fittings to be installed.
- D. Epoxy Adhesive for RTRC Conduit and Fittings: As recommended by manufacturer of conduit and fittings to be installed.
- E. Pull Strings: Use nylon cord with average breaking strength of not less than 200 pound-force (890 N).
- F. Sealing Compound for Sealing Fittings: Listed for use with the particular fittings to be installed.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- G. Modular Seals for Conduit Penetrations: Rated for minimum of 40 psig; Suitable for the conduits to be installed.
- H. Sealing Systems for Roof Penetrations: Premanufactured components and accessories as required to preserve integrity of roofing system and maintain roof warranty; suitable for conduits and roofing system to be installed; designed to accommodate existing penetrations where applicable.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that mounting surfaces are ready to receive conduits.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Perform work in accordance with NECA 1 (general workmanship).
- C. Install intermediate metal conduit (IMC) in accordance with NECA 101.
- D. Install rigid polyvinyl chloride (PVC) conduit in accordance with NECA 111.
- E. Conduit Routing:
 - 1. Unless dimensioned, conduit routing indicated is diagrammatic.
 - 2. When conduit destination is indicated without specific routing, determine exact routing required.
 - 3. Conduits installed underground or embedded in concrete may be routed in the shortest possible manner unless otherwise indicated. Route all other conduits parallel or perpendicular to building structure and surfaces, following surface contours where practical.
 - 4. Arrange conduit to maintain adequate headroom, clearances, and access.
 - 5. Arrange conduit to provide no more than the equivalent of four 90 degree bends between pull points.
 - 6. Arrange conduit to provide no more than 150 feet (46 m) between pull points.
 - 7. Route conduits above water and drain piping where possible.
 - 8. Arrange conduit to prevent moisture traps. Provide drain fittings at low points and at sealing fittings where moisture may collect.
 - 9. Maintain minimum clearance of 6 inches (150 mm) between conduits and piping for other systems.
 - 10. Maintain minimum clearance of 12 inches (300 mm) between conduits and hot surfaces. This includes, but is not limited to:
 - a. Heaters.
 - b. Hot water piping.
 - 11. Group parallel conduits in the same area together on a common rack.
- F. Conduit Support:
 - 1. Secure and support conduits in accordance with NFPA 70 and Section 26 0529 using suitable supports and methods approved by the authority having jurisdiction.
 - 2. Provide independent support from building structure. Do not provide support from piping, ductwork, or other systems.
- G. Connections and Terminations:
 - 1. Use approved zinc-rich paint or conduit joint compound on field-cut threads of galvanized steel conduits prior to making connections.
 - 2. Where two threaded conduits must be joined and neither can be rotated, use three-piece couplings or split couplings. Do not use running threads.
 - 3. Use suitable adapters where required to transition from one type of conduit to another.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

4. Terminate threaded conduits in boxes and enclosures using threaded hubs or double lock nuts for dry locations and raintight hubs for wet locations.
 5. Provide insulating bushings or insulated throats at all conduit terminations to protect conductors.
 6. Secure joints and connections to provide maximum mechanical strength and electrical continuity.
- H. Penetrations:
1. Do not penetrate or otherwise notch or cut structural members, including footings and grade beams, without approval of Structural Engineer.
 2. Make penetrations perpendicular to surfaces unless otherwise indicated.
 3. Provide sleeves for penetrations as indicated or as required to facilitate installation. Set sleeves flush with exposed surfaces unless otherwise indicated or required.
 4. Conceal bends for conduit risers emerging above ground.
 5. Seal interior of conduits entering the building from underground at first accessible point to prevent entry of moisture and gases.
 6. Where conduits penetrate waterproof membrane, seal as required to maintain integrity of membrane.
 7. Make penetrations for roof-mounted equipment within associated equipment openings and curbs where possible to minimize roofing system penetrations. Where penetrations are necessary, seal as indicated or as required to preserve integrity of roofing system and maintain roof warranty. Include proposed locations of penetrations and methods for sealing with submittals.
 8. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 8400.
- I. Conduit Movement Provisions: Where conduits are subject to movement, provide expansion and expansion/deflection fittings to prevent damage to enclosed conductors or connected equipment. This includes, but is not limited to:
1. Where conduits cross structural joints intended for expansion, contraction, or deflection.
 2. Where calculated in accordance with NFPA 70 for rigid polyvinyl chloride (PVC) conduit installed above ground to compensate for thermal expansion and contraction.
 3. Where conduits are subject to earth movement by settlement or frost.
- J. Condensation Prevention: Where conduits cross barriers between areas of potential substantial temperature differential, provide sealing fitting or approved sealing compound at an accessible point near the penetration to prevent condensation. This includes, but is not limited to:
1. Where conduits pass from outdoors into conditioned interior spaces.
 2. Where conduits pass from unconditioned interior spaces into conditioned interior spaces.
- K. Provide grounding and bonding in accordance with Section 26 0526.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.
- B. Repair cuts and abrasions in galvanized finishes using zinc-rich paint recommended by manufacturer. Replace components that exhibit signs of corrosion.
- C. Correct deficiencies and replace damaged or defective conduits.

3.04 CLEANING

- A. Clean interior of conduits to remove moisture and foreign matter.

3.05 PROTECTION

- A. Immediately after installation of conduit, use suitable manufactured plugs to provide protection from entry of moisture and foreign material and do not remove until ready for installation of conductors.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 26 0533.16
BOXES FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Outlet and device boxes up to 100 cubic inches (1,650 cu cm), including those used as junction and pull boxes.
- B. Cabinets and enclosures, including junction and pull boxes larger than 100 cubic inches (1,650 cu cm).
- C. Boxes and enclosures for integrated power, data, and audio/video.
- D. Floor boxes.
- E. Accessories.

1.02 RELATED REQUIREMENTS

- A. Section 26 0526 - Grounding and Bonding for Electrical Systems.
- B. Section 26 0529 - Hangers and Supports for Electrical Systems.
- C. Section 26 0533.13 - Conduit for Electrical Systems:
 - 1. Conduit bodies and other fittings.
- D. Section 26 0553 - Identification for Electrical Systems: Identification products and requirements.
- E. Section 26 2726 - Wiring Devices:
 - 1. Wall plates.
 - 2. Floor box service fittings.
- F. Section 27 1000 - Structured Cabling: Additional requirements for communications systems outlet boxes.

1.03 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2015.
- B. NECA 130 - Standard for Installing and Maintaining Wiring Devices; 2010.
- C. NEMA FB 1 - Fittings, Cast Metal Boxes, and Conduit Bodies for Conduit, Electrical Metallic Tubing, and Cable; 2014.
- D. NEMA OS 1 - Sheet-Steel Outlet Boxes, Device Boxes, Covers, and Box Supports; 2013.
- E. NEMA OS 2 - Nonmetallic Outlet Boxes, Device Boxes, Covers and Box Supports; 2013.
- F. NEMA 250 - Enclosures for Electrical Equipment (1000 Volts Maximum); 2018.
- G. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- H. SCTE 77 - Specification for Underground Enclosure Integrity; 2017.
- I. UL 50 - Enclosures for Electrical Equipment, Non-Environmental Considerations; Current Edition, Including All Revisions.
- J. UL 50E - Enclosures for Electrical Equipment, Environmental Considerations; Current Edition, Including All Revisions.
- K. UL 508A - UL Standard for Safety Industrial Control Panels; 2018.
- L. UL 514A - Metallic Outlet Boxes; Current Edition, Including All Revisions.
- M. UL 514C - Nonmetallic Outlet Boxes, Flush-Device Boxes, and Covers; Current Edition, Including All Revisions.
- N. UL 1203 - Explosion-Proof and Dust-Ignition-Proof Electrical Equipment for Use in Hazardous (Classified) Locations; Current Edition, Including All Revisions.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the work with other trades to avoid placement of ductwork, piping, equipment, or other potential obstructions within the dedicated equipment spaces and working clearances for electrical equipment required by NFPA 70.
 - 2. Coordinate arrangement of electrical equipment with the dimensions and clearance requirements of the actual equipment to be installed.
 - 3. Coordinate minimum sizes of boxes with the actual installed arrangement of conductors, clamps, support fittings, and devices, calculated according to NFPA 70.
 - 4. Coordinate minimum sizes of pull boxes with the actual installed arrangement of connected conduits, calculated according to NFPA 70.
 - 5. Coordinate the placement of boxes with millwork, furniture, devices, equipment, etc. installed under other sections or by others.
 - 6. Coordinate the work with other trades to preserve insulation integrity.
 - 7. Coordinate the work with other trades to provide walls suitable for installation of flush-mounted boxes where indicated.
 - 8. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for cabinets and enclosures, boxes for hazardous (classified) locations, floor boxes, and underground boxes/enclosures.
- C. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Receive, inspect, handle, and store products in accordance with manufacturer's instructions.

PART 2 PRODUCTS

2.01 BOXES

- A. General Requirements:
 - 1. Do not use boxes and associated accessories for applications other than as permitted by NFPA 70 and product listing.
 - 2. Provide all boxes, fittings, supports, and accessories required for a complete raceway system and to accommodate devices and equipment to be installed.
 - 3. Provide products listed, classified, and labeled as suitable for the purpose intended.
 - 4. Where box size is not indicated, size to comply with NFPA 70 but not less than applicable minimum size requirements specified.
 - 5. Provide grounding terminals within boxes where equipment grounding conductors terminate.
- B. Outlet and Device Boxes Up to 100 cubic inches (1,650 cu cm), Including Those Used as Junction and Pull Boxes:
 - 1. Use sheet-steel boxes for dry locations unless otherwise indicated or required.
 - 2. Use cast iron boxes or cast aluminum boxes for damp or wet locations unless otherwise indicated or required; furnish with compatible weatherproof gasketed covers.
 - 3. Use suitable concrete type boxes where flush-mounted in concrete.
 - 4. Use suitable masonry type boxes where flush-mounted in masonry walls.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

5. Use raised covers suitable for the type of wall construction and device configuration where required.
 6. Use shallow boxes where required by the type of wall construction.
 7. Do not use "through-wall" boxes designed for access from both sides of wall.
 8. Sheet-Steel Boxes: Comply with NEMA OS 1, and list and label as complying with UL 514A.
 9. Cast Metal Boxes: Comply with NEMA FB 1, and list and label as complying with UL 514A; furnish with threaded hubs.
 10. Nonmetallic Boxes: Comply with NEMA OS 2, and list and label as complying with UL 514C.
 11. Boxes for Supporting Luminaires and Ceiling Fans: Listed as suitable for the type and weight of load to be supported; furnished with fixture stud to accommodate mounting of luminaire where required.
 12. Boxes for Ganged Devices: Use multigang boxes of single-piece construction. Do not use field-connected gangable boxes unless specifically indicated or permitted.
 13. Wall Plates: Comply with Section 26 2726.
- C. Cabinets and Enclosures, Including Junction and Pull Boxes Larger Than 100 cubic inches (1,650 cu cm):
1. Comply with NEMA 250, and list and label as complying with UL 50 and UL 50E, or UL 508A.
 2. NEMA 250 Environment Type, Unless Otherwise Indicated:
 3. Junction and Pull Boxes Larger Than 100 cubic inches (1,650 cu cm):
 - a. Provide screw-cover or hinged-cover enclosures unless otherwise indicated.
- D. Floor Boxes:
1. Description: Floor boxes compatible with floor box service fittings provided in accordance with Section 26 2726; with partitions to separate multiple services; furnished with all components, adapters, and trims required for complete installation.
 2. Use cast iron floor boxes within slab on grade.
 3. Use sheet-steel or cast iron floor boxes within slab above grade.
 4. Metallic Floor Boxes: Fully adjustable (with integral means for leveling adjustment prior to and after concrete pour).
 5. Manufacturer: Same as manufacturer of floor box service fittings.

2.02 ACCESSORIES

- A. Flashing Panels for Exterior Wall Penetrations: Premanufactured components and accessories as required to preserve integrity of building envelope; suitable for boxes and facade materials to be installed.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that mounting surfaces are ready to receive boxes.
- C. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install boxes in accordance with NECA 1 (general workmanship) and, where applicable, NECA 130, including mounting heights specified in those standards where mounting heights are not indicated.
- C. Arrange equipment to provide minimum clearances in accordance with manufacturer's instructions and NFPA 70.
- D. Provide separate boxes for emergency power and normal power systems.
- E. Unless otherwise indicated, provide separate boxes for line voltage and low voltage systems.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- F. Flush-mount boxes in finished areas unless specifically indicated to be surface-mounted.
- G. Box Supports:
 - 1. Secure and support boxes in accordance with NFPA 70 and Section 26 0529 using suitable supports and methods approved by the authority having jurisdiction.
 - 2. Provide independent support from building structure except for cast metal boxes (other than boxes used for fixture support) supported by threaded conduit connections in accordance with NFPA 70. Do not provide support from piping, ductwork, or other systems.
- H. Install boxes plumb and level.
- I. Flush-Mounted Boxes:
 - 1. Install boxes in noncombustible materials such as concrete, tile, gypsum, plaster, etc. so that front edge of box or associated raised cover is not set back from finished surface more than 1/4 inch (6 mm) or does not project beyond finished surface.
 - 2. Install boxes in combustible materials such as wood so that front edge of box or associated raised cover is flush with finished surface.
 - 3. Repair rough openings around boxes in noncombustible materials such as concrete, tile, gypsum, plaster, etc. so that there are no gaps or open spaces greater than 1/8 inch (3 mm) at the edge of the box.
- J. Install boxes as required to preserve insulation integrity.
- K. Metallic Floor Boxes: Install box level at the proper elevation to be flush with finished floor.
- L. Install permanent barrier between ganged wiring devices when voltage between adjacent devices exceeds 300 V.
- M. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 8400.
- N. Close unused box openings.
- O. Install blank wall plates on junction boxes and on outlet boxes with no devices or equipment installed or designated for future use.
- P. Provide grounding and bonding in accordance with Section 26 0526.
- Q. Identify boxes in accordance with Section 26 0553.

3.03 CLEANING

- A. Clean interior of boxes to remove dirt, debris, plaster and other foreign material.

3.04 PROTECTION

- A. Immediately after installation, protect boxes from entry of moisture and foreign material until ready for installation of conductors.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 26 0553
IDENTIFICATION FOR ELECTRICAL SYSTEMS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Electrical identification requirements.
- B. Identification nameplates and labels.
- C. Voltage markers.
- D. Underground warning tape.
- E. Warning signs and labels.

1.02 RELATED REQUIREMENTS

- A. Section 26 0519 - Low-Voltage Electrical Power Conductors and Cables: Color coding for power conductors and cables 600 V and less; vinyl color coding electrical tape.
- B. Section 27 1000 - Structured Cabling: Identification for communications cabling and devices.

1.03 REFERENCE STANDARDS

- A. ANSI Z535.2 - American National Standard for Environmental and Facility Safety Signs; 2011.
- B. ANSI Z535.4 - American National Standard for Product Safety Signs and Labels; 2011.
- C. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- D. NFPA 70E - Standard for Electrical Safety in the Workplace; 2018.
- E. UL 969 - Marking and Labeling Systems; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Verify final designations for equipment, systems, and components to be identified prior to fabrication of identification products.
- B. Sequencing:
 - 1. Do not conceal items to be identified, in locations such as above suspended ceilings, until identification products have been installed.
 - 2. Do not install identification products until final surface finishes and painting are complete.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittals procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for each product.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.

1.07 FIELD CONDITIONS

- A. Do not install adhesive products when ambient temperature is lower than recommended by manufacturer.

PART 2 PRODUCTS

2.01 IDENTIFICATION REQUIREMENTS

- A. Identification for Equipment:
 - 1. Use identification nameplate to identify each piece of electrical distribution and control equipment and associated sections, compartments, and components.
 - a. Panelboards:
 - 1) Identify ampere rating.
 - 2) Identify voltage and phase.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- 3) Identify power source and circuit number. Include location when not within sight of equipment.
- 4) Use typewritten circuit directory to identify load(s) served for panelboards with a door. Identify spares and spaces using pencil.
- 5) For power panelboards without a door, use identification nameplate to identify load(s) served for each branch device. Do not identify spares and spaces.
- b. Transformers:
 - 1) Identify kVA rating.
 - 2) Identify voltage and phase for primary and secondary.
 - 3) Identify power source and circuit number. Include location when not within sight of equipment.
- c. Enclosed switches and circuit breakers:
 - 1) Identify voltage and phase.
 - 2) Identify power source and circuit number. Include location when not within sight of equipment.
2. Service Equipment:
 - a. Use identification nameplate to identify each service disconnecting means.
3. Emergency System Equipment:
 - a. Use identification nameplate or voltage marker to identify emergency system equipment in accordance with NFPA 70.
 - b. Use identification nameplate at each piece of service equipment to identify type and location of on-site emergency power sources.
4. Available Fault Current Documentation: Use identification label to identify the available fault current and date calculations were performed at locations requiring documentation by NFPA 70, including but not limited to the following.
 - a. Service equipment.
 - b. Industrial control panels.
 - c. Motor control centers.
 - d. Elevator control panels.
 - e. Industrial machinery.
5. Use warning signs to identify electrical hazards for entrances to all rooms and other guarded locations that contain exposed live parts operating at 600 V nominal or less with the word message "DANGER; Electrical hazard; Authorized personnel only" or approved equivalent.
- B. Identification for Conductors and Cables:
 1. Color Coding for Power Conductors 600 V and Less: Comply with Section 26 0519.
 2. Use identification nameplate or identification label to identify color code for ungrounded and grounded power conductors inside door or enclosure at each piece of feeder or branch-circuit distribution equipment when premises has feeders or branch circuits served by more than one nominal voltage system.

2.02 IDENTIFICATION NAMEPLATES AND LABELS

- A. Identification Nameplates:
 1. Materials:
 - a. Indoor Clean, Dry Locations: Use plastic nameplates.
 - b. Outdoor Locations: Use aluminum nameplates suitable for exterior use.
 2. Plastic Nameplates: Two-layer or three-layer laminated acrylic or electrically non-conductive phenolic with beveled edges; minimum thickness of 1/16 inch (1.6 mm); engraved text.
 3. Aluminum Nameplates: Anodized; minimum thickness of 1/32 inch (0.8 mm); engraved or laser-etched text.
 4. Mounting Holes for Mechanical Fasteners: Two, centered on sides for sizes up to 1 inch (25 mm) high; Four, located at corners for larger sizes.
- B. Identification Labels:

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1. Materials: Use self-adhesive laminated plastic labels; UV, chemical, water, heat, and abrasion resistant.
 2. Text: Use factory pre-printed or machine-printed text. Do not use handwritten text unless otherwise indicated.
- C. Format for Equipment Identification:
1. Minimum Size: 1 inch (25 mm) by 2.5 inches (64 mm).
 2. Text: All capitalized unless otherwise indicated.
 3. Minimum Text Height:
 - a. Equipment Designation: 1/2 inch (13 mm).
 - b. Other Information: 1/4 inch (6 mm).
 - c. Exception: Provide minimum text height of 1 inch (25 mm) for equipment located more than 10 feet (3.0 m) above floor or working platform.
 4. Color:
 - a. Normal Power System: White text on black background.
- D. Format for General Information and Operating Instructions:
1. Minimum Size: 1 inch (25 mm) by 2.5 inches (64 mm).
 2. Legend: Include information or instructions indicated or as required for proper and safe operation and maintenance.
 3. Text: All capitalized unless otherwise indicated.
 4. Minimum Text Height: 1/4 inch (6 mm).
 5. Color: Black text on white background unless otherwise indicated.
- E. Format for Caution and Warning Messages:
1. Minimum Size: 2 inches (51 mm) by 4 inches (100 mm).
 2. Legend: Include information or instructions indicated or as required for proper and safe operation and maintenance.
 3. Text: All capitalized unless otherwise indicated.
 4. Minimum Text Height: 1/2 inch (13 mm).
 5. Color: Black text on yellow background unless otherwise indicated.

2.03 VOLTAGE MARKERS

- A. Minimum Size:
- B. Legend:
- C. Color: Black text on orange background unless otherwise indicated.

2.04 UNDERGROUND WARNING TAPE

- A. Materials: Use non-detectable type polyethylene tape suitable for direct burial, unless otherwise indicated.
- B. Non-detectable Type Tape: 6 inches (152 mm) wide, with minimum thickness of 4 mil (0.1 mm).
- C. Legend: Type of service, continuously repeated over full length of tape.
- D. Color:
 1. Tape for Buried Power Lines: Black text on red background.
 2. Tape for Buried Communication, Alarm, and Signal Lines: Black text on orange background.

2.05 WARNING SIGNS AND LABELS

- A. Comply with ANSI Z535.2 or ANSI Z535.4 as applicable.
- B. Warning Signs:
 1. Materials:
 2. Minimum Size: 7 by 10 inches (178 by 254 mm) unless otherwise indicated.
- C. Warning Labels:

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1. Materials: Use factory pre-printed or machine-printed self-adhesive polyester or self-adhesive vinyl labels; UV, chemical, water, heat, and abrasion resistant; produced using materials recognized to UL 969.
2. Machine-Printed Labels: Use thermal transfer process printing machines and accessories recommended by label manufacturer.
3. Minimum Size: 2 by 4 inches (51 mm by 102 mm) unless otherwise indicated.

PART 3 EXECUTION

3.01 PREPARATION

- A. Clean surfaces to receive adhesive products according to manufacturer's instructions.

3.02 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Install identification products to be plainly visible for examination, adjustment, servicing, and maintenance. Unless otherwise indicated, locate products as follows:
 1. Surface-Mounted Equipment: Enclosure front.
 2. Flush-Mounted Equipment: Inside of equipment door.
 3. Free-Standing Equipment: Enclosure front; also enclosure rear for equipment with rear access.
 4. Elevated Equipment: Legible from the floor or working platform.
 5. Branch Devices: Adjacent to device.
 6. Interior Components: Legible from the point of access.
 7. Conductors and Cables: Legible from the point of access.
- C. Install identification products centered, level, and parallel with lines of item being identified.
- D. Secure nameplates to exterior surfaces of enclosures using stainless steel screws and to interior surfaces using self-adhesive backing or epoxy cement.
- E. Install self-adhesive labels and markers to achieve maximum adhesion, with no bubbles or wrinkles and edges properly sealed.
- F. Install underground warning tape above buried lines with one tape per trench at 3 inches (75 mm) below finished grade.
- G. Mark all handwritten text, where permitted, to be neat and legible.

3.03 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.
- B. Replace self-adhesive labels and markers that exhibit bubbles, wrinkles, curling or other signs of improper adhesion.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 26 0583
WIRING CONNECTIONS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Electrical connections to equipment.

1.02 RELATED REQUIREMENTS

- A. Section 26 0519 - Low-Voltage Electrical Power Conductors and Cables.
- B. Section 26 0533.13 - Conduit for Electrical Systems.
- C. Section 26 0533.16 - Boxes for Electrical Systems.
- D. Section 26 2726 - Wiring Devices.

1.03 REFERENCE STANDARDS

- A. NEMA WD 1 - General Color Requirements for Wiring Devices; 1999 (Reaffirmed 2015).
- B. NEMA WD 6 - Wiring Devices - Dimensional Specifications; 2016.
- C. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Obtain and review shop drawings, product data, manufacturer's wiring diagrams, and manufacturer's instructions for equipment furnished under other sections.
 - 2. Determine connection locations and requirements.
- B. Sequencing:
 - 1. Install rough-in of electrical connections before installation of equipment is required.
 - 2. Make electrical connections before required start-up of equipment.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide wiring device manufacturer's catalog information showing dimensions, configurations, and construction.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.
- B. Products: Listed, classified, and labeled as suitable for the purpose intended.
- C. Product Listing Organization Qualifications: An organization recognized by OSHA as a Nationally Recognized Testing Laboratory (NRTL) and acceptable to authorities having jurisdiction.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Cords and Caps: NEMA WD 6; match receptacle configuration at outlet provided for equipment.
 - 1. Colors: Comply with NEMA WD 1.
 - 2. Cord Construction: NFPA 70, Type SO, multiconductor flexible cord with identified equipment grounding conductor, suitable for use in damp locations.
 - 3. Size: Suitable for connected load of equipment, length of cord, and rating of branch circuit overcurrent protection.
- B. Wiring Devices: As specified in Section 26 2726.
- C. Flexible Conduit: As specified in Section 26 0533.13.
- D. Wire and Cable: As specified in Section 26 0519.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- E. Boxes: As specified in Section 26 0533.16.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that equipment is ready for electrical connection, wiring, and energization.

3.02 ELECTRICAL CONNECTIONS

- A. Make electrical connections in accordance with equipment manufacturer's instructions.
- B. Make conduit connections to equipment using flexible conduit. Use liquidtight flexible conduit with watertight connectors in damp or wet locations.
- C. Connect heat producing equipment using wire and cable with insulation suitable for temperatures encountered.
- D. Provide receptacle outlet to accommodate connection with attachment plug.
- E. Provide cord and cap where field-supplied attachment plug is required.
- F. Install suitable strain-relief clamps and fittings for cord connections at outlet boxes and equipment connection boxes.
- G. Install disconnect switches, controllers, control stations, and control devices to complete equipment wiring requirements.
- H. Install terminal block jumpers to complete equipment wiring requirements.
- I. Install interconnecting conduit and wiring between devices and equipment to complete equipment wiring requirements.
- J. Coolers and Freezers: Cut and seal conduit openings in freezer and cooler walls, floor, and ceilings.

END OF SECTION

SECTION 26 0923
LIGHTING CONTROL DEVICES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Occupancy sensors.
- B. Outdoor motion sensors.
- C. Outdoor photo controls.
- D. Daylighting controls.
- E. Lighting contactors.
- F. Accessories.

1.02 RELATED REQUIREMENTS

- A. Section 26 0526 - Grounding and Bonding for Electrical Systems.
- B. Section 26 0533.16 - Boxes for Electrical Systems.
- C. Section 26 0553 - Identification for Electrical Systems: Identification products and requirements.
- D. Section 26 2726 - Wiring Devices: Devices for manual control of lighting, including wall switches, wall dimmers, and fan speed controllers.
- E. Section 26 5100 - Interior Lighting.
- F. Section 26 5600 - Exterior Lighting.

1.03 REFERENCE STANDARDS

- A. ANSI C136.10 - American National Standard for Roadway and Area Lighting Equipment - Locking-Type Photocontrol Devices and Mating Receptacles - Physical and Electrical Interchangeability and Testing; 2010.
- B. ANSI C136.24 - American National Standard for Roadway and Area Lighting Equipment - Nonlocking (Button) Type Photocontrols; 2004 (R2010).
- C. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2015.
- D. NECA 130 - Standard for Installing and Maintaining Wiring Devices; 2010.
- E. NEMA 410 - Performance Testing for Lighting Controls and Switching Devices with Electronic Drivers and Discharge Ballasts; 2016.
- F. NEMA ICS 5 - Industrial Control and Systems: Control Circuit and Pilot Devices; 2017.
- G. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- H. UL 773A - Nonindustrial Photoelectric Switches for Lighting Control; Current Edition, Including All Revisions.
- I. UL 916 - Energy Management Equipment; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the placement of lighting control devices with millwork, furniture, equipment, etc. installed under other sections or by others.
 - 2. Coordinate the placement of occupancy sensors with millwork, furniture, equipment or other potential obstructions to motion detection coverage installed under other sections or by others.
 - 3. Notify Architect of any conflicts or deviations from Contract Documents to obtain direction prior to proceeding with work.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Include ratings, configurations, standard wiring diagrams, dimensions, colors, service condition requirements, and installed features.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.

1.07 DELIVERY, STORAGE, AND PROTECTION

- A. Store products in a clean, dry space in original manufacturer's packaging in accordance with manufacturer's written instructions until ready for installation.

1.08 FIELD CONDITIONS

1.09 WARRANTY

- A. See Section 01 7800 - Closeout Submittals, for additional warranty requirements.

PART 2 PRODUCTS

2.01 LIGHTING CONTROL DEVICES - GENERAL REQUIREMENTS

- A. Provide products listed, classified, and labeled as suitable for the purpose intended.
- B. Unless specifically indicated to be excluded, provide all required conduit, wiring, connectors, hardware, components, accessories, etc. as required for a complete operating system.

2.02 OCCUPANCY SENSORS

- A. All Occupancy Sensors:
 - 1. Description: Factory-assembled commercial specification grade devices for indoor use capable of sensing both major motion, such as walking, and minor motion, such as small desktop level movements, according to published coverage areas, for automatic control of load indicated.
 - 2. Sensor Technology:
 - 3. Provide LED to visually indicate motion detection with separate color LEDs for each sensor type in dual technology units.
 - 4. Operation: Unless otherwise indicated, occupancy sensor to turn load on when occupant presence is detected and to turn load off when no occupant presence is detected during an adjustable turn-off delay time interval.
 - 5. Turn-Off Delay: Field adjustable, with time delay settings up to 30 minutes.
 - 6. Compatibility (Non-Dimming Sensors): Suitable for controlling incandescent lighting, low-voltage lighting with electronic and magnetic transformers, fluorescent lighting with electronic and magnetic ballasts, and fractional motor loads, with no minimum load requirements.

2.03 OUTDOOR MOTION SENSORS

- A. Description: Factory-assembled wet location listed device suitable for wall or ceiling/eave mounting, with integral swivel for field adjustment of coverage, capable of detecting motion for automatic control of load indicated.
- B. Sensor Technology: Passive Infrared (PIR) designed to detect occupancy by sensing movement of thermal energy between zones.
- C. Operation: Unless otherwise indicated, motion sensor to turn load on when motion is detected and to turn load off when no motion is detected during an adjustable turn-off delay time interval.
- D. Turn-Off Delay: Field adjustable, with time delay settings available up to 15 minutes.
- E. Integral Photocell: For dusk to dawn operation.
- F. Manual Override: Activated by switching power off to unit and then back on.
- G. Load Rating: 1,000 W incandescent and fluorescent load at 120 V ac.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- H. Coverage: Capable of detecting motion within a distance of 50 feet (15 m) at a mounting height of 8 feet (2.4 m), with a field of view of 270 degrees.

2.04 OUTDOOR PHOTO CONTROLS

- A. Stem-Mounted Outdoor Photo Controls:
1. Description: Direct-wired photo control unit with threaded conduit mounting stem and field-adjustable swivel base, listed and labeled as complying with UL 773A.
 2. Housing: Weatherproof, impact resistant polycarbonate.
 3. Photo Sensor: Cadmium sulfide.
 4. Provide external sliding shield for field adjustment of light level activation.
 5. Light Level Activation: 1 to 5 footcandles (10.8 to 53.8 lux) turn-on and 3 to 1 turn-off to turn-on ratio with delayed turn-off.
 6. Voltage: As required to control the load indicated on the drawings.
 7. Failure Mode: Fails to the on position.
 8. Load Rating: As required to control the load indicated on the drawings.

2.05 DAYLIGHTING CONTROLS

- A. System Description: Control system consisting of photo sensors and compatible control modules and power packs, contactors, or relays as required for automatic control of load indicated according to available natural light; capable of integrating with occupancy sensors and manual override controls.

2.06 ACCESSORIES

- A. Auxiliary Contacts:
1. Comply with NEMA ICS 5.
 2. Provide number and type of contacts indicated or required to perform necessary functions, including holding (seal-in) circuit and interlocking, plus one normally open (NO) and one normally closed (NC) spare contact for each lighting contactor, minimum.
- B. Control and Timing Relays:
1. Comply with NEMA ICS 5.
 2. Provide number and type of relays indicated or required to perform necessary functions.
- C. Fire-Rated Device Enclosures:
1. Provide as required to preserve fire resistance rating of building elements.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 26 2416
PANELBOARDS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Power distribution panelboards.
- B. Load centers.
- C. Overcurrent protective devices for panelboards.

1.02 RELATED REQUIREMENTS

- A. Section 26 0526 - Grounding and Bonding for Electrical Systems.
- B. Section 26 0529 - Hangers and Supports for Electrical Systems.
- C. Section 26 0553 - Identification for Electrical Systems: Identification products and requirements.
- D. Section 26 2200 - Low-Voltage Transformers: Small power centers with integral primary breaker, transformer, and panelboard.

1.03 REFERENCE STANDARDS

- A. FS W-C-375 - Circuit Breakers, Molded Case; Branch Circuit and Service; 2013e (Amended 2017).
- B. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2015.
- C. NECA 407 - Standard for Installing and Maintaining Panelboards; 2015.
- D. NEMA 250 - Enclosures for Electrical Equipment (1000 Volts Maximum); 2018.
- E. NEMA PB 1 - Panelboards; 2011.
- F. NEMA PB 1.1 - General Instructions for Proper Installation, Operation and Maintenance of Panelboards Rated 600 Volts or Less; 2013.
- G. NETA ATS - Acceptance Testing Specifications for Electrical Power Equipment and Systems; 2017.
- H. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- I. UL 50 - Enclosures for Electrical Equipment, Non-Environmental Considerations; Current Edition, Including All Revisions.
- J. UL 50E - Enclosures for Electrical Equipment, Environmental Considerations; Current Edition, Including All Revisions.
- K. UL 67 - Panelboards; Current Edition, Including All Revisions.
- L. UL 489 - Molded-Case Circuit Breakers, Molded-Case Switches and Circuit Breaker Enclosures; Current Edition, Including All Revisions.
- M. UL 869A - Reference Standard for Service Equipment; Current Edition, Including All Revisions.
- N. UL 943 - Ground-Fault Circuit-Interrupters; Current Edition, Including All Revisions.
- O. UL 1053 - Ground-Fault Sensing and Relaying Equipment; Current Edition, Including All Revisions.
- P. UL 1699 - Arc-Fault Circuit-Interrupters; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the work with other trades to avoid placement of ductwork, piping, equipment, or other potential obstructions within the dedicated equipment spaces and working clearances for electrical equipment required by NFPA 70.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2. Coordinate arrangement of electrical equipment with the dimensions and clearance requirements of the actual equipment to be installed.
3. Coordinate the work with other trades to provide walls suitable for installation of flush-mounted panelboards where indicated.
4. Verify with manufacturer that conductor terminations are suitable for use with the conductors to be installed.
5. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for panelboards, enclosures, overcurrent protective devices, and other installed components and accessories.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.

1.07 FIELD CONDITIONS

- A. Maintain ambient temperature within the following limits during and after installation of panelboards:
 1. Panelboards Containing Circuit Breakers: Between 23 degrees F (-5 degrees C) and 104 degrees F (40 degrees C).

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Eaton Corporation: www.eaton.com/#sle.
- B. Schneider Electric; Square D Products: www.schneider-electric.us/#sle.
- C. Siemens Industry, Inc: www.usa.siemens.com/#sle.
- D. Substitutions: See Section 01 6000 - Product Requirements.
- E. Source Limitations: Furnish panelboards and associated components produced by the same manufacturer as the other electrical distribution equipment used for this project and obtained from a single supplier.

2.02 PANELBOARDS - GENERAL REQUIREMENTS

- A. Provide products listed, classified, and labeled as suitable for the purpose intended.
- B. Unless otherwise indicated, provide products suitable for continuous operation under the following service conditions:
 1. Altitude: Less than 6,600 feet (2,000 m).
 2. Ambient Temperature:
 - a. Panelboards Containing Circuit Breakers: Between 23 degrees F (-5 degrees C) and 104 degrees F (40 degrees C).
- C. Short Circuit Current Rating:
- D. Panelboards Used for Service Entrance: Listed and labeled as suitable for use as service equipment according to UL 869A.
- E. Mains: Configure for top or bottom incoming feed as indicated or as required for the installation.
- F. Branch Overcurrent Protective Devices: Replaceable without disturbing adjacent devices.
- G. Bussing: Sized in accordance with UL 67 temperature rise requirements.
 1. Provide solidly bonded equipment ground bus in each panelboard, with a suitable lug for each feeder and branch circuit equipment grounding conductor.
- H. Conductor Terminations: Suitable for use with the conductors to be installed.
- I. Enclosures: Comply with NEMA 250, and list and label as complying with UL 50 and UL 50E.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1. Environment Type per NEMA 250: Unless otherwise indicated, as specified for the following installation locations:
 2. Boxes: Galvanized steel unless otherwise indicated.
 - a. Provide wiring gutters sized to accommodate the conductors to be installed.
 3. Fronts:
 - a. Fronts for Surface-Mounted Enclosures: Same dimensions as boxes.
 - b. Fronts for Flush-Mounted Enclosures: Overlap boxes on all sides to conceal rough opening.
 4. Lockable Doors: All locks keyed alike unless otherwise indicated.
- J. Future Provisions: Prepare all unused spaces for future installation of devices including bussing, connectors, mounting hardware and all other required provisions.
- K. Ground Fault Protection: Where ground-fault protection is indicated, provide system listed and labeled as complying with UL 1053.

2.03 POWER DISTRIBUTION PANELBOARDS

- A. Description: Panelboards complying with NEMA PB 1, power and feeder distribution type, circuit breaker type, and listed and labeled as complying with UL 67; ratings, configurations and features as indicated on the drawings.
- B. Conductor Terminations:
1. Main and Neutral Lug Material: Aluminum, suitable for terminating aluminum or copper conductors.
 2. Main and Neutral Lug Type: Mechanical.
- C. Bussing:
1. Phase and Neutral Bus Material: Aluminum.
 2. Ground Bus Material: Aluminum.
- D. Circuit Breakers:
1. Provide bolt-on type or plug-in type secured with locking mechanical restraints.
- E. Enclosures:
1. Provide surface-mounted enclosures unless otherwise indicated.

2.04 LOAD CENTERS

- A. Description: Circuit breaker type load centers listed and labeled as complying with UL 67; ratings, configurations, and features as indicated on the drawings.
- B. Bussing:
1. Phase Bus Connections: Arranged for sequential phasing of overcurrent protective devices.
 2. Bus Material: Aluminum or copper.
- C. Circuit Breakers: Thermal magnetic plug-in type.
- D. Enclosures:
1. Provide flush-mounted enclosures unless otherwise indicated.
 2. Provide circuit directory label on inside of door or individual circuit labels adjacent to circuit breakers.

2.05 OVERCURRENT PROTECTIVE DEVICES

- A. Molded Case Circuit Breakers:
1. Description: Quick-make, quick-break, over center toggle, trip-free, trip-indicating circuit breakers listed and labeled as complying with UL 489, and complying with FS W-C-375 where applicable; ratings, configurations, and features as indicated on the drawings.
 2. Interrupting Capacity:
 - a. Provide circuit breakers with interrupting capacity as required to provide the short circuit current rating indicated, but not less than:
 - b. Fully Rated Systems: Provide circuit breakers with interrupting capacity not less than the short circuit current rating indicated.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3. Conductor Terminations:
 - a. Lug Material: Aluminum, suitable for terminating aluminum or copper conductors.
4. Thermal Magnetic Circuit Breakers: For each pole, furnish thermal inverse time tripping element for overload protection and magnetic instantaneous tripping element for short circuit protection.
5. Multi-Pole Circuit Breakers: Furnish with common trip for all poles.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that the ratings and configurations of the panelboards and associated components are consistent with the indicated requirements.
- C. Verify that mounting surfaces are ready to receive panelboards.
- D. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Perform work in accordance with NECA 1 (general workmanship).
- B. Install products in accordance with manufacturer's instructions.
- C. Install panelboards in accordance with NECA 407 and NEMA PB 1.1.
- D. Arrange equipment to provide minimum clearances in accordance with manufacturer's instructions and NFPA 70.
- E. Provide required support and attachment in accordance with Section 26 0529.
- F. Install panelboards plumb.
- G. Install flush-mounted panelboards so that trims fit completely flush to wall with no gaps and rough opening completely covered.
- H. Mount panelboards such that the highest position of any operating handle for circuit breakers or switches does not exceed 79 inches (2000 mm) above the floor or working platform.
- I. Provide minimum of six spare 1 inch (27 mm) trade size conduits out of each flush-mounted panelboard stubbed into accessible space above ceiling and below floor.
- J. Provide grounding and bonding in accordance with Section 26 0526.
- K. Install all field-installed branch devices, components, and accessories.
- L. Set field-adjustable ground fault protection pickup and time delay settings as indicated.
- M. Provide filler plates to cover unused spaces in panelboards.

3.03 ADJUSTING

- A. Adjust tightness of mechanical and electrical connections to manufacturer's recommended torque settings.
- B. Adjust alignment of panelboard fronts.

3.04 CLEANING

- A. Clean dirt and debris from panelboard enclosures and components according to manufacturer's instructions.
- B. Repair scratched or marred exterior surfaces to match original factory finish.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 26 2726
WIRING DEVICES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Wall switches.
- B. Wall dimmers.
- C. Fan speed controllers.
- D. Receptacles.
- E. Wall plates.
- F. Floor box service fittings.

1.02 RELATED REQUIREMENTS

- A. Section 09 6900 - Access Flooring.
- B. Section 26 0519 - Low-Voltage Electrical Power Conductors and Cables: Manufactured wiring systems for use with access floor boxes with compatible pre-wired connectors.
- C. Section 26 0526 - Grounding and Bonding for Electrical Systems.
- D. Section 26 0533.16 - Boxes for Electrical Systems.
- E. Section 26 0583 - Wiring Connections: Cords and plugs for equipment.
- F. Section 27 1000 - Structured Cabling: Voice and data jacks.

1.03 REFERENCE STANDARDS

- A. FS W-C-596 - Connector, Electrical, Power, General Specification for; 2017h.
- B. FS W-S-896 - Switches, Toggle (Toggle and Lock), Flush-mounted (General Specification); 2017g.
- C. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2015.
- D. NECA 130 - Standard for Installing and Maintaining Wiring Devices; 2010.
- E. NEMA WD 1 - General Color Requirements for Wiring Devices; 1999 (Reaffirmed 2015).
- F. NEMA WD 6 - Wiring Devices - Dimensional Specifications; 2016.
- G. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- H. UL 20 - General-Use Snap Switches; Current Edition, Including All Revisions.
- I. UL 498 - Attachment Plugs and Receptacles; Current Edition, Including All Revisions.
- J. UL 514D - Cover Plates for Flush-Mounted Wiring Devices; Current Edition, Including All Revisions.
- K. UL 943 - Ground-Fault Circuit-Interrupters; Current Edition, Including All Revisions.
- L. UL 1472 - Solid-State Dimming Controls; Current Edition, Including All Revisions.
- M. UL 1917 - Solid-State Fan Speed Controls; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the placement of outlet boxes with millwork, furniture, equipment, etc. installed under other sections or by others.
 - 2. Coordinate wiring device ratings and configurations with the electrical requirements of actual equipment to be installed.
 - 3. Coordinate the installation and preparation of uneven surfaces, such as split face block, to provide suitable surface for installation of wiring devices.
 - 4. Notify Architect of any conflicts or deviations from Contract Documents to obtain direction prior to proceeding with work.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's catalog information showing dimensions, colors, and configurations.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.
- B. Products: Listed, classified, and labeled as suitable for the purpose intended.

1.07 DELIVERY, STORAGE, AND PROTECTION

- A. Store in a clean, dry space in original manufacturer's packaging until ready for installation.

PART 2 PRODUCTS

2.01 WIRING DEVICE APPLICATIONS

- A. Provide wiring devices suitable for intended use and with ratings adequate for load served.
- B. For single receptacles installed on an individual branch circuit, provide receptacle with ampere rating not less than that of the branch circuit.
- C. Provide weather resistant GFCI receptacles with specified weatherproof covers for receptacles installed outdoors or in damp or wet locations.
- D. Provide GFCI protection for receptacles installed within 6 feet (1.8 m) of sinks.
- E. Provide GFCI protection for receptacles serving electric drinking fountains.
- F. Unless noted otherwise, do not use combination switch/receptacle devices.
- G. For flush floor service fittings, use tile rings for installations in tile floors.
- H. For flush floor service fittings, use carpet flanges for installations in carpeted floors.

2.02 WIRING DEVICE FINISHES

- A. Provide wiring device finishes as described below unless otherwise indicated.
- B. Wiring Devices, Unless Otherwise Indicated: White with white nylon wall plate.

2.03 WALL SWITCHES

- A. Wall Switches - General Requirements: AC only, quiet operating, general-use snap switches with silver alloy contacts, complying with NEMA WD 1 and NEMA WD 6, and listed as complying with UL 20 and where applicable, FS W-S-896; types as indicated on the drawings.
 - 1. Wiring Provisions: Terminal screws for side wiring and screw actuated binding clamp for back wiring with separate ground terminal screw.
- B. Standard Wall Switches: Industrial specification grade, 20 A, 120/277 V with standard toggle type switch actuator and maintained contacts; single pole single throw, double pole single throw, three way, or four way as indicated on the drawings.

2.04 WALL DIMMERS

- A. Wall Dimmers - General Requirements: Solid-state with continuous full-range even control following square law dimming curve, integral radio frequency interference filtering, power failure preset memory, air gap switch accessible without removing wall plate, complying with NEMA WD 1 and NEMA WD 6, and listed as complying with UL 1472; types and ratings suitable for load controlled as indicated on the drawings.

2.05 FAN SPEED CONTROLLERS

- A. Description: 120 V AC, solid-state, full-range variable speed, slide control type with separate on/off switch, with integral radio frequency interference filtering, fan noise elimination circuitry, power failure preset memory, complying with NEMA WD 1 and NEMA WD 6, and listed as complying with UL 1917.
 - 1. Current Rating: 1.5 A unless otherwise indicated or required to control the load indicated on the drawings.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2.06 RECEPTACLES

- A. Receptacles - General Requirements: Self-grounding, complying with NEMA WD 1 and NEMA WD 6, and listed as complying with UL 498, and where applicable, FS W-C-596; types as indicated on the drawings.
 - 1. Wiring Provisions: Terminal screws for side wiring or screw actuated binding clamp for back wiring with separate ground terminal screw.
 - 2. NEMA configurations specified are according to NEMA WD 6.
- B. Convenience Receptacles:
 - 1. Standard Convenience Receptacles: Industrial specification grade, 20A, 125V, NEMA 5-20R; single or duplex as indicated on the drawings.
- C. GFCI Receptacles:
 - 1. GFCI Receptacles - General Requirements: Self-testing, with feed-through protection and light to indicate ground fault tripped condition and loss of protection; listed as complying with UL 943, class A.
 - 2. Standard GFCI Receptacles: Industrial specification grade, duplex, 20A, 125V, NEMA 5-20R, rectangular decorator style.
 - 3. Weather Resistant GFCI Receptacles: Industrial specification grade, duplex, 20A, 125V, NEMA 5-20R, rectangular decorator style, listed and labeled as weather resistant type complying with UL 498 Supplement SE suitable for installation in damp or wet locations.

2.07 WALL PLATES

- A. Wall Plates: Comply with UL 514D.
 - 1. Configuration: One piece cover as required for quantity and types of corresponding wiring devices.
 - 2. Size: Standard.
 - 3. Screws: Metal with slotted heads finished to match wall plate finish.
- B. Nylon Wall Plates: Smooth finish, high-impact thermoplastic.
- C. Weatherproof Covers for Damp Locations: Gasketed, cast aluminum, with self-closing hinged cover and corrosion-resistant screws; listed as suitable for use in wet locations with cover closed.
- D. Weatherproof Covers for Wet Locations: Gasketed, cast aluminum, with hinged lockable cover and corrosion-resistant screws; listed as suitable for use in wet locations while in use with attachment plugs connected and identified as extra-duty type.

2.08 FLOOR BOX SERVICE FITTINGS

- A. Description: Service fittings compatible with floor boxes provided under Section 26 0533.16 with components, adapters, and trims required for complete installation.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that outlet boxes are installed in proper locations and at proper mounting heights and are properly sized to accommodate devices and conductors in accordance with NFPA 70.
- C. Verify that wall openings are neatly cut and will be completely covered by wall plates.
- D. Verify that final surface finishes are complete, including painting.
- E. Verify that branch circuit wiring installation is completed, tested, and ready for connection to wiring devices.
- F. Verify that conditions are satisfactory for installation prior to starting work.

3.02 INSTALLATION

- A. Perform work in accordance with NECA 1 (general workmanship) and, where applicable, NECA 130, including mounting heights specified in those standards unless otherwise indicated.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Coordinate locations of outlet boxes provided under Section 26 0533.16 as required for installation of wiring devices provided under this section.
- C. Install wiring devices in accordance with manufacturer's instructions.
- D. Install permanent barrier between ganged wiring devices when voltage between adjacent devices exceeds 300 V.
- E. Where required, connect wiring devices using pigtails not less than 6 inches (150 mm) long. Do not connect more than one conductor to wiring device terminals.
- F. Connect wiring devices by wrapping conductor clockwise 3/4 turn around screw terminal and tightening to proper torque specified by the manufacturer. Where present, do not use push-in pressure terminals that do not rely on screw-actuated binding.
- G. Unless otherwise indicated, connect wiring device grounding terminal to branch circuit equipment grounding conductor and to outlet box with bonding jumper.
- H. Install wiring devices plumb and level with mounting yoke held rigidly in place.
- I. Install wall switches with OFF position down.
- J. Install wall dimmers to achieve full rating specified and indicated after derating for ganging as instructed by manufacturer.
- K. Do not share neutral conductor on branch circuits utilizing wall dimmers.
- L. Install vertically mounted receptacles with grounding pole on top and horizontally mounted receptacles with grounding pole on left.
- M. Install wall plates to fit completely flush to wall with no gaps and rough opening completely covered without strain on wall plate. Repair or reinstall improperly installed outlet boxes or improperly sized rough openings. Do not use oversized wall plates in lieu of meeting this requirement.
- N. Install blank wall plates on junction boxes and on outlet boxes with no wiring devices installed or designated for future use.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 26 5100
INTERIOR LIGHTING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Interior luminaires.
- B. Emergency lighting units.
- C. Exit signs.
- D. Accessories.

1.02 RELATED REQUIREMENTS

- A. Section 26 0529 - Hangers and Supports for Electrical Systems.
- B. Section 26 0533.16 - Boxes for Electrical Systems.
- C. Section 26 0553 - Identification for Electrical Systems: Identification products and requirements.
- D. Section 26 0923 - Lighting Control Devices.
- E. Section 26 2726 - Wiring Devices: Manual wall switches and wall dimmers.
- F. Section 26 5600 - Exterior Lighting.

1.03 REFERENCE STANDARDS

- A. NECA 1 - Standard for Good Workmanship in Electrical Construction; 2015.
- B. NECA/IESNA 500 - Standard for Installing Indoor Commercial Lighting Systems; 2006.
- C. NECA/IESNA 502 - Standard for Installing Industrial Lighting Systems; 2006.
- D. NEMA 410 - Performance Testing for Lighting Controls and Switching Devices with Electronic Drivers and Discharge Ballasts; 2016.
- E. NEMA LE 4 - Recessed Luminaires, Ceiling Compatibility; 2012.
- F. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- G. NFPA 101 - Life Safety Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- H. UL 924 - Emergency Lighting and Power Equipment; Current Edition, Including All Revisions.
- I. UL 1598 - Luminaires; Current Edition, Including All Revisions.
- J. UL 8750 - Light Emitting Diode (LED) Equipment for Use in Lighting Products; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate the installation of luminaires with mounting surfaces installed under other sections or by others. Coordinate the work with placement of supports, anchors, etc. required for mounting. Coordinate compatibility of luminaires and associated trims with mounting surfaces at installed locations.
 - 2. Coordinate the placement of luminaires with structural members, ductwork, piping, equipment, diffusers, fire suppression system components, and other potential conflicts installed under other sections or by others.
 - 3. Coordinate the placement of exit signs with furniture, equipment, signage or other potential obstructions to visibility installed under other sections or by others.
 - 4. Notify Architect of any conflicts or deviations from Contract Documents to obtain direction prior to proceeding with work.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Shop Drawings:
- C. Product Data: Provide manufacturer's standard catalog pages and data sheets including detailed information on luminaire construction, dimensions, ratings, finishes, mounting requirements, listings, service conditions, photometric performance, installed accessories, and ceiling compatibility; include model number nomenclature clearly marked with all proposed features.
- D. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, and installation of product.
- E. Operation and Maintenance Data: Instructions for each product including information on replacement parts.
- F. Maintenance Materials: Furnish the following for Owner's use in maintenance of project.
 - 1. See Section 01 6000 - Product Requirements, for additional provisions.

1.06 QUALITY ASSURANCE

- A. Comply with requirements of NFPA 70.

1.07 DELIVERY, STORAGE, AND PROTECTION

- A. Receive, handle, and store products according to NECA/IESNA 500 (commercial lighting), NECA/IESNA 502 (industrial lighting), and manufacturer's written instructions.
- B. Keep products in original manufacturer's packaging and protect from damage until ready for installation.

1.08 FIELD CONDITIONS

- A. Maintain field conditions within manufacturer's required service conditions during and after installation.

1.09 WARRANTY

- A. See Section 01 7800 - Closeout Submittals, for additional warranty requirements.

PART 2 PRODUCTS

2.01 LUMINAIRE TYPES

- A. Furnish products as indicated in luminaire schedule included on the drawings and attached specification sheets follow this section.
- B. Substitutions: See Section 01 6000 - Product Requirements, except where individual luminaire types are designated with substitutions not permitted.

2.02 LUMINAIRES

- A. Provide products that comply with requirements of NFPA 70.
- B. Provide products that are listed and labeled as complying with UL 1598, where applicable.
- C. Provide products listed, classified, and labeled as suitable for the purpose intended.
- D. Unless otherwise indicated, provide complete luminaires including lamp(s) and all sockets, ballasts, reflectors, lenses, housings and other components required to position, energize and protect the lamp and distribute the light.
- E. Unless specifically indicated to be excluded, provide all required conduit, boxes, wiring, connectors, hardware, supports, trims, accessories, etc. as necessary for a complete operating system.
- F. Provide products suitable to withstand normal handling, installation, and service without any damage, distortion, corrosion, fading, discoloring, etc.

2.03 EMERGENCY LIGHTING UNITS

- A. Description: Emergency lighting units complying with NFPA 101 and all applicable state and local codes, and listed and labeled as complying with UL 924.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- B. Operation: Upon interruption of normal power source or brownout condition exceeding 20 percent voltage drop from nominal, solid-state control automatically switches connected lamps to integral battery power for minimum of 90 minutes of rated emergency illumination, and automatically recharges battery upon restoration of normal power source.
- C. Battery:
 - 1. Size battery to supply all connected lamps, including emergency remote heads where indicated.
- D. Diagnostics: Provide power status indicator light and accessible integral test switch to manually activate emergency operation.
- E. Provide low-voltage disconnect to prevent battery damage from deep discharge.

2.04 EXIT SIGNS

- A. Description: Exit signs complying with NFPA 101 and applicable state and local codes, and listed and labeled as complying with UL 924.
 - 1. Number of Faces: Single- or double-face as indicated or as required for installed location.
 - 2. Directional Arrows: As indicated or as required for installed location.

2.05 ACCESSORIES

- A. Stems for Suspended Luminaires: Steel tubing, minimum 1/2" size, factory finished to match luminaire or field-painted as directed.
- B. Threaded Rods for Suspended Luminaires: Zinc-plated steel, minimum 1/4" size, field-painted as directed.
- C. Provide accessory plaster frames for luminaires recessed in plaster ceilings.
- D. Tube Guards for Linear Fluorescent Lamps: Provide clear virgin polycarbonate sleeves with endcaps where indicated.
- E. Fire-Rated Luminaire Enclosures:
 - 1. Provide as required to preserve fire resistance rating of building elements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify that outlet boxes are installed in proper locations and at proper mounting heights and are properly sized to accommodate conductors in accordance with NFPA 70.
- C. Verify that suitable support frames are installed where required.
- D. Verify that branch circuit wiring installation is completed, tested, and ready for connection to luminaires.
- E. Verify that conditions are satisfactory for installation prior to starting work.

3.02 PREPARATION

- A. Provide extension rings to bring outlet boxes flush with finished surface.
- B. Clean dirt, debris, plaster, and other foreign materials from outlet boxes.

3.03 INSTALLATION

- A. Coordinate locations of outlet boxes provided under Section 26 0533.16 as required for installation of luminaires provided under this section.
- B. Install products in accordance with manufacturer's instructions.
- C. Install luminaires securely, in a neat and workmanlike manner, as specified in NECA 500 (commercial lighting) and NECA 502 (industrial lighting).
- D. Provide required support and attachment in accordance with Section 26 0529.
- E. Install luminaires plumb and square and aligned with building lines and with adjacent luminaires.
- F. Suspended Ceiling Mounted Luminaires:

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

1. Do not use ceiling tiles to bear weight of luminaires.
 2. Do not use ceiling support system to bear weight of luminaires unless ceiling support system is certified as suitable to do so.
 3. Secure surface-mounted and recessed luminaires to ceiling support channels or framing members or to building structure.
 4. Secure lay-in luminaires to ceiling support channels using listed safety clips at four corners.
 5. See appropriate Division 9 section where suspended grid ceiling is specified for additional requirements.
- G. Recessed Luminaires:
1. Install trims tight to mounting surface with no visible light leakage.
 2. Non-IC Rated Luminaires: Maintain required separation from insulation and combustible materials according to listing.
 3. Luminaires Recessed in Fire-Rated Ceilings: Install using accessories and firestopping materials to meet regulatory requirements for fire rating.
- H. Install accessories furnished with each luminaire.
- I. Bond products and metal accessories to branch circuit equipment grounding conductor.
- J. Emergency Lighting Units:
1. Unless otherwise indicated, connect unit to unswitched power from same circuit feeding normal lighting in same room or area. Bypass local switches, contactors, or other lighting controls.
- K. Exit Signs:
1. Unless otherwise indicated, connect unit to unswitched power from same circuit feeding normal lighting in same room or area. Bypass local switches, contactors, or other lighting controls.
- L. Install lamps in each luminaire.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.
- B. Inspect each product for damage and defects.
- C. Operate each luminaire after installation and connection to verify proper operation.
- D. Test self-powered exit signs, emergency lighting units, and fluorescent emergency power supply units to verify proper operation upon loss of normal power supply.
- E. Correct wiring deficiencies and repair or replace damaged or defective products. Repair or replace excessively noisy ballasts as determined by Architect.

3.05 ADJUSTING

- A. Aim and position adjustable luminaires to achieve desired illumination as indicated or as directed by Architect. Secure locking fittings in place.
- B. Aim and position adjustable emergency lighting unit lamps to achieve optimum illumination of egress path as required or as directed by Architect or authority having jurisdiction.
- C. Exit Signs with Field-Selectable Directional Arrows: Set as indicated or as required to properly designate egress path as directed by Architect or authority having jurisdiction.

3.06 CLEANING

- A. Clean surfaces according to NECA 500 (commercial lighting), NECA 502 (industrial lighting), and manufacturer's instructions to remove dirt, fingerprints, paint, or other foreign material and restore finishes to match original factory finish.

3.07 CLOSEOUT ACTIVITIES

3.08 PROTECTION

- A. Protect installed luminaires from subsequent construction operations.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

3.09 ATTACHMENTS

- A. Luminaire cut sheets.

END OF SECTION

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

SECTION 27 1000
STRUCTURED CABLING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Communications system design requirements.
- B. Communications pathways.
- C. Copper cable and terminations.
- D. Communications equipment room fittings.
- E. Communications outlets.
- F. Communications grounding and bonding.
- G. Communications identification.

1.02 RELATED REQUIREMENTS

- A. Section 07 8400 - Firestopping.
- B. Section 26 0526 - Grounding and Bonding for Electrical Systems.
- C. Section 26 0533.13 - Conduit for Electrical Systems.
- D. Section 26 0533.16 - Boxes for Electrical Systems.
- E. Section 26 0553 - Identification for Electrical Systems: Identification products.
- F. Section 26 2726 - Wiring Devices.

1.03 REFERENCE STANDARDS

- A. BICSI N1 - Installation Practices for Telecommunications and ICT Cabling and Related Cabling Infrastructure, 1st Edition; 2019.
- B. EIA/ECA-310 - Cabinets, Racks, Panels, and Associated Equipment; Revision E, 2005.
- C. ICEA S-90-661 - Category 3, 5, & 5e Individually Unshielded Twisted Pair Indoor Cables (With or Without An Overall Shield) For Use in General Purpose and LAN Communications Wiring Systems Technical Requirements; 2012.
- D. NFPA 70 - National Electrical Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- E. TIA-568 (SET) - Commercial Building Telecommunications Cabling Standard Set; 2019.
- F. TIA-568.2 - Balanced Twisted-Pair Telecommunications Cabling and Components Standards; 2009c, with Addendum (2016).
- G. TIA-570 - Residential Telecommunications Infrastructure Standard; 2012c.
- H. TIA-606 - Administration Standard for Telecommunications Infrastructure; 2017c.
- I. TIA-607 - Generic Telecommunications Bonding and Grounding (Earthing) for Customer Premises; 2019d.
- J. UL (DIR) - Online Certifications Directory; Current Edition.
- K. UL 444 - Communications Cables; Current Edition, Including All Revisions.
- L. UL 514C - Nonmetallic Outlet Boxes, Flush-Device Boxes, and Covers; Current Edition, Including All Revisions.
- M. UL 1863 - Communications-Circuit Accessories; Current Edition, Including All Revisions.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
 - 1. Coordinate requirements for service entrance and entrance facilities with Communications Service Provider.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2. Coordinate the work with other trades to avoid placement of other utilities or obstructions within the spaces dedicated for communications equipment.
 3. Coordinate arrangement of communications equipment with the dimensions and clearance requirements of the actual equipment to be installed.
 4. Notify Architect of any conflicts with or deviations from Contract Documents. Obtain direction before proceeding with work.
- B. Arrange for Communications Service Provider to provide service.
- C. Preinstallation Meeting: Convene one week prior to commencing work of this section to review service requirements and details with Communications Service Provider representative.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets for each product.
- C. Evidence of qualifications for installer.
- D. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, installation, and operation of product.
- E. Field Test Reports.

1.06 QUALITY ASSURANCE

- A. Manufacturer Qualifications: At least 3 years experience manufacturing products of the type specified.
- B. Installer Qualifications: A company having at least 3 years experience in the installation and testing of the type of system specified, and:
1. Employing a BICSI Registered Communications Distribution Designer (RCDD).
 2. Supervisors and installers factory certified by manufacturers of products to be installed.
 3. Employing BICSI Registered Cabling Installation Technicians (RCIT) for supervision of all work.
- C. Products: Listed, classified, and labeled as suitable for the purpose intended.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Store products in manufacturer's unopened packaging until ready for installation.
- B. Keep stored products clean and dry.

1.08 WARRANTY

- A. See Section 01 7800 - Closeout Submittals, for additional warranty requirements.
- B. Correct defective Work within a 2 year period after Date of Substantial Completion.

PART 2 PRODUCTS

2.01 SYSTEM DESIGN

- A. Provide a complete permanent system of cabling and pathways for existing kitchen display system (KDS), including cables, conduits and wireways, pull wires, support structures, enclosures and cabinets, and outlets.
1. Provide fixed cables and pathways that comply with NFPA 70 and TIA-607 and are UL listed or third party independent testing laboratory certified.
 2. Provide connection devices that are rated for operation under conditions of 32 to 140 degrees F (0 to 60 degrees C) at relative humidity of 0 to 95 percent, noncondensing.
 3. In this project, the term plenum is defined as return air spaces above ceilings, inside ducts, under raised floors, and other air-handling spaces.
- B. Cabling to Outlets: Specified horizontal cabling, wired in star topology to distribution frame located at center hub of star; also referred to as "links".

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

2.02 PATHWAYS

- A. Conduit: As specified in Section 26 0533.13; provide pull cords in all conduit.
- B. Firestop Sleeves: Listed; provide as required to preserve fire resistance rating of building elements.

2.03 COPPER CABLE AND TERMINATIONS

- A. Copper Backbone Cable:
 - 1. Description: 100 ohm, balanced twisted pair cable complying with TIA-568.2, ICEA S-90-661, and listed and labeled as complying with UL 444; arranged in 25-pair binder groups.
 - 2. Cable Type: TIA-568.2 Category 3 UTP (unshielded twisted pair); 24 AWG.
 - 3. Cable Capacity: 4-pair.
 - 4. Cable Applications:
 - a. Plenum Applications: Use listed NFPA 70 Type CMP plenum cable.
 - b. Riser Applications: Use listed NFPA 70 Type CMR riser cable or Type CMP plenum cable.
- B. Copper Horizontal Cable:
 - 1. Description: 100 ohm, balanced twisted pair cable complying with TIA-568.2 and listed and labeled as complying with UL 444.
 - 2. Cable Type - Voice and Data: TIA-568.2 Category 6 UTP (unshielded twisted pair); 23 AWG.
 - 3. Cable Capacity: 4-pair.
- C. Copper Cable Terminations: Insulation displacement connection (IDC) type using appropriate tool; use screw connections only where specifically indicated.
- D. Jacks and Connectors: Modular RJ-45, non-keyed, terminated with 110-style insulation displacement connectors (IDC); high impact thermoplastic housing; suitable for and complying with same standard as specified horizontal cable; UL 1863 listed.
 - 1. Performance: 500 mating cycles.
 - 2. Voice and Data Jacks: 8-position modular jack, color-coded for both T568A and T568B wiring configurations.

2.04 COMMUNICATIONS OUTLETS

- A. Outlet Boxes: Comply with Section 26 0533.16.
 - 1. Provide depth as required to accommodate cable manufacturer's recommended minimum conductor bend radius.
- B. Wall Plates:
 - 1. Comply with system design standards and UL 514C.
 - 2. Accepts modular jacks/inserts.
 - 3. Capacity:

2.05 GROUNDING AND BONDING COMPONENTS

- A. Comply with TIA-607.
- B. Comply with Section 26 0526.

2.06 IDENTIFICATION PRODUCTS

- A. Comply with TIA-606.
- B. Comply with Section 26 0553.

PART 3 EXECUTION

3.01 INSTALLATION - GENERAL

- A. Comply with Communication Service Provider requirements.
- B. Grounding and Bonding: Perform in accordance with TIA-607 and NFPA 70.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- C. Install firestopping to preserve fire resistance rating of partitions and other elements, using materials and methods specified in Section 07 8400.

3.02 INSTALLATION OF PATHWAYS

- A. Install pathways with the following minimum clearances:
 - 1. 48 inches (1220 mm) from motors, generators, frequency converters, transformers, x-ray equipment, and uninterruptible power systems.
 - 2. 12 inches (300 mm) from power conduits and cables and panelboards.
 - 3. 5 inches (125 mm) from fluorescent and high frequency lighting fixtures.
 - 4. 6 inches (150 mm) from flues, hot water pipes, and steam pipes.
- B. Conduit, in Addition to Requirements of Section 26 0533.13:
- C. Outlet Boxes:
 - 1. Coordinate locations of outlet boxes provided under Section 26 0533.16 as required for installation of telecommunications outlets provided under this section.

3.03 INSTALLATION OF EQUIPMENT AND CABLING

- A. Cabling:
 - 1. Do not bend cable at radius less than manufacturer's recommended bend radius; for unshielded twisted pair use bend radius of not less than 4 times cable diameter.
 - 2. Do not over-cinch or crush cables.
 - 3. Do not exceed manufacturer's recommended cable pull tension.
 - 4. When installing in conduit, use only lubricants approved by cable manufacturer and do not chafe or damage outer jacket.
- B. Service Loops (Slack or Excess Length): Provide the following minimum extra length of cable, looped neatly:
 - 1. At Distribution Frames: 120 inches (3000 mm).
 - 2. At Outlets - Copper: 12 inches (305 mm).
- C. Copper Cabling:
 - 1. Category 5e and Above: Maintain cable geometry; do not untwist more than 1/2 inch (12 mm) from point of termination.
 - 2. For 4-pair cables in conduit, do not exceed 25 pounds (110 N) pull tension.
 - 3. Use T568B wiring configuration.
- D. Identification:
 - 1. Use wire and cable markers to identify cables at each end.
 - 2. Use manufacturer-furnished label inserts, identification labels, or engraved wallplate to identify each jack at communications outlets with unique identifier.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements, for additional requirements.
- B. Comply with inspection and testing requirements of specified installation standards.
- C. Visual Inspection:
 - 1. Inspect cable jackets for certification markings.
 - 2. Inspect cable terminations for color coded labels of proper type.
 - 3. Inspect outlet plates and patch panels for complete labels.
- D. Testing - Copper Cabling and Associated Equipment:
 - 1. Test backbone cables after termination but before cross-connection.
 - 2. Test backbone cables for DC loop resistance, shorts, opens, intermittent faults, and polarity between connectors and between conductors and shield, if cable has overall shield.
 - 3. Category 3 Backbone: Perform attenuation test.
 - 4. Category 3 Links: Test each pair for short circuit continuity, short to ground, crosses, reversed polarity, operational and ring-back, and dial tone.

AKWESASNE MOHAWK CASINO & RESORT
TAVERN KITCHEN RENOVATION

- E. Final Testing: After all work is complete, including installation of telecommunications outlets, and telephone dial tone service is active, test each voice jack for dial tone.

END OF SECTION

APPENDIX A

❖ Appendix A-Native American Preference Policy

AEDA PROJECT# 22012



07-28-2022



Saint Regis Mohawk Tribe

Chief Ron LaFrance Jr.
Chief Eric Thompson
Chief Beverly Cook
Sub-Chief Michael L. Conners
Sub-Chief Cheryl Jacobs
Sub-Chief Shelley Jacobs

Tribal Council Resolution

2016 - 82

RESOLUTION OF THE SAINT REGIS MOHAWK TRIBE TO ADOPT NATIVE AMERICAN PREFERENCE POLICY

WHEREAS, the Saint Regis Mohawk Tribal Council (the "Tribal Council") is the duly recognized governing body of the Saint Regis Mohawk Tribe (the "Tribe") and is responsible for the health, safety, education and welfare of all community members; and,

WHEREAS, in TCR 2007-36 the Saint Regis Mohawk Tribal Council committed to promoting full and open competition to ensure that all vendors/bidders are dealt with fairly and impartially when soliciting for the purchase of goods (including supplies, materials, equipment, and all other tangible commodities, except real properties) and service and construction contracts; and,

WHEREAS, in TCR 2016-72 the Saint Regis Mohawk Tribal Council adopted a Native American Preference Sliding Scale for all Native American vendors, consultants and service suppliers, which excluded construction contracts; and,

WHEREAS, the Saint Regis Mohawk Tribal Council wishes to ensure there is one document to address the Native American Preference for Procurement with vendors, consultants and service suppliers and construction contracts; now therefore be it

RESOLVED, the Saint Regis Mohawk Tribal Council hereby rescinds TCR 2007-36 and TCR 2016-72 and any other prior inconsistent resolution relating to Native or Mohawk preference; and be it further

RESOLVED, the Tribe hereby adopts this Tribal Council Resolution as the Native American Preference Policy for the Saint Regis Mohawk Tribe for the procurement of goods and services and construction contracts; and be it further

RESOLVED, the Tribal Council hereby adopts Exhibit A as attached and incorporates herein the sliding scale to support a preference for all Native American vendors, consultants and service suppliers, which excludes construction contracts; and be it finally

Page 1 of 2

Helping Build A Better Tomorrow
Iakhlénawá:se' Sénha Aiolanerénhake ne Enióhrhen'ne

412 State Route 37
Akwesasne, New York 13655
www.srmt-nsn.gov
Phone: 518-358-2272

RESOLVED, the Tribal Council hereby adopts Exhibit B as attached and incorporates herein the policy and sliding scale to support a preference for all Native American construction companies/organizations.

THE SAINT REGIS MOHAWK TRIBAL COUNCIL



Ron LaFrance, Jr.
Tribal Chief



Eric Thompson
Tribal Chief



Beverly Cook
Tribal Chief

CERTIFICATION: This is to certify that the Saint Regis Mohawk Tribal Council pursuant to the authority vested therein duly passed the above resolution.



Betty Roundpoint, Tribal Clerk

October 19, 2016
Date

Exhibit A

Saint Regis Mohawk Tribe

August 5th, 2016

Native American Preference Policy Sliding Scale Percentages

	Minimum	Maximum	%	Max Lowest Bid	% Applied	Preference \$	Extra Cost
Between	\$ 3,000	\$ 10,000	13.0%	\$ 10,000	13.0%	\$ 11,300	\$ 1,300.0
Between	\$ 10,001	\$ 25,000	12.0%	\$ 25,000	12.0%	\$ 28,000	\$ 3,000.0
Between	\$ 25,001	\$ 50,000	11.0%	\$ 50,000	11.0%	\$ 55,500	\$ 5,500.0
Between	\$ 50,001	\$ 100,000	10.0%	\$ 100,000	10.0%	\$ 110,000	\$ 10,000.0
Between	\$ 100,001	\$ 200,000	10.0%	\$ 200,000	10.0%	\$ 220,000	\$ 20,000.0
Between	\$ 200,001	\$ 500,000	10.0%	\$ 500,000	10.0%	\$ 550,000	\$ 50,000.0
Between	\$ 500,001	\$ 750,000	7.0%	\$ 750,000	7.0%	\$ 802,500	\$ 52,500.0
Between	\$ 750,001	\$ 1,000,000	5.0%	\$ 1,000,000	5.0%	\$ 1,050,000	\$ 50,000.0
Between	\$ 1,000,001	\$ 2,000,000	2.5%	\$ 2,000,000	2.5%	\$ 2,050,000	\$ 50,000.0
		2,000,001+	1.0%	2,000,001	1.0%	\$ 2,020,001	\$ 20,000.0

EXAMPLE: The lowest bid was a non-native with \$6,000
the native bidder must meet the 13% native preference
Meaning, the native bidder must meet or have a bid lower than \$6,780

	Minimum	Maximum	%	Lowest Bid	% Applied	Preference \$	Extra Cost
Between	\$ 3,000	\$ 10,000	13.0%	\$ 6,000.00	13%	\$ 6,780.00	\$ 780.00

EXAMPLE: The lowest bid was a non-native with \$11,500
the native bidder must meet the 12% native preference
Meaning, the native bidder must meet or have a bid lower than \$12,880

	Minimum	Maximum	%	Lowest Bid	% Applied	Preference \$	Extra Cost
Between	\$ 10,001	\$ 25,000	12.0%	\$ 11,500	12.00%	\$ 12,880	\$ 1,380

EXAMPLE: The lowest bid was a non-native with \$48,000
the native bidder must meet the 11% native preference
Meaning, the native bidder must meet or have a bid lower than \$53,280

	Minimum	Maximum	%	Lowest Bid	% Applied	Preference \$	Extra Cost
Between	\$ 25,001	\$ 50,000	11.0%	\$ 48,000.00	11.0%	\$ 53,280	\$ 5,280

Exhibit B

NATIVE AMERICAN/ALASKA NATIVE PREFERENCE CONSTRUCTION CONTRACTING

A. GENERAL PRACTICE

It is the practice of the Saint Regis Mohawk Tribe to adopt a strong Native American/Alaska Native workforce for all construction contracts and subcontracts of the Tribe and all tribally owned and operated entities.

B. DEFINITIONS

- 1) "Director" –the individual or department, appointed by Tribal Council to ensure that this practice is implemented and complied with and certify that a particular company is a Native American/Alaska Native owned business or company.
- 2) "Tribal Lands" shall mean any lands now or hereafter within the jurisdiction of the Saint Regis Mohawk Tribe.
- 3) "Qualified business or company" shall mean a Business or Company meeting the minimum requirements for a contract or subcontract. A Qualified Business or Company shall have proper insurance coverage, including liability, workmen's compensation and other essential coverage and meet all other requirements contained in the Request for Bids. A Qualified Business also means the practical, technical, administrative and financial ability of a firm to perform or provide by itself, if permitted, through subcontracts, the services or goods specially set out in the bid or request for proposal package.
- 4) "Native American Owned business or company" shall mean an entity which is:
 - a. Fifty-one percent (51%) or more Native American/Alaska Native-owned, such that Native American/Alaska Native provide real value for their ownership interest, obtain majority voting rights regarding decisions of the entity, are entitled to and receive at least fifty-one percent (51%) of all profits, and are entitled to at least fifty-one (51%) of the assets on dissolution of the entity.
 - b. Under significant Native American/Alaska Native-owned management such that at least one Native American/Alaska Native is substantially involved in the day-to-day management of the firm as his or her primary employment.

- c. Employs Native American/Alaska Native in all or most positions for which qualified Native American/Alaskan Native are available, which means those Native American/Alaska Native who have applied for an available position.
- 5) "Preference" means the process of providing advantage, or limiting bidding to Certified Native American/Alaska Native business entities to provide a means by which certified, qualified firms receive contracts and that Native American/Alaska Native employees are hired, in the following order:
- 6) "Responsive bid" means at a minimum that the bid shall comply with all bid requirements stated in writing and shall be a reasonable price.

C. SOLICITATION OF BIDS

- 1) Open Solicitation. The Tribe shall solicit bids from qualified non- Native American/Alaska Native as well as qualified Native American/Alaska Native owned companies.

D. AWARD OF BIDS

- 1) The award shall be made to the qualified Native American/Alaska Native owned company with the lowest responsive bid if the bid is within the maximum total contract price established for the specific project or activity being solicited. Otherwise, the contract shall be award to the lowest qualified bid, with the preference reflected, as exhibited in Section F. (2) of this document, utilized for any Qualified Native American/Alaska Native -owned company.

E. CERTIFICATION OF ELIGIBLE NATIVE AMERICAN/ALASKA NATIVE COMPANIES

- 1) Fifty-one Percent (51%) Owned. In order to be entitled to preference under this policy as a Native American/Alaska Native firm, the firm must submit an application to the Tribe proving that the company is at least fifty-one (51) percent owned by a Native American/Alaska Native and that the management of daily operations of the applicant is controlled by a Native American/Alaska Native. In addition, for those industries requiring professional licensing (i.e., public accountancy, law, professional engineering, insurance, etc.), the Native American/Alaska Native shall hold a license in such industry and individuals employed by the applicant shall hold any requisite license in such industry.
- 2) Director Makes Determination. All decisions on whether a firm meets the requirements with respect to eligibility for certification as a Native American/Alaskan Native firm shall be made by the Director. The Director shall also

maintain an updated list of ALL certified Native American/Alaska Native firms that it will provide to all contract bidders. This list shall include the specific types of contracts that the firm is certified to bid on. Any firm not included on the list at the time a Request for Bids "RFB" is issued, cannot challenge the bid process due to failure to receive the RFB.

F. CONTRACT AWARD

- 1) Award shall be made under unrestricted solicitations to the lowest responsive bid from a qualified Native American/Alaska Native -owned economic enterprise or organization within the maximum total contract price established for the specific project or activity being solicited, if the bid is no more than "X" higher than the total bid price of the lowest responsive bid from any qualified bidder. The factor "X" is determined as follows:

- 2) When the lowest responsive bid is:

less than \$100,000	10% of that bid, or \$9,000
At least \$100,000, but less than \$200,000	9% of that bid, or \$16,000
At least \$200,000, but less than \$300,000	8% of that bid, or \$21,000
At least \$300,000, but less than \$400,000	7% of that bid, or \$24,000
At least \$400,000, but less than \$500,000	6% of that bid, or \$25,000
At least \$500,000, but less than \$1 million	5% of that bid, or \$40,000
At least \$1 million, but less than \$2 million.	4% of that bid, or \$60,000
At least \$2 million, but less than \$4 million.	3% of that bid, or \$105,000
At least \$4 million, but less than \$7 million	2% of that bid, or \$105,000
\$7 million or more...	1.5% of the lowest responsive bid, with no dollar limit

- 3) **Factors other than Price.** Often factors, other than pricing, may affect whether a firm is "qualified" to be awarded a contract. In these instances, the RFP (request for proposals) shall clearly identify the relative importance of price and other evaluation factors and sub-factors, including the weight given to each technical factor and sub-factor. The proposals shall be evaluated only on the criteria stated in the request for proposals

Target Business Policy

POLICY ON MOHAWK PREFERENCE CONSTRUCTION CONTRACTING

GENERAL POLICY

It is the policy of the St. Regis Mohawk Tribe to adopt a strong Mohawk Preference policy for the award of all construction contracts and subcontracts of the Tribe and all tribally owned and operated entities. This policy will apply to all construction contracts and subcontracts for projects on tribal lands and funded exclusively by the St. Regis Mohawk Tribe and all State and Federally funded projects on tribal land or within the jurisdiction of the Tribe.

A. DEFINITIONS

1. "Director"-the individual or department, appointed by Tribal Council to ensure that this policy is implemented and complied with and certify that a particular company is Member or Mohawk-Owned.
2. "Tribal Lands" shall mean any lands now or hereafter within the jurisdiction of the St. Regis Mohawk Tribe.
3. "Qualified business or company" shall mean a Business or Company meeting the minimum requirements for a contract or subcontract. A Qualified Business or Company shall have proper insurance coverage, including liability, workmen's compensation and other essential coverage and meet all other requirements contained in the Request for Bids. A Qualified Business also means the practical, technical, administrative and financial ability of a firm to perform or provide by itself, if permitted, through subcontracts, the services or goods specially set out in the bid or request for proposal package.
4. Qualified worker shall meet all of the requirements of a job description.
5. "Mohawk-Owned business or company" shall mean an entity which is:
 - a. Fifty-one percent (51%) or more Mohawk-owned, such that Mohawks provide real value for their ownership interest, obtain majority voting rights regarding decisions of the entity, are entitled to and receive at least fifty-one percent (51%) of all profits, and are entitled to at least fifty-one (51%) of the assets on dissolution of the entity.
 - b. Under significant Mohawk management, such that at least one Mohawk is substantially involved in the day-to-day management of the firm as his or her primary employment.
 - c. Not created solely or primarily to take advantage of Mohawk preference.
 - d. Employs Mohawks in all or most positions for which qualified Mohawks are available, which means those Mohawks who've applied for an available position.

6. "Preference" means the process of providing advantage, or limiting bidding to Certified Mohawk business entities to provide a means by which certified, qualified firms receive contracts and that Mohawk employees are hired, in the following order:

Mohawk Preference shall be applied in the following manner:

- a. First Preference —Enrolled members of the St. Regis Mohawk Tribe.
- b. Second Preference-Akwesasne Mohawks
- c. Third Preference-Members of Mohawk or other Tribes or First Nations.

7. "Responsive bid" means at a minimum that the bid shall comply with all bid requirements stated in writing and shall be a reasonable price.

C. SOLICITATION OF BIDS

1. Open Solicitation. The Tribe shall solicit bids from qualified non-Mohawk as well as qualified Mohawk-owned companies.

D. AWARD OF BIDS

1. The award shall be made to the qualified Mohawk-owned company with the lowest responsive bid if the bid is within the maximum total contract price established for the specific project or activity being solicited. Otherwise, the contract shall be award to the lowest qualified bid, with the preference outlined in Exhibit A being utilized for any Qualified Mohawk-owned company.

E. MOHAWK PREFERENCE PLANS

1. Preference Plan Required. All companies who bid on a tribal construction project shall include in their bid a Mohawk Preference Plan for the prime contract and any subcontracts (Exhibit B).

2. Contents of Plan. The Mohawk Preference Plan shall indicate the name of the company's proposed subcontractors, whether the proposed sub-contractor(s) is/are a Mohawk company and if not, information on the company's good faith steps taken to identify Mohawk companies for the subcontract. The Mohawk Preference Plan shall be approved by the Director prior to commencement of any construction activities.

3. Plan Contracting/Subcontracting Requirements. The Tribe expects that all contractors will submit a plan that will include all qualified Mohawk subcontractors and that will include the maximum number of Mohawk workers for the project.

- a. The General Contractor and all Sub Contractors shall hire qualified Mohawk workers to the fullest extent possible. Exceptions for "key employees" defined as one who is in a top supervisory position or performs a critical function such that an employer would risk likely financial damage or loss if that task were assigned to a person unknown to that employer. A maximum of 25% of a Contractor or Sub Contractor's workforce may be considered key employees.
- b. The General Contractor, shall through Contract, require all subcontractors to hire at least Forty Percent (40%) qualified Mohawk workers in the project workforce.
- c. A contractor may not refuse to employ a Mohawk subcontractor for the reason that a non-Mohawk firm is more qualified so long as the Mohawk firm satisfies the threshold requirements for qualifications.

- d. Exceptions: If the Tribe's mandate of Mohawk preference in subcontracting and work force employment cannot be achieved, the contractor shall report that to the Director, with the reasons why that goal was not attained. An exception to this mandate may be granted only upon proof that there are fewer than 40% qualified Mohawk workers in a particular category of worker trades available and that the Contractor has made all reasonable efforts to comply with this requirement.

F. CERTIFICATION OF ELIGIBLE MOHAWK COMPANIES

1. Fifty-one Percent (51%) Owned. In order to be entitled to preference under this policy as a Mohawk firm, the firm must submit an application to the Tribe proving that the company is at least fifty-one (51) percent owned by a Mohawk and that the management of daily operations of the applicant is controlled by a Mohawk. In addition, for those industries requiring professional licensing (i.e., public accountancy, law, professional engineering, insurance, etc.), the Mohawk shall hold a license in such industry and individuals employed by the applicant shall hold any requisite license in such industry.

2. Director Makes Determination. All decisions on whether a firm meets the requirements with respect to eligibility for certification as a Mohawk firm shall be made by the Director. The Director shall also maintain an updated list of ALL certified Mohawk firms that it will provide to all contract bidders. This list shall include the specific types of contracts that the firm is certified to bid on. Any firm not included on the list at the time a Request for Bids "RFB" is issued, cannot challenge the bid process due to failure to receive the RFB.

Contract Award: Award shall be made under unrestricted solicitations to the lowest responsive bid from a qualified Mohawk-owned economic enterprise or organization within the maximum total contract price established for the specific project or activity being solicited, if the bid is no more than "X" higher than the total bid price of the lowest responsive bid from any qualified bidder. The factor "X" is determined as follows:

When the lowest responsive bid is:

less than \$100,000	10% of that bid, or \$9,000
At least \$100,000, but less than or \$200,000	9% of that bid, or \$16,000
At least \$200,000, but less than \$300,000	8% of that bid, or \$21,000
At least \$300,000, but less than \$400,000	7% of that bid, or \$24,000
At least \$400,000, but less than \$500,000	6% of that bid, or \$25,000
At least \$500,000, but less than \$1 million	5% of that bid, or \$40,000
At least \$1 million, but less than \$2 million.	4% of that bid, or \$60,000
At least \$2 million, but less than \$4 million.	3% of that bid, or \$105,000
At least \$4 million, but less than \$7 million	2% of that bid, or \$105,000
	1.5% of the lowest responsive bid, with no dollar limit.

\$7 million or more...

Factors other than Price. Often factors, other than pricing, may affect whether a firm is "qualified" to be awarded a contract. In these instances, the RFP (request for proposals) shall clearly identify the relative importance of price and other evaluation factors and sub-factors, including the weight given to each technical factor and sub-factor. The proposals shall be evaluated only on the criteria stated in the request for proposals

Mohawk Preference shall be applied in the following manner

- a. First Preference —Enrolled members of the St. Regis Mohawk Tribe.
- b. Second Preference-Akwesasne Mohawks
- c. Third Preference-Members of Mohawk Tribes or other Tribes or First Nations.

Approved in TCR 2011-56, Dated December 20, 2011.

MOHAWK PREFERENCE
COMPLIANCE PLAN & AGREEMENT:

Main Contractor_____ Sub Contractor_____

Name:_____

Address:_____

Contact person:_____

Title:_____

Phone: _____ Fax: _____

Cell: _____ Office: _____

Project Name: _____

Project No: _____

Location:_____

Project Owner:_____ Phone:_____

Project Funding Agency:

Funding Agency Contact:

Project Cost:_____

Project Start Date: _____

Completion Date:_____

Pre-Construction Meeting Date:_____

Sub-Contractor Meeting (Place, Days, and Times):

Approved in TCR 2011-56, Dated December 20, 2011.

Provide a numerical hiring goals and timetables that specify the number of Mohawks the employer will hire by craft or skill level or specify a set percentage of hiring goals by craft or skill level:

List all permanent key employees you are requesting for the project(s). A key employee is defined as: "an employee that is by business necessity, essential to the successful operation of the project and one without whom the project or the business would suffer substantial financial or time loss".

KEY EMPLOYEES

Name	Job Title	Rate Of Pay	Length of Employment	Attach Proof TRIBAL (YIN)

Do you or your sub-contractor have a collective bargaining agreement with one or more unions?

☐ YES

☐ NO

If yes, please attach a written agreement from said unions indicating that they (Union) will comply with Mohawk preference requirements.

LIST OF SUBCONTRACTORS: All Subcontractors need a Compliance Plan

Company	Contact Person	Phone#	Native (Y/N)

Attach additional sheets if needed.

What wage scale will be used (please explain or submit wage scale)?

Mohawk Preference Policy Received:

☐ YES

☐ NO

☐ Received prior to project

Understanding and Acceptance

I understand that Certified Payroll shall be submitted on a timely manner for each contractor/subcontractor to the Compliance Office on a monthly basis or as agreed upon.

On behalf of _____, I hereby certify that I have received and understand the St. Regis Mohawk Tribe's Mohawk Preference Policy as set forth in this Compliance Plan and Agreement, and hereby agree to accept the responsibility of compliance with the described obligations and requirements.

Title

Authorized Signature for Employer/Contractor/Sub Contractor

Date

Notice To Proceed:

The attached Compliance Plan and Agreement has been received, reviewed and is fully acceptable. On behalf of the St. Regis Mohawk Tribe, authorization to begin work on the above described project is hereby granted.

Elliot Lazore, Compliance Director

Date

APPENDIX B

❖ Appendix B - Fire Protection Calculations

AEDA PROJECT# 22012



07-28-2022



Hydraulic Calculations by HydraCALC

Hydratec Incorporated
64 Haverhill Road
Route 111
Windham, NH 03087
603-434-0502

Job Name : 2201032_Calcs
Drawing :
Location : AKWESASNE MOHAWK CASINO KITCHEN RENOVATION
Remote Area : 1
Contract :
Data File : 2201032_Calcs Area 1.WXF

HYDRAULIC CALCULATIONS
for

JOB NAME 2201032_Calcs
Location AKWESASNE MOHAWK CASINO KITCHEN RENOVATION
Drawing #
Contract #
Date 05-18-2022

DESIGN

Remote area # 1
Remote area location LEFT SIDE OF ROOM
Occupancy classification OH1
Density 0.15 - Gpm/SqFt
Area of application 1023 - SqFt
Coverage/sprinkler 120 - SqFt
Type of sprinkler calculated K-5.6 PENDENTS
Sprinklers calculated 14
In-rack demand - GPM
Hose streams 250 - GPM
Total water required (including hose streams) 525.015 - GPM @ 39.4627 - Psi
Type of system WET
Volume of system (dry or pre-action) - Gal

WATER SUPPLY INFORMATION

Test date
Location
Source of info

CONTRACTOR INFO RAN FIRE PROTECTION ENGINEERING
Address 1417 NEW KARNER
Phone # 518-275-0791
Name of designer
Authority having jurisdiction

NOTES:

THIS SYSTEM HAS A SAFETY FACTOR OF 13.58 PSI.


text1(35) - invisible

City Water Supply:

C1 - Static Pressure : 67
C2 - Residual Pressure: 40
C2 - Residual Flow : 750

Demand:

D1 - Elevation : 4.764
D2 - System Flow : 275.015
D2 - System Pressure : 39.463
Hose (Demand) : 250
D3 - System Demand : 525.015
Safety Margin : 13.580

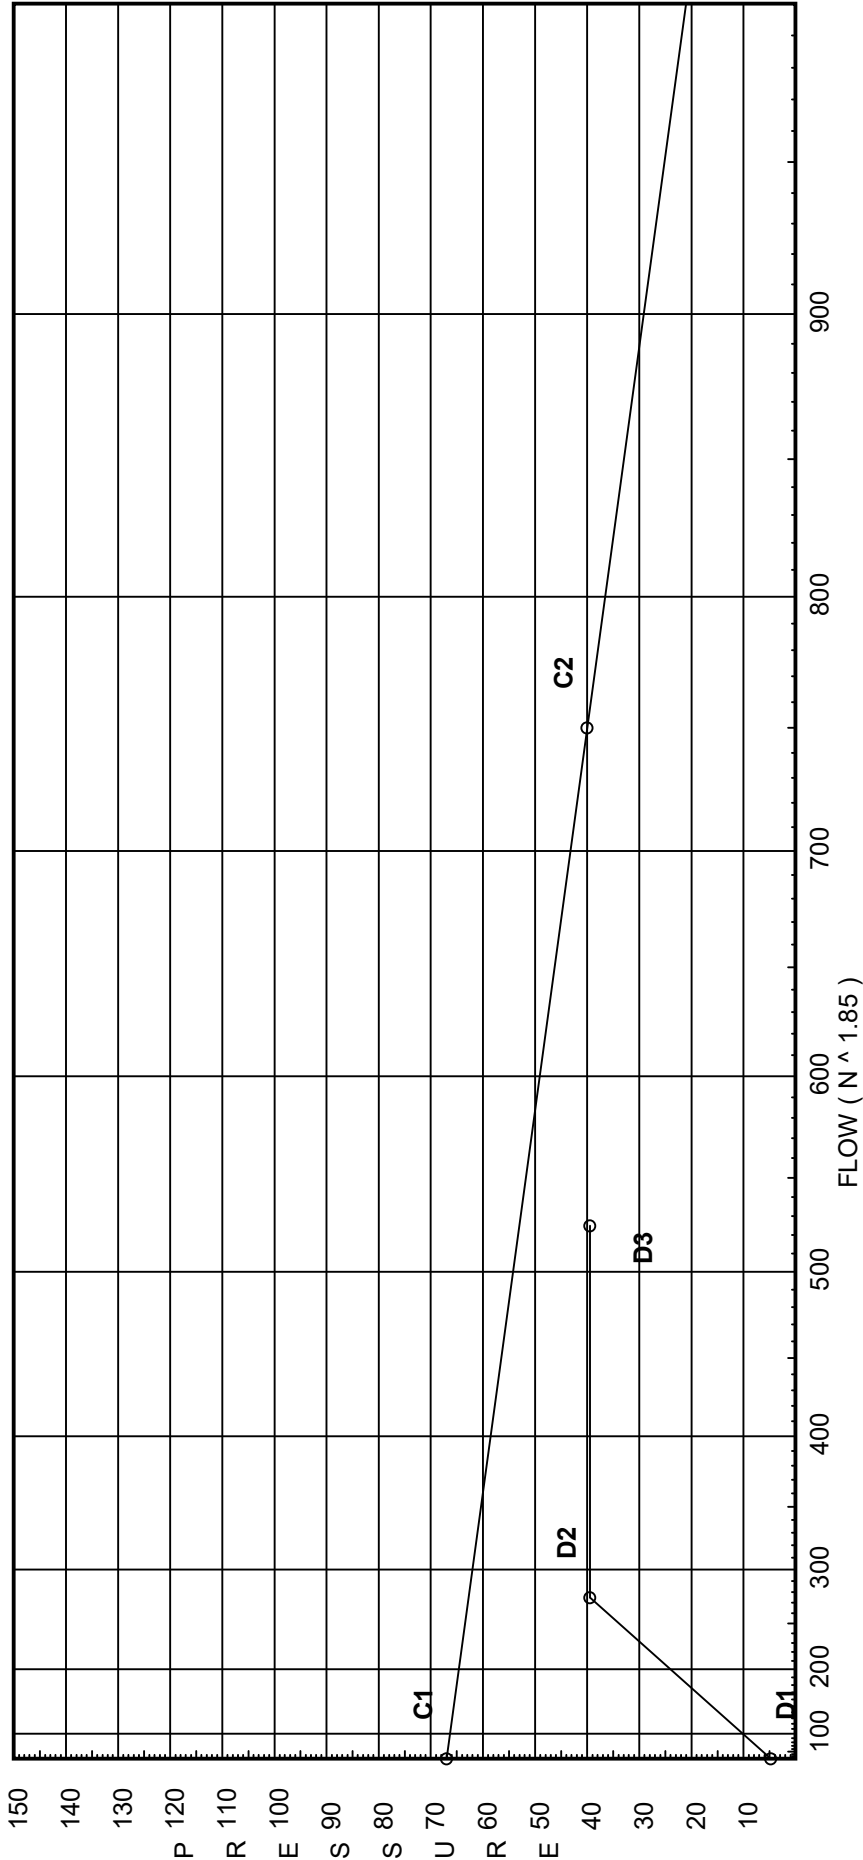

Fittings Used Summary

Hydratec Incorporated
2201032_Calcs

Fitting Legend Abbrev. Name	1/2	3/4	1	1 1/4	1 1/2	2	2 1/2	3	3 1/2	4	5	6	8	10	12	14	16	18	20	24
	Fitting generates a Fixed Loss Based on Flow																			
Aty Alarm Tyco AV-1	0	0	0	0	0	6	14	10	0	23	9	24	23	19	21	0	0	0	0	0
B NFPA 13 Butterfly Valve	1	2	2	3	4	5	6	7	8	12	12	10	18	22	27	35	40	45	50	61
E NFPA 13 90' Standard Elbow	Fitting generates a Fixed Loss Based on Flow																			
Fsp Flow Switch Potter VSR	0	0	0	0	0	1	1	1	1	2	2	3	4	5	6	7	8	10	11	13
G NFPA 13 Gate Valve	0	0	5	7	9	11	14	16	19	22	27	32	45	55	65					
S NFPA 13 Swing Check	3	4	5	6	8	10	12	15	17	20	25	30	35	50	60	71	81	91	101	121
T NFPA 13 90' Flow thru Tee	Fitting generates a Fixed Loss Based on Flow																			
Zac Ames 2000SS																				

Units Summary

- Diameter Units Inches
- Length Units Feet
- Flow Units US Gallons per Minute
- Pressure Units Pounds per Square Inch

Note: Fitting Legend provides equivalent pipe lengths for fittings types of various diameters. Equivalent lengths shown are standard for actual diameters of Sched 40 pipe and CFactors of 120 except as noted with *. The fittings marked with a * show equivalent lengths values supplied by manufacturers based on specific pipe diameters and CFactors and they require no adjustment. All values for fittings not marked with a * will be adjusted in the calculation for CFactors of other than 120 and diameters other than Sched 40 per NFPA.

Flow Summary - NFPA

Hydratec Incorporated
2201032_Calcs

Page 4
Date

SUPPLY ANALYSIS

<i>Node at Source</i>	<i>Static Pressure</i>	<i>Residual Pressure</i>	<i>Flow</i>	<i>Available Pressure</i>	<i>Total Demand</i>	<i>Required Pressure</i>
TEST	67.0	40	750.0	53.042	525.02	39.463

NODE ANALYSIS

<i>Node Tag</i>	<i>Elevation</i>	<i>Node Type</i>	<i>Pressure at Node</i>	<i>Discharge at Node</i>	<i>Notes</i>	
DP02	9.0	5.6	10.33	18.0	0.15	120
EQ02	11.0		9.89			
DP01	9.0	5.6	10.33	18.0	0.15	120
EQ01	11.0		10.22			
28	11.0	5.63	10.22	18.0	K=K @ EQ01	
29	11.0	5.63	11.5	19.1	K=K @ EQ01	
4	11.0		12.06			
5	10.0		17.34			
6	10.0		17.41			
7	10.0		22.16			
8	2.0		30.81			
9	-6.0		37.52			
HOSE	-6.0		37.72	250.0		
10	-6.0		38.54			
TEST	0.0		39.46			
1	11.0	5.72	10.84	18.84	K=K @ EQ02	
2	11.0		11.7			
3	11.0	5.63	11.97	19.48	K=K @ EQ01	
11	11.0	5.72	10.89	18.88	K=K @ EQ02	
12	10.0		17.32			
13	11.0	5.72	10.22	18.3	K=K @ EQ02	
14	11.0		10.89			
15	11.0		11.0			
16	11.0		11.4			
17	11.0		12.15			
18	11.0	5.72	10.33	18.39	K=K @ EQ02	
19	11.0	5.72	10.44	18.49	K=K @ EQ02	
22	11.0	5.72	11.38	19.3	K=K @ EQ02	
21	11.0		12.1			
20	11.0	5.72	11.87	19.71	K=K @ EQ02	
23	11.0	5.63	14.2	21.23	K=K @ EQ01	
24	11.0	5.63	14.42	21.39	K=K @ EQ01	
25	11.0		15.67			
26	11.0	5.72	14.85	22.05	K=K @ EQ02	
27	11.0	5.63	15.06	21.86	K=K @ EQ01	

Final Calculations : Hazen-Williams

Hydratec Incorporated
2201032_Calcs

Page 5
Date

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Eqiv	Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
DP02 to EQ02	9 11	5.60	18.00 18.0	1 1.049	E	2.0	2.000 2.000 4.000	120 0.1070	10.332 -0.866 0.428		Vel = 6.68	
EQ02			0.0 18.00						9.894		K Factor = 5.72	
DP01 to EQ01	9 11	5.60	18.00 18.0	1 1.049	T	5.0	2.000 5.000 7.000	120 0.1070	10.332 -0.866 0.749		Vel = 6.68	
EQ01			0.0 18.00						10.215		K Factor = 5.63	
28 to 29	11 11	5.63	18.00 18.0	1 1.049			12.000 12.000	120 0.1071	10.215 0.0 1.285		K = K @ EQ01 Vel = 6.68	
29 to 4	11 11	5.63	19.10 37.1	1.5 1.61			11.140 11.140	120 0.0506	11.500 0.0 0.564		K = K @ EQ01 Vel = 5.85	
4 to 5	11 10		57.20 94.3	1.5 1.61	2T	16.0	1.000 16.000 17.000	120 0.2846	12.064 0.433 4.839		Vel = 14.86	
5 to 6	10 10		86.52 180.82	4 4.26			9.030 9.030	120 0.0084	17.336 0.0 0.076		Vel = 4.07	
6 to 7	10 10		94.20 275.02	4 4.26	T 7E	26.334 92.17	144.840 118.504 263.344	120 0.0180	17.412 0.0 4.750		Vel = 6.19	
7 to 8	10 2		0.0 275.02	4 4.26	4E Fsp B S	52.668 0.0 15.8 28.968	23.490 97.436 120.926	120 0.0180	22.162 6.465 2.182		* * Fixed Loss = 3 Vel = 6.19	
8 to 9	2 -6		0.0 275.02	6 6.357	5E Aty 2B G Zac	88.014 30.176 25.147 3.772 0.0	8.000 147.109 155.109	120 0.0026	30.809 6.315 0.398		* * Fixed Loss = 2.85 Vel = 2.78	
9 to HOSE	-6 -6		0.0 275.02	6 6.16	2E	40.168	50.000 40.168 90.168	140 0.0023	37.522 0.0 0.203		Vel = 2.96	
HOSE to 10	-6 -6	H250	250.00 525.02	6 6.16	E	20.084	89.380 20.084 109.464	140 0.0074	37.725 0.0 0.815		Vel = 5.65	
10 to TEST	-6 0		0.0 525.02	6 6.16	5E 3G	100.42 12.911	359.700 113.331 473.031	140 0.0074	38.540 -2.599 3.522		Vel = 5.65	
TEST			0.0 525.02						39.463		K Factor = 83.58	
1 to 2	11 11	5.72	18.84 18.84	1 1.049	T	5.0	2.420 5.000 7.420	120 0.1164	10.837 0.0 0.864		K = K @ EQ02 Vel = 6.99	

Final Calculations : Hazen-Williams

Hydratec Incorporated
2201032_Calcs

Page 6
Date

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Equiv	Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
2 to 3	11 11		18.88 37.72	1.5 1.61			5.090 5.090	120 0.0523	11.701 0.0 0.266			
3 to 4	11 11	5.63	19.49 57.21	1.5 1.61			0.860 0.860	120 0.1128	11.967 0.0 0.097		K = K @ EQ01	
4			0.0 57.21						12.064		K Factor = 16.47	
11 to 2	11 11	5.72	18.88 18.88	1 1.049	E	2.0	4.930 2.000 6.930	120 0.1170	10.890 0.0 0.811		K = K @ EQ02	
2			0.0 18.88						11.701		K Factor = 5.52	
5 to 12	10 10		-86.52 -86.52	4 4.26			8.000 8.000	120 -0.0020	17.336 0.0 -0.016		Vel = 1.95	
12			0.0 -86.52						17.320		K Factor = -20.79	
13 to 14	11 11	5.72	18.30 18.3	1 1.049	T	5.0	1.030 5.000 6.030	120 0.1104	10.224 0.0 0.666		K = K @ EQ02	
14 to 15	11 11		0.0 18.3	1.5 1.61			8.000 8.000	120 0.0136	10.890 0.0 0.109		Vel = 2.88	
15 to 16	11 11		18.39 36.69	1.5 1.61			8.000 8.000	120 0.0496	10.999 0.0 0.397		Vel = 5.78	
16 to 17	11 11		18.49 55.18	1.5 1.61			7.140 7.140	120 0.1056	11.396 0.0 0.754		Vel = 8.70	
17 to 6	11 10		39.01 94.19	1.5 1.61	2T	16.0	1.000 16.000 17.000	120 0.2841	12.150 0.433 4.829		Vel = 14.84	
6			0.0 94.19						17.412		K Factor = 22.57	
18 to 15	11 11	5.72	18.39 18.39	1 1.049	T	5.0	1.030 5.000 6.030	120 0.1114	10.327 0.0 0.672		K = K @ EQ02	
15			0.0 18.39						10.999		K Factor = 5.55	
19 to 16	11 11	5.72	18.49 18.49	1 1.049	T	5.0	3.510 5.000 8.510	120 0.1125	10.439 0.0 0.957		K = K @ EQ02	
16			0.0 18.49						11.396		K Factor = 5.48	
22 to 21	11 11	5.72	19.30 19.3	1 1.049	T	5.0	0.970 5.000 5.970	120 0.1218	11.375 0.0 0.727		K = K @ EQ02	
											Vel = 7.16	

Final Calculations : Hazen-Williams

Hydratec Incorporated
2201032_Calcs

Page 7
Date

Node1 to Node2	Elev1 Elev2	K Fact	Qa Qt	Nom Act	Fitting or Equiv	Len	Pipe Ftngs Total	CFact Pf/Ft	Pt Pe Pf	*****	Notes	*****
21 to 17	11 11		19.71 39.01	1.5 1.61			0.860 0.860	120 0.0558	12.102 0.0 0.048		Vel = 6.15	
17			0.0 39.01						12.150		K Factor = 11.19	
20 to 21	11 11	5.72	19.71 19.71	1.5 1.61	E	4.0	10.920 4.000 14.920	120 0.0157	11.868 0.0 0.234		K = K @ EQ02 Vel = 3.11	
21			0.0 19.71						12.102		K Factor = 5.67	
23 to 24	11 11	5.63	21.23 21.23	1.5 1.61			12.000 12.000	120 0.0181	14.203 0.0 0.217		K = K @ EQ01 Vel = 3.35	
24 to 25	11 11	5.63	21.38 42.61	1.5 1.61	T	8.0	11.140 8.000 19.140	120 0.0655	14.420 0.0 1.253		K = K @ EQ01 Vel = 6.72	
25 to 12	11 10		43.91 86.52	1.5 1.61	E	4.0	1.000 4.000 5.000	120 0.2428	15.673 0.433 1.214		Vel = 13.63	
12			0.0 86.52						17.320		K Factor = 20.79	
26 to 27	11 11	5.72	22.05 22.05	1.5 1.61	E	4.0	7.060 4.000 11.060	120 0.0193	14.848 0.0 0.214		K = K @ EQ02 Vel = 3.47	
27 to 25	11 11	5.63	21.86 43.91	1.5 1.61	T	8.0	0.830 8.000 8.830	120 0.0692	15.062 0.0 0.611		K = K @ EQ01 Vel = 6.92	
25			0.0 43.91						15.673		K Factor = 11.09	